City of Houston
Department of Public Works and Engineering
Engineering and Construction Division

PROJECT MANUAL
Greens Road Paving and Drainage Improvements Project
From Aldine Westfield Road to John F. Kennedy Boulevard

WBS No. N-000686-0002-4
CSJ No. 0912-71-739

VOLUME NO. 1 OF 1

Divisions 00 through 16

July 2016

STATE OF TEXAS
CASSANDRA L. LASSER
84713
LICENSED
PROFESSIONAL ENGINEER

Cassandra L. Lasser
7-11-16

AECOM

AECOM Technical Services, Inc.
19219 Katy Freeway, Suite 100
Houston, TX 77094
Ph. 281-646-2400
TBPE Reg. No. F-3580

Doc. No. **Document Title** **Doc. Date**

Document 00010

TABLE OF CONTENTS

NOTE: Capitalized Specification Sections are included in http://documents.publicworks.houstontx.gov/document-center/cat_view/88-engineering-and-construction/92-specifications.html; and are incorporated in Project Manuals by reference as if copied verbatim. Documents listed "for filing" are to be provided by Bidder and are not included in this Project Manual unless indicated for example only. The Document numbers and titles hold places for actual documents to be submitted by Contractor during Bid, post-bid, or construction phase of the Project. Specification Sections marked with an asterisk (*) are amended by a supplemental specification, printed on blue paper and placed in front of the Specification it amends. Documents in the 200, 300 and 400 series of Division 00, except for Document 00410B – Bid Form, Part B, are not part of the Contract.

Doc. No. **Document Title** **Doc. Date**

INTRODUCTORY INFORMATION

00010-T Table of Contents 05-27-2016
00015 List of Drawings 02-01-2004
00041 List of Pre-Qualified Asbestos & Lead Abatement Contractors 03-21-2012
00042 List of Designated Subcontractors and Suppliers 02-01-2004

BIDDING REQUIREMENTS

INSTRUCTIONS TO BIDDERS

00200 Instructions to Bidders 08-01-2015
00210-T Supplementary Instructions to Bidders 08-01-2015
00220 Request for Bid Information 02-08-2011
00251 Prebid Meeting Agenda 07-23-2012

INFORMATION AVAILABLE TO BIDDERS

00320 Geotechnical Information 09-02-2005
00330 Existing Conditions 04-20-2004
00340 Environmental Information 08-01-2015

BID FORMS AND SUPPLEMENTS

00410 Bid Form, Parts A & B 08-01-2015
00430 Bidder's Bond (For filing; Example Form) 08-01-2015
00452 Contractor Submission List - Fair Campaign Ordinance 04-30-2004
00454 Affidavit of Non-interest 02-01-2004
00455 Affidavit of Ownership or Control 09-04-2007

Doc. No.	Document Title	Doc. Date
00456	Bidder's Certificate of Compliance with Buy American Program	02-01-2004
00457	Conflict of Interest Questionnaire	02-28-2006
00458	Bidder's Certificate Regarding Foreign Trade Restriction	02-01-2004
00459	Contractor's Statement Regarding Previous Contracts Subject to EEO	02-01-2004
00460	Pay or Play Program Acknowledgement Form	07-03-2012

POST-BID PROCEDURES

00495-T	Post-bid Procedures	03-09-2016

CONTRACTING REQUIREMENTS

AGREEMENT

00501	Resolution of Contractor	02-01-2010
00520-T	Agreement	03-02-2016

BONDS AND CERTIFICATES

00600-T	List of Proposed Subcontractors and Suppliers	03-25-2013
00601	Drug Policy Compliance Agreement	02-01-2004
00603	Checklist for Drug Policy Submittal	02-09-2012
00604	History of OSHA Actions and List of On-the-job Injuries	02-01-2004
00605	List of Safety Impact Positions	02-01-2004
00606	Contractor's Certification of No Safety Impact Positions	02-01-2004
00607	Certification Regarding Debarment, Suspension, and Other Responsibility Matters	02-01-2004
00610	Performance Bond	05-17-2005
00611	Statutory Payment Bond	05-17-2005
00612-T	One-year Maintenance Bond	04-10-2013
00620	Affidavit of Insurance (with attached Certificates of Insurance)	02-01-2004
00622	Name and Qualifications of Proposed Superintendent (For filing)	
00624	Affidavit of Compliance with Affirmative Action Program	02-01-2004
00633	Equal Employment Opportunity–Certification by Material Suppliers	02-01-2010
00636	Certificate of Interested Parties	03-29-2016
00642	Monthly Subcontractor Payment Reporting Form	02-01-2010
00646	Payment Notification Explanation of Withholding	02-01-2010

GENERAL CONDITIONS

00700	General Conditions	08-15-2015

Doc. No.	Document Title	Doc. Date
SUPPLEMENTARY CONDITIONS		
00800-T	Supplementary Conditions	05-20-2016
00805	Equal Employment Opportunity Requirements	03-01-2016
00806-T	Disadvantaged Business Enterprise Program Requirements	03-31-2012
00812	Federal Wage Rate - Heavy	02-01-2016
00830	Trench Safety Geotechnical Information	02-01-2004
00851	Buy America Requirements	05-21-2012
00852	Changed Conditions Clauses	08-01-2011
ADDENDA AND MODIFICATIONS		
00910	Addendum	02-01-2004
00912	Rider	05-15-2009

Doc. No.	Document Title	Doc. Date

SPECIFICATIONS

DIVISION 1 - GENERAL REQUIREMENTS

01110	Summary of Work	11-06-2015
01145	Use of Premises	01-01-2011
01255	Change Order Procedures	08-01-2003
01270S	Measurement and Payment	08-01-2003
*01270	Measurement and Payment	08-01-2003
01292	Schedule of Values	08-01-2003
01312	Coordination and Meetings	08-01-2003
01321	Construction Photographs	08-01-2003
01325	Construction Schedule	08-01-2003
01326	Construction Schedule (Bar Chart)	08-01-2003
01330	Submittal Procedures	08-01-2003
01340	Shop Drawings, Product Data, and Samples	08-01-2003
01351	Environmental Safety and Worker Protection	01-01-2011
01410	TPDES Requirements (with Attachments)	02-01-2011
01422	Reference Standards	08-01-2003
01450	Contractor's Quality Control	08-01-2003
01452	Inspection Services	08-01-2003
01454	Testing Laboratory Services	08-01-2003
01502	Mobilization	08-01-2008
01504	Temporary Facilities and Controls	01-01-2011
01506	Diversion Pumping	08-01-2003
01520	Temporary Field Office	02-08-2012
01554	Traffic Control and Street Signs	07-01-2012
01555	Traffic Control and Regulation	01-01-2011
01562	Tree and Plant Protection	01-01-2011
01570	Storm Water Pollution Control	01-26-2012
01575	Stabilized Construction Access	02-01-2011
01576	Waste Material Disposal	08-01-2003
01578	Control of Ground and Surface Water	01-01-2011
01580	Project Identification Signs	08-01-2003
01581	Excavation in Public Way Permit Signs	08-01-2003
01610	Basic Product Requirements	01-01-2011
01630	Product Substitution Procedures	08-01-2003
01725	Field Surveying	01-01-2011
01731	Cutting and Patching	01-01-2011

Doc. No.	Document Title	Doc. Date
01732	Procedure for Water Valve Assistance (with Attachments)	08-01-2003
01740	Site Restoration	08-01-2003
01755	Starting Systems	08-01-2003
01770	Closeout Procedures	08-01-2003
01782	Operations and Maintenance Data	08-01-2003
01785	Project Record Documents	08-01-2003

Doc. No.	Document Title	Doc. Date
DIVISION 2 - SITE WORK		
02081	**CAST-IN-PLACE CONCRETE MANHOLES**	**01-01-2011**
02082	**PRECAST CONCRETE MANHOLES**	**01-01-2011**
02084	**FRAMES, GRATES, RINGS, AND COVERS**	**08-01-2008**
02085	**VALVE BOXES, METER BOXES, AND METER VAULTS**	**01-01-2011**
02086	**ADJUSTING MANHOLES, INLETS, AND VALVE BOXES TO GRADE**	**01-01-2011**
02087	**BRICK MANHOLE FOR STORM SEWERS**	**10-01-2002**
02105	CHEMICAL SAMPLING AND ANALYSIS	02-17-2011
02120	OFF-SITE TRANSPORTATION AND DISPOSAL	02-17-2011
02136	**WASTE MATERIAL HANDLING, TESTING, AND DISPOSAL**	**01-01-2011**
02221S	*REMOVING EXISTING PAVEMENTS, STRUCTURES, WOOD, AND DEMOLITION DEBRIS*	*10-24-2012*
***02221**	**REMOVING EXISTING PAVEMENTS AND STRUCTURES**	**07-01-2009**
02222	**ABANDONMENT OF SEWERS**	**01-01-2011**
02233	**CLEARING AND GRUBBING**	**01-01-2011**
02260	**TRENCH SAFETY SYSTEM**	**02-01-2011**
02315	**ROADWAY EXCAVATION**	**07-01-2009**
02316	**EXCAVATION AND BACKFILL FOR STRUCTURES**	**01-01-2011**
02317	**EXCAVATION AND BACKFILL FOR UTILITIES**	**01-01-2011**
02318	**EXTRA UNIT PRICE WORK FOR EXCAVATION AND BACKFILL**	**01-01-2011**
02319	**BORROW**	**01-01-2011**
02320	**UTILITY BACKFILL MATERIALS**	**01-01-2011**
02321	**CEMENT STABILIZED SAND**	**01-01-2011**
02322	**FLOWABLE FILL**	**08-01-2008**
02330	**EMBANKMENT**	**10-01-2002**
02336	**LIME-STABILIZED SUBGRADE**	**10-01-2002**
02337	**LIME/FLY-ASH STABILIZED SUBGRADE**	**10-01-2002**
02338	**PORTLAND CEMENT STABILIZED SUBGRADE**	**10-01-2002**
02400	**RUNNEL SHAFTS**	**01-01-2011**
02401	**COMMON TUNNEL SHAFTS**	**01-01-2011**
02425(LD)	TUNNEL EXCAVATION AND PRIMARY LINER FOR WATER MAINS	07-01-2002
02425	**TUNNEL EXCAVATION AND PRIMARY LINER**	**10-01-2002**
02431	**TUNNEL GROUT**	**10-01-2002**
02441	**MICROTUNNELING AND PIPE-JACKED TUNNELS**	**01-01-2011**
02447	**AUGERING PIPE AND CONDUIT**	**10-01-2002**
02448	**PIPE AND CASING AUGERING FOR SEWERS**	**10-01-2002**

Doc. No.	Document Title	Doc. Date
02465	DRILLED SHAFT FOUNDATIONS	10-01-2002
02501	DUCTILE IRON PIPE AND FITTINGS	02-01-2011
02502	STEEL PIPE AND FITTINGS	01-01-2011
02505	HIGH DENSITY POLYETHYLENE (HDPE) SOLID AND PROFILE WALL PIPE	02-01-2011
02506	POLYVINYL CHLORIDE PIPE	01-01-2011
02507	PRESTESSED CONCRETE CYLINDER PIPE	01-01-2011
02511S	*WATER LINES*	*10-21-2013*
*02511	WATER LINES	01-01-2011
02512	WATER TAP AND SERVICE LINE INSTALLATION	04-27-2012
02513S	*WET CONNECTIONS*	*10-24-2012*
*02513	WET CONNECTIONS	10-01-2002
02514	DISINFECTION OF WATER LINES	01-01-2011
02515	HYDROSTATIC TESTING OF PIPELINES	01-01-2011
02516	CUT, PLUG, AND ABANDONMENT OF WATER LINES	01-01-2011
02517	WATER LINE IN TUNNELS	10-01-2002
02518	STEEL PIPE AND FITTINGS FOR LARGE-DIAMETER WATER LINES	01-01-2011
02520	FIRE HYDRANTS	05-05-2011
02521	GATE VALVES	01-01-2011
02522	BUTTERFLY VALVES	01-01-2011
02523	PRESSURE REDUCING VALVES	10-01-2002
02524	AIR RELEASE AND VACUUM RELIEF VALVES	01-01-2011
02525S	*TAPPING SLEEVES AND VALVES*	*10-24-2012*
*02525	TAPPING SLEEVES AND VALVES	01-01-2011
02526	WATER METERS	01-01-2011
02527	POLYURETHANE COATINGS ON STEEL OR DUCTILE IRON PIPE	10-01-2002
02528	POLYETHYLENE WRAP	01-01-2011
02531	GRAVITY SANITARY SEWERS	01-01-2011
02532	SANITARY SEWER FORCE MAINS	01-01-2011
02533	ACCEPTANCE TESTING FOR SANITARY SEWERS	01-01-2011
02534	SANITARY SEWER SERVICE STUBS OR RECONNECTIONS	01-01-2011
02550	SLIPLINING SANITARY SEWERS	01-01-2011
02553	POINT REPAIR AND OBSTRUCTION REMOVALS	01-01-2011
02555	MANHOLE REHABILITATION	01-01-2011
02581	STREET LIGHTING CONDUIT	10-01-2002
02582	TRAFFIC SIGNAL POLE ASSEMBLIES	07-01-2009
02611	REINFORCED CONCRETE PIPE	02-01-2011
02612	PRECAST REINFORCED CONCRETE BOX SEWERS	10-01-2002
02613	BAR WRAPPED STEEL CYLINDER PIPE	01-01-2011
02621	GEOTEXTILE	10-01-2002
02631	STORM SEWERS	01-26-2012

Doc. No.	Document Title	Doc. Date
02632	CAST-IN-PLACE INLETS, HEADWALLS, AND WINGWALLS	10-01-2002
02633	PRECAST CONCRETE INLETS, HEADWALLS, AND WINGWALLS	10-01-2002
02642	CORRUGATED METAL PIPE	10-01-2002
02711	HOT MIX ASPHALT BASE COURSE	07-01-2009
02712	CEMENT STABILIZED BASE COURSE	10-01-2002
02714	FLEXIBLE BASE COURSE FOR TEMPORARY DRIVEWAYS	07-01-2009
02741	ASPHALTIC CONCRETE PAVEMENT	07-01-2009
02751	CONCRETE PAVING	07-01-2009
02752S	*CONCRETE PAVEMENT JOINTS*	*12-30-2009*
*02752	CONCRETE PAVEMENT JOINTS	10-01-2002
02753	CONCRETE PAVEMENT CURING	10-01-2002
02754	CONCRETE DRIVEWAYS	09-01-2002
02761	COLORED CONCRETE FOR MEDIANS AND SIDEWALKS	09-01-2002
02762	BLAST CLEANING OF PAVEMENT	10-01-2002
02764	RAISED PAVEMENT MARKERS	10-01-2002
02765	TEMPORARY AND REMOVABLE REFLECTORIZED PAVEMENT MARKINGS	10-01-2002
02767	THERMOPLASTIC PAVEMENT MARKINGS	10-01-2002
02771	CURB, CURB AND GUTTER, AND HEADERS	10-01-2002
02772	CONCRETE MEDIANS AND DIRECTIONAL ISLANDS	10-01-2002
02775	CONCRETE SIDEWALKS	10-01-2002
02893	TRAFFIC SIGNAL CONSTRUCTION	07-01-2009
02915	TREE PLANTING	01-01-2011
02921	HYDROMULCH SEEDING	01-01-2011
02922	SODDING	07-01-2009

DIVISION 3 – CONCRETE

03315	CONCRETE FOR UTILITY CONSTRUCTION	10-01-2002

DIVISION 4 - MORTAR

04061	MORTAR	10-01-2002
04210	BRICK MASONRY FOR UTILITY CONSTRUCTION	10-01-2002

DIVISION 5 – METALS

05501	METAL FABRICATIONS	01-01-2011

DIVISION 6 – WOOD AND PLASTICS

DIVISION 7 – THERMAL AND MOISTURE PROTECTION

DIVISION 8 – DOORS AND WINDOWS

Doc. No.	Document Title	Doc. Date
DIVISION 9 – FINISHES		
09901	**PROTECTIVE COATINGS**	**01-01-2011**
DIVISION 10 – SPECIALTIES		
DIVISION 11 – EQUIPMENT		
DIVISION 12 – FURNISHINGS		
DIVISION 13 – SPECIAL CONSTRUCTION		
13281	ASBESTOS ABATEMENT SPECIFICATIONS	04-21-2015
DIVISION 14 – CONVEYING SYSTEMS		
DIVISION 15 – MECHANICAL		
15640	**JOINT BONDING AND ELECTRICAL ISOLATION**	**01-01-2011**
15641	**CORROSION CONTROL TEST STATIONS**	**01-01-2011**
DIVISION 16 – ELECTRICAL		
16640	**CATHODIC PROTECTION FOR PIPELINES**	**01-01-2011**
16710	**PULL BOXES**	**07-01-2009**
16711	**TRAFFIC SIGNAL CONDUIT**	**07-01-2009**
16715	**VEHICLE SIGNAL HEADS**	**07-01-2009**
16720	**TRAFFIC SIGNAL CABLE**	**07-01-2009**
16724	**EMERGENCY VEHICLE PREEMPTION (EVP)**	**07-01-2015**
16730	**ITS CONTROLLER CABINET ASSEMBLY**	**01-16-2015**
16732	**UNINTERRUPTIBLE POWER SUPPLY (UPS) SYSTEM FOR TRAFFIC SIGNAL CABINETS**	**07-01-2012**
16733	**MANAGED FIELD HARDENED ETHERNET SWITCH**	**07-01-2009**
16734	**WIMAX**	**07-01-2012**
16785	**GPS COMMUNICATIONS SERIAL MODULE**	**07-01-2012**

Doc. No.	Document Title	Doc. Date
	Texas Department of Transportation Specifications	
132	Embankment	11-01-2014
160	Topsoil	11-01-2014
400	Excavation and Backfill for Structures	11-01-2014
416	Drilled Shaft Foundations	11-01-2014
420	Concrete Substructures	11-01-2014
422	Concrete Superstructures	11-01-2014
423	Retaining Walls	11-01-2014
425	Precast Prestressed Concrete Structural Members	11-01-2014
432	Riprap	11-01-2014
442	Metal for Structures	11-01-2014
450	Railing	11-01-2014
454	Bridge Expansion Joints	11-01-2014
465	Junction Boxes, Manholes, and Inlets	11-01-2014
466	Headwalls and Wingwalls	11-01-2014
467	Safety End Treatment	11-01-2014
496	Removing Structures	11-01-2014
506	Temporary Erosion, Sedimentation, and Environmental Controls	11-01-2014
540	Metal Beam Guard Fence	11-01-2014
545	Crash Cushion Attenuators	11-01-2014

TxDOT Specifications can be found at: http://www.txdot.gov/business/resources/txdot-specifications.html

Texas Department of Transportation Special Provisions

SPE 000---001L	Schedule of Liquidated Damages
SPE 000---002L	Nondiscrimination
SPE 000---003L	Certification of Nondiscrimination in Employment
SPE 000---004L	Notice of Requirement for Affirmative Action to Ensure Equal Employment Opportunity (Executive Order 112246)
SPE 000---005L	Standard Federal Equal Employment Opportunity Construction Contract Specifications(Executive Order 11246)
SPE 000---007L	Disadvantaged Business Enterprise in Federal Aid Contracts
SPE 007---001L	Legal Relations and Responsibilities
SP506-003	Temporary Erosion, Sedimentation, and Environmental Controls

Additional Special Provisions

Disclosure of Lobbying Activities

Doc. No.	Document Title	Doc. Date
	Child Support Certificate (Language in the 00410B)	
	FHWA 1273-Required Contract Provisions for Federal-Aid Construction Contracts	
	Form SMS4906T	
	Form 2229 Significant Project Procedures	

Harris County Flood Control District Standard Specifications

Doc. No.	Document Title	Doc. Date
02314	Fill Material	August 2005
02315	Excavating and Backfilling	August 2005
02316	Structural Excavating and Backfilling	August 2005
02376	Concrete Channel Lining and Concrete Interceptor Structures	August 2005
02378	Riprap and Granular Fill	August 2005
02505	High Density Polyethylene Pipe	August 2005
02631	Storm Sewers and Outfalls	August 2005

Harris County Flood Control District Specifications can be found at:
https://www.hcfcd.org/technical-area/technical-document-library/

Flap Gate Specifications

NA	Checkmate Slip-in Inline Check Valves	2015

APPENDICES

Utility Certification Letter
Trench Safety Recommendation Letter
TxDOT Wage Rates
Storm Water Pollution Prevention Report

END OF DOCUMENT

Document 00015
LIST OF DRAWINGS

SHEET NO.	DRAWING TITLE
GENERAL	
1	TITLE SHEET
2	INDEX OF SHEETS (SHEET 1 OF 3)
3	INDEX OF SHEETS (SHEET 2 OF 3)
4	INDEX OF SHEETS (SHEET 3 OF 3)
5	GENERAL CONSTRUCTION & PRIVATE UTILITY NOTES
6	LEGEND, ABBREVIATIONS, AND NOTES
7	HARRIS COUNTY EXPRESS REVIEW SHEET
8	PROJECT LAYOUT, SHEET LAYOUT, & BORING LOG LAYOUT (SHEET 1 OF 3)
9	PROJECT LAYOUT, SHEET LAYOUT, & BORING LOG LAYOUT (SHEET 2 OF 3)
10	PROJECT LAYOUT, SHEET LAYOUT, & BORING LOG LAYOUT (SHEET 3 OF 3)
11	EXISTING TYPICAL SECTIONS (SHEET 1 OF 2)
12	EXISTING TYPICAL SECTIONS (SHEET 2 OF 2)
13	PROPOSED TYPICAL SECTIONS (1 OF 3)
14	PROPOSED TYPICAL SECTIONS (2 OF 3)
15	PROPOSED TYPICAL SECTIONS (3 OF 3)
16	SUMMARY OF TRAFFIC CONTROL QUANTITIES
17	SUMMARY OF DEMOLITION QUANTITIES
18	SUMMARY OF ROADWAY QUANTITIES
19	SUMMARY OF RETAINING WALL (MSE) QUANTITIES
20	SUMMARY OF DETENTION POND QUANTITIES
21	SUMMARY OF STORM SEWER QUANTITIES
22	SUMMARY OF WATER LINE QUANTITIES
23	SUMMARY OF SANITARY SEWER QUANTITIES
TRAFFIC CONTROL PLANS	
24	TCP NOTES, CHANNELIZING DEVICES AND BARRICADES
25	NARRATIVE OF CONSTRUCTION SEQUENCE
26	TRAFFIC CONTROL PHASING OVERVIEW
27	ADVANCED WARNING SIGNS (SHEET 1 OF 2)
28	ADVANCED WARNING SIGNS (SHEET 2 OF 2)

TRAFFIC CONTROL PLANS, continued	
29	TRAFFIC CONTROL PHASE 1 STEP 1 DETENTION POND
29A	TRAFFIC CONTROL PHASE 1 STEP 2 & 3
30	TRAFFIC CONTROL PHASE 1 STEP 2 CULVERT PHASING
31	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 BEGINNING TO ALDINE WESTFIELD
32	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 ALDINE WESTFIELD TO STA 19+00
33	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 STA 19+00 TO STA 31+00
34	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 STA 31+00 TO STA 43+00
35	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 STA 43+00 TO STA 55+00
36	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 STA 55+00 TO STA 67+00
37	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 STA 67+00 TO STA 78+00
38	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 STA 78+00 TO STA 90+00
39	TRAFFIC CONTROL PHASE 2 STEP 1, 2 & 3 STA 90+00 TO END
40	TRAFFIC CONTROL PHASE 2 STEP 4, 5 & 6 BEGINNING TO ALDINE WESTFIELD
41	TRAFFIC CONTROL PHASE 2 STEP 4, 5 & 6 ALDINE WESTFIELD TO STA 19+00
42	TRAFFIC CONTROL PHASE 2 STEP 4, 5 & 6 STA 19+00 TO STA 31+00
43	TRAFFIC CONTROL PHASE 2 STEP 4, 5 & 6 STA 31+00 TO STA 43+00
44	TRAFFIC CONTROL PHASE 2 STEP 2 STA 43+00 TO STA 55+00
45	TRAFFIC CONTROL PHASE 2 STEP 4, 5 & 6 STA 55+00 TO STA 67+00
46	TRAFFIC CONTROL PHASE 2 STEP 2 STA 67+00 TO STA 78+00
47	TRAFFIC CONTROL PHASE 2 STEP 4, 5 & 6 STA 78+00 TO STA 90+00
48	TRAFFIC CONTROL PHASE 2 STEP 4, 5 & 6 STA 90+00 TO END
49	TRAFFIC CONTROL PHASE 3 STEP 1 BEGINNING TO ALDINE WESTFIELD

TRAFFIC CONTROL PLANS, continued	
50	TRAFFIC CONTROL PHASE 3 STEP 1 ALDINE WESTFIELD TO STA 19+00
51	TRAFFIC CONTROL PHASE 3 STEP 1 STA 19+00 TO STA 31+00
52	TRAFFIC CONTROL PHASE 3 STEP 1 STA 31+00 TO STA 43+00
53	TRAFFIC CONTROL PHASE 3 STEP 1 STA 43+00 TO STA 55+00
54	TRAFFIC CONTROL PHASE 3 STEP 1 STA 55+00 TO STA 67+00
55	TRAFFIC CONTROL PHASE 3 STEP 1 STA 67+00 TO STA 78+00
56	TRAFFIC CONTROL PHASE 3 STEP 1 STA 78+00 TO STA 90+00
57	TRAFFIC CONTROL PHASE 3 STEP 1 STA 90+00 TO END
57A	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 BEGINNING TO ALDINE WESTFIELD
57B	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 ALDINE WESTFIELD TO STA 19+00
57C	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 STA 19+00 TO STA 31+00
57D	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 STA 31+00 TO STA 43+00
57E	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 STA 43+00 TO STA 55+00
57F	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 STA 55+00 TO STA 67+00
57G	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 STA 67+00 TO STA 78+00
57H	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 STA 78+00 TO STA 90+00
57I	TRAFFIC CONTROL PHASE 3 STEP 2 & 3 STA 90+00 TO END
57J	TRAFFIC CONTROL PHASE 3 STEP 4 BEGINNING TO ALDINE WESTFIELD
57K	TRAFFIC CONTROL PHASE 3 STEP 4 ALDINE WESTFIELD TO STA 19+00
57L	TRAFFIC CONTROL PHASE 3 STEP 4 STA 19+00 TO STA 31+00
57M	TRAFFIC CONTROL PHASE 3 STEP 4 STA 31+00 TO STA 43+00
57N	TRAFFIC CONTROL PHASE 3 STEP 4 STA 43+00 TO STA 55+00
57O	TRAFFIC CONTROL PHASE 3 STEP 4 STA 55+00 TO STA 67+00
57P	TRAFFIC CONTROL PHASE 3 STEP 4 STA 67+00 TO STA 78+00
57Q	TRAFFIC CONTROL PHASE 3 STEP 4 STA 78+00 TO STA 90+00
57R	TRAFFIC CONTROL PHASE 3 STEP 4 STA 90+00 TO END

TRAFFIC CONTROL PLANS, continued	
58	TRAFFIC CONTROL PHASE 3 STEP 4 CULVERT PHASING
59	TRAFFIC CONTROL PHASE 4 BEGINNING TO ALDINE WESTFIELD
60	TRAFFIC CONTROL PHASE 4 ALDINE WESTFIELD TO STA 19+00
61	TRAFFIC CONTROL PHASE 4 STA 19+00 TO STA 31+00
62	TRAFFIC CONTROL PHASE 4 STA 31+00 TO STA 43+00
63	TRAFFIC CONTROL PHASE 4 STA 43+00 TO STA 55+00
64	TRAFFIC CONTROL PHASE 4 STA 55+00 TO STA 67+00
65	TRAFFIC CONTROL PHASE 4 STA 67+00 TO STA 78+00
66	TRAFFIC CONTROL PHASE 4 STA 78+00 TO STA 90+00
67	TRAFFIC CONTROL PHASE 4 STA 90+00 TO END
68	TRAFFIC CONTROL ONE-WAY INTERSECTION PHASING FOR SIDE STREETS
69	TRAFFIC CONTROL MEDIAN ONE-WAY PHASING
70	GREENS ROAD TRAFFIC CONTROL MISCELLANEOUS DETAILS
71	CITY OF HOUSTON STANDARD DETAIL TCP ONE LANE CLOSURE PHASE 1 & 2
72	CITY OF HOUSTON STANDARD DETAIL TCP ONE LANE CLOSURE
73	*BARRICADE AND CONSTRUCTION GENERAL NOTES AND REQUIREMENTS BC(1) - 14
74	*BARRICADE AND CONSTRUCTION PROJECT LIMITS BC(2) - 14
75	*BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT BC(3) - 14
76	*BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES BC(4) - 14 (MOD)
77	*BARRICADE AND CONSTRUCTION TYPICAL SIGN SUPPORT BC(5) - 14
78	*BARRICADE AND CONSTRUCTION PORTABLE CHANGEABLE MESSAGE SIGN (PCMS) BC(6) - 14
79	*BARRICADE AND CONSTRUCTION ARROW PANEL, RELFECTORS, WARNING LIGHTS & ATTENUATORS BC(7) - 14 (MOD)
80	*BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES BC(8) - 14
81	*BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES BC(9) - 14

*TxDOT Standard Drawing

TRAFFIC CONTROL PLANS, continued	
82	*BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES BC(10) – 14
83	*BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS BC(11) - 14 (MOD)
84	*BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS PATTERNS BC(12) - 14 (MOD)
85	*LOW PROFILE CONCRETE BARRIER PRECAST BARRIER (TYPE 1) LPCB - 13 (MOD)
86	*LOW PROFILE CONCRETE BARRIER PRECAST BARRIER (TYPE 2) LPCB - 13
87	*TRAFFIC CONTROL PLAN CONVENTIONAL ROAD SHOULDER WORK TCP (1-1) - 12 (MOD)
88	*TRAFFIC CONTROL PLAN ONE-LANE ONE-WAY TRAFFIC CONTROL TCP (1-2) -12 (MOD)
89	*TRAFFIC CONTROL PLAN LANE CLOSURES ON MULTILANE CONVENTIONAL ROADS TCP (1-4) - 12 (MOD)
90	*DRIVEWAY SIGNING DS TC8020-04
ROADWAY DETAILS	
91	SURVEY CONTROL LAYOUT (SHEET 1 OF 2)
92	SURVEY CONTROL LAYOUT (SHEET 2 OF 2)
93	CONTROL SKETCHES (SHEET 1 OF 2)
94	CONTROL SKETCHES (SHEET 2 OF 2)
95	HORIZONTAL ALIGNMENT DATA (SHEET 1 OF 3)
96	HORIZONTAL ALIGNMENT DATA (SHEET 2 OF 3)
97	HORIZONTAL ALIGNMENT DATA (SHEET 3 OF 3)
98	DEMOLITION PLAN BEGIN TO STA 18+00
99	DEMOLITION PLAN STA 18+00 TO STA 27+00
100	DEMOLITION PLAN STA 27+00 TO STA 36+00
101	DEMOLITION PLAN STA 36+00 TO STA 44+00
102	DEMOLITION PLAN STA 44+00 TO STA 53+00
103	DEMOLITION PLAN STA 53+00 TO STA 62+00
104	DEMOLITION PLAN STA 62+00 TO STA 71+00
105	DEMOLITION PLAN STA 71+00 TO STA 80+00
106	DEMOLITION PLAN STA 80+00 TO STA 89+00
107	DEMOLITION PLAN STA 89+00 TO END

*TxDOT Standard Drawing

ROADWAY DETAILS, continued	
108	GREENS ROAD ROADWAY PLAN & PROFILE BEGIN TO STA 14+00
109	GREENS ROAD ROADWAY PLAN & PROFILE STA 14+00 TO STA 18+00
110	GREENS ROAD ROADWAY PLAN & PROFILE STA 18+00 TO STA 23+00
111	GREENS ROAD ROADWAY PLAN & PROFILE STA 23+00 TO STA 27+00
112	GREENS ROAD ROADWAY PLAN & PROFILE STA 27+00 TO STA 31+00
113	GREENS ROAD ROADWAY PLAN & PROFILE STA 31+00 TO STA 35+00
114	GREENS ROAD ROADWAY PLAN & PROFILE STA 35+00 TO STA 39+00
115	GREENS ROAD ROADWAY PLAN & PROFILE STA 39+00 TO STA 44+00
116	GREENS ROAD ROADWAY PLAN & PROFILE STA 44+00 TO STA 49+00
117	GREENS ROAD ROADWAY PLAN & PROFILE STA 49+00 TO STA 54+00
118	GREENS ROAD ROADWAY PLAN & PROFILE STA 54+00 TO STA 59+00
119	GREENS ROAD ROADWAY PLAN & PROFILE STA 59+00 TO STA 64+00
120	GREENS ROAD ROADWAY PLAN & PROFILE STA 64+00 TO STA 68+00
121	GREENS ROAD ROADWAY PLAN & PROFILE STA 68+00 TO STA 73+00
122	GREENS ROAD ROADWAY PLAN & PROFILE STA 73+00 TO STA 78+00
123	GREENS ROAD ROADWAY PLAN & PROFILE STA 78+00 TO STA 83+00
124	GREENS ROAD ROADWAY PLAN & PROFILE STA 83+00 TO STA 87+00
125	GREENS ROAD ROADWAY PLAN & PROFILE STA 87+00 TO STA 92+00
126	GREENS ROAD ROADWAY PLAN & PROFILE STA 92+00 TO END

ROADWAY DETAILS, continued	
127	GREEN MOUNTAIN DRIVE PLAN & PROFILE STA 10+00 TO STA 13+00
128	GREENVIEW DRIVE PLAN & PROFILE STA 10+00 TO STA 13+00
129	FARR AVENUE PLAN & PROFILE STA 10+00 TO STA 13+00 (DELETED)
130	STEPHENSON DRIVE PLAN & PROFILE STA 10+00 TO STA 13+00
131	MORALES ROAD PLAN & PROFILE STA 10+00 TO STA 13+00
132	MILNER ROAD PLAN & PROFILE STA 10+00 TO STA 13+00
133	GREEN MOUNTAIN DRIVE INTERSECTION AND GRADING LAYOUT
134	GREENVIEW DRIVE INTERSECTION AND GRADING LAYOUT
135	FARR AVENUE INTERSECTION AND GRADING LAYOUT (DELETED)
136	MORALES INTERSECTION AND GRADING LAYOUT
137	MILNER INTERSECTION AND GRADING LAYOUT
138	DRIVEWAY SCHEDULE
139	ROADWAY DETAILS MISCELLANEOUS SHEET 1 OF 2
140	ROADWAY DETAILS MISCELLANEOUS SHEET 2 OF 2
141	PEDESTRIAN RAIL DETAIL
142	*METAL BEAM GUARD FENCE GF (31) - 14
143	*SINGLE SIDED CRASH CUSHION (BEAT-SSCC) SSCC - 03A
144	CITY OF HOUSTON PAVING DETAILS SHEET 1 OF 4
145	CITY OF HOUSTON PAVING DETAILS SHEET 2 OF 4
146	CITY OF HOUSTON PAVING DETAILS SHEET 3 OF 4
147	CITY OF HOUSTON PAVING DETAILS SHEET 4 OF 4
RETAINING WALL DETAILS	
148	RETAINING WALL "A1" PLAN & PROFILE
149	RETAINING WALL "B1" PLAN & PROFILE
150	RETAINING WALL "C1" PLAN & PROFILE
151	RETAINING WALL "D1" PLAN & PROFILE
152	RETAINING WALL "A" PLAN & PROFILE
153	RETAINING WALL "B" PLAN & PROFILE
154	RETAINING WALL "C" PLAN & PROFILE
155	RETAINING WALL "D" PLAN & PROFILE
156	*MECHANICALLY STABILIZED RETAINING WALL - MSRW-CSB
157	*RETAINING WALL TRAFFIC RAILING FOUNDATIONS - RW(TRF)
158	*COMBINATION RAIL TYPE C221 SHEET 1 OF 3

*TxDOT Standard Drawing

RETAINING WALL DETAILS, continued	
159	*COMBINATION RAIL TYPE C221 SHEET 2 OF 3
160	*COMBINATION RAIL TYPE C221 SHEET 3 OF 3
161	*TRAFFIC RAIL FOUNDATION AND MISCELLANEOUS DETAIL - TRF
162	*RAIL ANCHORAGE CURB BOX CULVERT RAIL MOUNTING DETAILS RAC SHEET 1 OF 2
163	*RAIL ANCHORAGE CURB BOX CULVERT RAIL MOUNTING DETAILS RAC SHEET 2 OF 2
DRAINAGE DETAILS	
164	HYDRAULIC DATA SHEET P140-00-00 (HOODS BAYOU) AT GREENS ROAD
165	HYDRAULIC DATA SHEET P240-00-00 AT GREENS ROAD
166	HYDRAULIC DATA SHEET P240-00-00 / P140-00-00 CONFLUENCE
167	DETENTION POND LAYOUT (HCFCD UNIT No. P540-01-00)
168	DETENTION INFLOW STRUCTURE PLAN & PROFILE
169	DETENTION OUTFALL STRUCTURE PLAN & PROFILE
170	DETENTION POND CROSS-SECTIONS
171	HCFCD UNIT No's: P140 / P240 CONFLUENCE CULVERT PLAN & PROFILE
172	HCFCD UNIT No's: P140 / P240 CONFLUENCE CULVERT CROSS-SECTIONS
173	OVERALL DRAINAGE AREA MAP LAYOUT
174	DRAINAGE AREA MAP LAYOUT BEGIN TO STA 19+00
175	DRAINAGE AREA MAP LAYOUT STA 19+00 TO STA 31+00
176	DRAINAGE AREA MAP LAYOUT STA 31+00 TO STA 43+00
177	DRAINAGE AREA MAP LAYOUT STA 43+00 TO STA 55+00
178	DRAINAGE AREA MAP LAYOUT STA 55+00 TO STA 67+00
179	DRAINAGE AREA MAP LAYOUT STA 67+00 TO STA 78+00
180	DRAINAGE AREA MAP LAYOUT STA 78+00 TO STA 90+00
181	DRAINAGE AREA MAP LAYOUT STA 90+00 TO END
182	SYSTEMS "A & B" INLET CALCULATIONS
183	SYSTEMS "C" INLET CALCULATIONS
184	SYSTEMS "A" STORM SEWER CALCULATIONS
185	SYSTEMS "B" STORM SEWER CALCULATIONS
186	SYSTEMS "C" STORM SEWER CALCULATIONS SHEET 1 OF 2

*TxDOT Standard Drawing

DRAINAGE DETAILS, continued	
187	SYSTEMS "C" STORM SEWER CALCULATIONS SHEET 2 OF 2
188	GREENS ROAD STORM SEWER PLAN & PROFILE BEGIN TO STA 18+00
189	GREENS ROAD STORM SEWER PLAN & PROFILE STA 18+00 TO STA 23+00
190	GREENS ROAD STORM SEWER PLAN & PROFILE STA 23+00 TO STA 27+00
191	GREENS ROAD STORM SEWER PLAN & PROFILE STA 27+00 TO STA 31+00
192	GREENS ROAD STORM SEWER PLAN & PROFILE STA 31+00 TO STA 35+00
193	GREENS ROAD STORM SEWER PLAN & PROFILE STA 35+00 TO STA 39+00
194	GREENS ROAD STORM SEWER PROFILE STA 35+00 TO STA 39+00
195	GREENS ROAD STORM SEWER PLAN & PROFILE STA 39+00 TO STA 44+00
196	GREENS ROAD STORM SEWER PLAN & PROFILE STA 44+00 TO STA 49+00
197	GREENS ROAD STORM SEWER PLAN & PROFILE STA 49+00 TO STA 54+00
198	GREENS ROAD STORM SEWER PLAN & PROFILE STA 54+00 TO STA 59+00
199	GREENS ROAD STORM SEWER PLAN & PROFILE STA 59+00 TO STA 64+00
200	GREENS ROAD STORM SEWER PLAN & PROFILE STA 64+00 TO STA 68+00
201	GREENS ROAD STORM SEWER PLAN & PROFILE STA 68+00 TO STA 73+00
202	GREENS ROAD STORM SEWER PLAN & PROFILE STA 73+00 TO STA 78+00
203	GREENS ROAD STORM SEWER PLAN & PROFILE STA 78+00 TO STA 83+00
204	GREENS ROAD STORM SEWER PLAN & PROFILE STA 83+00 TO STA 87+00
205	GREENS ROAD STORM SEWER PLAN & PROFILE STA 87+00 TO STA 92+00

DRAINAGE DETAILS, continued	
206	GREENS ROAD STORM SEWER PLAN & PROFILE STA 92+00 TO END
207	GREEN MOUNTAIN DR STORM SEWER PLAN & PROFILE STA 10+00 TO STA 13+00
208	GREENVIEW DRIVE STORM SEWER PLAN & PROFILE STA 10+00 TO STA 13+00
209	FARR AVENUE STORM SEWER PLAN & PROFILE STA 10+00 TO STA 13+00 (DELETED)
210	STEPHENSON DRIVE STORM SEWER PLAN & PROFILE STA 10+00 TO STA 13+00
211	MORALES ROAD STORM SEWER PLAN & PROFILE STA 10+00 TO STA 13+00
212	MILNER ROAD STORM SEWER PLAN & PROFILE STA 10+00 TO STA 13+00
213	SYSTEM "A" STORM SEWER LATERALS SHEET 1 OF 2
214	SYSTEM "A" STORM SEWER LATERALS SHEET 2 OF 2
215	SYSTEM "B" STORM SEWER LATERALS
216	SYSTEM "C" STORM SEWER LATERALS SHEET 1 OF 3
217	SYSTEM "C" STORM SEWER LATERALS SHEET 2 OF 3
218	SYSTEM "C" STORM SEWER LATERALS SHEET 3 OF 3
219	JUNCTION BOX "A" STATION 32+21.70 DETAILS
220	JUNCTION BOX "B" STATION 36+25.00 DETAILS
221	JUNCTION BOX "C" STATION 37+71.00 DETAILS
222	STORM SEWER DETAILS MISCELLANEOUS
223	*SINGLE BOX CULVERTS PRECAST 4'-0" SPAN - SCP-4 (MOD)
224	*SINGLE BOX CULVERTS PRECAST 5'-0" SPAN - SCP-5 (MOD)
225	*SINGLE BOX CULVERTS PRECAST 6'-0" SPAN - SCP-6 (MOD)
226	*SINGLE BOX CULVERTS PRECAST 7'-0" SPAN - SCP-7 (MOD)
226A	*SINGLE BOX CULVERTS PRECAST 8'-0" SPAN - SCP-8 (MOD)
227	*BOX CULVERTS PRECAST MISCELLANEOUS DETAILS - SCP-MD (MOD)
228	HCFCD INTERCEPTOR STRUCTURE DETAILS - HCFCD-ISD(1) (MOD)
229	HCFCD INTERCEPTOR STRUCTURE DETAILS - HCFCD-ISD(2)
230	HARRIS COUNTY FLOOD CONTROL DISTRICTS NOTES - HCFCD-N (MOD)

*TxDOT Standard Drawing

DRAINAGE DETAILS, continued	
231	HCFCD STORM SEWER OUTFALL DETAILS - HCFCD-SSOD (MOD)
232	*MISCELLANEOUS SEWER DETAILS - MSD (MOD)
233	*MANHOLES TYPE A & B - MH-A/B
234	*INLET TYPE A - HIL-A (MOD)
235	*PRECASE SAFETY END TREATMENT TYPE II - PARALLEL DRAINAGE - PSET-SP (MOD)
236	*PRECAST BASE - PB (MOD)
237	*PRECAST JUNCTION BOX - PJB (MOD)
238	*DESIGN DATA FOR PRECAST BASE AND JUNCTION BOX - PDD
239	*PRECAST CURB INLET OUTSIDE ROADWAY - PCO (SHEET 1 OF 2)
240	*PRECAST CURB INLET OUTSIDE ROADWAY - PCO (SHEET 2 OF 2) (MOD)
241	*CURB & GUTTER TRANSITION DETAILS FOR PCO INLET - CGT-PCO (MOD)
242	*PRECAST AREA ZONE DRAIN - PAZD (MOD)
243	HCFCD CONCRETE CHANNEL LINING DETAILS - HCFCH-CCLD(1) (MOD)
244	HCFCD CONCRETE CHANNEL LINING DETAILS - HCFCH-CCLD(2) (MOD)
245	*CONCRETE WINGWALLS WITH PARALLEL WINGS FOR BOX CULVERTS TYPES PW-1 AND PW-2
246	*CONCRETE HEADWALLS WITH FLARED WINGS FOR 0 DEGREES SKEW PIPE CULVERTS CH-FW-0
247	*CONCRETE HEADWALLS WITH FLARED WINGS FOR 30 DEGREES SKEW PIPE CULVERTS CH-FW-30
248	*CONCRETE HEADWALLS WITH PARALLEL WINGS FOR NON-SKEWED PIPE CULVERTS CH-PW-0
249	*DRIVEWAY DETAILS AT DETENTION POND ENTRANCE (SHEET 1 OF 2)
250	*DRIVEWAY DETAILS AT DETENTION POND ENTRANCE (SHEET 2 OF 2)
251	24-INCH FLAPGATE DETAIL
252	*BOX CULVERT SUPPLEMENT WINGS AND END TREATMENT-BCS

*TxDOT Standard Drawing

UTILITY DETAILS	
253	GREENS ROAD WATER PLAN & PROFILE BEGIN TO STA 18+00
254	GREENS ROAD WATER PLAN & PROFILE STA 18+00 TO STA 23+00
255	GREENS ROAD WATER PLAN & PROFILE STA 23+00 TO STA 27+00
256	GREENS ROAD WATER PLAN & PROFILE STA 27+00 TO STA 31+00
257	GREENS ROAD WATER PLAN & PROFILE STA 31+00 TO STA 35+00
258	GREENS ROAD WATER PLAN & PROFILE STA 35+00 TO STA 39+00
259	GREENS ROAD WATER PROFILE STA 35+00 TO STA 39+00
260	GREENS ROAD WATER PLAN & PROFILE STA 39+00 TO STA 44+00
261	GREENS ROAD WATER PLAN & PROFILE STA 44+00 TO STA 49+00
262	GREENS ROAD WATER PLAN & PROFILE STA 49+00 TO STA 54+00
263	GREENS ROAD WATER PLAN & PROFILE STA 54+00 TO STA 59+00
264	GREENS ROAD WATER PLAN & PROFILE STA 59+00 TO STA 64+00
265	GREENS ROAD WATER PLAN & PROFILE STA 64+00 TO STA 68+00
266	GREENS ROAD WATER PLAN & PROFILE STA 68+00 TO STA 73+00
267	GREENS ROAD WATER PLAN & PROFILE STA 73+00 TO STA 78+00
268	GREENS ROAD WATER PLAN & PROFILE STA 78+00 TO STA 83+00
269	GREENS ROAD WATER PLAN & PROFILE STA 83+00 TO STA 87+00
270	GREENS ROAD WATER PLAN & PROFILE STA 87+00 TO STA 92+00
271	GREENS ROAD WATER PROFILE STA 87+00 TO STA 92+00
272	GREENS ROAD WATER PLAN & PROFILE STA 92+00 TO END
272A	GREENS ROAD WATER PROFILE STA 92+00 TO END

UTILITY DETAILS, continued	
273	GREENVIEW DRIVE WATER PLAN & PROFILE STA 10+00 TO 13+00
274	PROPOSED WATER LINE LATERAL STA 39+93.00
275	STEPHENSON DRIVE WATER PLAN & PROFILE STA 10+00 TO 13+00
276	MORALES ROAD WATER PLAN & PROFILE STA 10+00 TO 13+00
277	PROPOSED WATER LINE LATERALS SHEET 1 OF 2
278	PROPOSED WATER LINE LATERALS SHEET 2 OF 2
279	CITY OF HOUSTON UTILITY DETAILS SHEET 1 OF 3
280	CITY OF HOUSTON UTILITY DETAILS SHEET 2 OF 3
281	CITY OF HOUSTON UTILITY DETAILS SHEET 3 OF 3
282	STEEL PIPE DETAIL
283	VALVE AND SERVICE MANHOLE DETAILS
284	AIR VALVE AND MANHOLE DETAILS
285	MISCELLANEOUS WATER LINE DETAILS
286	EXCAVATION, BEDDING, BACKFILL & PAVEMENT REPAIR DETAILS
287	TUNNEL AND CASING DETAILS
288	CATHODIC PROTECTION DETAILS SHEET 1 OF 5
289	CATHODIC PROTECTION DETAILS SHEET 2 OF 5
290	CATHODIC PROTECTION DETAILS SHEET 3 OF 5
291	CATHODIC PROTECTION DETAILS SHEET 4 OF 5
292	CATHODIC PROTECTION DETAILS SHEET 5 OF 5
293	CATHODIC PROTECTION SCHEDULE
BORING LOGS	
294	BORING LOG (SHEET 1 OF 15)
295	BORING LOG (SHEET 2 OF 15)
296	BORING LOG (SHEET 3 OF 15)
297	BORING LOG (SHEET 4 OF 15)
298	BORING LOG (SHEET 5 OF 15)
299	BORING LOG (SHEET 6 OF 15)
300	BORING LOG (SHEET 7 OF 15)
301	BORING LOG (SHEET 8 OF 15)
302	BORING LOG (SHEET 9 OF 15)
303	BORING LOG (SHEET 10 OF 15)
304	BORING LOG (SHEET 11 OF 15)

BORING LOGS, continued	
305	BORING LOG (SHEET 12 OF 15)
306	BORING LOG (SHEET 13 OF 15)
307	BORING LOG (SHEET 14 OF 15)
308	BORING LOG (SHEET 15 OF 15)
BRIDGE DESIGN	
309	PROPOSED BRIDGE ESTIMATED QUANTITY SUMMARY
310	BRIDGE LAYOUT WESTBOUND HOODS BAYOU
311	BRIDGE LAYOUT EASTBOUND HOODS BAYOU
312	TYPICAL SECTIONS HOODS BAYOU
313	ABUTMENT 1 WESTBOUND HOODS BAYOU
314	ABUTMENT 4 WESTBOUND HOODS BAYOU
315	ABUTMENT 1 EASTBOUND HOODS BAYOU
316	ABUTMENT 4 EASTBOUND HOODS BAYOU
317	BENTS 2 & 3 WESTBOUND HOODS BAYOU
318	BENTS 2 & 3 EASTBOUND HOODS BAYOU
319	SLAB BEAM SPANS WESTBOUND HOODS BAYOU
320	SLAB BEAM SPANS EASTBOUND HOODS BAYOU
321	PRESTRESSED CONCRETE SLAB BEAMS (NON-STANDARD SPANS) - PSBND
322	HCFCD UNIT No. P240-00-00 BRIDGE CLASS CULVERT PLAN & PROFILE
323	HCFCD UNIT No. P240-00-00 BRIDGE CLASS CULVERT CROSS-SECTIONS
324	*PRESTRESSED CONCRETE SLAB BEAM DETAILS (TYPE 4SB15) - PSB-4SB15
325	*PRESTRESSED CONCRETE SLAB BEAM DETAILS (TYPE 5SB15) - PSB-5SB15
326	*ELASTOMETRIC BEARING DETAILS SKEWS FROM 0° TO 30° - PSBEB
327	*RAIL AND ANCHORAGE DETAILS - PSBRA
328	*SEALED EXPANSION JOINT TYPE A WITHOUT OVERLAY - SEJ-A SHEET 1 OF 2
329	*SEALED EXPANSION JOINT TYPE A WITHOUT OVERLAY - SEJ-A SHEET 2 OF 2
330	*TRAFFIC RAIL - TYPE T221 SHEET 1 OF 2
331	*TRAFFIC RAIL - TYPE T221 SHEET 2 OF 2

*TxDOT Standard Drawing

BRIDGE DESIGN, continued	
332	*BRIDGE RAISED SIDEWALK AND MEDIAN DETAILS - BRSM SHEET 1 OF 2
333	*BRIDGE RAISED SIDEWALK AND MEDIAN DETAILS - BRSM SHEET 2 OF 2
334	*BRIDGE SIDEWALK EXPANSION JOINT COVER PLATE - BS-EJCP
335	*COMMON FOUNDATION DETAILS - FD SHEET 1 OF 2
336	*COMMON FOUNDATION DETAILS - FD SHEET 2 OF 2
337	*BRIDGE APPROACH SLAB-BAS-C_HOUSTON DISTRICT
338	*STONE RIPRAP DETAILS - SRR SHEET 1 OF 2
339	*STONE RIPRAP DETAILS - SRR SHEET 2 OF 2
TRAFFIC SIGNAL PLANS	
340	TRAFFIC SIGNAL SUMMARY OF QUANTITIES FIRE STATION #64 3000 GREENS RD
341	TRAFFIC SIGNAL GENERAL NOTES
342	TRAFFIC SIGNAL PLAN FIRE STATION #64 3000 GREENS
343	TRAFFIC SIGNAL POLE SCHEDULE FIRE STATION #64 3000 GREENS
344	TRAFFIC SIGNAL CABLE SCHEMATIC FIRE STATION #64 3000 GREENS
345	UPS BATTERY BACKUP SYSTEM DETAILS
346	WIMAX INSTALLATION DETAILS
347	TRAFFIC SIGNAL HARDWARE LEGEND
SIGNAGE AND PAVEMENT MARKINGS, AND ILLUMINATION PLANS	
348	SIGNING & PAVEMENT MARKING LAYOUT BEGIN TO STA 31+00
349	SIGNING & PAVEMENT MARKING LAYOUT 31+00 TO STA 56+50
350	SIGNING & PAVEMENT MARKING LAYOUT 56+50 TO STA 81+50
351	SIGNING & PAVEMENT MARKING LAYOUT 81+50 TO END
352	SUMMARY OF QUANTITIES SHEET
353	SUMMARY OF SMALL SIGNS DWG NO. 01509-07
354	ILLUMINATION PLAN BEGIN TO STA 31+00
355	ILLUMINATION PLAN STA 31+00 TO STA 56+50
356	ILLUMINATION PLAN STA 56+50 TO STA 81+50
357	ILLUMINATION PLAN STA 81+50 TO END
TREE PRESERVATION	
358	TREE PRESERVATION PLAN STA: 14+00 TO 30+00 SHEET L101

*TxDOT Standard Drawing

TREE PRESERVATION, continued	
359	TREE PRESERVATION PLAN STA: 30+00 TO 46+25 SHEET L102
360	TREE PRESERVATION PLAN STA: 46+25 TO 62+40 SHEET L103
361	TREE PRESERVATION PLAN STA: 62+40 TO 78+75 SHEET L104
362	TREE PRESERVATION PLAN STA: 78+75 TO 94+20 SHEET L105
363	TREE INVENTORY SHEET 1 OF 1 L200
364	TREE PRESERVATION DETAILS SHEET 1 OF 3 L301
365	TREE PRESERVATION DETAILS SHEET 2 OF 3 L302
366	TREE PRESERVATION DETAILS SHEET 3 OF 3 L303
367	PLANTING DETAILS/TREE SUMMARY L400
368	TREE REMOVAL AND MITIGATION SUMMARY L500
ENVIRONMENTAL	
369	STORM WATER POLLUTION PREVENTION GENERAL NOTES
370	STORM WATER POLLUTION PREVENTION PLAN BEGIN TO STA 31+00
371	STORM WATER POLLUTION PREVENTION PLAN 31+00 TO STA 56+50
372	STORM WATER POLLUTION PREVENTION PLAN 56+50 TO STA 81+50
373	STORM WATER POLLUTION PREVENTION PLAN 81+50 TO END
374	HCFCD STORM WATER POLLUTION PREVENTION PLAN STANDARD DETAILS
374A	COH STORM WATER POLLUTION PREVENTION PLAN DETAILS
375	*ENVIRONMENTAL PERMITS ISSUES AND COMMITMENTS (SHEET 1 OF 4)
376	*ENVIRONMENTAL PERMITS ISSUES AND COMMITMENTS (SHEET 2 OF 4)
377	*ENVIRONMENTAL PERMITS ISSUES AND COMMITMENTS (SHEET 3 OF 4)
378	*ENVIRONMENTAL PERMITS ISSUES AND COMMITMENTS (SHEET 4 OF 4)
379	US CORPS OF ENGINEERS PERMIT (SHEET 1 OF 8)
380	US CORPS OF ENGINEERS PERMIT (SHEET 2 OF 8)
381	US CORPS OF ENGINEERS PERMIT (SHEET 3 OF 8)
382	US CORPS OF ENGINEERS PERMIT (SHEET 4 OF 8)
383	US CORPS OF ENGINEERS PERMIT (SHEET 5 OF 8)
384	US CORPS OF ENGINEERS PERMIT (SHEET 6 OF 8)

*TxDOT Standard Drawing

ENVIRONMENTAL, continued	
385	US CORPS OF ENGINEERS PERMIT (SHEET 7 OF 8)
386	US CORPS OF ENGINEERS PERMIT (SHEET 8 OF 8)
ROADWAY CROSS SECTIONS	
387	ROADWAY CROSS SECTIONS (1 OF 14)
388	ROADWAY CROSS SECTIONS (2 OF 14)
389	ROADWAY CROSS SECTIONS (1 OF 14)
390	ROADWAY CROSS SECTIONS (4 OF 14)
391	ROADWAY CROSS SECTIONS (5 OF 14)
392	ROADWAY CROSS SECTIONS (6 OF 14)
393	ROADWAY CROSS SECTIONS (7 OF 14)
394	ROADWAY CROSS SECTIONS (8 OF 14)
395	ROADWAY CROSS SECTIONS (9 OF 14)
396	ROADWAY CROSS SECTIONS (10 OF 14)
397	ROADWAY CROSS SECTIONS (11 OF 14)
398	ROADWAY CROSS SECTIONS (12 OF 14)
399	ROADWAY CROSS SECTIONS (13 OF 14)
400	ROADWAY CROSS SECTIONS (14 OF 14)
401	CUT & FILL SUMMARY TABLE (SHEET 1 OF 2)
402	CUT & FILL SUMMARY TABLE (SHEET 2 OF 2)
PROJECT SIGN	
403	CITY OF HOUSTON CONSTRUCTION SIGN DETAIL

END OF DOCUMENT

Document 00041

LIST OF PRE-QUALIFIED ASBESTOS/LEAD ABATEMENT, MOLD & SOIL REMEDIATION, DEMOLITION AND PETROLEUM STORAGE TANK REMOVAL CONTRACTORS

1.1 DOCUMENT INCLUDES

A. Authorization

B. List of Authorized Contractors.

2.1 RELATED DOCUMENTS

A. Section 13280 – Hazardous Materials Remediation

B. Section 13281&13282 – Abatement of Asbestos/Lead Containing Materials

3.1 AUTHORIZATION

A. The list of Contractors Pre-qualified for Asbestos/Lead Abatement, Mold & Soil Remediation, Demolition & Petroleum Storage Tank Removal ("List") was authorized on March 21, 2012, by City of Houston Council Motion No. 12-0180.

B. Only those firms on the List can be utilized by Bidder in subcontracting for asbestos & lead abatement, mold & soil remediation, demolition & petroleum storage tank removal included in the Work.

C. The List is administered by General Services Department. All inquiries should be directed to Gabriel Mussio (832-393-8079).

4.1 LIST OF AUTHORIZED CONTRACTORS

A. As of the date specified in paragraph 3.0.A., all contractors listed in paragraph 4.0.B were licensed in the State of Texas for the type of work. Authorized Contractors must maintain there license to be on the list.

B. Authorized Contractors:

1. AAR Incorporated, 6640 Signat Drive, Houston, Texas 77041

2. A & M Environmental, LLC, 6536 Supply Row, Houston, Texas 77011

3. ARC Abatement Inc., 6827 Signat Drive, Houston, Texas 77041

4. AIA General Contractors, Inc., 18331 Running Vine Lane, Spring, Texas 77379

5. Arrow Services, Inc., 10202 Airline Drive, Suite A, Houston, Texas 77037

6. Basic Environmental Group, LLC., 1839 Key Biscayne Court, Houston,

Texas 77065

7. Cherry Environmental Services, Inc., 4501 Cherry Lane, Santa Fe, Texas 77517

8. Clark-Tech Environmental Systems, Inc., 1515 Globe Street, Houston, Texas 77034

9. CRG Environmental Services, LLC., 2504 Avenue I, Rosenberg, Texas 77471

10. DNB Enterprises, Inc., 12969 West Hardy, Houston, Texas 77037

11. Dunphey Petroleum Services, Inc., 3505 Daphne, Houston, Texas 77021

12. EC Government Services, 5850 San Felipe, Suite 400, Houston, Texas 77057

13. Effective Environmental, Inc., 9950 Chemical Road, Pasadena, Texas 77507

14. GenTech Construction Company, LLC., 2211 West 34th Street, Houston, Texas 77018

15. Hazard Assessment Leaders, Inc., dba HAL, Inc., 5311 Petty Street, Houston, Texas 77007

16. Inland Environmental, Ltd., PO Box 6751, Kingwood, Texas 77325

17. J.T.B. Services, Inc., 9026 Lambright, Houston, Texas 77075

18. NCM, 16421 Aldine Westfield Road, Houston, Texas 77032

19. PfP Abatement Group, LLC., 3823 Shadow Trail Drive, Houston, Texas 77084

20. PEMCO, Inc., PO Box 2009, Pearland, Texas 77588-2009

21. RNDI Companies, Inc., 2255 Ridge Road, Suite 216, Rockwell, Texas 75807

22. Separation Systems Consultants, Inc., 17041 El Camino Real, Suite 200 Houston, Texas 77058

23. Texas Environmental Control, Inc., 4623 Steffani Lane, Houston, Texas 77041

24. Weston Solutions, Inc., 5599 San Felipe, Suite 700, Houston, Texas 77056

25. 1 Priority Environmental Services, Inc., 2573 Gravel Drive, Fort Worth, Texas 76118

END OF DOCUMENT

Document 00042

DESIGNATED SUBCONTRACTORS AND SUPPLIERS

A. Subcontract work for the following Sections to firm(s) listed and for reason(s) stated below:

1. [Section 12610- Open Office Furniture; procurement and installation of Open Office Furniture. The City has an existing procurement/installation contract with the firm stated in Section 12610.]

END OF DOCUMENT

****

List of Changes:

04-30-2004: Added List of Changes. Notice to Bidders Section. Defined new term (Code). Provided information on how errors in extending unit prices and totaling alternates would be handled. Changed document number for Notice of Intent to Award.

12-10-2004: Corrected paragraph references in Paragraphs 6.0.B, 11.0.B.2 and 11.0.C.3.

02-28-2006: Deleted Paragraphs 9.0.D and 9.0.J. Guidance on how to handle math errors in Bid Form is provided in tabular form in Document 00210 – Supplementary Instructions to Bidders.

08-10-2006: Added Small Business Enterprise (SBE) title and DBE to Paragraph 12.0 B.

04-12-2013: Added required no-contact/quiet period language as Paragraph 3.0 C., drawn from the City Procurement Manual.

02-26-2014: Add the updated no-contact/quiet period language as Paragraph 3.0 C., again drawn from the City Procurement Manual.

06-09-2015: Added language stating that Minimum Bid Prices may not be decreased in Paragraph 9.0 E.

****

Document 00200

TABLE OF CONTENTS

INSTRUCTIONS TO BIDDERS

PARA	TITLE	PAGE
1.0	*RELATED DOCUMENTS*	3
2.0	*DEFINITIONS*	3
3.0	*NOTICE TO BIDDERS*	3
4.0	*BID DOCUMENTS*	4
5.0	*EXAMINATION OF DOCUMENTS, SITE, AND LOCAL CONDITIONS*	4
6.0	*INTERPRETATIONS DURING BIDDING*	4
7.0	*ADDENDA*	4
8.0	*SUBSTITUTION OF PRODUCTS*	5
9.0	*PREPARATION OF BIDS*	5
10.0	*BID SUBMISSION*	5
11.0	*BID SECURITY*	5
12.0	*SUBCONTRACTORS AND SUPPLIERS*	6
13.0	*MODIFICATION OR WITHDRAWAL OF BID*	6
14.0	*BID DISQUALIFICATION*	6
15.0	*PREBID MEETING*	6
16.0	*OPENING OF BIDS*	6
17.0	*EVALUATION AND CONSIDERATION OF BIDS*	6
18.0	*ACCEPTANCE OF THE BID*	6

Document 00200

INSTRUCTIONS TO BIDDERS

1.0 *RELATED DOCUMENTS*

A. Document 00210 – Supplementary Instructions to Bidders.

B. Document 00320 – Geotechnical Information.

C. Document 00330 – Existing Conditions.

D. Document 00410 – Bid Form, Parts A & B.

E. Document 00495 – Post-Bid Procedures.

F. Document 00520 – Agreement.

G. Document 00700 – General Conditions.

H. Document 00800 – Supplementary Conditions.

2.0 *DEFINITIONS*

A. Definitions set forth in Document 00700 – General Conditions and in other documents of Project Manual, are applicable to Bid Documents.

B. *Addendum:* Written or graphic instrument issued prior to Bid opening, which clarifies, modifies, corrects, or changes Bid Documents.

C. *Alternate:* The total amount bid for additions to work, as described in Section 01110 – Summary of Work. Each Alternate includes cost of effects on adjacent or related components, and Bidder's overhead and profit.

D. *Bid:* A complete and properly signed offer to perform the Work in accordance with this Document and Document 00210 – Supplementary Instructions to Bidders.

E. *Bid Date:* Date and time set for receipt of Bids as stated in Document 00210 – Supplementary Instructions to Bidders, or as modified by Addenda.

F. *Bid Documents:* Project Manual, Drawings, and Addenda.

G. *Bid Supplement: A* Bid submittal that is required in Document 00410 – Bid Form.

H. *Bidder:* Person or firm, identified in Document 00410B – Bid Form – Part B, including its successors, and its authorized representative.

I. *Code:* Code of Ordinances, Houston, Texas.

J. *Low Bidder:* Apparent successful Bidder that qualifies as a responsible Bidder and that submits Bid with lowest Total Bid Price.

K. *Project Manager:* Person designated in Document 00100 – Advertisement for Bids and Document 00220 – Request for Bid Information to represent the City during bidding and post-bid periods.

L. *Project Manual:* Volume assembled for the Work that includes the bidding requirements, sample forms, Conditions of the Contract, and Specifications.

M. *Security Deposit:* A certified check, cashier's check, or bid bond in the amount of 10 percent of the Total Bid Price.

N. *Total Bid Price:* Total amount bid for performing the Work as identified by Bidder in Document 00410B – Bid Form – Part B, which amount includes:

1. Stipulated Price;

2. Total Base Unit Prices;

3. Total Extra Unit Prices;

4. Total Cash Allowances; and

5. Total Alternates.

3.0 *NOTICE TO BIDDERS*

A. The City of Houston Fair Campaign Ordinance makes it unlawful for a Contractor to offer any contribution to a candidate for City elective office (including elected officers and officers-elect) during a certain period of time prior to and following the award of the Contract by the City Council. The term "Contractor" includes proprietors of proprietorships, all partners of partnerships, and all officers, directors, and holders of 10 percent or more of the outstanding shares of corporations. A statement disclosing the names and business addresses of each of those persons will be required to be submitted with each bid or proposal; for a City Contract. Bidder shall complete and submit Document 00452 – Form A, Contractor Submission List, City of Houston Fair Campaign Ordinance, with its Bid to comply with this requirement. See Chapter 18 of the Code for further information.

B. Chapter 15, Article VIII, of the City's Code provides that no contract shall be let, nor any other business transaction entered into, by the City with any person indebted to the City or a qualifying entity, if the contractor or transaction comes within the provisions of Section 15-1 (c) of the Code. Exceptions are provided in Section 15-126 of the Code. Bidder shall complete and submit Document 00455 – Affidavit of Ownership or Control, with its Bid to comply with this requirement.

C. Neither bidder(s) nor any person acting on bidder(s)'s behalf shall attempt to influence the outcome of the award by the offer, presentation or promise of gratuities, favors, or anything of value to any appointed or elected official or employee of the City of Houston, their families or staff members. All inquiries regarding the solicitation are to be directed to the designated City Representative identified on the first page of the solicitation. Upon issuance of the solicitation through the pre-award phase and up to the date the City Secretary publicly posts notice of any City Council agenda containing the applicable award, aside from bidder's formal response to the solicitation, through the pre-award phase, written requests for clarification during the period officially designated for such purpose by the City Representative, neither bidder(s) nor persons acting on their behalf shall communicate with any appointed or elected official or employee of the City of Houston, their families or staff through written or oral means in an attempt to persuade or influence the outcome of the award or to obtain or deliver information intended to or which could reasonably result in an advantage to any bidder. However, nothing in this paragraph shall prevent a bidder from making public statements to the City Council convened for a regularly scheduled session after the official selection has been made and placed on the City Council agenda for action, or to a City Council committee convened to discuss a recommendation regarding the solicitation.

4.0 *BID DOCUMENTS*

A. The Bid Documents may be obtained at location specified in Document 00210 – Supplementary Instructions to Bidders.

B. The Bid Documents are made available only for the purpose of bidding on the Work. Receipt of Bid Documents does not grant a license for other purposes.

C. On receipt of Bid Documents, Bidder shall verify that documents are legible and complete, compare contents of Project Manual with Document 00010 – Table of Contents, and compare Index of Drawings with Document 00015 – List of Drawings. Bidder shall notify Project Manager if Bid Documents are incomplete.

D. If City of Houston Standard Specifications or Standard Details are required by the Project Manual, Bidder shall refer to Document 00210 – Supplementary Instructions to Bidders for purchase information.

5.0 *EXAMINATION OF DOCUMENTS, SITE, AND LOCAL CONDITIONS*

A. Bidder shall examine Project site, become familiar with local conditions under which the Work shall be performed, conduct appropriate investigations, and correlate personal observations with requirements of the Bid Documents before submitting a Bid.

B. Bidder shall make site investigations to the extent Bidder deems necessary to ascertain extent of subsurface conditions.

C. Failure of Bidder to perform the investigations prior to submitting a Bid does not relieve Bidder of responsibility for investigations, interpretations and proper use of available information in the preparation of its Bid.

D. Bidder shall observe limitations of access to occupied or restricted site as stated in Document 00210 – Supplementary Instructions to Bidders.

6.0 *INTERPRETATIONS DURING BIDDING*

A. Bidder shall immediately submit Document 00220 – Request for Bid Information to Project Manager upon finding errors, discrepancies, or omissions in Bid Documents. Confirmation of receipt of questions by the City is the responsibility of Bidder. Verbal discussions and answers are not binding.

B. Document 00220 – Request for Bid Information must be received at least 10 days before the Bid Date to allow issuance of Addenda in accordance with Paragraph 7.O.D. Replies, if issued, are by Addenda.

7.0 *ADDENDA*

A. Addenda that affect bidding requirements are applicable only during applicable only through issuance of the Notice to Proceed. Addenda that affect the Contract are a part of the Contract.

B. BIDDERS WHO SUBMIT A BID ON THIS PROJECT SHALL BE PRESUMED TO HAVE RECEIVED ALL ADDENDA AND TO HAVE INCLUDED ANY COST THEREOF IN THEIR BIDS, REGARDLESS OF WHETHER THEY ACKNOWLEDGE THE ADDENDA OR NOT.

C. The City will make Addenda available at same location where the Bid Documents may be obtained. The City will notify plan holders of record when Addenda are available. Bidders are responsible for obtaining Addenda after notification.

D. No Addendum will be issued later than noon on Monday before Bid Date, except Addenda with minor clarifications, withdrawing request for Bids, or postponing Bid Date.

8.0 *SUBSTITUTION OF PRODUCTS*

A. No substitutions of Products will be considered during the bidding period.

9.0 *PREPARATION OF BIDS*

A. Bidder shall fill in applicable blanks in Document 00410A&B – Bid Form – Parts A & B and Bid Supplements. In addition, Bidder shall bid all Alternates. Bidder shall properly sign Document 00410B -Bid Form.

B. Bidder shall initial all pages, except signature page, of Document 00410B – Bid Form – Part B.

C. Bidder is responsible for all costs incurred by the Bidder, associated with preparation of its Bid and compliance with Post-bid Procedures.

D. Bidder may not adjust preprinted price on line items stating "Fixed Unit Price" in the description on the Bid Form.

E. Bidder may increase, but not decrease, preprinted price on line items stating "Minimum Bid Price" in the description on the Bid Form by crossing out the minimum and inserting revised price on the line above. Bidder **may not** decrease the preprinted price on line items stating "Minimum Bid Price".

F. Bidder may decrease, but not increase, preprinted price on line items stating "Maximum Bid Price" in the description on the Bid Form by crossing out the maximum and inserting revised price on the line above. Bidder **may not** increase the preprinted price on line items stating "Maximum Bid Price".

G. Bidder shall insert a price no greater than the maximum preprinted range and no less than the preprinted range for line items stating "Fixed Range Unit Price" in the description on the Bid Form by crossing out prices noted and inserting revised price on the line above.

H. Bidder may not adjust Cash Allowance amounts.

10.0 *BID SUBMISSION*

A. City Secretary will receive Bids on Bid Date at location specified in Document 00210 – Supplementary Instructions to Bidders.

B. Bids submitted after Bid Date will be returned to Bidder unopened.

C. Verbal, facsimile, or electronic Bids are invalid and will not be considered.

D. Bidder shall submit in person or by mail one copy of the signed Document 00410 – Bid Form, Parts A and B, along with required Security Deposit, and required Bid Supplements, in a sealed, opaque envelope. In addition, Bidder shall clearly identify Project, Bid Date and Bidder's name on outside of envelope. If forwarded by mail, the sealed envelope containing the Bid must be enclosed in another envelope addressed for postal delivery.

11.0 *BID SECURITY*

A. Bidder shall submit a Security Deposit with its Bid.

B. Certified Check or Cashier's Check

1. Bidder shall make check payable to the City of Houston.

2. A check is submitted on the condition that if Bidder is named Low Bidder and fails either to timely and properly submit documents required in Document 00495 – Post-Bid Procedures, the City will cash the check in accordance with Paragraph 11.0.E.

C. Bid Bond

1. The bid bond must be a valid and enforceable bond, signed by a surety that complies with other requirements set out by law.

2. The bid bond must name the City of Houston as obligee, and be signed by the Bidder as principal and signed and sealed by the surety.

3. The bid bond must be conditioned such that if Bidder is named Low Bidder and then fails to timely and properly submit documents required in Document 00495 – Post-Bid Procedures, surety will be obligated to pay to the City an amount in accordance with Paragraph 11.0.E.

D. Security Deposits will be retained until after the Contract is awarded or all Bids are rejected.

E. Low Bidder forfeits Security Deposit if it fails to timely and properly submit documents required in Document 00495 – Post-Bid Procedures. The City may claim an amount equal to the difference between the Total Bid Price of the defaulting Bidder and the Total Bid Price of the Bidder awarded the Contract. If Security Deposit is a check, the City will reimburse any remaining balance to the defaulting Bidder.

12.0 *SUBCONTRACTORS AND SUPPLIERS*

A. The City may reject proposed Subcontractors or Suppliers.

B. Refer to Document 00800 – Supplementary Conditions, for MWBEPDBE, DBE and SBE goals.

13.0 *MODIFICATION OR WITHDRAWAL OF BID*

A. A Bidder may modify or withdraw a Bid submitted before the Bid Date by written notice to the City Secretary. The notice may not reveal the amount of the original Bid and must be signed by the Bidder.

B. Bidder may not modify or withdraw its Bid by verbal, facsimile, or electronic means.

C. A withdrawn Bid may be resubmitted up to the time designated for receipt of Bids.

14.0 *BID DISQUALIFICATION*

A. The City may disqualify a Bid if the Bidder:

1. fails to provide required Security Deposit in the proper amount;

2. improperly or illegibly completes information required by the Bid Documents;

3. fails to sign Bid or improperly signs Bid;

4. qualifies its Bid; or

5. improperly submits its Bid.

B. When requested, Low Bidder shall present satisfactory evidence that Bidder has regularly engaged in performing construction work as proposed, and has the capital, labor, equipment, and material to perform the Work.

15.0 *PREBID MEETING*

A. A prebid meeting is scheduled to be held at the place, time, and date listed in Document 00210 – Supplementary Instructions to Bidders.

B. All Bidders, subcontractors, and suppliers are invited to attend.

C. Representatives of City Engineer will attend.

16.0 *OPENING OF BIDS*

A. Bids are opened by the City Secretary and publicly read in City Council Chambers on the Public Level in City Hall Annex at 11:00 a.m. on Bid Date.

B. Place and date of Bid opening may be changed in accordance with Sections 15-3(b)(5) and 15-3(b)(6) of the City Code.

17.0 *EVALUATION AND CONSIDERATION OF BIDS*

A. Project Manager will tabulate, record and evaluate Bids.

B. The City may reject all Bids or may reject any defective Bid.

18.0 *ACCEPTANCE OF THE BID*

A. The City will send to Low Bidder Document 00498 – Notice of Intent to Award. Acceptance by the City is conditioned upon Bidder's timely and proper submittal of documents required in Document 00495 – Post-Bid Procedures.

B. The Bid remains open to acceptance and is irrevocable for the period of time stated in Document 00410A – Bid Form – Part A.

END OF DOCUMENT

Document 00210-T

TxDOT-FUNDED SUPPLEMENTARY INSTRUCTIONS TO BIDDERS

The following Paragraphs modify Document 00200 - Instructions to Bidders. Where a portion of the Instructions to Bidders is modified or deleted by these Supplementary Instructions, the unaltered portions of the Instructions to Bidders remains in effect.

2.0 – DEFINITIONS: Add the following Paragraphs to this Section:

O. *Office of Business Opportunity (OBO):* All references to Affirmative Action Contract Compliance Division (AACC) set forth in Document 00700 – General Conditions and in other documents of the Project Manual, shall refer to, and include, the Office of Business Opportunity.

P. *Certificate of Responsibility:* An unexpired and unrevoked letter from the Director containing an identification number and stating that a Bidder has met the minimum qualifications to bid on street and bridge contracts within the amount and type of bidding capacity, based on Texas Department of Transportation (TxDOT) determination of Bidder's capability and approval of financial stability.

Q. *Director:* Director, Department of Public Works and Engineering, City of Houston.

3.0 - NOTICE TO BIDDERS: Add the following Paragraph to this Section:

C. This is a City Street and Bridge Construction or Improvement Contract which requires a current Certificate of Responsibility filed with the Director no later than three business days prior to Project Bid Date. A Certificate of Responsibility is a valid Prequalification Approval Letter issued by TxDOT stating that a Bidder is qualified to bid on State Highway improvement contracts pursuant to 43 Texas Administrative Code, Section 9.12, as it may be amended from time-to-time, and Chapter 15, Article IV of the Code of Ordinances, Houston, Texas (the "Ordinance").

4.0 – BID DOCUMENTS: Add the following Paragraphs to this Section:

A. Add the following Paragraph A.1:

1. Bid documents may only be obtained electronically at the City's website: http://bidsets.publicworks.houstontx.gov/ .

D. Add the following Paragraph D.1:

1. Copies of the City Standard Specifications and Details may be acquired at no cost on the City's website **http://documents.publicworks.houstontx.gov/document-center/specifications/index.htm**

E. The following plan rooms, whose names, addresses, phone and fax numbers were last updated on April 9, 2007, have been authorized by the City to display Bid Documents for examination:

1. AMTEK Information Services, Inc., 4001 Sherwood Lane, Houston, TX 77092, 713-956-0100, Fax 713-956-5340, Email: planroom@amtekusa.com

2. Associated Builders & Contractors, Inc., (ABC), 3910 Kirby, Suite 131, Houston, TX 77098-4151, 713-523-6222, Fax 713-874-0747. Email: lori@abchouston.org

3. Associated General Contractors (AGC-BB) Building Branch, 3825 Dacoma, Houston, TX 77092-8717, 713-843-3700, Fax 713-843-3701. Email: karla.s@agchouston.org

4. Associated General Contractors, (AGC-HHUI), Highway, Heavy Utilities and Industrial Branch, 2400 Augusta St., Suite 180, Houston, TX 77057, 713-334-7100, Fax 713-334-7130. Email: houston@agctx.org (Attention: Mel Keyser)

5. Construction Information Network, 1225 North Loop West, Suite 550, Houston, TX 77008, 713-868-2233 ext. 329, Fax 866-852-2713. Email: paul.tilford@cnsx.com

6. F. W. Dodge Corporation, 4101 Greenbriar, Suite 320, Houston, TX 77098, 713-529-4895, Fax 713-524-7639. Email: terrie_harris@mcgraw-hill.com

7. Hispanic Contractors Association of Houston (HCA-GHA), 11 Parker Road, Suite 7, Houston, TX 77241, 713-699-2732 or 832-754-3705, Fax 713-695-1556, Email: hispanicontractorsassociation@yahoo.com; or Randymagdaleno@yahoo.com

8. Houston Minority Business Development Center, 2900 Woodridge, Suite 124, Houston, TX 77087, 713-644-0821, Fax 713-644-3523. Email: gtamez@gacompanies.com

9. Reed Construction Data, 30 Technology Parkway South, Suite 100, Norcross, GA – 30092-8629. Tel. 1-800-424-3996 or 1-800-699-8640; Fax 1-800-317-0870 or 1-800-508-5370.

10. The Builders' Exchange of Texas, Inc., 3910 Kirby, Suite 131, Houston, TX 77098, 210-564-6900, Fax: 210-564-6921, Email: houston@bxtx.com

5.0 - EXAMINATION OF DOCUMENTS, SITE, AND LOCAL CONDITIONS: Insert the following paragraph:

D. Add the following Paragraph D.1:

1. Work will be performed in public right-of-way. The site may be examined at any time during daylight hours.

9.0 – PREPARATION OF BIDS: Add the following Paragraph I to this Paragraph:

I. For math errors the City encounters in analyzing Bids, the following guidance will be used:

In the event of a conflict between:	The Bid Price is:
1. Individual Unit Price and Extension of that Unit Price	Individual Unit Price times Estimated Quantity
2. A Unit Price extension and total of Unit Price Extensions	Sum of all Individual Unit Price Extensions
3. Individual Alternate and total of Alternates	Sum of all Individual Alternates
4. Individual subtotals for Stipulated Price, Base Unit Prices, Extra Unit Prices, Contractor Bonus, Cash Allowances, and Alternates; and the Total Bid Price	Sum of Individual subtotals for Stipulated Price, Base Unit Prices, Extra Unit Prices, Contractor Bonus, Cash Allowances and Alternates

10.0 – BID SUBMISSION: Add the following Paragraph A.1 to this Section:

A. Add the following Paragraph A.1:

1. City Secretary will receive Bids at 900 Bagby, Room P101, Houston, Texas until 10:30 a.m., local time on August 11, 2016.

D. Submit one copy of the executed offer on the bid forms provided, properly signed, with required Security Deposit, and other Supplements to Bid Forms, in a sealed, opaque envelope. On the outside of the envelope, clearly identify the Certificate of Responsibility number, Bidders name, Project name, and the City's name. Bids submitted by mail shall be enclosed in a separate envelope addressed for mailing, and identifying the enclosure as a bid.

E. Bidders are responsible for obtaining a Certificate of Responsibility number for the class of contract indicated in Document 00210 – Supplementary Instructions to Bidders. TxDOT Certificate of Qualification letter must be filed with the Director not less than three days prior to Project Bid opening. Bidders who do not have a City of Houston Certificate of Responsibility will be notified by the City.

14.0 – BID DISQUALIFICATION: Delete paragraphs A and B and replace with the following paragraph A:

A. The City shall disqualify a Bid if the Bidder:

1. fails to provide required Security Deposit in the proper amount;
2. improperly or illegibly completes information required by the Bid Documents;
3. fails to sign Bid or improperly signs Bid;
4. qualifies its Bid; or
5. improperly submits its Bid.

15.0 – PREBID MEETING: Add the following Paragraph A.1 to this Section:

A. Add the following Paragraph A.1:

1. A Prebid Meeting will be held at 10:30:00 AM on Tuesday, August 2, 2016, in 14th Floor, Conference Room No. 1453 at 611 Walker, Houston, Texas 77002.

END OF DOCUMENT

Document 00220

REQUEST FOR BID INFORMATION

PROJECT: Greens Road Paving and Drainage Improvements from Aldine Westfield to J.F Kennedy Boulevard

PROJECT No.: WBS No. N-000686-0002-4; CSJ 0912-71-739

TO: Sudarshan Gouni, P.E.
14th Floor
611 Walker, Houston, Texas 77002

Phone No. (832) 395-2231
Fax No. (832) 395-2252
Email Addr. sudarshan.gouni@houstontx.gov

(Type or Print question legibly; use back if more space is needed)

This request relates to _____ and/or _____
Drawing / Detail No. Specification Section No.

Attachments to this request: _____

Signature _____ Date _____

(Type or Print Name) _____

(Type or Print Company Name) _____

END OF DOCUMENT

Document 00251

PREBID MEETING AGENDA

Project: Greens Road Paving and Drainage Improvements from Aldine Westfield to J.F Kennedy Boulevard
Project No.: WBS No. N-000686-0002-4; CSJ 0912-71-739
Date: Tuesday, August 2, 2016
Time: 10:30:00 AM, 14th Floor, Conference Room No. 1453
Location: 611 Walker, Houston, Texas 77002

- Announce the name, location and general scope of the project to all attendees and state purpose of meeting. Announce that, at present, bids will be taken on Thursday, August 11, 2016.

- Pass around sign in sheet. Have everyone sign it and tell them that they are to include a FAX number or email address if they want a copy of the completed list of attendees. If location permits you may be able to run a copy of sign in sheet for everyone before meeting ends.

- Advise all attendees that whatever is said during the meeting is meant to be helpful but does not and cannot change the Bid Documents. Bidders must rely on published Addenda for official answers to questions that are not currently covered by Bid Documents.

- Introduce all parties present who are involved in the Project.

Project Manager	Sudarshan Gouni, P.E.
Design Consultant Representative	
User Department Representative	
Construction Manager	
Environmental/Abatement Rep.	
Contract Compliance Inspector	
MWBE & Wage Rate Monitor	
Testing Laboratory Representative	

- If Office of Business Opportunity (OBO) or Dept. of Housing & Community Development (DHCD) representative does not attend, announce MWBE and any PDBE or DBE participation goals for Project. Remind them about monthly reports that must be filed with AA/CCD or DHCD. **POP and HHF are not applicable.**

- If OBO or DHCD representative is present, allow them, at this point, to make their presentation and leave.

- Explain to attendees difference between City Code Inspectors and our own Contract Compliance Inspectors.

- Announce Addendum No. 1 is to be released shortly or on _____. Registered Plan Holders will receive notification to download electronically at the City's website: http://bidsets.publicworks.houstontx.gov/ . All Addenda for those who have not yet downloaded, Bid Documents are available as part of a set of complete Bid Documents, on the City's website.

- Announce a tentative schedule of events:

Last Addendum	_____
Receive Bids	August 11, 2016
Notify apparent Low Bidder	[Monday after Bid Date]
Low Bidder provides Post Bid Docs	[usually 10 days later]
Contract Awarded	[45-90 days later]

- Discuss other issues peculiar to Project (e.g. asbestos and lead abatement, soil remediation, buried tanks, archeological, etc.)

Name	Company	Phone	* FAX/email

* Include FAX number or email address if you want a completed copy of the sign up sheet sent to you.

Document 00320

GEOTECHNICAL INFORMATION

1. DOCUMENT INCLUDES

   A. Soils investigation reports.
   B. Bidder's responsibilities.

2. RELATED DOCUMENTS

   A. Document 00340 – Environmental Information
   B. Section 02260 - Trench Safety Systems

3. SITE INVESTIGATION REPORTS

   A. In the design and preparation of Contract documents for this Project, the City and Design Consultant have used information in geotechnical reports for the investigation and analysis of soils and subsurface conditions at the Project site.

   B. An electronic copy of the report for this project is included in a CD-Rom affixed to the inside front cover of the project manual.

   C. Neither the City nor Design Consultant is responsible for accuracy or completeness of any information or data.

4. GEOTECHNICAL REPORTS

   A. Report No.: HJ0519680; Prepared By (Firm Name):HVJ Associates, Inc.; Title: Geotechnical Study Greens Road From Aldine Westfield To J F K Blvd.; Report Date: March 2015; No. of Pages: 185

5. BIDDER RESPONSIBILITIES

   A. Bidder shall take full responsibility for interpretation and use of information contained in above listed reports for its bidding and construction purposes.

B. Bidder may perform additional soils investigations as Bidder deems appropriate.

END OF DOCUMENT

Document 00330

EXISTING CONDITIONS

****

Do not use this Document in Project Manual unless specific surveys or studies have been performed and documented concerning site conditions, subsurface surveys or video taping, or environmental conditions. Information based on data provided by sources, other than the City or Design Consultant, except as specifically noted, is not a part of the Contract documents, and responsibility for the accuracy of the information lies with the preparer. Bidder is responsible for interpretation of the information in preparing its Bid. List and identify each report in a separate paragraph, editing the text as appropriate to describe the report. This is a Bid Document, not a Contract document; do not reference this Document in the list of Contract documents.

****

1. DOCUMENT INCLUDES

   A. Subsurface investigation reports

   B. Existing structures

2. RELATED DOCUMENTS

   A. Document 00320 - Geotechnical Information

3. SUBSURFACE INVESTIGATION REPORT

****

In Paragraph 3.0A, change the phrase "Owners of Underground Facilities" to "investigation by an independent firm," if applicable. Edit this paragraph as needed to make it specific for the Project.

****

   A. In the design and preparation of Contract documents for this Project, the City and Design Consultant have used information with respect to Underground Facilities and existing structures at or contiguous to the site, based on data furnished to the City or Design Consultant by owners of the Underground Facilities, as noted in reports listed below.

****

Change Paragraph 3.0B to either of the following options, as applicable:

B. A copy of each report is provided with Bid Documents as information to Bidders.

*****[OR]*****

B. A copy of each report is available for examination at the office of Design Consultant as information for Bidders.

*****[OR]*****

B. A copy of each report is available for examination at the office of Survey Company as information for Bidders.
****

C. Neither the City nor Design Consultant is responsible for the accuracy or completeness of any such information or data.

****
List reports, if any, or DELETE 4.0 A. & B.
****

4. EXISTING CONDITIONS REPORTS

****
In Paragraph 4.0, list all applicable reports, report number, subject, firm preparing report, title of report, and its date and number of pages.
****

Existing Conditions Report(s) available to Bidders: (List information. Use back of page if necessary.)

A. Report No. _______ on _____________, prepared by ___________, entitled ___________________________, dated ___________, consisting of _________ sheets of drawings and _______ pages.

B. Report No. _______ on _____________, prepared by ___________, entitled ___________________________, dated ___________, consisting of _________ sheets of drawings and _______ pages.

5. EXISTING STRUCTURES

- Contract documents indicate physical conditions in or relating to existing surface and subsurface structures which are at or contiguous to the site that were known to, and have been used by, the City and Design Consultant in preparation of Contract documents.

****

Edit the subparagraphs under Paragraph 6.0A. as required. Delete Paragraph 6.0 if no video tapes are available. Remove brackets and instructions. Change color of remaining text to black.
****

6. VIDEO TAPES OF SANITARY SEWER

   A. In the design and preparation of Contract documents for this Project, the City and Design Consultant have used information contained on video tapes with respect to the trunk sewer at the site.

   B. For bidding purposes, the trunk sewer has been televised to show the most current information.

   C. The video tapes are available for inspection by contacting Sudarshan Gouni, P.E. at (832) 395-2231. Give at least 24 hours advance notice to reserve a viewing time. Television Inspection Reports created using the video tapes are also available.

   D. Pavement core testing was performed for the determination of the existing pavement material properties. The report is provided with Project Manual.

   E. Neither the City nor Design Consultant shall be responsible for the accuracy or completeness of any information or data.

7. BIDDER RESPONSIBILITIES

   A. Bidder shall have full responsibility for reviewing and verifying information and data, for locating Underground Facilities and existing structures shown or indicated in the Contract documents, and for coordination of the Work with the owners of such Underground Facilities and existing structures during construction.

END OF DOCUMENT

Document 00340

ENVIRONMENTAL INFORMATION

1.0 DOCUMENT INCLUDES

A. Environmental Site Assessment, if applicable.

B. Asbestos and Lead Surveys, if applicable.

C. Bidder's responsibilities.

2.0 RELATED DOCUMENTS

A. Document 00320 - Geotechnical Information

3.0 SITE INVESTIGATION REPORTS

A. In the design and preparation of Contract documents for this Project, the City and Design Consultant have used information in environmental site assessment reports for the investigation and analysis of soils and subsurface conditions at the Project site.

B. In the design and preparation of Contract documents for this Project, the City and Design Consultant have relied upon information in surveys taken for Asbestos-containing Materials (ACMs) and lead at the Project site.

C. An electronic copy of each report for this project is included in a CD-Rom affixed to the inside front cover of the project manual.

D. Neither the City nor Design Consultant is responsible for accuracy or completeness of any information or data.

4.0 REPORTS

A. Environmental Assessment Surveys

1. Report No.: HE1114417; Prepared By (Firm Name): HVJ Associates, Inc. Title: Phase I Environmental Site Assessment; Report Date: November 2014; No. of Pages: 66

2. Report No.: HE1114418 ; Prepared by (Firm Name): Hvj Associates, Inc.; Title: Phase Ii Environmental Site Assessment; Report Date: March 2015; No. of Pages: 60

5.0 BIDDER RESPONSIBILITIES

A. Bidder shall take full responsibility for interpretation and use of information contained in above listed reports for bidding and construction purposes.

B. Bidder may perform additional investigations as Bidder deems appropriate.

END OF DOCUMENT

Document 00410A

BID FORM – PART A

To: **The Honorable Mayor and City Council of the City of Houston**
City Hall Annex
900 Bagby Street
Houston, Texas 77002

Project: Greens Road Paving and Drainage Improvements from Aldine Westfield Road to John F. Kennedy Boulevard

Project No.: WBS No. N-000686-0002-4; CSJ No. 0912-71-739

Bidder: _____

(Print or type full name of business entity, such as corporation, LLC, etc)

OFFER

A. Total Bid Price: Having examined the Project location and all matters referred to in Bid Documents for the Project, we, the undersigned, offer to enter into a Contract to perform the Work for the Total Bid Price shown on the signature page of this Document

B. Security Deposit: Included with the Bid is a Security Deposit in the amount of 10 percent of the Total Bid Price subject to terms described in Document 00200 – Instructions to Bidders.

C. Period for Bid Acceptance: This offer is open to acceptance and is irrevocable for 90 days from Bid Date. That period may be extended by mutual written agreement of the City and Bidder.

D. Addenda: All Addenda have been received. Modifications to Bid Documents have been considered and all related costs are included in the Total Bid Price.

E. Bid Supplements: The following documents are attached:

[X] Security Deposit *(as defined in Document 00200–Instructions to Bidders)*
[X] Document 00450 - Bidder's Statement of MWSBE Status
[X] Document 00452 - Contractor's Submission List - Fair Campaign Ordinance Form A
[X] Document 00453 – Bidder's Statement of Residency *(not required for AIP funded project)*
[X] Document 00454 - Affidavit of Non-interest
[X] Document 00455 - Affidavit of Ownership or Control
[ ] Document 00456 - Bidder's Certificate of Compliance with Buy American Program *(required for AIP funded project)*
[X] Document 00457 – Conflicts of Interest Questionnaire (CIQ)
[ ] Document 00458 - Bidder's Certificate Regarding Foreign Trade Restriction *(required for AIP funded project)*
[ ] Document 00459 - Contractor's Statement Regarding Previous Contracts Subject to EEO *(required for AIP funded project)*

[X] Document 00460 – Pay or Play Acknowledgement Form (POP 1-A)
[ ] Document 00470 – Bidder's MWSBE Participation Plan *(required unless no MWSBE participation goal is provided in Document 00800* (the "Goal")*).*
[ ] Document 00471 – Bidder's Record of Good Faith Efforts *(required if the goal in Bidder's Participation Plan–Document 00470 is lower than the Goal).*
[ ] Document 00472 – Bidder's Goal Deviation Request *(required if the goal in Bidder's Participation Plan–Document 00470 is lower than the Goal).*
[ ] Others as listed: Valid official letter from OBO with your designation as a City or Local Business (Bidder's Participation Hire Houston First)

CONTRACT TIME

A. If offer is accepted, Contractor shall achieve Date of Substantial Completion within 944 days after Date of Commencement of the Work, subject to adjustments of Contract Time as provided in the Contract.

Document 00410B

BID FORM – PART B

1.0 TOTAL BID PRICE HAS BEEN CALCULATED BY BIDDER, USING THE FOLLOWING COMPONENT PRICES AND PROCESS (PRINT OR TYPE NUMERICAL AMOUNTS):

A. STIPULATED PRICE: $[N/A]

(Total Bid Price; minus Base Unit Prices, Extra Unit Prices, Cash Allowances and All Alternates, if any)

B. BASE UNIT PRICE TABLE:

1.UNIT PRICES – GENERAL ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in Figures
1	01502	Mobilization	LS	1	$475,000 (1)	$475,000 (1)
2	01555	Traffic Control And Regulation	LS	1	$550,000(2)	$550,000(2)
3	01555	Flagmen	LS	1	$150,000(2)	$150,000(2)
4	01506	Diversion Pumping	LS	1		
5	01555	Install Portable Low Profile Concrete Barriers (Including Type I And II)	LF	6,533		
6	01555	Move And Reset Portable Low Profile Concrete Barriers (Including Type I And II)	LF	8,133		
7	01555	Remove Portable Low Profile Concrete Barriers (Including Type I And II)	LF	6,533		
8	01570	Storm Inlet Sediment Trap	EA	74		
9	01570	Sand Bag Barrier	LF	3,200		
10	01570	Filter Fabric Fence	LF	15,660		
11	01575	Stabilized Construction Exit	EA	1		
12	01578	Ground Water Control For Open-Cut Construction	LF	2,000		
13	02105	Preparatory Work For Sampling And Analysis In Potentially Petroleum Contaminated Area (PPCA)	LS	1	$50,000(2)	$50,000(2)
14	02120	Disposal Of Contaminated Groundwater From PPCA	GAL	500		
15	02120	PPCA Disposal (Class I)	CY	5,000		
16	02120	PPCA Disposal (Class II)	CY	2,500		
17	02221	Remove And Dispose Of Concrete Pavement With Or Without Asphalt Overlay Regardless Of Thickness, From Back Of Curbs, Including Base And Subgrade, W/ Or Without Curb, All Depths	SY	2,882		
18	02221	Remove And Dispose Of Concrete Sidewalk 4-Inch Thick Or More	SY	230		
19	02221	Remove And Dispose Of Concrete Driveways, All Thickness	SY	3,114		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in Figures
20	02221	Remove And Dispose Of Concrete Curb	LF	468		
21	02221	Remove And Dispose Of Asphalt Pavement With Or Without Base	SY	24,284		
22	02221	Remove And Dispose Of Asphalt Driveways, All Thickness	SY	3,479		
23	02221	Remove And Dispose Of Existing Inlets All Sizes/Depths	EA	10		
24	02221	Remove And Dispose Of Existing Manholes All Sizes/Depths	EA	5		
25	02221	Remove And Dispose Of Existing 4-Inch Dia Waterline	LF	15		
26	02221	Remove And Dispose Of Existing 6-Inch Dia Waterline	LF	30		
27	02221	Remove And Dispose Of Existing 8-Inch Dia Waterline	LF	30		
28	02221S	Remove And Dispose Of Existing 8-Inch Dia AC Waterline	LF	63		
29	02221	Remove And Dispose Of Existing 16-Inch Dia Steel Waterline At Aerial Crossing	LF	127		
30	02221S	Remove And Dispose Of Existing 16-Inch Dia AC Waterline	LF	382		
31	02221	Remove And Dispose Of Existing 8-Inch Storm Sewer PVC	LF	96		
32	02221	Remove And Dispose Of Existing 10-Inch Storm Sewer PVC	LF	60		
33	02221	Remove And Dispose Of Existing 12-Inch Storm Sewer PVC	LF	90		
34	02221	Remove And Dispose Of Existing 18-Inch Storm Sewer PVC	LF	11		
35	02221	Remove And Dispose Of Existing 10-Inch Storm Sewer RCP	LF	30		
36	02221	Remove And Dispose Of Existing 12-Inch Storm Sewer RCP	LF	67		
37	02221	Remove And Dispose Of Existing 15-Inch Storm Sewer RCP	LF	11		
38	02221	Remove And Dispose Of Existing 18-Inch Storm Sewer RCP	LF	65		
39	02221	Remove And Dispose Of Existing Pipe Culvert, All Sizes	LF	2,059		
40	02221	Remove And Dispose Of Existing 24-Inch RCP Storm Sewer Pipe	LF	204		
41	02221	Remove And Dispose Of Existing 24-Inch RCP Storm Sewer Pipe Including SET	LF	10		
42	02221	Remove And Dispose Of Existing Pipe Culvert Including SET, All Sizes	LF	148		
43	0221	Remove And Dispose Of Existing Pipe Culvert Including Headwall, All Sizes	LF	118		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
44	02221	Remove And Dispose Of Existing 30-Inch RCP Storm Sewer Pipe	LF	173		
45	02221	Remove And Dispose Of Existing 36-Inch RCP Storm Sewer Pipe	LF	61		
46	02221	Remove And Dispose Of Existing 48-Inch RCP Storm Sewer Pipe	LF	92		
47	02315	Ditch Excavation	CY	51		
48	TxDOT 496-6010	Remove STR (Bridge 100-499 Ft Length)	EA	1		
49	TxDOT 496-6016	Remove And Dispose Of Existing 18-Inch CMP	EA	1		
50	TxDOT 496-6016	Remove And Dispose Of Existing 36-Inch CMP	EA	1		
51	TxDOT 496-6016	Remove And Dispose Of Existing 72-Inch CMP Pipe	EA	1		
52	See Demo Plans	Remove and Relocate Existing Mailbox	EA	12		
53	TxDOT 496-6040	Remove Existing Retaining Wall	LF	357		
54	TxDOT 496-6057	Remove STR (Pipe Support Structure)	EA	1		
SUBTOTAL UNIT PRICES-GENERAL ITEMS						

2.UNIT PRICES-PAVING ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
55	01554	Installation Of Traffic Signs	EA	35		
56	01554	Relocation Of Existing Traffic Sign With New Base	EA	3		
57	01562	Tree And Protection And Preservation	LS	1		
58	02233	Clearing And Grubbing	AC	20		
59	02315	Roadway Excavation With Or Without Subgrade	CY	33,841		
60	02315	Roadway Excavation With Or Without Subgrade Within Limits Of PPCA	CY	3,499		
61	02336	Lime Stabilized Subgrade 8-Inch Thick	SY	66,385		
62	02336	Lime for Stabilized Subgrade (6% Dry Weight)	TON	1,327		
63	02752	Horizontal Dowels 1-1/4-Inch Diameter 18-Inch Long @ 12-Inch Spacing	EA	1,016		
64	02581	Conduit (PVC) (SCH 40) 2-Inch	LF	4,060		
65	02581	Conduit (PVC) (SCH 80) 2-Inch (Bore)	LF	1,940		
66	02581	Pullboxes, Complete In Place	EA	3		
67	02642	Install Temporary 72-Inch CMP For Temporary Flow Diversion With Fittings (Including Removal After Cross Culverts At Approximate Sta. 32+10 Are Installed)	LF	32		
68	02711	8-Inch Asphalt Stabilized Base (Gr 2)	TON	669		
69	02714	Flexible Base Course/Tem Driveways Commercial Up To 24 Feet Wide	EA	43		
70	02741	Temporary 1.5-Inch Asphalt Pavement Including 8-Inch Asphalt Base For Driveways, Detour/Roadway And Shoulder	SY	1,485		
71	02741	3-Inch Type "D" HMAC For Transition Pavement	TON	276		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
72	02751	Reinforced Concrete Pavement 10-Inch Thick	SY	54,133		
73	02751	High Early Strength Reinforced Concrete Pavement 10-Inch Thick	SY	1,104		
74	02752	Street Pavement Expansion Joints With Load Transfer	LF	12,194		
75	02752	Performed Expansion Joints for Sidewalks	LF	2,510		
76	02752	Sawcut (Concrete)	LF	429		
77	02754	Concrete Driveways Including Excavation, 7-Inch Thick	SF	25,316		
78	02762	Blast Cleaning Pavement Markers 4-Inch Wide Lines	LF	12,516		
79	02762	Blast Cleaning Pavement Markers 6-Inch Wide Lines	LF	1,808		
80	02762	Blast Cleaning Pavement Markers 24-Inch Wide Lines	LF	251		
81	02762	Blast Cleaning Pavement Markers Turning ARROW	EA	38		
82	02762	Blast Cleaning Pavement Marking ONLY	EA	3		
83	02764	Raised Pavement Marker TY II Two Face Reflective (W/W)	EA	267		
84	02765	Temporary and Removable Reflectorized Pavement Markings, 4-Inch (White or Yellow)	LF	39,294		
85	02765	Temporary and Removable Reflectorized Pavement Markings, 24-Inch (White or Yellow)	LF	40		
86	02767	Thermoplastic Pavement Marking 4-Inch Wide White (SLD)	LF	946		
87	02767	Thermoplastic Pavement Marking 4-Inch Wide White (BRK)	LF	4,140		
88	02767	Thermoplastic Pavement Marking 4-Inch Wide Yellow (SLD)	LF	7,695		
89	02767	Thermoplastic Pavement Marking 6-Inch Wide White	LF	1,808		
90	02767	Thermoplastic Pavement Marking 24-Inch Wide White	LF	251		
91	02767	Thermoplastic Pavement Marking Symbol Turning ARROW	EA	38		
92	02767	Thermoplastic Pavement Marking Elongated Word ONLY	EA	3		
93	02771	Concrete Paving Header	LF	168		
94	02771	6-Inch Concrete Curb (Monolithic)	LF	22,134		
95	02771	6-Inch Doweled on Curb	LF	6,085		
96	02771	6-inch Doweled on Slotted Curb	LF	349		
97	02772	6-Inch Concrete for Directional Island and Median Nose	SY	309		
98	02771	Mountable Curb Divider	SF	78		
99	See Plans Sheet 140	Concrete Retaining Wall (6-Inch to 24-Inch), Complete In Place	LF	1,668		
100	02775	Sidewalk 4 1/2-Inch Thick	SF	41,134		
101	02775	Wheelchair Ramp, Complete In Place	SF	476		
102	02915	Tree Planting (100 Gallon)	EA	181		
103	02921	Hydromulch Seeding	AC	8.47		
104	02922	Sodding	SY	11,841		
105	See Plans Sheet 141	Pedestrian Rail on Retaining Walls along Greens Rd	LF	142		

Bidder's Initials [ ]

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
106	TxDOT 506-6002	Rock Filter Dams (TY 2)	LF	55		
107	TxDOT 506-6003	Rock Filter Dams (TY 3)	LF	1,420		
108	TxDOT 540-6003	MTL THRIE-BEAM GD FEN (TIM POST)	LF	96		
109	TxDOT 545-6001	Crash Cush Atten (INSTL)	EA	2		
SUBTOTAL UNIT PRICES-PAVING ITEMS						

3.UNIT PRICES-STORM SEWER ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
110	02082	Type C Storm Sewer Conflict Manhole Including 12-Inch DI Casing	EA	1		
111	02084 &02086	Convert Grate Top to Solid Cover and Adjust Inlet Top to Final Grade	EA	1		
112	02086	Adjust Existing Inlet Grate/Manhole to Match Final Grade	EA	3		
113	02260	Trench Safety System for Storm Sewer Excavations	LF	9,849		
114	02315	Regrade Swale	LF	371		
115	02315	Regrade Ditch	LF	411		
116	02631	24-Inch Diameter Storm Sewer by Open Cut	LF	2,919		
117	02631	24-Inch Diameter Storm Sewer by Open Cut in PPCA Area	LF	323		
118	02631	30-Inch Diameter Storm Sewer by Open Cut	LF	925		
119	02631	30-Inch Diameter Storm Sewer by Open Cut in PPCA Area	LF	167		
120	02631	36-Inch Diameter Storm Sewer by Open Cut	LF	306		
121	02631	36-Inch Diameter Storm Sewer by Open Cut for Temporary Drainage Including tie-in to Existing Manhole at Sta. 37+93 and Removal after Trunk Line on the South Side of Greens Road is Installed	LF	620		
122	02631	36-Inch Diameter Storm Sewer by Trenchless Construction for Temporary Drainage Including Removal after Trunk Line on the South Side of Greens Road is Installed	LF	92		
123	02631	42-Inch Diameter Storm Sewer by Open Cut	LF	1,137		
124	02631	48-Inch Diameter Storm Sewer by Open Cut	LF	995		
125	02631	4-Foot by 3-Foot Box Storm Sewer by Open Cut	LF	820		
126	02631	4-Foot by 4-Foot Box Storm Sewer by Open Cut	LF	401		
127	02631	5-Foot by 4-Foot Box Storm Sewer by Open Cut	LF	644		
128	02631	6-Foot by 4-Foot Box Storm Sewer by Open Cut	LF	865		
129	02631	6-Foot by 4-Foot Box Storm Sewer by Open Cut for Cross Culvert, Including Rail Anchorage Curb	LF	213		
130	02631	6-Foot by 6-Foot Box Storm Sewer by Open Cut for Cross Culvert, Including Rail Anchorage Curb	LF	138		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
131	02631	7-Foot by 4-Foot Box Storm Sewer by Open Cut	LF	180		
132	02631	7-Foot by 5-Foot Box Storm Sewer by Open Cut	LF	420		
133	02631	30-Inch CMP Storm Sewer Outfall	LF	65		
134	02631	84-Inch Diameter CMP Storm Sewer Outfall	LF	57		
135	02631	24-Inch Diameter Storm Sewer by Open Cut, Including Concrete Collar and Tie-in to Existing Offsite Drainage Structure	LF	66		
136	02631	24-Inch Diameter Storm Sewer by Open Cut, Including Concrete Collar and Tie-in to Existing Offsite Drainage Structure in PPCA Area	LF	5		
137	02631	24-Inch Diameter Storm Sewer by Open Cut, Including Ring Grate	LF	40		
138	02631	24-Inch Diameter Storm Sewer by Open Cut, Including Ring Grate in PPCA Area	LF	12		
139	02631	24-Inch Diameter Storm Sewer by Open Cut, Including Tie In to Existing Inlet	LF	18		
140	02631	36-Inch Diameter Storm Sewer by Open Cut, Including Concrete Collar and Tie-in to Existing Offsite Drainage Structure	LF	7		
141	02632	Prop 8'-10"x9'-1" Junction Box "A" at Sta. 32+21.70	EA	1		
142	02632	Prop 11'-0"x6'-4" Junction Box "B" at Sta. 36+25	EA	1		
143	02632	Prop 7'-0"x6'-4" Junction Box "C" at Sta. 37+71	EA	1		
144	TxDOT 160-6005	Furnishing and Placing Top Soil at P240 Bridge Class Culvert,, Including Regrading P240-00-00 Channel	CY	35		
145	TxDOT 420-6002	CL A Conc (Channel Lining) at P240 Bridge Class Culvert	CY	67		
146	TxDOT 432-6033	RipRap (Stone Protection)(18 IN) at P240 Bridge Class Culvert and P140 Outfalls	CY	205		
147	TxDOT 465-6002	MANH (COMPL)(PRM)(48IN)	EA	15		
148	TxDOT 465-6002	MANH (COMPL) (PRM)(48IN) Including Removal after Trunk Line on the South Side of Greens Road is Installed	EA	1		
149	TxDOT 465-6002	MANH (COMPL)(PRM)(48IN) Including Tie-in to 30" RCP Storm Sewer	EA	1		
150	TxDOT 465-6021	Inlet (COMPL)(PCO)(5FT)(None)	EA	13		
151	TxDOT 465-6022	Inlet (COMPL)(PCO)(5FT)(Left)	EA	13		
152	TxDOT 465-6023	Inlet (COMPL)(PCO)(5FT)(Right)	EA	11		
153	TxDOT 465-6024	Inlet (COMPL)(PCO)(5FT)(Both)	EA	16		
154	TxDOT 465-6150	Inlet (COMPL)(PAZD)(SL)(3FTX3FT)	EA	2		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
155	TxDOT 465-6152	Inlet (COMPL)(PAZD)(RC)(3FTX3FT)	EA	2		
156	TxDOT 465-6275	MANH (COMPL) (JUNCT BOX)	EA	6		
157	TxDOT 466-6172	Wingwall (PW-1)(HW=11FT) at P240 Bridge Class Culvert	EA	1		
158	TxDOT 467-6395	SET (TY II) (24 IN) (RCP) (6:1) (P)	EA	4		
159	HCFCD 02315	Backfill Existing Channel at P240 Bridge Class Culvert	SY	64		
SUBTOTAL UNIT PRICES-STORM SEWER ITEMS						

4.UNIT PRICES-P140/P240 CONFLUENCE CULVERT ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
160	02631	4-Foot by 8-Foot Box Storm Sewer by Open Cut at P140/P240 Confluence Culvert	LF	52		
161	02631	8-Foot by 4-Foot Box Storm Sewer by Open Cut at P140/P240 Confluence Culvert	LF	105		
162	See Plans Sheet 141	Pedestrian Rail at P140/P240 Confluence Culvert	LF	97		
163	HCFCD 02314	Fill Material at P140/P240 Confluence Culvert	SY	146		
164	HCFCD 02315	Backfill Existing Channel at P140/P240 Confluence Culvert	SY	33		
165	TxDOT 160-6005	Furnishing and Placing Top Soil at P140/P240 Confluence Culvert	CY	213		
166	TxDOT 420-6002	CL A Conc (Misc) for Channel Lining at P140/P240 Confluence Culvert	CY	36		
167	TxDOT 432-6033	RipRap (Stone Protection)(18 IN) at P140/P240 Confluence Culvert	CY	111		
168	TxDOT 466-6172	Wingwall (PW-1)(HW=11FT) at P140/P240 Confluence Culvert	EA	2		
169	TxDOT 496-6016	Remove and Dispose of Existing 84-Inch CMP at P140/P240 Confluence Culvert	EA	1		
SUBTOTAL UNIT PRICES-P140/P240 CONFLUENCE CULVERT ITEMS						

5.UNIT PRICES-DETENTION POND ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
170	02233	Clearing and Grubbing of Detention Pond Limits Including Removal of Barbed Wire Fence	AC	4.45		
171	02631	6-Foot by 3-Foot Box Storm Sewer by Open Cut at Detention Pond Inflow Structure	LF	132		
172	02631	30-Inch RCP Culvert under Detention Pond Driveway	LF	30		
173	02711	6-Inch Flexible Base for the proposed driveway at the Detention Pond	TON	12		
174	02741	Hot Mix Asphalt Concrete Pavement for the Proposed Driveway at the Detention Pond	TON	9		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
175	See Plans Sheet 167	Pilot Channel at the Detention Pond	LF	483		
176	See Plans Sheet 251	24-Inch Slip-in Flap Gate	EA	1		
177	HCFCD 02316	Detention Basin Excavation, Grading and Off-Site Disposal, Including Backslope Swales	CY	72,370		
178	HCFCD 02376	Backslope Interceptor Structure Including All Pipe, Bedding and Backfill, All Depths, Complete in Place	EA	3		
179	02631	24-Inch RCP Strom Sewer by Open Cut	LF	181		
180	TxDOT 160-6005	Furnishing and Placing Top Soil at Detention Pond Inflow Structure	CY	47		
181	TxDOT 420-6002	CL A Conc (Misc) for Channel Lining at Detention Pond Inflow Structure	CY	5		
182	TxDOT 432-6033	Rip Rap (Stone Protection)(18IN) at Detention Pond Inflow and Outfall Structures	CY	143		
183	TxDOT 466-6035	Headwall (CH-FW-30) (DIA=24IN) at Detention Pond Outfall Structure	EA	1		
184	TxDOT 466-6180	Wingwall (PW-1) HW=5 FT at Detention Pond Inflow Structure	EA	1		
185	TxDOT 466-6182	Wingwall (PW-1) HW=7 FT at Detention Pond Inflow Structure	EA	1		
SUBTOTAL UNIT PRICES-DETENTION POND ITEMS						

6.UNIT PRICES-WATER ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
186	02086	Adjust Water MH Top to Match Final Grade, including relocation of Existing Vent with Bollards	EA	2		
187	02086	Adjust Existing Fire Hydrant and Valve Box to Match Final Grade Elevation	EA	2		
188	02502	24-Inch Diameter Steel Waterline Welded Steel for Aerial Crossing, Including Support Bracket Assembly, Pipe Roller and Roller Support	LF	152		
189	02511	6-Inch Diameter Cut and Plug	EA	3		
190	02511	8-Inch Diameter Plug and Clamp	EA	3		
191	02511	24-Inch Dished Head Plug within Limits of PPCA	EA	1		
192	02511	4-Inch Diameter DIP Waterline by Trenchless Construction	LF	48		
193	02511	4-Inch Diameter Waterline by Open-Cut	LF	10		
194	02511	6-Inch Diameter DIP Waterline by Trenchless Construction	LF	106		
195	02511	6-Inch Diameter DIP Waterline by Open-Cut	LF	10		
196	02511	8-Inch Diameter Waterline by Trenchless Construction	LF	36		
197	02511	8-Inch Diameter DIP Waterline by Trenchless Construction With Restrained Joint	LF	367		
198	02511	8-Inch Diameter DIP Waterline by Open-Cut	LF	10		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
199	02511	12-Inch Diameter Waterline by Open-Cut within Limits of PPCA	LF	32		
200	02511	16-Inch Diameter Waterline by Open-Cut within Limits of PPCA	LF	8		
201	02511	24-Inch Diameter Steel Waterline by Open-Cut	LF	4,916		
202	02511	24-Inch Diameter Steel Waterline by Open-Cut With Restrained Joint	LF	903		
203	02511	24-Inch Diameter Steel Waterline by Open-Cut With Restrained Joint within Limits of PPCA	LF	200		
204	02511	24-Inch Diameter Steel Waterline by Trenchless Construction With Restrained Joint within Limits of PPCA	LF	183		
205	02512	¾-Inch to 1-Inch Diameter Water Taps and Copper Service With Meter Box, Long Side	EA	11		
206	02512	1 1/2-Inch to 2-Inch Diameter Water Taps and Copper Service With Meter Box, Long Side	EA	14		
207	02513	4-Inch Diameter Wet Connection	EA	1		
208	02513	6-Inch Diameter Wet Connection	EA	2		
209	02513	8-Inch Diameter Wet Connection	EA	2		
210	02513S	8-Inch Diameter Wet Connection(Connection to AC Pipe)	EA	1		
211	02513	24-Inch Diameter Wet Connection	EA	1		
212	02516	Cut, Plug, and Abandon Existing 4-Inch Diameter Waterline	EA	1		
213	02516	Cut, Plug, and Abandon Existing 6-Inch Diameter Waterline	EA	2		
214	02516	Cut, Plug, and Abandon Existing 8-Inch Diameter Waterline	EA	6		
215	02516	Cut, Plug, and Abandon Existing 12-Inch Diameter Waterline within Limits of PPCA	EA	1		
216	02516S	Cut, Plug, and Abandon Existing 16-Inch Diameter AC Waterline	EA	36		
217	02516	Cut, Plug, and Abandon Existing 16-Inch Diameter Waterline within Limits of PPCA	EA	1		
218	02516	Cut, Plug, and Abandon Existing 24-Inch Diameter Waterline	EA	1		
219	02517	24-Inch Diameter Waterline in Tunnel with Steel Casing by Trenchless Construction	LF	7		
220	02517	24-Inch Diameter Waterline in Tunnel with Steel Casing by Trenchless Construction within Limits of PPCA	LF	33		
221	02520	Fire Hydrant Assembly, All Depths, Including 6-Inch Diameter Gate Valve and Box	EA	24		
222	02520	Fire Hydrant Assembly, All Depths, Including 6-Inch Diameter Gate Valve and Box, Within Limits of PPCA	EA	3		
223	02520	6-Iinch Diameter Fire Hydrant Branch by Open-Cut	LF	12		
224	02520	6-Iinch Diameter Fire Hydrant Branch by Open-Cut, Within Limits of PPCA	LF	6		
225	02520	6-Iinch Diameter DIP Restrained Joint Fire Hydrant Branch by Open-Cut	LF	220		
226	02520	6-Iinch Diameter DIP Restrained Joint Fire Hydrant Branch by Open-Cut, Within Limits of PPCA	LF	80		
227	02520	Remove and Salvage Existing Fire Hydrant	EA	13		

Item No.						
228	02520	Remove and Salvage Existing Fire Hydrant Within Limits of PPCA	EA	2		
229	02522	24-inch Butterfly Valve With Operator Manhole	EA	4		
230	02522	24-inch Butterfly Valve With Operator Manhole within Limits of PPCA	EA	1		
231	02524	2-Inch Diameter Combination Air Valve Assembly	EA	4		
232	02524	2-Inch Diameter Combination Air Valve Assembly within Limits of PPCA	EA	2		
233	02524	2-Inch Diameter Combination Air Valve Assembly for Aerial Crossing	EA	2		
234	02525	24-Inch by 6-Inch Tapping Sleeve and Valve	EA	3		
235	02525	24-Inch by 6-Inch Tapping Sleeve and Valve, Within Limits of PPCA	EA	1		
236	02525S	24-Inch by 12-Inch Tapping Sleeve and Valve, Within Limits of PPCA	EA	1		
237	02525	24-Inch by 16-Inch Tapping Sleeve and Valve, Within Limits of PPCA	EA	1		
238	02525S	12-Inch by 12-Inch Tapping Sleeve and Valve, Within Limits of PPCA	EA	1		
239	02526	Remove, Relocate and Reconnect Existing Water Meter to Proposed Waterline With New Box to Match New Grade, Replace All Damaged or Missing Parts, Complete In Place	EA	22		
240	15640, 15641, 16640	Cathodic Protection System and Two Sacrificial Anode Groundbeds	LS	1		
SUBTOTAL UNIT PRICES-WATER ITEMS						

7.UNIT PRICES-WASTEWATER ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
241	02082	Connect Proposed Sanitary Sewer Line to Existing Service Line	EA	1		
242	02086	Adjust Existing Sanitary Manhole Frame and Cover to New Grade	EA	8		
243	02221	Remove 8-Inch Sanitary Sewer	LF	36		
244	02260	Trench Safety System for Sanitary Sewer Trench Excavation	LF	36		
245	02531	8-In Diameter Sanitary Sewer, by Open-Cut	LF	36		
246	02534	Service Stubs or Reconnections Without Stack on Sanitary Sewer	EA	1		
SUBTOTAL UNIT PRICES-WASTEWATER ITEMS						

8.UNIT PRICES-BRIDGE ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
247	TxDOT 132-6006	Embankment (FINAL)(DENS CONT)(TYC)	CY	1,336.90		
248	TxDOT 400-6005	Cement Stabilized Backfill	CY	64		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
249	TxDOT 416-6002	Drill Shaft (24 IN)	LF	1,632		
250	TxDOT 420-6012	CL B Conc (Misc)	CY	32		
251	TxDOT 420-6013	CL C Conc (Abut)	CY	44.80		
252	TxDOT 420-6025	CL C Conc (Bent)	CY	36.20		
253	TxDOT 420-6037	CL C Conc (Column)	CY	16		
254	TxDOT 422-6001	Reinforced Concrete Slab	SF	7,950		
255	TxDOT 422-6013	Bridge Sidewalk	SF	1,456		
256	TxDOT 422-6015	Approach Slab	CY	118.40		
257	TxDOT 423-6001	Retaining Wall (MSE)	SF	4,512		
258	TxDOT 423-6066	CL C Conc(Rail Foundation)	CY	4		
259	TxDOT 425-6011	Prestressed Concrete Slab Beam (4SB15)	LF	1,105		
260	TxDOT 425-6012	Prestressed Concrete Slab Beam (5SB15)	LF	663		
261	TxDOT 432-6024	Rip Rap (STONE COMMON) (DRY) (12 IN)	CY	328		
262	TxDOT 442-6007	Sructural Steel (Misc Non-Bridge)	LB	350		
263	TxDOT 450-6004	Rail (TY T221)	LF	248		
264	TxDOT 450-6030	Rail (TY C221)	LF	1,343		
265	TxDOT 454-6001	Sealed Expansion Joint (4 IN) (SEJ-A)	LF	113.20		
SUBTOTAL UNIT PRICES-BRIDGE ITEMS						

9.UNIT PRICES-TRAFFIC SIGNAL ITEMS

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
266	01554	Ground Mounted Sign and Post Assembly	EA	4		
267	02582	20-FT. Mast Arm Pole Assembly With Foundation	EA	1		
268	02582	25-FT. Mast Arm Pole Assembly With Foundation	EA	2		
269	02893-14	Electrical Service Pedestal Assembly - ("Square D" Breakers Included)	EA	1		
270	02893	Sign,"Emergency Signal", R10-13 (36"X24")	EA	3		
271	16710	Type "B" Pull Box With Apron, Gravel and Ground Rod	EA	1		
272	16710	Type "C" Pull Box With Apron, Gravel and Ground Rod	EA	1		
273	16711	Conduit, 2-IN SCH 80 PVC Trench (Includes Bond Wire and Pull Tape)	LF	370		
274	16711	Conduit, 2-IN SCH 80 PVC Bore (Includes Bond Wire and Pull Tape)	LF	150		

Item No.	Spec Ref.	Base Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
275	16711	Conduit, 2-IN RMC (Includes Bond Wire and Pull Tape)	LF	50		
276	16711	Conduit, 3-IN SCH 80 PVC Trench (Includes Bond Wire and Pull Tape)	LF	35		
277	16711	Conduit, 3-IN SCH 80 PVC Bore (Includes Bond Wire and Pull Tape)	LF	90		
278	16715	3-Section Vehicle Signal Head Assembly (RYY) (HORIZONTAL) (H3)	EA	4		
279	16715	3-Section Vehicle Signal Head Assembly (RYG) (HORIZONTAL) (H3)	EA	2		
280	16720	Traffic Signal Cables, 7/C-#14 AWG Solid Cable	LF	780		
281	16720	#4 XHHW Service Wire	LF	850		
282	16724	Emergency Vehicle Preemption System	EA	1		
283	16730	ITS Controller Cabinet Assembly (MODEL 346) (TYPE 2070L)	EA	1		
284	02893-10B	Controller Cabinet Foundation With Apron	EA	1		
285	16732	Uninterrruptible Power Supply (Furnish, Install and Program)	EA	1		
286	16785	GPS Serial Communication Module	EA	1		
287	02767	Thermoplastic Pavement Markings, 24-IN White, Solid	LF	57		
288	16733	Field Hardened Ethernet Switch (Six Copper Ports Only)	EA	1		
289	16734	WIMAX	EA	1		
SUBTOTAL UNIT PRICES-TRAFFIC SIGNAL ITEMS						

C. EXTRA UNIT PRICE TABLE:

Item No.	Spec Ref.	Extra Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
290	02221	Remove Miscellaneous Concrete And Masonry	CY	100	$15.00(2)	
291	01270S	De-Mobilization And Re-Mobilization	LS	1	$25,000.00(2)	
292	02318	Extra Hand Excavation Around Obstacles	CY	100	$20.00(2)	
293	02318	Extra Hand Excavation	CY	100	$20.00(2)	
294	02318	Extra Machine Excavation	CY	100	$20.00(2)	
295	02318	Extra Placement Of Backfill Material	CY	100	$10.00(2)	
296	02318	Extra Placement Of Granular Fill Material	CY	100	$40.00(2)	
297	02318	Extra Cement Stabilized Sand	CY	100	$30.00(2)	
298	02501	Extra Ductile Iron Compact Fittings In Place	TON	1	$3,000.00(2)	
299	02511	Extra Water Fittings In Place	TON	1	$3,000.00(2)	
300	02120	Excavation Around Obstructions In PPCA	CY	1	$40.00(2)	
SUBTOTAL UNIT PRICES-EXTRA UNIT PRICE						

D. CASH ALLOWANCE TABLE:

Item No.	Spec Ref.	Extra Unit Short Title	Unit Measure	Estimated Quantity	Unit Price (this column controls)	Total in figures
301	01110	CITY OF HOUSTON STREET CUT PERMITS	CA	1	$1,000.00	$1,000.00
302	01110	HCFCD PERMIT	CA	1	$1,250.00	$1,250.00
303	01110	CITY OF HOUSTON FLOODPLAIN MANAGEMENT OFFICE DEVELOPMENT PERMIT	CA	1	$2,725.00	$2,725.00
304	01110	STREET LIGHT CASH ALLOWANCE	CA	1	$12,400.00	$12,400.00
TOTAL CASH ALLOWANCE						**$17,375.00**

E. ALTERNATES TABLE (N/A):

Item No.	Spec Ref.	Alternate Short Title	Unit of Measure	Estimated Quantity	Unit Price (this column controls)	Total Price for Alternate in figures
TOTAL ALTERNATES						$_____

F. TOTAL BID PRICE: $_____
(Add Totals for Stipulated Price, Base Unit Price, Extra Unit Price, Cash Allowance, and All Alternates, if any)

2.0 SIGNATURES: By signing this Document, I agree that I have received and reviewed all Addenda and considered all costs associated with the Addenda in calculating the Total Bid Price.

Bidder: _____
(Print or type full name of your proprietorship, partnership, corporation, or joint venture.*)

**By: _____
Signature Date

Name: _____
(Print or type name) Title

Address: _____
(Mailing)

_____
(Street, if different)

Telephone and Fax Number: _____
(Print or type numbers)

* If Bid is a joint venture, add additional Bid Form signature sheets for each member of the joint venture.

** Bidder certifies that the only person or parties interested in this offer as principals are those named above. Bidder has not directly or indirectly entered into any agreement, participated in any collusion, or otherwise taken any action in restraint of free competitive bidding.

*** Under Section 231.006, Family Code, the Bidder certifies that the individual or business entity named in this bid is not ineligible to receive the specified grant, loan, or payment and acknowledges that this contract may be terminated and payment may be withheld if this certification is inaccurate."

Note: This document constitutes a government record, as defined by § 37.01 of the Texas Penal Code. Submission of a false government record is punishable as provided in § 37.10 of the Texas Penal Code.

Footnotes for Tables B through E:
(1) Fixed Unit Price determined prior to Bid. Cannot be adjusted by the Bidder.
(2) Minimum Bid Price determined prior to Bid. Can be increased by the Bidder, but not decreased, by crossing out the Minimum and inserting revised price on the line above. **Cannot** be decreased by the Bidder.
(3) Maximum Bid Price determined prior to Bid. Can be decreased by the Bidder, but not increased, by crossing out the Maximum and inserting revised price on the line above. A Bid that increases the Maximum Bid Price may be found non-conforming and non-responsive. **Cannot** be increased by the Bidder.
(4) Fixed Range Bid Price determined prior to Bid. Unit Price can be adjusted by Bidder to any amount within the range defined by crossing out prices noted and noting revised price on the line above

Bidder's Initials [ ]

Document 00430

BIDDER'S BOND

THAT WE, _____, as Principal,
(Bidder)
("Bidder"), and the other subscriber hereto, _____, as Surety, do hereby acknowledge ourselves to be held and firmly bound to the City of Houston, a municipal corporation, in the sum of _____ Dollars ($_____) (an amount equal to 10 percent of the Total Bid Price, including Cash Allowances and Alternates, if any, for the payment of which sum, well and truly to be made to the City of Houston and its successors, the Bidder and Surety do bind themselves, their heirs, executors, administrators, successors, and assigns, jointly and severally.

THE CONDITIONS OF THIS OBLIGATION ARE SUCH THAT:

WHEREAS, the Bidder has submitted on or about this day a proposal offering to perform the following:

_____
(Project Name, Location and Number)
in accordance with the Drawings, Specifications, and terms and conditions related thereto to which reference is hereby made.

NOW, THEREFORE, if the Bidder's offer as stated in the Document 00410 – Bid Form is accepted by the City, and the Bidder executes and returns to the City Document 00520 – Agreement, required by the City, on the forms prepared by the City, for the Work and also executes and returns the same number of the Performance, Payment and Maintenance Bonds (such bonds to be executed by a Corporate Surety authorized by the State Board of Insurance to conduct insurance business in the State of Texas, and having an underwriting limitation in at least the amount of the bond) and other submittals as required by Document 00495 - Post-Bid Procedures, in connection with the Work, within the Contract Time, then this obligation shall become null and void; otherwise it is to remain in full force and effect.

If Bidder is unable to or fails to perform the obligations undertaken herein, the undersigned Bidder and Surety shall be liable to the City for the full amount of this obligation which is hereby acknowledged as the amount of damages which will be suffered by the City on account of the failure of such Bidder to perform such obligations, the actual amount of such damages being difficult to ascertain.

Notices required or permitted hereunder shall be in writing and shall be deemed delivered when actually received or, if earlier, on the third day following deposit in a United States Postal Service post office or receptacle, with proper postage affixed (certified mail, return receipt requested), addressed to the respective other Party at the address prescribed in the Contract documents, or at such other address as the receiving Party may hereafter prescribe by written notice to the sending Party.

IN WITNESS THEREOF, the Bidder and Surety have signed and sealed this instrument on the respective dates written below their signatures and have attached current Power of Attorney.

ATTEST, SEAL: (if a corporation)
WITNESS: (if not a corporation)

By: _____
Name:
Title:

ATTEST/SURETY WITNESS: (SEAL)

By: _____
Name:
Title:
Date:

_____
(Name of Bidder)

By: _____
Name:
Title:
Date:

_____
(Full Name of Surety)

_____
(Address of Surety for Notice)

_____
(Telephone Number of Surety)

By: _____
Name:
Title:
Date:

END OF DOCUMENT

Bidder's Initials [ ]

Document 00452
Form A
CONTRACTOR SUBMISSION LIST
CITY OF HOUSTON FAIR CAMPAIGN ORDINANCE

The City of Houston Fair Campaign Ordinance makes it unlawful for a Contractor to offer any contribution to a candidate for City elective office (including elected officers-elect) during a certain period of time prior to and following the award of the Contract by the City Council. The term "Contractor" includes proprietors of proprietorships, partners or joint venturers having an equity interest of 10 percent or more for the partnership or joint venture, and officers, directors and holders of 10 percent or more of the outstanding shares of corporations. Submission of a statement disclosing the names and business addresses of each of those persons is required with each Bid/Proposal for a City Contract. See Chapter 18 of the City of Houston Code of Ordinances for further information.

This list is submitted under the provisions of Section 18-36(b) of the City of Houston Code of Ordinances in connection with the attached Bid/Proposal of:

Firm or Company Name: _____
Firm or Company Address: _____
_____

The firm/company is organized as indicated below. Check one as applicable and attach additional pages if needed to supply the required names and addresses.

[ ] SOLE PROPRIETOR

Name _____ _____
Proprietor Address

[ ] A PARTNERSHIP

LIST EACH PARTNER HAVING EQUITY INTEREST OF 10% OR MORE OF PARTNERSHIP (IF NONE STATE "NONE")

Name _____ _____
Partner Address

Name _____ _____
Partner Address

[ ] A CORPORATION

LIST ALL DIRECTORS OF THE CORPORATION (IF NONE STATE "NONE")

Name _____ _____
Director Address

Name _____ _____
Director Address

Name _____ _____
Director Address

LIST ALL OFFICERS OF THE CORPORATION (IF NONE STATE "NONE")

Name _____ _____
Officer Address

Name _____ _____
Officer Address

Name _____ _____
Officer Address

LIST ALL INDIVIDUALS OWNING 10% OR MORE OF OUTSTANDING SHARES OF STOCK OF THE CORPORATION (IF NONE STATE "NONE")

Name _____ _____
Owner Address

Name _____ _____
Owner Address

Name _____ _____
Owner Address

I certify that I am duly authorized to submit this list on behalf of the firm, that I am associated with the firm in the capacity noted below, and that I have knowledge of the accuracy of the information provided herein.

_____
Signature

_____
Printed Name

_____
Title

Note: This list constitutes a government record as defined by § 37.01 of the Texas Penal Code.

END OF DOCUMENT

Document 00454

AFFIDAVIT OF NON-INTEREST

BEFORE ME, the undersigned authority, a Notary Public in and for the State of Texas, on this day personally appeared_____, who
Affiant

being by me duly sworn on his oath stated that he is_____, of
Title

_____,
Name of Firm

the firm named and referred to and in the foregoing; and that he knows of no officer, agent, or employee of the City of Houston being in any manner interested either directly or indirectly in such Contract.

_____
Affiant's Signature

SWORN AND SUBSCRIBED before me on_____.
Date

_____
Notary Public in and for the State of TEXAS

_____
Print or type name

My Commission Expires: _____
Expiration Date

END OF DOCUMENT

Document 00455

AFFIDAVIT OF OWNERSHIP OR CONTROL

ORIG. DEPT.: DEPARTMENT OF PUBLIC WORKS AND ENGINEERING **FILE/I.D. NO.:** N-000686-0002-4; CSJ 0912-71-739

INSTRUCTION: ENTITIES USING AN ASSUMED NAME SHOULD DISCLOSE SUCH FACT TO AVOID REJECTION OF THE AFFIDAVIT. THE FOLLOWING FORMAT IS RECOMMENDED: CORPORATE/LEGAL NAME DBA ASSUMED NAME.

STATE OF _____ §
§ **AFFIDAVIT OF OWNERSHIP OR CONTROL**
COUNTY OF _____ §

BEFORE ME, the undersigned authority, on this day personally appeared _____ [*FULL NAME*] (hereafter "Affiant"), _____ [*STATE TITLE/CAPACITY WITH CONTRACTING ENTITY*] of _____ [*CONTRACTING ENTITY'S CORPORATE/LEGAL NAME*] ("Contracting Entity"), who being by me duly sworn on oath stated as follows:

1. Affiant is authorized to give this affidavit and has personal knowledge of the facts and matters herein stated.

2. Contracting Entity seeks to do business with the City in connection with _____ _____ [*DESCRIBE PROJECT OR MATTER*] which is expected to be in an amount that exceeds $50,000.

3. The following information is submitted in connection with the proposal, submission or bid of Contracting Entity in connection with the above described project or matter.

4. Contracting Entity is organized as a business entity as noted below (check box as applicable).

FOR PROFIT ENTITY:

[ ] SOLE PROPRIETORSHIP
[ ] CORPORATION
[ ] PARTNERSHIP
[ ] LIMITED PARTNERSHIP
[ ] JOINT VENTURE
[ ] LIMITED LIABILITY COMPANY
[ ] OTHER (Specify type in space below)

NON-PROFIT ENTITY:

[ ] NON-PROFIT CORPORATION
[ ] UNINCORPORATED ASSOCIATION

_____

_____

5. The information shown below is true and correct for the Contracting Entity and all owners of 5% or more of the Contracting Entity and, where the Contracting Entity is a non-profit entity, the required information has been shown for each officer, *i.e.*, president, vice-president, secretary, treasurer, etc. ***[NOTE: IN ALL CASES, USE FULL NAMES, LOCAL BUSINESS AND RESIDENCE ADDRESSES AND TELEPHONE NUMBERS. DO NOT USE POST OFFICE BOXES FOR ANY ADDRESS. INCLUSION OF E-MAIL ADDRESSES IS OPTIONAL, BUT RECOMMENDED. ATTACH ADDITIONAL SHEETS AS NEEDED.]***

Contracting Entity

Name: _____

Business Address *[NO./STREET]* _____

[CITY/STATE/ZIP CODE] _____

Telephone Number (_____)_____

Email Address *[OPTIONAL]* _____

Residence Address *[NO./STREET]* _____

[CITY/STATE/ZIP CODE] _____

Telephone Number (_____)_____

Email Address *[OPTIONAL]* _____

5% Owner(s) or More (IF NONE, STATE "NONE.")

Name: _____

Business Address *[NO./STREET]* _____

[CITY/STATE/ZIP CODE] _____

Telephone Number (_____)_____

Email Address *[OPTIONAL]* _____

Residence Address *[NO./STREET]* _____

[CITY/STATE/ZIP CODE] _____

Telephone Number (_____)_____

Email Address *[OPTIONAL]* _____

6. *Optional Information*

Contracting Entity and/or _____ [***NAME OF OWNER OR NON-PROFIT OFFICER***] is actively protesting, challenging or appealing the accuracy and/or amount of taxes levied against _____ [***CONTRACTING ENTITY, OWNER OR NON-PROFIT OFFICER***] as follows:

Name of Debtor: _____

Tax Account Nos. _____

Case or File Nos. _____

Attorney/Agent Name _____

Attorney/Agent Phone No. (_____)_____

Tax Years _____

Status of Appeal *[**DESCRIBE**]* _____

_____

_____

_____

Affiant certifies that he or she is duly authorized to submit the above information on behalf of the Contracting Entity, that Affiant is associated with the Contracting Entity in the capacity noted above and has personal knowledge of the accuracy of the information provided herein, and that the information provided herein is true and correct to the best of Affiant's knowledge and belief.

_____
Affiant

SWORN TO AND SUBSCRIBED before me this _____ day of _____, 20_____.

(Seal)

_____
Notary Public

NOTE:
This affidavit constitutes a **government record** as defined by Section 37.01 of the Texas Penal Code. Submission of a false government record is punishable as provided in Section 37.10 of the Texas Penal Code. Attach additional pages if needed to supply the required names and addresses.

END OF DOCUMENT

Document 00456

BIDDER'S CERTIFICATION OF COMPLIANCE WITH
BUY AMERICAN PROGRAM
(AVIATION SAFETY AND CAPACITY EXPANSION ACT OF 1990)

By submitting a bid, except for those items listed by Bidder below or on additional copies of this page, attached to this page, Bidder certifies that steel and each manufactured product, is produced in the United States (as defined in the clause Buy American - Steel and Manufactured Products for Construction Contracts) and that components of unknown origin are considered to have been produced or manufactured outside the United States. In case of conflicts with corresponding provisions of other Bidding Documents, Buy American Program provisions govern.

Bidders may obtain from the City a list of products excepted from this provision. Use additional copies of this page as required.

PRODUCT	COUNTRY OF ORIGIN

The above information is true and complete to the best of my knowledge and belief.

_____
(Printed or typed Name of Signatory)

_____ _____
Signature Date

Note: The penalty for making false statements in offers is prescribed in 18 U.S.C. 1001.

END OF DOCUMENT

Document 00457

Conflict of Interest Questionnaire

****

Print out latest version of CIQ form from website listed below:

****

Local Government Code Chapter 176 requires Bidders with the City of Houston ("City") to file a Conflict of Interest Questionnaire with the City Secretary of the City of Houston.

The Conflict of Interest Questionnaire is available for downloading on the Texas Ethics Commission's website at: http://www.ethics.state.tx.us/forms/CIQ.pdf. The completed Conflict of Interest Questionnaire will be posted on the City Secretary's website. Also you will find a list of the City Local Government Officers on the City Secretary's website.

For your convenience the CIQ form is attached as part of this document. Although the City has provided this document for the Bidders convenience, it is the Bidders responsibility to submit the latest version of the CIQ form as promulgated by the Texas Ethics Commission.

The Failure of any Bidder to comply with this law is a Class C misdemeanor.

END OF DOCUMENT

Document 00458

BIDDER'S CERTIFICATION REGARDING FOREIGN TRADE RESTRICTIONS (49 CFR PART 30)

The undersigned certifies that Contractor (a) is not owned or controlled by one or more citizens or nationals of a foreign country included in the list of countries that discriminate against U.S. firms published by the Office of the United States Trade representative (USTR); (b) has not knowingly entered into any contract or subcontract for this project with a contractor that is a citizen or national of a foreign country on said list, or is owned or controlled directly or indirectly by one or more citizens or nationals of a foreign country on said list; (c) has not procured any product nor subcontracted for the supply of any product for use in the Work that is produced in a foreign country on said list.

Unless the restrictions of this clause are waived by the Secretary of Transportation in accordance with 49 CFR 30.17, no contract shall be awarded to a contractor or subcontractor who is unable to certify to the above. If Contractor knowingly procures or subcontracts for the supply of any product or service of a foreign country on said list for use in the Work, the Federal Aviation Administration may direct, through the sponsor, cancellation of the Contract at no cost to the Government.

Further, Contractor agrees that, if awarded a contract, Contractor will incorporate this provision for certification without modification in each contract and in all lower tier subcontracts. Contractor may rely upon the certification of a prospective subcontractor unless Contractor has knowledge that the certification is erroneous. Contractor shall provide immediate written notice to the City if Contractor learns that its certification or that of a Subcontractor was erroneous when submitted or has become erroneous by reason of changed circumstances. Subcontractor agrees to provide immediate written notice to Contractor, if at any time it learns that Subcontractor certification was erroneous by reason of changed circumstances.

This certification is a material representation of fact upon which reliance was placed when making the award. If it is later determined that Contractor or Subcontractors knowingly rendered an erroneous certification, the Federal Aviation Administration may direct, through the City, cancellation of the Contract or subcontract for default at no cost to the City.

Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render, in good faith, certification required by this provision. The knowledge and information of Contractor is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

This certification concerns a matter within the jurisdiction of an agency of the United States of America and the making of a false, fictitious, or fraudulent certification may render the maker subject to prosecution under Title 18, United States Code, Section 1001.

Certification- The above information is true and complete to the best of my knowledge and belief.

_____
(Printed or typed Name of Signatory)

_____ _____
Signature Date

Note: The penalty for making false statements in offers is prescribed in 18 U.S.C. 1001.

END OF DOCUMENT

Document 00459

CONTRACTOR'S STATEMENT REGARDING PREVIOUS CONTRACTS SUBJECT TO EQUAL EMPLOYMENT OPPORTUNITY

Section 60-1.7(b) of the Regulations of the Secretary of Labor requires each bidder or prospective prime contractor and proposed subcontractor, where appropriate, to state in the bid or at the outset of negotiations for the contract whether it has participated in any previous contract or subcontract subject to the equal opportunity clause; and if so, whether it has filed with the Joint Reporting Committee, the Director, an agency, or the former President's Committee on Equal Employment Opportunity all reports due under the applicable filing requirements. In any case in which a bidder or prospective prime contractor or proposed subcontractor which participated in a previous contract subject to Executive Order 10925, 11114. or 11246 has not filed a report due under the applicable filing documents, no contract or subcontract shall be awarded unless such contractor submits a report covering the delinquent period or such other period specified by the FAA or the Director, OFCCP.

Contractor has has not participated in a previous contract subject to the equal opportunity clause prescribed by Executive Order 10925, or Executive Order 11114, or Executive Order 11246.

Contractor has has not submitted all compliance reports in connection with any such contract due under the applicable filing requirements; and that representations indicating submission of required compliance reports signed by proposed subcontractors will be obtained prior to award of subcontracts.

If Contractor has participated in a previous contract subject to the equal opportunity clause and has not submitted compliance reports due under applicable filing requirements, Contractor (Proposer) shall submit a compliance report on Standard Form 100, "Employee Information Report EEO-1" prior to the award of the Contract.

Standard Form 100 is normally furnished to contractors annually, based on a mailing list currently maintained by the Joint Reporting Committee. In the event Contractor has not received the form, Contractor may obtain it by writing to the following address:

Joint Reporting Committee
1800 G Street
Washington, DC 20506

_____
(Printed or typed Name of Signatory)

_____ _____
Signature Date

_____
Title

_____
Contractor's Firm Name

NOTE: The penalty for making false statements in offers is prescribed in 18 U.S.C. 1001.

END OF DOCUMENT

Document 00460
(POP -1)
City of Houston
Pay or Play Program
Acknowledgement Form

It has been determined that the project currently open for bidding meets the criteria of the City of Houston Pay or Play program. This form acknowledges your awareness of the Pay or Play program which is authorized by Ordinance 2007-534. Your signature below affirms that you will comply with the requirements of the program if you are the successful bidder/proposer, and ensure the same on behalf of subcontracts subject to the Pay or Play Program.

I declare under penalty of perjury under the laws of the State of Texas that if awarded this contract which meets the criteria for the City of Houston's Pay or Play Program, I will comply with all requirements of the Pay or Play Program in accordance with Executive Order 1-7.

***Fill out all information below and submit this form with your bid/proposal packet.**

_____
Solicitation Number

_____ _____
Signature Date

_____ _____
Print Name City Vendor ID

_____ _____
Company Name Phone Number

_____
Email Address

Note: For more information contact your POP Liaison or the POP Contract Administrator. All contact information can be found on www.houstontx.gov →Departments→Office of Business Opportunity→Pay or Play.

Document 00495-T

POST-BID PROCEDURES
FOR TXDOT FUNDED PROJECTS

1. DOCUMENT ADDRESSES

   A. Notice of Intent to Award

   B. Monitoring Authority

   C. Requirements of Bidder

   D. Failure of Bidder to comply with requirements

   E. Notice to Proceed

2. NOTICE OF INTENT TO AWARD

   A. The City will provide written Notice of Intent to Award to Low Bidder.

3. DEFINITIONS

   A. The "Monitoring Authority" for this Project is:
   Director, Mayor's Office of Business Opportunity
   City of Houston
   611 Walker Street, 7th Floor
   Houston, Texas 77002

   B. The "Contracting Department" for this Project is:
   Director, Department of DEPARTMENT OF PUBLIC WORKS AND ENGINEERING
   City of Houston
   611 Walker Street
   Houston, Texas 77002
   ATTN: **Sudarshan Gouni, P.E.,**

4. REQUIREMENTS OF BIDDER

   A. Within10 days of receipt of Notice of Intent to Award, Low Bidder shall execute and deliver to Sudarshan Gouni, P.E., Project Manager and Monitoring Authority, for the City's approval, documents indicated by an "X" below:
   [X] Executed Subcontract(s), Letter(s) of Intent, or documentation of good faith efforts to meet the MWBE/PDBE/DBE/SBE goals

B. Within 10 days of receipt of Notice of Intent to Award, Low Bidder shall execute and deliver to Sudarshan Gouni, P.E., Project Manager for the City's approval, documents indicated by an "X" below:

[ ] Document 00500 - Form of Business
[X] Document 00501 - Resolution of Contractor
[X] Document 00520-T - Agreement
[X] Document 00600 - List of Proposed Subcontractors and Suppliers
[X] Document 00601 - Drug Policy Compliance Agreement
[X] Document 00602 - Contractor's Drug-free Workplace Policy *(Contractor creates this document.)*
[X] Document 00604 - History of OSHA Actions and List of On-the-job Injuries
[X] Document 00605 - List of Safety Impact Positions *(Contractor completes this list. Do not submit if submitting Document 00606.)*
[ ] Document 00606 - Contractor's Certification of No Safety Impact Positions *(Do not submit if submitting Document 00605.)*
[X] Document 00610 - Performance Bond
[X] Document 00611 - Statutory Payment Bond
[X] Document 00612-T - One-year Warranty Bond
[X] Document 00620 - Affidavit of Insurance *(with Certificate of Insurance attached)*
[X] Document 00622 - Name and Qualifications of Proposed Superintendent *(Contractor creates this document.)*
[X] Document 00624 - Affidavit of Compliance with S/WMBE Program
[ ] Document 00625 - SRF Participation Summary
[ ] Document 00626 - SRF Affirmative Steps Solicitation Report
[ ] Document 00627 - SRF Prime Contractor Affirmative Steps Certification and Goals
[ ] Document 00629 - Affidavit for FAA Form 7460-1
[ ] Document 00630 - Certification of Compliance with Pay or Play Program
[ ] Document 00631 - City of Houston Pay or Play Program – List of Subcontractors
[X] Document 00636 - Certificate of Interested Parties

C. Within 10 days of receipt of Notice of Intent to Award, Low Bidder shall execute the following forms and deliver them directly to the Monitoring Authority.

1. Original forms contained in Document 00805 – Equal Employment Opportunity Program Requirements:

[ ] Pages 00805-3 to 00805-5, Certification by Bidder Regarding Equal Employment Opportunity
[ ] Page 00805-6, Total Work Force Composition of the Company, or copy of latest EEO-1 form (required only if Contractor has a work force of 50 or more people and the Original Contract Price is $50,000 or more)
[ ] Page 00805-7, Equal Employment Opportunity Compliance Program
[ ] Page 00805-26, Certification by Proposed Subcontractor Regarding Equal Employment Opportunity

[ ] *Page 00805-29, Certification by Proposed Material Supplier, Lessor, and Professional Service Providers Regarding Equal Employment Opportunity*

2. Original completed form Document 00633 - Certification by Proposed Material Suppliers, Lessors, and Professional Service Providers Regarding Equal Employment Opportunity, for each proposed material supplier and equipment supplier.

3. Original forms contained in Document 00820 – Wage Scale for Engineering Construction.
   [ ] *Certificate from Contractor Appointing Officer or Employee to Supervise Payment of Employees*
   [ ] *Certificate from SubContractor Appointing Officer or Employee to Supervise Payment of Employees*
   [X] Document 00812, Exhibit "A" – Certificate from Contractor Appointing Officer or Employee to Supervise Payment of Employees

D. Designations of Subcontractors and Suppliers, who have been selected by Bidder in Document 00600 - List of Proposed Subcontractors and Suppliers, and accepted by the City, may be changed only with prior notice and acceptance by Project Manager as provided in Conditions of the Contract. For each Product Supplier subsequently added or substituted, provide an original completed form, Document 00633 - Certification by Proposed Material Suppliers, Lessors, and Professional Service Providers Regarding Equal Employment Opportunity, directly to the Monitoring Authority.

E. On Bidder's written request, Sudarshan Gouni, P.E., Project Manager may grant an extension of time, not to exceed 5 days, to furnish documents specified in Paragraphs 4.0.A and 4.0.B. If Bidder is required to resubmit documents specified in Paragraph 4.0.A or 4.0.B, Bidder shall do so within time limits provided in the request for resubmission.

Designations of Subcontractors and Suppliers, who have been selected by Bidder in Document 00600 - List of Proposed Subcontractors and Suppliers, and accepted by the City, may be changed only with prior notice and acceptance by Project Manager as provided in Conditions of the Contract. For each Product Supplier subsequently added or substituted, provide an original completed form, Document 00633 - Certification by Proposed Material Suppliers, Lessors, and Professional Service Providers Regarding Equal Employment Opportunity, directly to the Monitoring Authority.

E. On Bidder's written request, Sudarshan Gouni, P.E., Project Manager may grant an extension of time, not to exceed 5 days, to furnish documents specified in Paragraphs 4.0.A and 4.0.B. If Bidder is required to resubmit documents specified in Paragraph 4.0.A or 4.0.B, Bidder shall do so within time limits provided in the request for resubmission.

F. Designations of Subcontractors and Suppliers, who have been selected by Bidder in its Participation Plan, and accepted by the City, may be changed only with prior notice and acceptance by the Monitoring Authority as provided in Document 00806-T– Disadvantaged Business Enterprise Program Requirements.

5. FAILURE OF BIDDER TO COMPLY WITH REQUIREMENTS

A. Should Bidder, on receipt of Notice of Intent to Award, fail to comply with requirements of this Document 00495-T within stated time, the City may declare award in default and require forfeiture of the Security Deposit.

B. After the City's written notice of default to Low Bidder, the City may award the Contract to Bidder whose offer is the next lowest bid, and Security Deposit of Bidder in default shall be forfeited to the City in accordance with provisions of Document 00200-T - Instructions to Bidders.

6. NOTICE TO PROCEED

A. Upon the City's execution of the Agreement and delivery to Contractor, City Engineer will give Document 00551 - Notice to Proceed to Contractor, which establishes Date of Commencement of the Work.

END OF DOCUMENT

Document 00501

RESOLUTION OF CONTRACTOR

_____ ("Contractor"),
(Name of Contractor, e.g., "Biz. Inc.", "Biz LLP")

is a _____,
(Type of Organization, e.g.: Corporation, Limited Partnership, Limited Liability Partnership, Limited Liability Company, etc.)

which is bound by acts of _____,
(Name and Form of Governing Entity, e.g., "Biz Inc. Board of Directors", "Bill Smith, GP", etc.)

("Governing Entity").

On the _____ day of _____, 20_____, the Governing Entity resolved, in accordance with all documents, rules, and laws applicable to the Contractor, that _____, is authorized to act as the
(Contractor's Representative)

Contractor's Representative in all business transactions (initial one) ____ conducted in the State of Texas OR ____ related to this Contract; and

The Governing Entity warrants that the above resolution (a) was entered into without dissent or reservation by the Governing Entity, (b) has not been rescinded or amended, and (c) is now in full force and effect; and

In authentication of the adoption of this resolution, I subscribe my name on this ____ day of _____, 20___.

_____ _____
(Authorized Signature for Governing Entity) (Print or Type Name and Title of Authorized Signatory)

SWORN AND SUBSCRIBED before me on _____
Date

_____
Notary Public in and for the State of Texas

My Commission Expires: _____ _____
Expiration Date Print or Type Name of Notary Public

Document 00520-T

AGREEMENT

Project: Greens Road Paving and Drainage Improvements from Aldine Westfield to J.F Kennedy Boulevard

Project Location: The project is generally bound by Aldine Westfield on the west and John F. Kennedy Boulevard on the east. (Key Map No. 373R, 374N and P)

Project No: WBS No. N-000686-0002-4; CSJ 0912-71-739

The City: THE CITY OF HOUSTON, 900 Bagby Street, Houston, Texas 77002 (the "City")

and

Contractor: _____

(Address for Written Notice) _____

_____

Fax Number: _____ **Phone Number:** _____

City Engineer, with respect to Sections 4.1.9 and 4.3 thru 4.5 of the General Conditions, is:

J. Timothy Lincoln, P.E. (or his successor)

P. O. Box 1562, Houston, Texas 77251-1562 (Address for Written Notice)

Fax Number: 832-394-9622

City Engineer, with respect to all other terms of the General Conditions, is:

Joseph T. Myers, P.E.

Fax Number: 832-395-2410

THE CITY AND CONTRACTOR AGREE AS FOLLOWS:

ARTICLE 1
THE WORK OF THE CONTRACT

1.1 Contractor shall perform the Work in accordance with the Contract.

ARTICLE 2
CONTRACT TIME

2.1 Contractor shall achieve Date of Substantial Completion within **944** days after Date of Commencement of the Work, subject to adjustments of Contract Time as provided in the Contract.

2.2 The Parties recognize that time is of the essence for this Agreement and that the City will suffer financial loss if the Work is not completed within the Contract Time. Parties also recognize delays, expense, and difficulties involved in proving in a legal or arbitration proceeding actual loss suffered by the City if the Work is not completed on time. Accordingly, instead of requiring any such proof, the Parties agree that as liquidated damages for delay (but not as a penalty), Contractor shall pay the City the amount stipulated in Document 00800 – Supplementary Conditions, for each day beyond Contract Time.

ARTICLE 3
CONTRACT PRICE

3.1 Subject to terms of the Contract, the City will pay Contractor in current funds for Contractor's performance of the Contract, Contract Price of ____$_____ which includes Alternates, if any, accepted below.

3.2 The City accepts Alternates as follows:

****

Delete or add lines below to indicate all Alternates that were included in Request for competative sealed proposals. Remove brackets and instructions when done. Change color of remaining text to black.

****

Alternate No. 1 _____ *[Accepted or Not Accepted]* _____
Alternate No. 2 _____ *[Accepted or Not Accepted]* _____
Alternate No. 3 _____ *[Accepted or Not Accepted]* _____
Alternate No. 4 _____ *[Accepted or Not Accepted]* _____

ARTICLE 4
PAYMENTS

4.1 The City will make progress payments to Contractor as provided below and in Conditions of the Contract.

4.2 The Period covered by each progress payment is one calendar month ending on the 15th, or [___] last day of the month.

4.3 The City will issue Certificates for Payment and will make progress payments on the basis of such Certificates as provided in Conditions of the Contract.

4.4 Final payment, constituting entire unpaid balance of Contract Price, will be made by the City to Contractor as provided in Conditions of the Contract.

ARTICLE 5
CONTRACTOR REPRESENTATIONS

5.1 Contractor represents:

5.1.1 Contractor has examined and carefully studied Contract documents and other related data identified in the Request For Competitive Sealed Proposals or Competitive Sealed Bids.

5.1.2 Contractor has visited the site and become familiar with and is satisfied as to general, local, and site conditions that may affect cost, progress, and performance of the Work.

5.1.3 Contractor is familiar with and is satisfied as to all federal, state, and local laws and regulations that may affect cost, progress, and performance of the Work.

5.1.4 Contractor has carefully studied all: (1) reports of explorations and tests of subsurface conditions at or contiguous to the site and all drawings of physical conditions in or relating to existing surface or subsurface structures at or contiguous to the site (except Underground Facilities) which have been identified in Contract documents and (2) reports and drawings of a hazardous environmental condition, if any, at the site which has been identified in Contract documents.

5.1.5 Contractor has obtained and carefully studied (or assumes responsibility for having done so) all additional or supplementary examinations, investigations, explorations, tests, studies, and data concerning conditions (surface, subsurface, and Underground Facilities) at or contiguous to the site which may affect cost, progress, or performance of the Work or which relate to any aspect of the means, methods, techniques, sequences, and procedures of construction to be employed by Contractor, including applying specific means, methods, techniques, sequences, and procedures of construction, if any, expressly required by the Contract to be employed by Contractor, and safety precautions and programs incident thereto

5.1.6 Contractor does not consider that any further examinations, investigations, explorations, tests, studies, or data are necessary for performance of the Work at Contract Price, within Contract Time, and in accordance with the Contract.

5.1.7 Contractor is aware of general nature of work to be performed by the City and others at the site that relates to the Work as indicated in Contract documents.

5.1.8 Contractor has correlated information known to Contractor, information and observations obtained from visits to the site, reports and drawings identified in the Contract, and all additional examinations, investigations, explorations, tests, studies, and data with the Contract.

5.1.9 Contractor has given City Engineer written notice of all conflicts, errors, ambiguities, or discrepancies that Contractor has discovered in the Contract, and written resolution thereof by City Engineer is acceptable to Contractor.

5.1.10 Contract documents are generally sufficient to indicate and convey understanding of all terms and conditions for performance and furnishing of the Work.

ARTICLE 6
MISCELLANEOUS PROVISIONS

6.1 The Contract may be terminated by either Party as provided in Conditions of the Contract.

6.2 The Work may be suspended by the City as provided in Conditions of the Contract.

ARTICLE 7
ENUMERATION OF CONTRACT DOCUMENTS

7.1 The following documents are incorporated into this Agreement:

7.1.1 Document 00700 - General Conditions.

7.1.2 Document 00800-T – TxDOT Supplementary Conditions.

7.1.3 General Requirements.

7.1.4 Divisions 02 through 16 of Specifications.

7.1.5 Drawings listed in Document 00015 - List of Drawings. Drawing No. None and bound separately.

7.1.6 Addenda [and Riders] which apply to the Contract, are as follows:

Addendum No. 1, dated None

Addendum No. 2, dated None

Addendum No. 3, dated N/A

Rider No. [ ], dated None

7.1.7 Other documents:

	Document No.	Title
[X]	00410B	Proposal Form – Part B
[ ]	00470	Standard Pre-Bid Participation Plan Document
[ ]	00471	Pre-Bid Good Faith Efforts Report
[ ]	00472	Goal Deviation Request
[X]	00501	Resolution of Contractor
[ ]	00570	Amended S/MWBE Participation Plan
[ ]	00571	Contractor's Good Faith Efforts Report
[ ]	00572	Plan Deviation Request
[X]	00610	Performance Bond
[X]	00611	Statutory Payment Bond
[X]	00612-T	One-year Warranty Work Bond
[X]	00620	Affidavit of Insurance (with the Certificate of Insurance attached)
[ ]	00623	Contractor's Act of Assurance (SRF Form ED-103)
[X]	00624	Affidavit of Compliance with Affirmative Action Program
[ ]	00630	(POP-2) Certification of Compliance with Pay or Play Program
[ ]	00631	(POP-3) Pay or Play Program List of Subcontractors
[ ]	00803	Work Order Supplementary Conditions
[ ]	00802	SRF Supplementary Conditions
[ ]	00805	Equal Employment Opportunity Program Requirements (DELETE If AIP Funded)
[X]	00806-T	TxDOT Disadvantaged Business Enterprise (DBE) Program Requirements
[ ]	00807	Bidder/Contractor Requirements for DBE Program
[ ]	00808	Minority and Women-owned Business Enterprise (MWBE) & Persons with Disabilities Business Enterprise (PDBE) Program
[X]	00810	Federal Wage Rate - Highway
[ ]	00811	Federal Wage Rate - Building
[X]	00812	Federal Wage Rate – Heavy
[ ]	00820	Wage Rate for Engineering Construction
[ ]	00830	Trench Safety Geotechnical Information
[X]	00851	Buy America Requirements
[X]	00852	Changed Conditions
[ ]	00840	Pay or Play Program Requirements
[ ]	00912	Rider
[X]	FHWA1273	Required Contract Provisions for Federal-Aid Construction Contracts
[X]	SPE 000---003	Notice to All Bidders
[X]	SPE 000---004	Notice of Requirement for Affirmative Action to Ensure Equal Employment Opportunity
[X]	SPE 000---006	Standard Federal EEO Construction Contract Specifications
[X]	SPE 000---009	Certificate of Non-Discrimination

[X] SPE 000---011 Department Division Mailing and Physical Addresses
[X] SPE 000---1483 Changes to Payroll Information
[X] SPE 000---2638 On the Job Training Program
[X] SPE 000---2329 Partnering
[X] SPE 000---2607 Nondiscrimination
[X] SPE 000---1966 Disadvantaged Business Enterprise in Federal Aid Contracts
[X] SPE 440---006 Reinforcing Steel

ARTICLE 8
SIGNATURES

8.1 This Agreement is executed in two original copies and is effective as of the date of countersignature by City Controller.

CONTRACTOR:

By: _____

Name: _____

Title: _____

Date: _____

Tax Identification Number: _____

(If Joint Venture)

By: _____

Name: _____

Title: _____

Date: _____

Tax Identification Number: _____

CITY OF HOUSTON, TEXAS

APPROVED:

By: _____
Director,
Department of Public Works and Engineering

SIGNED:

By: _____
Mayor

COUNTERSIGNED:

By: _____
City Controller

Date Countersigned:

_____

_____

ATTEST/SEAL:

By: _____
City Secretary

8.2 This Contract and Ordinance have been reviewed as to form by the undersigned legal assistant and have been found to meet established Legal Department criteria. Legal Department has not reviewed the content of these documents.

_____
Legal Assistant

_____
Date

END OF DOCUMENT

Document 00600-T

LIST OF PROPOSED SUBCONTRACTORS AND SUPPLIERS - PART A[1]
DBE PARTICIPATION PLAN

PROJECT NAME: *Greens Rd. Paving & Drainage Improvements*
ORIG. CONTRACT PRICE: $_____
PROJECT NO.: N-000686-0002-4; CSJ 0912-71-739
PART. AMOUNT: $_____
DATE OF REPORT: _____ PERCENTAGE: _____%
PERCENTAGE DBE: _____%

SUBCONTRACTOR OR SUPPLIER[2] (INLCUDE MBE/WBE/PDBE/DBE/SBE DESIGNATION)	ADDRESS	SCOPE OF WORK[3]	AGREED PRICE

NOTES:
1. RETURN PART A FOR PROJECTS WITH A STATED MWBE, PDBE, DBE AND/OR SBE PERCENTAGE GOAL, AS REQUIRED IN DOCUMENT 00800 – SUPPLEMENTARY CONDITIONS. RETURN PART A WITHIN THE SPECIFIED NUMBER OF DAYS AFTER RECEIPT OF NOTICE OF INTENT TO AWARD
2. FIRMS LISTED IN PART A SHALL BE CERTIFIED BY THE CITY AFFIRMATIVE ACTION/ CONTRACT COMPLIANCE DIVISION.
3. DESCRIBE THE WORK TO BE PERFORMED, FOR WHICH THE FIRM IS CERTIFIED, SUCH AS PAVING, ELECTRICAL, ETC.

CONTRACTOR SHALL EXECUTE CONTRACTS WITH APPROVED SUBCONTRACTORS AND SUPPLIERS WITHIN 30 DAYS AFTER THE DATE OF THE NOTICE TO PROCEED.

SIGNATURE: _____ COMPANY NAME: _____

NAME: _____ TITLE: _____
(Type or Print)

END OF DOCUMENT

Document 00600-T

LIST OF PROPOSED SUBCONTRACTORS AND SUPPLIERS - PART B[1]
SCHEDULE OF NON- DBE SUBCONTRACTORS AND SUPPLIERS

PROJECT NAME: *Greens Rd. Paving & Drainage Improvements*
DATE OF REPORT: _____
PROJECT NO.: N-000686-0002-4; CSJ 0912-71-739

SUBCONTRACTOR OR SUPPLIER	ADDRESS	SCOPE OF WORK[2]

NOTES:
1. RETURN PART B FOR ALL PROJECTS WITHIN THE SPECIFIED NUMBER OF DAYS AFTER RECEIPT OF NOTICE OF INTENT TO AWARD:
2. DESCRIBE THE WORK TO BE PERFORMED, SUCH AS PAVING, ELECTRICAL, ETC.

CONTRACTOR SHALL EXECUTE CONTRACTS WITH APPROVED SUBCONTRACTORS AND SUPPLIERS WITHIN 30 DAYS AFTER THE DATE OF THE NOTICE TO PROCEED.

SIGNATURE: _____ COMPANY NAME: _____

NAME: _____ TITLE: _____
(Type or Print)

END OF DOCUMENT

Document 00601

DRUG POLICY COMPLIANCE AGREEMENT

I, _____ _____,
Name Title

of _____
Contractor

have authority to bind Contractor with respect to its Bid, Proposal, or performance of any and all contracts it may enter into with the City of Houston; and that by making this Agreement, I affirm that Contractor is aware of and by the time the Contract is awarded will be bound by and agree to designate appropriate safety impact positions for company employee positions, and to comply with the following requirements before the City issues a Notice to Proceed:

1. Develop and implement a written Drug Free Workplace Policy and related drug testing procedures for Contractor that meet the criteria and requirements established by the Mayor's Amended Policy on Drug Detection and Deterrence (Mayor's Drug Policy) and the Mayor's Drug Detection and Deterrence Procedures for Contractors (Executive Order No. 1-31).

2. Obtain a facility to collect urine samples consistent with Health and Human Services (HHS) guidelines and an HHS-certified drug-testing laboratory to perform drug tests.

3. Monitor and keep records of drug tests given and results; and upon request from the City of Houston, provide confirmation of such testing and results.

4. Submit semi-annual Drug Policy Compliance Declarations.

I affirm on behalf of Contractor that full compliance with the Mayor's Drug Policy and Executive Order No. 1-31 is a material condition of the Contract with the City of Houston,

I further acknowledge that falsification, failure to comply with or failure to timely submit declarations or documentation in compliance with the Mayor's Drug Policy or Executive Order No. 1-31 will be considered a breach of the Contract with the City and may result in non-award or termination of the Contract by the City.

_____ _____
Contractor Title

_____ _____
Signature Date

END OF DOCUMENT

Document 00603
CHECKLIST FOR DRUG POLICY SUBMITTAL

TO: CARLOS MARTINEZ
PWE/DIRECTOR'S OFFICE
SECURITY MANAGEMENT SECTION
611 WALKER STREET
3RD FLOOR ANNEX
HOUSTON, TEXAS 77002

FROM: **ASSISTANT DIRECTOR**
[*CONTRACTING DIVISION*]
[*CONTRACTING DEPARTMENT*]

DATE: [*Today's Date*]

CONTRACTOR: _____

PROJECT NAME: Greens Road Paving and Drainage Improvements from Aldine Westfield to J.F Kennedy Boulevard

PROJECT No.: WBS No. N-000686-0002-4; CSJ 0912-71-739

PROJECT MANAGER: Sudarshan Gouni, P.E. **TELEPHONE:** (832) 395-2231 **FAX:** (832) 395-2

DOCUMENTS CHECKED BELOW ARE BEING SUBMITTED: (Project Manager, check.)

- ☐ **DOC. 00601 - DRUG POLICY COMPLIANCE AGREEMENT (Standard Form)**
- ☐ **DOC. 00602 - CONTRACTOR'S DRUG-FREE WORKPLACE POLICY (Contractor creates this Document)**
- ☐ **DOC. 00605 - LIST OF SAFETY IMPACT POSITIONS (Contractor creates this List)**
  "OR"
- ☐ **DOC. 00606 - CONTRACTOR'S CERTIFICATION OF NO SAFETY IMPACT POSITIONS**

CCODT REVIEW: THE FOLLOWING CHECKED ITEM(S) ARE MISSING FROM SUBMISSION/POLICY AND NEED TO BE CORRECTED PRIOR TO AWARD:

- ☐ **NAME OF DRUG TESTING LAB**
  REASON FOR TESTING:
  - ☐ **RANDOM TESTING - 25% ANNUALLY**
  - ☐ **REASONABLE SUSPICION**
  - ☐ **POST ACCIDENT**
- ☐ **SAFETY IMPACT POSITIONS INCOMPLETE**
- ☐ **EMPLOYEE ACKNOWLEDGMENT FORM**
- ☐ **DRUG TESTING PROCEDURES**
- ☐ **CONSEQUENCE OF POSITIVE TEST:** *PERMANENTLY REMOVED FROM ANY CONTRACT CITY WORKSITE.*
- ☐ **CONSEQUENCE OF REFUSAL TO CONSENT:** *PERMANENTLY REMOVED FROM ANY CONTRACT CITY WORKSITE.*
- ☐ **OTHER:** _____

REJECTED	_____
	_____
	_____
APPROVED	_____

COMMENTS: _____

DATE RECEIVED: _____ **RESUBMITTAL DATE:** _____

END OF DOCUMENT

Document 00604

HISTORY OF OSHA ACTIONS AND LIST OF ON-THE-JOB INJURIES

Prior to award of the Contract, Low Bidder will be required to file the following with the City:

1. A history of all OSHA actions, advisories, etc., Contractor has received on all jobs worked in any capacity, prime or subcontractor. The history shall be for the two-year period preceding the Bid Date of the Project.

2. A list of all on-the-job injuries, accidents, and fatalities suffered by any present or former employees of Contractor during the same two-year period.

3. If less than the two-year period, give the date Contractor started doing business.

This information must be submitted to the City within the time period stated in Document 00498 - Notice of Intent to Award. An officer of the company must certify in a notarized statement that the information submitted is true and correct.

END OF DOCUMENT

Document 00605

LIST OF SAFETY IMPACT POSITIONS

****

Contractor is to provide a complete List of Employee Classifications that are considered in a "Safety Impact Position" and the number of employees in each of those classifications.

****

Employee Classification	Number of Employees

END OF DOCUMENT

Document 00606

CONTRACTOR'S CERTIFICATION OF
NO SAFETY IMPACT POSITIONS IN PERFORMANCE OF A CITY CONTRACT

BEFORE ME, the undersigned authority, on this day personally appeared

_____,
Affiant

who being by me duly sworn on his oath stated that he is _____
Title

of _____
Contractor

and that no employee safety impact positions, as defined in §5.17 of Executive Order No. 1-31, will be involved in performing_____.
Project

Contractor agrees and covenants that it shall immediately notify the City of Houston Director of Personnel if any safety impact positions are established to provide services in performing this City Contract.

_____
Affiant's Signature

SWORN AND SUBSCRIBED before me on this day of_____, 20___.

_____
Notary Public in and for the State of TEXAS

_____
Print or Type Notary Public Name

My Commission Expires: _____
Expiration Date

END OF DOCUMENT

Document 00607

CERTIFICATION REGARDING DEBARMENT,
SUSPENSION, AND OTHER RESPONSIBILITY MATTERS

Contractor certifies to the best of its knowledge and belief that it and its principals:

1. Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from covered transactions by any Federal, State, or local department or agency;

2. Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State, or local) transaction or contract under a public transaction: violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;

3. Are not presently indicted for or otherwise criminally or civilly charged by a government entity (Federal, State, or local) with commission of any of the offenses enumerated in paragraph 2 of this certification; and

4. Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State, or local) terminated for cause or default.

I understand that a false statement on this certification may be grounds for rejection of this proposal or termination of the award. In addition, under 18 USC Section 1001, a false statement may result in a fine of up to $10,000 or imprisonment for up to five years, or both.

Company:

_____
Typed Name & Title of Authorized Representative

_____ _____
Signature of Authorized Representative Date

- I am unable to certify the above statements. My explanation is attached.

END OF DOCUMENT

Document 00610

PERFORMANCE BOND

THAT WE, _____, as Principal, (the "Contractor"), and the other subscriber hereto, _____, as Surety, do hereby acknowledge ourselves to be held and firmly bound to the City of Houston (the "City"), a municipal corporation, in the penal sum of $_____ for the payment of which sum, well and truly to be made to the City, its successors and assigns, Contractor and Surety do bind themselves, their heirs, executors, administrators, successors and assigns, jointly and severally.

THE CONDITIONS OF THIS OBLIGATION ARE SUCH THAT:

WHEREAS, the Contractor has on or about this day executed a Contract in writing with the City for _____
_____,
all of such work to be done as set out in full in said Contract documents therein referred to and adopted by the City Council, all of which are made a part of this instrument as fully and completely as if set out in full herein.

NOW THEREFORE, if the said Contractor shall faithfully and strictly perform the Contract in all its terms, provisions, and stipulations in accordance with its true meaning and effect, and in accordance with the Contract documents referred to therein and shall comply strictly with each and every provision of the Contract and with this Bond, then this obligation shall become null and void and shall have no further force and effect; otherwise the same is to remain in full force and effect. Should the Contractor fail to faithfully and strictly perform the Contract in all its terms, including but not limited to the indemnifications thereunder, the Surety shall be liable for all damages, losses, expenses and liabilities that the City may suffer in consequence thereof, as more fully set forth herein.

It is further understood and agreed that the Surety does hereby relieve the City or its representatives from the exercise of any diligence whatever in securing compliance on the part of the Contractor with the terms of the Contract, and the Surety agrees that it shall be bound to take notice of and shall be held to have knowledge of all acts or omissions of the Contractor in all matters pertaining to the Contract. The Surety understands and agrees that the provision in the Contract that the City will retain certain amounts due the Contractor until the expiration of 30 days from the acceptance of the Work is intended for the City's benefit, and the City will have the right to pay or withhold such retained amounts or any other amount owing under the Contract without changing or affecting the liability of the Surety hereon in any degree.

It is further expressly agreed by Surety that the City or its representatives are at liberty at any time, without notice to the Surety, to make any change in the Contract documents and in the Work to be done thereunder, as provided in the Contract, and in the terms and conditions thereof, or to make any change in, addition to, or deduction from the Work to be done thereunder; and that such changes, if made, shall not in any way vitiate the obligation in this Bond and undertaking or release the Surety therefrom.

It is further expressly agreed and understood that the Contractor and Surety will fully indemnify and save harmless the City from any liability, loss, cost, expense, or damage arising out of Contractor's performance of the Contract.

If the City gives Surety notice of Contractor's default, Surety shall, within 45 days, take one of the following actions:

1. Arrange for Contractor, with consent of the City, to perform and complete the Contract; or

2. Take over and assume completion of the Contract itself, through its agents or through independent contractors, and become entitled to the payment of the balance of the Contract Price.

If the Surety fails to take either of the actions set out above, it shall be deemed to have waived its right to perform and complete the Contract and receive payment of the balance of the Contract Price and the City shall be entitled to enforce any remedies available at law, including but not limited to completing the Contract itself and recovering any cost in excess of the Original Contract Price from the Surety.

This Bond and all obligations created hereunder shall be performable in Harris County, Texas. This Bond is given in compliance with the provisions of Chapter 2253, Texas Government Code, as amended, which is incorporated herein by this reference.

Notices required or permitted hereunder shall be in writing and shall be deemed delivered when actually received or, if earlier, on the third day following deposit in a United States Postal Service post office or receptacle, with proper postage affixed (certified mail, return receipt requested), addressed to the respective other Party at the address prescribed in the Contract documents, or at such other address as the receiving party may hereafter prescribe by written notice to the sending party.

IN WITNESS THEREOF, the said Contractor and Surety have signed and sealed this instrument on the respective dates written below their signatures and have attached current Power of Attorney.

ATTEST, SEAL: (if a corporation)
WITNESS: (if not a corporation)

_____
Name of Contractor

By: _____
Name:
Title:

By: _____
Name:
Title:
Date:

ATTEST/SURETY WITNESS:

(SEAL)

_____
Full Name of Surety

_____
Address of Surety for Notice

_____

_____
Telephone Number of Surety

By: _____
Name:
Title:
Date:

By: _____
Name:
Title: Attorney-in-Fact
Date:

This Ordinance or Contract has been reviewed as to form by the undersigned legal assistant and have been found to meet established Legal Department criteria. The Legal Department has not reviewed the content of these documents.

_____
Legal Assistant

_____
Date

END OF DOCUMENT

Document 00611

STATUTORY PAYMENT BOND

THAT WE, _____, as Principal, hereinafter called Contractor and the other subscriber hereto, _____, as Surety, do hereby acknowledge ourselves to be held and firmly bound unto the City of Houston, a municipal corporation, in the sum of $_____ for the payment of which sum, well and truly to be made to the City of Houston, and its successors, the said Contractor and Surety do bind themselves, their heirs, executors, administrators, successors, jointly and severally.

THE CONDITIONS OF THIS OBLIGATION ARE SUCH THAT:

WHEREAS, the Contractor has on or about this day executed a contract in writing with the City of Houston for _____
_____,
all of such work to be done as set out in full in said Contract documents therein referred to and adopted by the City Council, all of which are made a part of this instrument as fully and completely as if set out in full herein;

NOW, THEREFORE, if the said Contractor shall pay all claimants supplying labor and materials to him or a Subcontractor in the prosecution of the Work provided for in the Contract, then, this obligation shall be void; otherwise the same is to remain in full force and effect;

PROVIDED HOWEVER, that this Bond is executed pursuant to the provisions of Chapter 2253, Texas Government Code, as amended, and all liabilities on this Bond shall be determined in accordance with the provisions of said Article to the same extent as if it were copied at length herein.

IN WITNESS THEREOF, the said Contractor and Surety have signed and sealed this instrument on the respective dates written below their signatures and have attached current Power of Attorney.

ATTEST, SEAL: (if a corporation)
WITNESS: (if not a corporation)

_____
Name of Contractor

By: _____
Name:
Title:

By: _____
Name:
Title:
Date:

ATTEST/SURETY WITNESS:

(SEAL)

_____
Full Name of Surety

_____
Address of Surety for Notice

_____

_____
Telephone Number of Surety

By: _____
Name:
Title:
Date:

By: _____
Name:
Title: Attorney-in-Fact
Date:

This Ordinance or Contract has been reviewed as to form by the undersigned legal assistant and have been found to meet established Legal Department criteria. The Legal Department has not reviewed the content of these documents.

_____
Legal Assistant

_____
Date

END OF DOCUMENT

Document 00612-T

ONE-YEAR WARRANTY OF WORK BOND

THAT WE, [Name of Low Bidder]_____, as Principal, hereinafter called Contractor, and the other subscriber hereto, [Name of Surety]_____, as Surety, do hereby acknowledge ourselves to be held and firmly bound to the City of Houston, a municipal corporation, in the sum of $_____, for the payment of which sum well and truly to be made to the City of Houston and its successors, the said Contractor and Surety do bind themselves, their heirs, executors, administrators, successors, jointly and severally.

THE CONDITIONS OF THIS OBLIGATION ARE SUCH THAT:

WHEREAS, the Contractor has on or about this day executed a Contract in writing with the City of Houston for [Legal Project Name]_____, all of such work to be done as set out in full in said Contract documents therein referred to and adopted by the City Council, all of which are made a part of this instrument as fully and completely as if set out in full herein.

NOW THEREFORE, if the said Contractor shall comply with the provisions of Paragraph 11.5.1 of the General Conditions, and correct work not in accordance with the Contract documents discovered within the established one-year period, then this obligation shall become null and void, and shall be of no further force and effect; otherwise, the same is to remain in full force and effect.

Notices required or permitted hereunder shall be in writing and shall be deemed delivered when actually received or, if earlier, on the third day following deposit in a United States Postal Service post office or receptacle, with proper postage affixed (certified mail, return receipt requested), addressed to the respective other party at the address prescribed in the Contract documents, or at such other address as the receiving party may hereafter prescribe by written notice to the sending party.

IN WITNESS THEREOF, the said Contractor and Surety have signed and sealed this instrument on the respective dates written below their signatures and have attached current Power of Attorney.

ATTEST, SEAL: (if a corporation)
WITNESS: (if not a corporation)

_____
Name of Contractor

By: _____
Name:
Title:

By: _____
Name:
Title:
Date:

ATTEST/SURETY WITNESS:

(SEAL)

_____
Full Name of Surety

_____
Address of Surety for Notice

_____

_____
Telephone Number of Surety

By: _____
Name:
Title:
Date:

By: _____
Name:
Title: Attorney-in-Fact
Date:

This Ordinance or Contract has been reviewed as to form by the undersigned legal assistant and have been found to meet established Legal Department criteria. The Legal Department has not reviewed the content of these documents.

_____
Legal Assistant

_____
Date

END OF DOCUMENT

Document 00620

AFFIDAVIT OF INSURANCE

BEFORE ME, the undersigned authority, on this day personally appeared

_____, who
Affiant

being by me duly sworn on his oath stated that he is _____, of
Title

_____,
Contractor's Company Name

the Contractor named and referred to within the Contract documents; that he is fully competent and authorized to give this affidavit and that the attached original insurance certificate truly and accurately reflects the insurance coverage that is now available and will be available during the term of the Contract.

_____
Affiant's Signature

SWORN AND SUBSCRIBED before me on _____.
Date

_____
Notary Public in and for the State of TEXAS

_____
Print or type Notary Public name

My Commission Expires: _____
Expiration Date

END OF DOCUMENT

Document 00624

AFFIDAVIT OF COMPLIANCE WITH
AFFIRMATIVE ACTION PROGRAM

BEFORE ME, the undersigned authority, on this day personally appeared

_____, who
Affiant

being by me duly sworn on his oath stated that he is _____,
Title

of _____,
Contractor

the Contractor named and referred to within the Contract documents; that he is fully competent and authorized to give this affidavit and that the Contract is in compliance with the Affirmative Action Program of the City and has done all that is required by the Contract documents, the Affirmative Action Program, and pursuant to Chapter 15, Code of Ordinances, City of Houston, §15.16 et seq.

_____
Affiant's Signature

SWORN AND SUBSCRIBED before me on this day of _____, 20___.

_____
Notary Public in and for the State of TEXAS

_____
Print or Type Notary Public Name

My Commission Expires: _____
Expiration Date

END OF DOCUMENT

Document 00633

CERTIFICATION BY PROPOSED MATERIAL SUPPLIERS,
LESSORS, AND PROFESSIONAL SERVICE PROVIDERS
REGARDING EQUAL EMPLOYMENT OPPORTUNITY

Company Name:_____ $_____
(Supplier, Lessor, Professional Service Provider) (Amount of Contract)

Company Address: _____

Company Telephone Number:_____Fax:_____

E-mail Address: _____

Web Page/URL Address:_____

Company Tax Identification Number: _____

Project No.: [*WBS/CIP/AIP/File No.*]_____

Project Name: [*Legal Project Name*]_____

In accordance with the City of Houston Ordinance 78-1538, Supplier/Lessor/Professional Service Provider represents to be an equal opportunity employer and agrees to abide by the terms of the Ordinance. This certification is required of all Suppliers/Lessors/Professional Service Providers (herein Supplier) with contracts in the amount of $10,000.00 or more.

[ ] Yes [ ] No Supplier agrees not to discriminate against any employee or applicant for employment because of race, religion, color, sex, national origin, or age.

[ ] Yes [ ] No Supplier agrees that all qualified applicants will receive consideration for employment without regard to race, religion, color, sex, national origin, or age.

[ ] Yes [ ] No Supplier will comply with all provisions of Executive Order No. 11246 and rules, regulations and applicable orders of the Department of Labor or other Federal Agency responsible for enforcement of applicable equal opportunity and affirmative action provisions and will likewise furnish all information and reports required by the Mayor or Contract Compliance Officers for the purpose of investigation to ascertain and effect compliance with the City of Houston's Office of Affirmative Action and Contract Compliance.

[ ] Yes [ ] No The Supplier shall file and cause their sub-tier contractors to file compliance reports with the City in the form and to the extent as may be prescribed by the Mayor or Contract Compliance Officers. Compliance reports filed at such times as directed shall contain information including, but not limited to, the practices, policies, programs, and employment policies.

I hereby certify that the above information is true and correct.

_____ _____
COMPANY OFFICER (Signature) DATE

_____
NAME AND TITLE (Print or type)

END OF DOCUMENT

Document 00636

Certificate of Interested Parties

In accordance with Texas Gov't Code §2252.908, the successful bidder must complete Form 1295, Certificate of Interested Parties. Form 1295 is available for downloading on the Texas Ethics Commission's (TEC) website: https://www.ethics.state.tx.us/forms/1295.pdf.

The successful bidder must use the application to enter the required information on Form 1295 and print a copy of the completed form, which will include a certification of filing that will contain a unique certification number.

No later than 30 days after the contract's effective date, the City will upload the successful bidder's completed Form 1295. The TEC will post the Contractor's completed Form 1295 within seven business days of receipt.

For your reference, Form 1295 is attached as part of this document.

END OF DOCUMENT

Document 00642

MONTHLY SUBCONTRACTOR PAYMENT REPORTING FORM

Legal Project Name:_____

Outline Agreement No.:_____ WBS No.:_____

Contractor's Company Name: _____

Address: _____

CERTIFICATION

_____, Contractor's Representative for the above referenced Contract, hereby certifies that (1) Contractor has paid all subcontractors, except those noted below, (2) Contractor made such payments (a) in proportion to the amount City paid Contractor and (b) in accordance and compliance with all applicable Contract Documents and laws; and (3) Contractor withheld no sums from any subcontractor for allegations of deficiency in Work. The term "subcontractor", as used herein, includes all persons or firms furnishing work, materials, services or equipment Contractor ordered incorporated into Work or placed near the Project for which the City made partial payment.

EXCEPTION: Contractor sent Payment Notifications to the following subcontractors explaining why Contractor withheld payment. Copies are attached.

Subcontractor Name:_____	Subcontractor Name: _____
Street Address:_____	Street Address: _____
City, State, and Zip Code:_____	City, State, and Zip Code: _____
Amount of Payment Withheld:_____	Amount of Payment Withheld: _____
Date Payment First Withheld:_____	Date Payment First Withheld: _____
Description of Good Faith Reason:_____	Description of Good Faith Reason:_____
_____	_____

_____
(Signature of Contractor's Representative)

_____
(Print or Type Name of Contractor's Representative)

SWORN TO AND SUBSCRIBED before me on: _____
Date

_____
Notary Public in and for the State of Texas

My Commission Expires: _____
Expiration Date

_____
Print or Type Name of Notary Public

PAYMENT NOTIFICATION
EXPLANATION OF WITHHOLDING

****

Instructions:

If Contractor withholds any amount of a payment to a Subcontractor for any reason, the Contractor shall send Payment Notifications to the Subcontractor explaining why the payment was withheld.

Contractor shall provide the City Monitoring Authority with Payment Notifications for each subcontractor from which Contractor has withheld payment. Contractor shall submit all necessary Payment Notifications (Document 00646), Payment Reporting Forms (Document 00642), and other documentation at the same time Contractor submits the Application and Certification for Payment or the Estimate for Payment.

****

Document 00646

PAYMENT NOTIFICATION – EXPLANATION OF WITHHOLDING

Legal Project Name:_____

Outline Agreement No.:_____ WBS No.:_____

Contractor's Company Name: _____

Address: _____

Date: _____

SUBCONTRACTOR PAYMENT INFORMATION:

Subcontractor Name:_____

Street Address: _____

City, State, and Zip Code: _____

Business Phone Number: _____

Amount of Subcontractor Invoice: _____

Amount of Payment Made: _____

Amount of Payment Withheld:_____

Date Payment First Withheld: _____

DETAILED EXPLANATION OF WITHHOLDING: _____

_____

_____

_____

_____

_____ _____

(Signature of Contractor's Representative) (Print or Type Name of Contractor's Representative)

Document 00700

GENERAL CONDITIONS

August 15, 2015 EDITION

TABLE OF ARTICLES

1. GENERAL PROVISIONS
2. THE CITY
3. CONTRACTOR
4. ADMINISTRATION OF THE CONTRACT
5. SUBCONTRACTORS AND SUPPLIERS
6. CONSTRUCTION BY THE CITY OR BY SEPARATE CONTRACTORS
7. CHANGES IN THE WORK
8. TIME
9. PAYMENTS AND COMPLETION
10. SAFETY PRECAUTIONS
11. INSURANCE AND BONDS
12. UNCOVERING AND CORRECTION OF THE WORK
13. MISCELLANEOUS PROVISIONS
14. TERMINATION OR SUSPENSION OF THE CONTRACT

ARTICLE 1 - GENERAL PROVISIONS 3

1.1 DEFINITIONS 3
1.2 EXECUTION, CORRELATION, AND INTENT 5
1.3 OWNERSHIP AND USE OF DOCUMENTS 6
1.4 INTERPRETATION 6

ARTICLE 2 - THE CITY 6

2.1 LIMITATIONS OF THE CITY'S OFFICERS AND EMPLOYEES 6
2.2 DUTIES OF THE CITY 6
2.3 AVAILABILITY OF LAND AND USE OF SITE 6
2.4 THE CITY'S RIGHT TO STOP THE WORK 7
2.5 THE CITY'S RIGHT TO CARRY OUT WORK 7

ARTICLE 3 - CONTRACTOR 7

3.1 RESPONSIBILITIES 7
3.2 REVIEW OF CONTRACT AND FIELD CONDITIONS BY CONTRACTOR 7
3.3 SUPERVISION AND CONSTRUCTION PROCEDURES 7
3.4 SUPERINTENDENT 8
3.5 LABOR 8
3.6 PREVAILING WAGE RATES 9
3.7 LABOR CONDITIONS 9
3.8 DRUG DETECTION AND DETERRENCE 9
3.9 MATERIALS & EQUIPMENT 10
3.10 PRODUCT OPTIONS AND SUBSTITUTIONS 10
3.11 CASH ALLOWANCES 11
3.12 WARRANTY 11
3.13 TAXES 12
3.14 PERMITS, FEES, AND NOTICES 12
3.15 CONSTRUCTION SCHEDULES 12
3.16 DOCUMENTS AND SAMPLES AT THE SITE 12
3.17 MANUFACTURER'S SPECIFICATIONS 12
3.18 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES 13
3.19 CULTURAL RESOURCES AND ENDANGERED SPECIES 13
3.20 CUTTING AND PATCHING 14
3.21 CLEANING 14
3.22 SANITATION 14
3.23 ACCESS TO WORK AND TO INFORMATION 14
3.24 TRADE SECRETS 14
3.25 INDEMNIFICATION 14
3.26 RELEASE AND INDEMNIFICATION – PATENT, COPYRIGHT, TRADEMARK, AND TRADE SECRET INFRINGEMENT 15
3.27 INDEMNIFICATION PROCEDURES 15
3.28 CONTRACTOR DEBT 156

ARTICLE 4 - ADMINISTRATION OF THE CONTRACT 16

4.1 CONTRACT ADMINISTRATION 16
4.2 COMMUNICATIONS IN ADMINISTRATION OF THE CONTRACT 17
4.3 CLAIMS AND DISPUTES 17
4.4 RESOLUTION OF CLAIMS AND DISPUTES 18
4.5 CONDITION PRECEDENT TO SUIT; WAIVER OF ATTORNEYFEES AND INTEREST 18
4.6 INTERIM PAYMENT WAIVER & RELEASE 18

ARTICLE 5 - SUBCONTRACTORS AND SUPPLIERS 19

5.1 AWARD OF SUBCONTRACTS OTHER CONTRACTS FOR PORTIONS OF THE WORK 19
5.2 CONTRACTOR RESPONSIBILITY FOR SUBCONTRACTORS 19

ARTICLE 6 - CONSTRUCTION BY THE CITY OR BY SEPARATE CONTRACTORS 19

6.1 THE CITY'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS 19
6.2 COORDINATION 19
6.3 MUTUAL RESPONSIBILITY 20
6.4 THE CITY'S RIGHT TO CLEAN UP 20

ARTICLE 7 - CHANGES IN THE WORK 20

7.1 CHANGES 20
7.2 WORK CHANGE DIRECTIVES 20
7.3 ADJUSTMENTS IN CONTRACT PRICE 21
7.4 MINOR CHANGES IN THE WORK 22

ARTICLE 8 - TIME 22

8.1 PROGRESS AND COMPLETION 22
8.2 DELAYS AND EXTENSIONS OF TIME 22

ARTICLE 9 - PAYMENTS AND COMPLETION 23

9.1 UNIT PRICE WORK 23
9.2 ESTIMATES FOR PAYMENT, UNIT PRICE WORK 23
9.3 STIPULATED PRICE WORK 24
9.4 APPLICATIONS FOR PAYMENT, STIPULATED PRICE WORK 24
9.5 CERTIFICATES FOR PAYMENT 24
9.6 COMPUTATIONS OF CERTIFICATES FOR PAYMENT 24
9.7 DECISIONS TO WITHHOLD CERTIFICATION 24
9.8 PROGRESS PAYMENTS 25
9.9 DATE OF SUBSTANTIAL COMPLETION 25
9.10 PARTIAL OCCUPANCY OR USE 26
9.11 FINAL COMPLETION AND FINAL PAYMENT 26

9.12 LIQUIDATED DAMAGES 27

ARTICLE 10 - SAFETY PRECAUTIONS 27

10.1 SAFETY PROGRAMS 27
10.2 POLLUTANTS AND POLLUTANT FACILITIES 28
10.3 SAFETY OF THE ENVIRONMENT, PERSONS, AND PROPERTY 28
10.4 EMERGENCIES 28

ARTICLE 11 - INSURANCE AND BONDS 28

11.1 GENERAL INSURANCE REQUIREMENTS 28
11.2 INSURANCE TO BE PROVIDED BY CONTRACTOR 29
11.3 PROOF OF INSURANCE 32
11.4 PERFORMANCE AND PAYMENT BONDS 33
11.5 MAINTENANCE BONDS 33
11.6 SURETY 33
11.7 DELIVERY OF BONDS 344

ARTICLE 12 - UNCOVERING AND CORRECTION OF THE WORK 344

12.1 UNCOVERING OF THE WORK 34
12.2 CORRECTION OF THE WORK 34
12.3 ACCEPTANCE OF NONCONFORMING WORK 34

ARTICLE 13 - MISCELLANEOUS PROVISIONS 34

13.1 GOVERNING LAWS 34
13.2 SUCCESSORS 345
13.3 BUSINESS STRUCTURE AND ASSIGNMENTS . 355
13.4 WRITTEN NOTICE 35
13.5 RIGHTS AND REMEDIES 35
13.6 TESTS AND INSPECTIONS 35
13.7 INTEREST 35
13.8 PARTIES IN INTEREST 36
13.9 ENTIRE CONTRACT 36
13.10 WRITTEN AMENDMENT 36
13.11 COMPLIANCE WITH LAWS 36
13.12 SEVERABILITY 36

ARTICLE 14 - TERMINATION OR SUSPENSION OF THE CONTRACT 36

14.1 TERMINATION BY THE CITY FOR CAUSE 36
14.2 TERMINATION BY THE CITY FOR CONVENIENCE 37
14.3 SUSPENSION BY THE CITY FOR CONVENIENCE 37
14.4 TERMINATION BY CONTRACTOR 38

ARTICLE 1 - GENERAL PROVISIONS

1.1 DEFINITIONS

1.1.1 Agreement: Document signed by the Parties and binding the Parties, containing the name of Contractor, title and location of the Project, Original Contract Time, Original Contract Price, enumeration of documents included in the Contract, and other provisions.

1.1.2 Bonds: Performance Bond, Payment Bond, Maintenance Bond, and other Surety instruments executed by Surety. When in singular form, refers to individual instrument.

1.1.3 Business Enterprise: Any business entity registered in a program authorized by 49 C.F.R. § 26 (where applicable) or City Code of Ordinances, Chapter 15, Article II, relating to Equal Opportunity Employment and taking affirmative action to ensure that applicants are employed and employees are treated without regard to race, religion, color, sex, national origin, or age. The term "Business Enterprise" may include any Disadvantaged Business Enterprise ("DBE"), Minority Business Enterprise ("MBE"), Woman Business Enterprise ("WBE"), Small Business Enterprise ("SBE"), Person with Disability Enterprise ("PDBE"), and any Historically Underutilized Business ("HUB").

1.1.4 Business Enterprise Policy: Contract documents and applicable policies relating to Business Enterprises and authorized under 49 C.F.R. § 26 or City Code of Ordinances, Chapter 15, Article II.

1.1.5 Cash Allowance: An estimated sum of money to be used only for a limited class of expenditures such as utility relocation costs, fees for special licenses or permits, or other "pass-through" costs that would be the same for any contractor. Cash Allowances may not be used to purchase goods or services that are not specified in the Contract. The unspecified items must be purchased according to the terms of Article 7.

1.1.6 Change Order: Written instrument prepared by the City and signed by City Engineer and Contractor, specifying the following:

1.1.6.1 a change in the Work;
1.1.6.2 a change in Contract Price, if any; and
1.1.6.3 a change in Contract Time, if any.

The value of a Change Order is the net amount after offsetting all deductions against all additions effected by the Change Order.

1.1.7 City: The City of Houston, a home rule municipality located principally within Harris County, Texas, including its successors and its authorized representatives.

1.1.8 City Engineer: The City Engineer, or the City employee representing the City Engineer, designated in the Agreement and authorized to represent the City, or successors.

1.1.9 Claim: Written demand or written assertion by one Party seeking adjustment of the Contract, payment of money, extension of time, or other relief under the Contract and includes, but is not limited to, claims for materials, labor, equipment, delay, changes, adjustments, substitutions, fees and third party claims. The Party making the Claim has the responsibility to substantiate the Claim.

1.1.10 Conditions of the Contract: General Conditions and Supplementary Conditions.

1.1.11 Construction Manager: Person or firm under contract with the City as its authorized representative to oversee and administer construction of the Work, and who may perform the role of Project Manager and Inspector, as designated by City Engineer in writing.

1.1.12 Contract: The Agreement; documents enumerated in and incorporated into the Agreement, Modifications, and amendments.

1.1.13 Contract Price: The monetary amount stated in the Agreement adjusted by Change Order, and increases or decreases in Unit Price Quantities, if any.

1.1.14 Contract Time: The number of days stated in the Agreement to substantially complete the Work, plus days authorized by Change Order.

1.1.15 Contractor: Person or firm identified as such in the Agreement including its successors and its authorized representatives.

1.1.16 Date of Commencement of the Work: Date established in Notice to Proceed on which Contract Time will commence. This date will not be changed by failure of Contractor, or persons or entities for whom Contractor is responsible, to act.

1.1.17 Date of Substantial Completion: Date that construction, or portion thereof designated by City Engineer, is certified by City Engineer to be substantially complete.

1.1.18 Design Consultant: Person or firm, under contract with the City, to provide professional services during construction and its authorized representatives. If a Design Consultant is not employed for services during construction, Project Manager will perform duties of Design Consultant designated in the Contract in addition to usual duties of Project Manager.

1.1.19 Drawings: Graphic and pictorial portions of the Contract that define the character and scope of the Work.

1.1.20 Extra Unit Price: Unit Prices, which may be required for completion of the Work. These Unit Prices and Unit Price Quantities are in the Contract and are included in Original Contract Price.

1.1.21 Furnish: To supply, pay for, deliver to the site, and unload.

1.1.22 General Requirements: The sections of Division 01 Specifications that specify administrative and procedural requirements and temporary facilities required for the Work.

1.1.23 Inspector: City's employee or agent authorized to assist with inspection of the Work.

1.1.24 Install: Unpack, assemble, erect, place, anchor, apply, work to dimension, finish, cure, clean, protect, and similar operations.

1.1.25 Legal Holiday: Day established by the City Council as a holiday.

1.1.26 Major Unit Price Work: An individual Unit Price item,

1.1.26.1 whose value is greater than five percent of Original Contract Price,

1.1.26.2 whose value becomes greater than five percent of Original Contract Price as the result of an increase in quantity, or

1.1.26.3 whose value is $100,000, whichever is least.

1.1.27 Minor Change in the Work: A written change in the Work, ordered by City Engineer, that does not change Contract Price or Contract Time, and that is consistent with the general scope of the Contract.

1.1.28 Modification: Change Order, Work Change Directive, or Minor Change in the Work.

1.1.29 Notice of Noncompliance: A written notice by City Engineer to Contractor regarding defective or nonconforming work that does not meet the Contract requirements, and that establishes a time by which Contractor shall correct the defective or nonconforming work.

1.1.30 Notice to Proceed: A written notice by City Engineer to Contractor establishing Date of Commencement of the Work.

1.1.31 Office of Business Opportunity: any reference to, or use of, the "Office of Affirmative Action" shall mean the Office of Business Opportunity, or any such future name to which it is changed.

1.1.32 Original Contract Price: The monetary amount originally stated in the Agreement.

1.1.33 Parties: Contractor and the City. When in singular form, refers to Contractor or the City.

1.1.34 Pollutant: Any materials subject to the Texas Solid Waste Disposal Act.

1.1.35 Pollutant Facility: Any facility regulated by the State of Texas to protect the health and environment from contamination by Pollutants, including without limitation, landfills, oil and gas production and storage facilities, wastewater facilities, waste injection wells, and storage tanks (including drums).

1.1.36 Product: Materials, equipment, or systems incorporated into the Work or to be incorporated into the Work.

1.1.37 Product Data: Illustrations, standard schedules, performance charts, instructions, brochures, diagrams, and other information furnished by Contractor to illustrate a Product.

1.1.38 Project: Total construction, of which the Work performed under the Contract may be the whole or a part, and which may include construction by the City or by separate contractors.

1.1.39 Project Manager: City Engineer's authorized representative for administration of the Work. Titles used within the City's departments may be different than those used in this definition.

1.1.40 Provide: Furnish and Install, complete, ready for intended use.

1.1.41 Samples: Physical examples that illustrate Products, or workmanship, and establish standards by which the Work is judged.

1.1.42 Shop Drawings: Drawings, diagrams, schedules, and other data specially prepared for the Work by Contractor, Subcontractor or Supplier, to illustrate a portion of the Work.

1.1.43 Specifications: Divisions 01 through 16 of the documents that are incorporated into the Agreement, consisting of written General Requirements and requirements for Products, standards, and workmanship for the Work, and performance of related services.

1.1.44 Stipulated Price: Single lump sum amount stated in the Contract for completion of the Work, or for designated portion of the Work.

1.1.45 Subcontractor: Person or firm that has direct or indirect contract with Contractor or with another Subcontractor to perform a portion of the Work and its authorized representatives.

1.1.46 Superintendent: Employee of Contractor having authority and responsibility to act for and represent Contractor.

1.1.47 Supplementary Conditions: Part of Conditions of the Contract that amends or supplements General Conditions.

1.1.48 Supplier: Manufacturer, distributor, materialman, or vendor having a direct agreement with Contractor or Subcontractor for Products, or services and its authorized representatives.

1.1.49 Surety: Corporate entity that is bound by one or more Bonds, and is responsible for completion of the Work, including the correction period, and for payment of debts incurred in fulfilling the Contract. Surety shall include co-surety or reinsurer, as applicable.

1.1.50 Underground Facilities: Pipes, conduits, ducts, cables, wires, manholes, vaults, tanks, tunnels, or other such facilities or attachments and encasements containing such facilities that exist below ground level.

1.1.51 Unit Price: An amount stated in the Contract for an individual, measurable item of work, which, when multiplied by actual quantity incorporated into the Work, amounts to full compensation for completion of the item, including work incidental to it.

1.1.52 Unit Price Quantities: Quantities indicated in the Contract that are approximations made by the City for contracting purposes.

1.1.53 Work: Entire construction required by the Contract, including all labor, Products, and services provided by Contractor to fulfill Contractor's obligations. The Work may constitute the whole or a portion of the Project.

1.1.54 Work Change Directive: A written change in the Work, ordered by City Engineer, that is within the general scope of the Contract and consisting of additions, deletions, or other revisions. A Work Change Directive will state proposed basis for adjustment, if any, in Contract Price or Contract Time, or both.

1.2 EXECUTION, CORRELATION, AND INTENT

1.2.1 Execution of the Contract by Contractor is conclusive that Contractor has visited the Work site, become familiar with local conditions under which the Work will be performed, and fully informed itself as to conditions and matters which can affect the Work or costs. Contractor further agrees that it has carefully correlated personal observations with requirements of the Contract.

1.2.2 The Contract and Modifications have been read and carefully considered by Contractor, who understands and agrees to their sufficiency for the Work. The Contract may not be more strongly construed against the City than against Contractor and Surety.

1.2.3 Contractor shall include all items necessary for proper execution and completion of the Work.

1.2.4 Reference to standard specifications, manuals, or codes of a technical society, organization, or association, or to laws or regulations of a governmental authority, whether specific or implied, mean the latest edition in effect as of date of receipt of bids, except as may be otherwise specifically stated in the Contract.

1.2.5 No provision of any referenced standard, specification, or manual changes the duties and responsibilities of the City, City Engineer, Contractor, or Design Consultant from those set forth in the Contract. Nor do these provisions assign to Design Consultant any duty or authority to supervise or direct performance of the Work or any duty or

authority to undertake any actions contrary to provisions of the Contract.

1.2.6 Organization of Specifications into divisions, sections, and articles and arrangement of Drawings does not control Contractor in dividing the Work among Subcontractors or in establishing the extent of work to be performed by any trade.

1.2.7 Unless otherwise defined in the Contract, words which have well-known construction industry technical meanings are used in the Contract in accordance with these recognized meanings.

1.3 OWNERSHIP AND USE OF DOCUMENTS

1.3.1 Drawings, Specifications, and other documents prepared by the City or by Design Consultant are instruments of service through which the Work to be executed by Contractor is described. Contractor may retain one Contract record set.

1.3.2 Neither Contractor, Subcontractor, nor Supplier will own or claim a copyright to documents contained in the Contract or any part of the Contract.

1.3.3 Documents contained in the Contract, prepared by the City or by Design Consultant, and copies furnished to Contractor, are for use solely with respect to the Work. They may not be used by Contractor, Subcontractor or Supplier on other projects or for additions to the Work, outside the scope of the Work, without the specific written consent of City Engineer, and Design Consultant, when applicable.

1.3.4 Contractor, Subcontractors, and Suppliers are granted a limited license to use and reproduce applicable portions of the Contract appropriate to and for use in execution of their work under the Contract.

1.4 *INTERPRETATION*

1.4.1 Specifications are written in an imperative streamlined form and are directed to Contractor, unless noted otherwise. When written in this form, words "shall be" are included by inference where a colon (:) is used within sentences or phrases.

1.4.2 In the interest of brevity, the Contract frequently omits modifying words such as "all" and "any" and articles such as "the" and "an", but an absent modifier or article is not intended to affect interpretation of a statement.

ARTICLE 2 - THE CITY

2.1 *LIMITATIONS OF THE CITY'S OFFICERS AND EMPLOYEES*

2.1.1 No officer or employee of the City may authorize Contractor to perform an act or work contrary to the Contract, except as otherwise provided in the Contract.

2.2 *DUTIES OF THE CITY*

2.2.1 If a building permit is required, the City will process an application for, and Contractor shall purchase the building permit before Date of Commencement of the Work.

2.2.2 The City will make available to Contractor a reproducible set of Drawings. Additional copies will be furnished, on Contractor's request, at the cost of reproduction.

2.2.3 When necessary for performance of the Work, the City will provide surveys describing physical characteristics, legal limitations, legal description of site, and horizontal and vertical control adequate to lay out the Work.

2.2.4 Information or services that the City is required to provide under the Contract will be provided by the City with reasonable promptness to avoid delay in orderly progress of the Work.

2.2.5 The Contract imposes no implied duty on the City. The City does not warrant any plans or specifications associated with the Contract.

2.2.6 Except as expressly stated in this Article, the City owes no duty to the Contractor or any subcontractor.

2.3 *AVAILABILITY OF LAND AND USE OF SITE*

2.3.1 The City will furnish, as indicated in the Contract, rights-of-way, land on which the Work is to be performed, and other land designated in the Contract for use by Contractor unless otherwise provided in the Contract.

2.3.2 Contractor shall confine operations at site to those areas permitted by law, ordinances, permits, and the Contract, and may not unreasonably encumber site with materials or equipment.

2.3.3 In addition to land provided by the City under Section 2.3, Contractor shall provide all land and access to land that may be required for use by Contractor for temporary construction facilities or for storage of materials and equipment, and shall indemnify the City during its use of the land as stated in Section 3.25.

2.4 *THE CITY'S RIGHT TO STOP THE WORK*

2.4.1 If Contractor fails to carry out the Work in accordance with the Contract, or fails to correct work which is not in accordance with requirements of the Contract as required in Sections 12.1 and 12.2, the City may, by Notice of Noncompliance, order Contractor to stop the Work or any portion of the Work until the cause for the order has been eliminated. However, the right of the City to stop the Work will not give rise to a Claim for delay or to a duty on the part of the City to exercise this right for the benefit of Contractor or any other person or entity, except to the extent required by Section 6.2. If Contractor corrects the defective or nonconforming work within the time established in Notice of Noncompliance, City Engineer will give written notice to Contractor to resume performance of the Work.

2.5 *THE CITY'S RIGHT TO CARRY OUT WORK*

2.5.1 If Contractor fails to carry out work in accordance with the Contract, and fails within the period established in a Notice of Noncompliance to correct the nonconforming work, the City may, after expiration of the required period, correct the deficiencies without prejudice to other remedies the City may have, including rights of the City under Section 14.1.

2.5.1.1 When the City corrects deficiencies, City Engineer will issue an appropriate Change Order and deduct from payments then or thereafter due Contractor the cost of correcting the deficiencies, including compensation for Design Consultant's and Construction Manager's additional services and expenses made necessary by such default, neglect, or failure. This action by the City and amounts charged to Contractor are both subject to prior approval of City Engineer. If payments, then or thereafter due Contractor, are not sufficient to cover these amounts, Contractor shall pay the difference to the City.

2.5.2 Notwithstanding the City's right to carry out work, maintenance and protection of the Work remains Contractor's responsibility, as provided in the Contract.

ARTICLE 3 - CONTRACTOR

3.1 *RESPONSIBILITIES*

3.1.1 Contractor shall maintain office with agent in the greater City of Houston area during the Contractor's performance under the Contract. Contractor shall file its street address with City Engineer.

3.1.2 Contractor and Contractor's employees shall not give or lend money or anything of value to an officer or employee of the City. Should this Paragraph 3.1.2 be violated, City Engineer may terminate the Contract under Section 14.1.

3.2 *REVIEW OF CONTRACT AND FIELD CONDITIONS BY CONTRACTOR*

3.2.1 Contractor shall carefully study and compare documents contained in the Contract with each other and with information furnished by the City pursuant to Section 2.2 and shall immediately report, in writing, any errors, inconsistencies, or omissions to City Engineer. If work is affected, Contractor shall obtain a written interpretation or clarification from City Engineer before proceeding with the affected work. However, Contractor will not be liable to the City for failure to report an error, inconsistency, or omission in the Contract unless Contractor had actual knowledge or should have had knowledge of the error, inconsistency, or omission.

3.2.2 Contractor shall take field measurements and verify field conditions, and shall carefully compare the conditions and other information known to Contractor with the Contract, before commencing activities. Contractor shall immediately report, in writing, to City Engineer for interpretation or clarification of discrepancies, inconsistencies, or omissions discovered during this process.

3.2.3 Contractor shall make a reasonable attempt to understand the Contract before requesting interpretation from City Engineer.

3.3 *SUPERVISION AND CONSTRUCTION PROCEDURES*

3.3.1 Contractor shall supervise, direct, and inspect the Work competently and efficiently, devoting the attention and applying the skills and

expertise as necessary to perform the Work in accordance with the Contract. Contractor is solely responsible and has control over construction means, methods, techniques, sequences, and procedures of construction; for safety precautions and programs in connection with the Work; and for coordinating all work under the Contract.

3.3.2 Regardless of observations or inspections by the City or City's consultants, Contractor shall perform and complete the Work in accordance with the Contract and submittals approved pursuant to Section 3.18. The City is not liable or responsible to Contractor or Surety for work performed by Contractor that is not in accordance with the Contract regardless of whether discovered during construction or after acceptance of the Work.

3.4 *SUPERINTENDENT*

3.4.1 Contractor shall employ a competent Superintendent and necessary assistants who shall be present at the site during performance of the Work. Communications given to Superintendent are binding on the Contractor.

3.4.2 Contractor shall notify City Engineer in writing of its intent to replace the Superintendent. Contractor may not replace the Superintendent if City Engineer makes a reasonable objection in writing.

3.5 *LABOR*

3.5.1 Contractor shall provide competent, qualified personnel to survey and lay out the Work and perform construction as required by the Contract. The City may, by written notice, require Contractor to remove from the Work any employee of Contractor or Subcontractors to whom City Engineer makes reasonable objection.

3.5.2 Contractor shall comply with the applicable Business Enterprise Policy set out in this Agreement and in the Supplementary Conditions, as set out in Chapter 15, Article V of the City of Houston Code of Ordinances.

3.5.3 When Original Contract Price is greater than $1,000,000, Contractor shall make Good Faith Efforts to award subcontracts or supply agreements in at least the percentages set out in the Supplementary Conditions for Business Enterprise Policy. Contractor acknowledges that it has reviewed the requirements for Good Faith Efforts on file with the City's Office of Business Opportunity and shall comply with them.

3.5.3.1 Contractor shall require written subcontracts with Business Enterprises and shall submit all disputes with Business Enterprises to voluntary mediation. Business Enterprise subcontracts complying with City Code of Ordinances Chapter 15, Article II must contain the terms set out in Subparagraph 3.5.3.2. If Contractor is an individual person, as distinguished from a corporation, partnership, or other legal entity, and the amount of the subcontract is $50,000 or less, the subcontract must also be signed by the attorneys of the respective parties.

3.5.3.2 Contractor shall ensure that subcontracts with Business Enterprise firms are clearly labeled **"THIS CONTRACT MAY BE SUBJECT TO MEDIATION ACCORDING TO THE TEXAS ALTERNATIVE DISPUTE RESOLUTION ACT"** and contain the following terms:

3.5.3.2.1 (Business Enterprise) may not delegate or subcontract more than 50 percent of work under this subcontract to any other subcontractor without the express written consent of the City's OBO Director (the "Director").

3.5.3.2.2 (Business Enterprise) shall permit representatives of the City of Houston, at all reasonable times, to perform (1) audits of the books and records of the Subcontractors and Suppliers, and (2) inspections of all places where work is to be undertaken in connection with this subcontract. (Business Enterprise) shall keep the books and records available for this purpose for at least four years after the end of its performance under this subcontract. Nothing in this provision shall affect the time for bringing a cause of action nor the applicable statute of limitations.

3.5.3.2.3 Within five business days of execution of this subcontract, Contractor and (Business Enterprise) shall designate in writing to the Director an agent for receiving any notice required or permitted to be given pursuant to Chapter 15 of the Houston City Code of Ordinances, along with the street and mailing address and phone number of the agent.

3.5.4 The requirements and terms of the City of Houston Pay or Play Program, as set out in Executive Order 1-7 and Ordinance 2007-0534, are incorporated into the Contract for all purposes. Contractor shall comply with the terms and conditions of the Pay or Play Program as they are set out at the time of City Council approval of this

agreement. IF CONTRACTOR DOES NOT PAY IN ACCORDANCE WITH THE PAY OR PLAY PROGRAM WITHIN 30 DAYS OF THE DATE CITY ENGINEEER SENDS CONTRACTOR WRITTEN NOTIFICATION, CITY CONTROLLER MAY DEDUCT FUNDS UP TO THE AMOUNT OWED FROM ANY PAYMENTS OWED TO CONTRACTOR UNDER THIS AGREEMENT, AND CONTRACTOR WAIVES ANY RECOURSE.

3.6 *PREVAILING WAGE RATES*

3.6.1 Contractor shall comply with governing statutes providing for labor classification of wage scales for each craft or type of laborer, worker, or mechanic.

3.6.2 Prevailing wage rates applicable to the Work may be one or a combination of the following wage rates identified in Division 00:

- 3.6.2.1 Federal Wage Rate General Decisions
  - 3.6.2.1.1 Highway Rates
  - 3.6.2.1.2 Building Rates
  - 3.6.2.1.3 Heavy Construction Rates
  - 3.6.2.1.4 Residential Rates
- 3.6.2.2 City Prevailing Wage Rates
  - 3.6.2.2.1 Building Construction Rates
  - 3.6.2.2.2 Engineering Construction Rates
  - 3.6.2.2.3 Asbestos Worker Rates

3.6.3 Each week Contractor shall submit to the City's Mayor's Office of Business Opportunity certified copies of payrolls showing classifications and wages paid by Contractor, Subcontractors, and Suppliers for each employee under the Contract, for any day included in the Contract.

3.7 *LABOR CONDITIONS*

3.7.1 In the event of labor disputes affecting Contractor or Contractor's employees, Contractor shall utilize all possible means to resolve disputes in order that the Work not be delayed to any extent. These means will include seeking injunctive relief and filing unfair labor practice charges, and any other action available to Contractor.

3.7.2 When Contractor has knowledge that any actual or potential labor dispute is delaying or is threatening to delay timely performance of the Work, Contractor shall immediately notify City Engineer in writing. No Claims will be accepted by City Engineer for costs incurred as a result of jurisdictional or labor disputes.

3.8 *DRUG DETECTION AND DETERRENCE*

3.8.1 It is the policy of the City to achieve a drug-free work force and to provide a workplace that is free from the use of illegal drugs and alcohol. It is also the policy of the City that manufacture, distribution, dispensation, possession, sale, or use of illegal drugs or alcohol by contractors while on the City's premises is prohibited. By executing the Contract, Contractor represents and certifies that it meets and will comply with all requirements and procedures set forth in the Mayor's Policy on Drug Detection and Deterrence, City Council Motion No. 92-1971 ("Mayor's Policy") and the Mayor's Drug Detection and Deterrence Procedures for Contractors, Executive Order No. 1-31, (Revised) ("Executive Order"). Mayor's Policy is on file in the office of the City Secretary. Copies of Executive Order may be obtained at the location specified in the Advertisement for Bids.

3.8.1.1 The Executive Order applies to the City's contracts for labor or services except the following:

- 3.8.1.1.1 contracts authorized by Emergency Purchase Orders,
- 3.8.1.1.2 contracts in which imposition of requirements of the Executive Order would exclude all potential bidders or proposers, or would eliminate meaningful competition for the Contract,
- 3.8.1.1.3 contracts with companies that have fewer than 15 employees during any 20-week period during a calendar year and no safety impact positions,
- 3.8.1.1.4 contracts with non-profit organizations providing services at no cost or reduced cost to the public, and
- 3.8.1.1.5 contracts with federal, state, or local governmental entities.

3.8.1.2 Prior to execution of the Contract, Contractor shall have filed with the City:

- 3.8.1.2.1 a Drug Policy Compliance Agreement form (Attachment "A" to the Executive Order), and
- 3.8.1.2.2 a copy of Contractor's drug free workplace policy, and
- 3.8.1.2.3 a written designation of all safety impact positions, if applicable, or a Contractor's Certification of a No Safety Impact Positions form (Attachment "C" to the Executive Order).

3.8.1.3 Every six months during performance of the Contract and upon completion of the Contract, Contractor shall file a Drug Policy Compliance Declaration form (Attachment "B" to the Executive Order). The Contractor shall submit the Drug Policy Compliance Declaration within 30 days of expiration of each six-month period of performance and within 30 days of completion of the Contract. The first six-month period shall begin on Date of Commencement of the Work.

3.8.1.4 Contractor shall have a continuing obligation to file updated designation of safety impact positions when additional safety impact positions are added to Contractor's employee workforce during performance of the Work.

3.8.1.5 Contractor shall require its Subcontractors and Suppliers to comply with the Mayor's Policy and Executive Order. Contractor is responsible for securing and maintaining required documents from Subcontractors and Suppliers for the City inspection throughout the term of the Contract.

3.8.1.6 Failure of Contractor to comply with requirements will be a material breach of the Contract entitling the City to terminate in accordance with Section 14.1.

3.9 *MATERIALS & EQUIPMENT*

3.9.1 Unless otherwise provided in the Contract, Contractor shall provide and assume full responsibility for Products, labor, transportation, construction equipment and machinery, tools, appliances, fuel, power, light, heat, telephone, water, sanitary facilities, transportation, temporary facilities, supplies, and other facilities and incidentals necessary for Furnishing, performing, testing, starting-up, and completing the Work.

3.9.1.1 Contractor, Subcontractors, and Suppliers shall use Ultra Low Sulfur Diesel Fuel in all diesel operating vehicles and motorized equipment utilized in performing the Work. Ultra Low Sulfur Diesel Fuel is defined as diesel fuel having 15 ppm or the applicable standard set by state or federal law or rules and regulations of the Texas Commission on Environmental Quality, or the Environmental Protection Agency, whichever is less in sulfur content. Off-road Ultra Low Sulfur Diesel Fuel may be used in lieu of on-road Ultra Low Sulfur Diesel Fuel. Contractor shall provide, upon request by City Engineer, proof that Contractor, Subcontractors, and Suppliers are using Ultra Low Sulfur Diesel Fuel.

3.9.2 Contractor shall provide Products that are:

3.9.2.1 new, unless otherwise required or permitted by the Contract, and

3.9.2.2 of specified quality.

If required by City Engineer, Contractor shall furnish satisfactory evidence, including reports of required tests, as to kind and quality of Products.

3.9.3 Contractor shall store Products in a safe, neat, compact, and protected manner. Contractor shall also store Products delivered during the work, along the right-of-way:

3.9.3.1 so as to cause the least inconvenience to property owners, tenants, and general public; and

3.9.3.2 so as not to block access to, or be closer than, three feet to any fire hydrant.

Contractor shall protect trees, lawns, walks, drives, streets, and other improvements that are to remain, from damage. If private or public property is damaged by Contractor, Contractor shall, at its sole expense, restore the damaged property to at least its original condition.

3.9.3.1 Contractor shall obtain City Engineer's approval for storage areas used for Products for which payment has been requested under Paragraph 9.6.1. Contractor shall provide the City access to the storage areas for inspection purposes. Products, once paid for by the City, become the property of the City and may not be removed from place of storage, without City Engineer's written permission except for a movement to the site. Contractor's Installation Floater, required under Section 11.2, shall cover all perils, including loss or damage to Products during storage, loading, unloading, and transit to the site.

3.10 *PRODUCT OPTIONS AND SUBSTITUTIONS*

3.10.1 For Products specified by reference standards or by description only, Contractor may provide any Product meeting those standards or description.

3.10.2 For Products specified by naming one or more manufacturers with provision for substitutions or equal, Contractor may submit a request for substitution for any manufacturer not named.

3.10.3 City Engineer will consider requests for substitutions only within the first 15 percent of Contract Time, or first 90 days after date of Notice to Proceed, whichever is less.

3.10.4 Contractor shall document each request for substitution with complete data

substantiating compliance of proposed substitution with the Contract.

3.10.5 A request for substitution constitutes a representation that Contractor:

3.10.5.1 has investigated the proposed Product and determined that it meets or exceeds the quality level of the specified Product;

3.10.5.2 shall provide the same warranty for the substitution as for the specified Product;

3.10.5.3 shall coordinate installation of the proposed substitution and make changes to other work which may be required for the Work to be completed, with no additional cost or increase in time to the City;

3.10.5.4 confirms that cost data is complete and includes all related costs under the Contract;

3.10.5.5 waives Claim for additional costs or time extensions that may subsequently become apparent; and

3.10.5.6 shall provide review or redesign services by a design consultant with appropriate professional license and shall obtain re-approval and permits from authorities.

3.10.6 City Engineer will not consider and will not approve substitutions when:

3.10.6.1 they are indicated or implied on Shop Drawing or Product Data submittals without separate written request; or

3.10.6.2 acceptance will require revision to the Contract.

3.10.7 City Engineer may reject requests for substitution, and his decision will be final and binding on the Parties.

3.11 *CASH ALLOWANCES*

3.11.1 Contract Price includes Cash Allowances as identified in the Contract.

3.11.2 The City will pay the actual costs of Cash Allowance item exclusive of profit, overhead or administrative costs. If actual costs exceed the Cash Allowance, City Engineer must approve a Change Order for the additional costs.

3.12 *WARRANTY*

3.12.1 Contractor warrants to the City that Products furnished under the Contract are:

3.12.1.1 free of defects in title;

3.12.1.2 of good quality; and

3.12.1.3 new, unless otherwise required or permitted by the Contract.

If required by the City Engineer, Contractor shall furnish satisfactory evidence as to kind, quality and title of Products, and that Products conform to requirements of the Contract.

3.12.2 In the event of a defect in a Product, either during construction or warranty period, Contractor shall take appropriate action with manufacturer of Product to assure correction or replacement of defective Product with minimum delay.

3.12.3 Contractor warrants that the Work is free of defects not inherent in the quality required or permitted, and that the Work does conform with the requirements of the Contract. Contractor further warrants that the Work has been performed in a thorough and workmanlike manner.

3.12.4 Contractor warrants that the Work is free of concentrations on polychlorinated biphenyl (PCB) and other substances defined as hazardous by the Comprehensive Environmental Response Compensation and Liability Act (CERCLA) or any other applicable law or regulation.

3.12.5 Work not conforming to requirements of Section 3.12, including substitutions not properly approved and authorized, may be considered nonconforming work.

3.12.6 Contractor's warranty excludes remedy for damage or defect caused by:

3.12.6.1 improper or insufficient maintenance by the City;

3.12.6.2 normal wear and tear under normal usage; or

3.12.6.3 claim that hazardous material was incorporated into the Work, if that material was specified in the Contract.

3.12.7 Contractor warrants that title to all work covered by Contractor's request for payment passes to the City upon incorporation into the Work or upon Contractor's receipt of payment, whichever occurs first. The Contractor further warrants that the title is free of all liens, claims, security interests or other interests ("Encumbrances"). If not, upon written demand from City Engineer, Contractor shall immediately take legal action necessary to remove Encumbrances.

3.13 *TAXES*

3.13.1 Contractor shall pay all sales, consumer, use, and similar taxes, which are in effect or scheduled to go into effect on or before bids are received, related to work provided by Contractor.

3.13.2 Contractor shall obtain, and require Subcontractors and Suppliers to obtain, necessary permits from the state and local taxing authorities to perform contractual obligations under the Contract, including sales tax permits.

3.13.3 The City is exempt from the Federal Transportation and Excise Tax. Contractor shall comply with federal regulations governing the exemptions.

3.13.4 Products incorporated into the Work are exempt from state sales tax according to provisions of the TEX. TAX CODE ANN. CH. 151, Subsection H.

3.14 *PERMITS, FEES, AND NOTICES*

3.14.1 Unless otherwise provided in the Contract, Contractor shall secure and pay for all construction permits, licenses, and inspections:

3.14.1.1 necessary for proper execution and completion of the Work; and

3.14.1.2 legally required at time bids are received.

3.15 *CONSTRUCTION SCHEDULES*

3.15.1 On receipt of Notice to Proceed, Contractor shall promptly prepare and submit construction schedule for the Work for City Engineer's review. The schedule must reflect the minimum time required to complete the Work not to exceed Contract Time.

3.15.2 Contractor shall give 24-hour written notice to City Engineer before commencing work or resuming work where work has been stopped. Contractor shall also give the same notice to inspectors.

3.15.3 Contractor shall incorporate milestones specified in Summary of Work Specification into the construction schedule. Contractor's failure to meet a milestone, as determined by City Engineer, may be considered a material breach of the Contract.

3.15.4 Each month, Contractor shall submit to City Engineer a copy of an updated construction schedule indicating actual progress, incorporating applicable changes, and indicating courses of action required to assure completion of the Work within Contract Time.

3.15.5 Contractor shall keep a current schedule of submittals that coordinates with the construction schedule, and shall submit the initial schedule of submittals to City Engineer for approval.

3.16 *DOCUMENTS AND SAMPLES AT THE SITE*

3.16.1 Contractor shall maintain at the site, and make available to City Engineer, one record copy of Drawings, Specifications, and Modifications. Contractor shall maintain the documents in good order and marked currently to record changes and selections made during construction. In addition, Contractor shall maintain at the site, approved Shop Drawings, Product Data, Samples, and similar submittals, which will be delivered to City Engineer prior to final inspection as required in Paragraph 9.11.4.

3.16.2 Contractor shall maintain all books, documents, papers, accounting records, and other relevant documentation pursuant to the Work and shall make the books, documents, papers, and accounting records available to representatives of the City for review and audits during the Contract term and for the greater of three years following Date of Substantial Completion or until all litigation or audits are fully resolved.

3.16.3 Contractor shall provide to City Attorney all documents and records that City Attorney deems necessary to assist in determining Contractor's compliance with the Contract, with the exception of those documents made confidential by federal or state law or regulation.

3.17 *MANUFACTURER'S SPECIFICATIONS*

3.17.1 Contractor shall handle, store, and Install Products and perform all work in the manner required by Product manufacturer. Should the Contract and manufacturer's instructions conflict, Contractor shall report conflict to City Engineer for resolution prior to proceeding with the affected work.

3.17.2 References in the Contract to the manufacturer's specifications, directions, or recommendations, mean manufacturer's current published documents in effect as of date of receipt of bids, or in the case of a Modification, as of date of Modification.

3.18 SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

3.18.1 Shop Drawings, Product Data, and Samples are not part of the Contract. The purpose of Contractor submittals is to demonstrate, for those portions of the Work for which submittals are required, the way Contractor proposes to conform to information given and design concept expressed in the Contract.

3.18.2 Contractor shall submit to Project Manager for review the Shop Drawings, Product Data, and Samples, which are required by the Contract. Review by Project Manager is subject to limitations of Paragraph 4.1.4. Contractor shall transmit the submittals to the Project Manager with reasonable promptness and in a sequence, so as to cause no delay in the Work or in activities of the City or of separate contractors. Contractor shall transmit submittals in time to allow a minimum of 30 days for Project Manager's review prior to date Contractor needs reviewed submittals returned. This time may be shortened for a particular job requirement if approved by Project Manager in advance of submittal.

3.18.3 Contractor shall certify that the content of submittals conforms to the Contract without exception by affixing Contractor's approval stamp and signature. By certifying and submitting Shop Drawings, Product Data, and Samples, Contractor represents, and Contractor's stamp of approval shall state, that Contractor has determined and verified materials, quantities, field measurements, and field construction criteria related to the submittal, and has checked and coordinated information contained within the submittals with requirements of the Contract.

3.18.4 Contractor may not perform any work requiring submittal and review of Shop Drawings, Product Data, or Samples until the submittal has been returned with appropriate review decision by the Project Manager. Contractor shall perform work in accordance with the review.

3.18.5 If Contractor performs any work requiring submittals prior to review and acceptance of the submittals by Project Manager, such work is at Contractor's risk and the City is not obligated to accept work if the submittals are later found to be unacceptable.

3.18.6 If, in the opinion of Project Manager, the submittals are incomplete, or demonstrate an inadequate understanding of the Work or lack of review by the Contractor, then submittals may be returned to the Contractor for correction and resubmittal.

3.18.7 Contractor shall direct specific attention in writing and on the resubmitted Shop Drawings, Product Data, or Samples to any additional proposed revisions, other than those revisions requested by Project Manager on previous submittals.

3.18.8 Contractor is not relieved of responsibility for deviations from requirements of the Contract by Project Manager's review of Shop Drawings, Product Data, or Samples unless Contractor has specifically informed Project Manager in writing of the deviation at the time of the submittal, and Project Manager has given written approval of the deviation.

3.18.9 When professional certification of performance criteria of Products is required by the Contract, the City may rely upon accuracy and completeness of the calculations and certifications.

3.18.10 For Product colors or textures to be selected by the City, Contractor shall submit all samples together to allow preparation of a complete selection schedule.

3.18.11 Contractor shall submit informational submittals, on which Project Manager is not expected to take responsive action, as required by the Contract.

3.18.12 Submittals made by Contractor which are not required by the Contract may be returned to Contractor without action.

3.19 CULTURAL RESOURCES AND ENDANGERED SPECIES

3.19.1 Contractor may not remove or disturb, or cause to be removed or disturbed, any historical, archaeological, architectural, or other cultural artifacts, relics, vestiges, remains, or objects of antiquity. If Contractor discovers one of these items, Contractor shall immediately notify City Engineer and further comply with the requirements of 13 Tex. Admin. Code Chs. 25 and 26 (2002), or successor regulation. Contractor shall protect site and cultural resources from further disturbance until professional examination can be made or until clearance to proceed is authorized in writing by City Engineer.

3.19.2 Should either threatened or endangered plant or animal species be encountered,

Contractor shall cease work immediately in the area of encounter and notify City Engineer.

3.20 *CUTTING AND PATCHING*

3.20.1 Contractor is responsible for necessary cutting, fitting, and patching to accomplish the Work and shall suitably support, anchor, attach, match, and trim or seal materials to work of other contractors. Contractor shall coordinate the Work with work of other contractors to minimize conflicts, as provided in Article 6.

3.20.2 Contractor may not endanger work by cutting, digging, or other action, and may not cut or alter work of other contractors except by written consent of City Engineer and affected contractor.

3.21 *CLEANING*

3.21.1 Contractor shall perform daily cleanup of all dirt, debris, scrap materials and other disposable items resulting from Contractor's operations, whether on-site or off-site. Unless otherwise authorized in writing by City Engineer, Contractor shall keep all streets, access streets, driveways, areas of public access, walkways, and other designated areas clean and open at all times.

3.21.2 Failure of Contractor to maintain a clean site, including access streets, is the basis for City Engineer to issue a Notice of Noncompliance. Should compliance not be attained within the time period in the Notice of Noncompliance, City Engineer may authorize necessary cleanup to be performed by others and the cost of the cleanup will be deducted from monies due Contractor.

Contractor shall legally dispose off-site, all waste materials and other excess materials resulting from Contractor's operations.

3.22 *SANITATION*

3.22.1 Contractor shall provide and maintain sanitary facilities at site for use of all construction forces under the Contract. Newly-constructed or existing sanitary facilities may not be used by Contractor.

3.23 *ACCESS TO WORK AND TO INFORMATION*

3.23.1 Contractor shall provide the City, Design Consultant, testing laboratories, and governmental agencies which have jurisdictional interests, access to the Work in preparation and in progress wherever located. Contractor shall provide proper and safe conditions for the access.

3.23.2 If required by City Engineer, Contractor shall furnish information concerning character of Products and progress and manner of the Work, including information necessary to determine cost of the Work, such as number of employees, pay of employees, and time employees worked on various classes of the Work.

3.24 *TRADE SECRETS*

3.24.1 Contractor will not make any claim of ownership of trade secrets as to products used in the Work, or preparation of any mixture for the Work. City Engineer will at all times have the right to demand and Contractor shall furnish information concerning materials or samples of ingredients of any materials used, or proposed to be used, in preparation of concrete placed or other work to be done. Mixtures, once agreed on, shall not be changed in any manner without knowledge and consent of City Engineer. The City will make its best efforts to protect confidentiality of proprietary information.

3.25 *INDEMNIFICATION*

3.25.1 CONTRACTOR AGREES TO AND SHALL DEFEND, INDEMNIFY, AND HOLD THE CITY, ITS AGENTS, EMPLOYEES, OFFICERS, AND LEGAL REPRESENTATIVES (COLLECTIVELY THE "CITY") HARMLESS FOR ALL CLAIMS, CAUSES OF ACTION, LIABILITIES, FINES, AND EXPENSES (INCLUDING, WITHOUT LIMITATION, ATTORNEYS' FEES, COURT COSTS, AND ALL OTHER DEFENSE COSTS AND INTEREST) FOR INJURY, DEATH, DAMAGE, OR LOSS TO PERSONS OR PROPERTY SUSTAINED IN CONNECTION WITH OR INCIDENTAL TO PERFORMANCE UNDER THE CONTRACT INCLUDING, WITHOUT LIMITATION, THOSE CAUSED BY:

3.25.1.1 CONTRACTOR'S AND/OR ITS AGENTS', EMPLOYEES', OFFICERS', DIRECTORS', CONTRACTORS', OR SUBCONTRACTORS' (COLLECTIVELY IN NUMBERED SUBPARAGRAPHS .1 through .3, "CONTRACTOR") ACTUAL OR ALLEGED NEGLIGENCE OR INTENTIONAL ACTS OR OMISSIONS;

3.25.1.2 THE CITY'S AND CONTRACTOR'S ACTUAL OR ALLEGED CONCURRENT NEGLIGENCE, WHETHER CONTRACTOR IS IMMUNE FROM LIABILITY OR NOT;

3.25.1.3 THE CITY'S AND CONTRACTOR'S ACTUAL OR ALLEGED STRICT PRODUCTS LIABILITY OR STRICT STATUTORY LIABILITY, WHETHER CONTRACTOR IS IMMUNE FROM LIABILITY OR NOT.

CONTRACTOR SHALL DEFEND, INDEMNIFY, AND HOLD THE CITY HARMLESS DURING THE TERM OF THE CONTRACT AND FOR FOUR YEARS AFTER THE CONTRACT TERMINATES. CONTRACTOR SHALL NOT INDEMNIFY THE CITY FOR THE CITY'S SOLE NEGLIGENCE.

3.25.2 NOTWITHSTANDING ANYTHING TO THE CONTRARY, THE LIABILITY OF CONTRACTOR FOR THE CITY'S CONCURRENT NEGLIGENCE SHALL NOT EXCEED $1,000,000.

3.26 *RELEASE AND INDEMNIFICATION – PATENT, COPYRIGHT, TRADEMARK, AND TRADE SECRET INFRINGEMENT*

3.26.1 UNLESS OTHERWISE SPECIFICALLY REQUIRED BY THE CONTRACT, CONTRACTOR AGREES TO AND SHALL RELEASE AND DEFEND, INDEMNIFY, AND HOLD HARMLESS THE CITY, ITS AGENTS, EMPLOYEES, OFFICERS, AND LEGAL REPRESENTATIVES (COLLECTIVELY THE "CITY") FROM ALL CLAIMS OR CAUSES OF ACTION BROUGHT AGAINST THE CITY BY ANY PARTY, INCLUDING CONTRACTOR, ALLEGING THAT THE CITY'S USE OF ANY EQUIPMENT, SOFTWARE, PROCESS, OR DOCUMENTS CONTRACTOR FURNISHES DURING THE TERM OF THE CONTRACT INFRINGES ON A PATENT, COPYRIGHT, OR TRADEMARK, OR MISAPPROPRIATES A TRADE SECRET. CONTRACTOR SHALL PAY ALL COSTS (INCLUDING, WITHOUT LIMITATION, ATTORNEYS' FEES, COURT COSTS, AND ALL OTHER DEFENSE COSTS, AND INTEREST) AND DAMAGES AWARDED.

3.26.2 CONTRACTOR SHALL NOT SETTLE ANY CLAIM ON TERMS WHICH PREVENT THE CITY FROM USING THE EQUIPMENT, SOFTWARE, PROCESS, OR PRODUCT WITHOUT THE CITY ENGINEER'S PRIOR WRITTEN CONSENT.

3.26.3 UNLESS OTHERWISE SPECIFICALLY REQUIRED BY THE CONTRACT, WITHIN 60 DAYS AFTER BEING NOTIFIED OF THE CLAIM, CONTRACTOR SHALL, AT ITS OWN EXPENSE, EITHER:

3.26.3.1 OBTAIN FOR THE CITY THE RIGHT TO CONTINUE USING THE EQUIPMENT, SOFTWARE, PROCESS, OR PRODUCT, OR

3.26.3.2 IF BOTH PARTIES AGREE, REPLACE OR MODIFY THEM WITH COMPATIBLE AND FUNCTIONALLY EQUIVALENT PRODUCTS.

IF NONE OF THESE ALTERNATIVES IS REASONABLY AVAILABLE, THE CITY MAY RETURN THE EQUIPMENT, SOFTWARE, OR PRODUCT, OR DISCONTINUE THE PROCESS, AND CONTRACTOR SHALL REFUND THE PURCHASE PRICE.

3.27 *INDEMNIFICATION PROCEDURES*

3.27.1 *Notice of Indemnification Claims:* If the City or Contractor receives notice of any claim or circumstances which could give rise to an indemnified loss, the receiving party shall give written notice to the other Party within 10 days. The notice must include the following:

3.27.1.1 a description of the indemnification event in reasonable detail,

3.27.1.2 the basis on which indemnification may be due, and

3.27.1.3 the anticipated amount of the indemnified loss.

This notice does not estop or prevent the City from later asserting a different basis for indemnification or a different amount of indemnified loss than that indicated in the initial notice. If the City does not provide this notice within the 10-day period, it does not waive any right to indemnification except to the extent that Contractor is prejudiced, suffers loss, or incurs expense because of the delay.

3.27.2 *Defense of Indemnification Claims:*

3.27.2.1 *Assumption of Defense:* Contractor may assume the defense of the claim at its own expense with counsel chosen by it that is reasonably satisfactory to the City. Contractor shall then control the defense and any negotiations to settle the claim. Within 10 days after receiving written notice of the indemnification request, Contractor must advise the City as to whether or not it will defend the claim. If Contractor does not assume the defense, the City shall assume and control the defense, and all defense expenses constitute an indemnified loss.

3.27.2.2 *Continued Participation:* If Contractor elects to defend the claim, the City may

retain separate counsel to participate in, but not control, the defense and to participate in, but not control, any settlement negotiations. Contractor may settle the claim without the consent or agreement of the City, unless it:

3.27.2.2.1 would result in injunctive relief or other equitable remedies or otherwise require the City to comply with restrictions or limitations that adversely affect the City;

3.27.2.2.2 would require the City to pay amounts that Contractor does not fund in full; or

3.27.2.2.3 would not result in the City's full and complete release from all liability to the plaintiffs or claimants who are parties to or otherwise bound by the settlement.

3.28 ***CONTRACTOR DEBT***

IF CONTRACTOR, AT ANY TIME DURING THE TERM OF THIS AGREEMENT, INCURS A DEBT, AS THE WORD IS DEFINED IN SECTION 15-122 OF THE HOUSTON CITY CODE OF ORDINANCES, IT SHALL IMMEDIATELY NOTIFY CITY CONTROLLER IN WRITING. IF CITY CONTROLLER BECOMES AWARE THAT CONTRACTOR HAS INCURRED A DEBT, IT SHALL IMMEDIATELY NOTIFY CONTRACTOR IN WRITING. IF CONTRACTOR DOES NOT PAY THE DEBT WITHIN 30 DAYS OF EITHER SUCH NOTIFICATION, CITY CONTROLLER MAY DEDUCT FUNDS IN AN AMOUNT EQUAL TO THE DEBT FROM ANY PAYMENTS OWED TO CONTRACTOR UNDER THIS AGREEMENT, AND CONTRACTOR WAIVES ANY RECOURSE THEREFOR. CONTRACTOR SHALL FILE A NEW AFFIDAVIT OF OWNERSHIP, USING THE FORM DESIGNATED BY CITY, BETWEEN FEBRUARY 1 AND MARCH 1 OF EVERY YEAR DURING THE TERM OF THE CONTRACT.

ARTICLE 4 - ADMINISTRATION OF THE CONTRACT

4.1 *CONTRACT ADMINISTRATION*

4.1.1 City Engineer will provide administration of the Contract and City Engineer is authorized to issue Change Orders, Work Change Directives, and Minor Changes in the Work.

4.1.2 City Engineer may act through Project Manager, Design Consultant, or Inspector. When the term "City Engineer" is used in the Contract, action by City Engineer is required unless City Engineer delegates his authority in writing. The City Engineer may not delegate authority to render decisions under Section 4.4.

The City does not have control over or charge of, and is not responsible for, supervision, construction, and safety procedures enumerated in Section 3.3. The City does not have control over or charge of and is not responsible for acts or omissions of Contractor, Subcontractors, or Suppliers.

4.1.3 The City and Design Consultant may attend project meetings and visit the site to observe progress and quality of the Work. The City and Design Consultant are not required to make exhaustive or continuous on-site inspections to check quality or quantity of the Work.

4.1.4 Project Manager will review and approve or take other appropriate action on Contractor's submittals, but only for limited purpose of checking for conformance with information given and design concept expressed in the Contract.

4.1.5 Project Manager's review of the submittals is not conducted for purpose of determining accuracy and completeness of other details, such as dimensions and quantities, or for substantiating instructions for installation or performance of Products, all of which remain the responsibility of Contractor.

4.1.6 Project Manager's review of submittals does not relieve Contractor of its obligations under Sections 3.3, 3.12, and 3.18. Review does not constitute approval of safety precautions or, unless otherwise specifically stated by Project Manager in writing, of construction means, methods, techniques, sequences, or procedures. Project Manager's review of a specific item does not indicate approval of an assembly of which the item is a component.

4.1.7 Based on field observations and evaluations, Project Manager will process Contractor's progress payments, certify amounts due Contractor, and issue Certificates for Payment in the amount certified.

4.1.8 Project Manager will receive and forward to City Engineer for his review and records, written warranties and related documents required by the Contract and assembled by Contractor.

4.1.9 Upon written request by Contractor or Project Manager, City Engineer will resolve matters of interpretation of or performance of the Contract, which are not Claims. City Engineer's decisions are final and binding on the Parties.

4.1.10 City Engineer may reject work which does not conform to the Contract.

4.1.11 When City Engineer considers it necessary to implement the intent of the Contract, City Engineer may require additional inspection or testing of work in accordance with Paragraphs 13.6.3 and 13.6.4, whether such work is fabricated, Installed, or completed.

4.2 *COMMUNICATIONS IN ADMINISTRATION OF THE CONTRACT*

4.2.1 Except as otherwise provided in the Contract or when authorized by City Engineer in writing, Contractor shall communicate with Project Manager. Contractor shall communicate with Design Consultant, Design Consultant's subconsultants, and separate contractors through Project Manager. The City will communicate with Subcontractors and Suppliers through Contractor.

4.3 *CLAIMS AND DISPUTES*

4.3.1 *Documentation by Project Manager:* Contractor shall submit Claims, including those alleging an error or omission by Project Manager or Design Consultant, to Project Manager for documentation and recommendation to City Engineer.

4.3.2 *Decision of City Engineer:* Upon submission of Claim by Project Manager or Contractor, City Engineer will resolve Claims in accordance with Section 4.4.

4.3.3 *Time Limits on Claims:* Claims by Contractor must be made within 90 days after occurrence of event giving rise to the Claim.

4.3.4 *Continuing the Contract Performance:* Pending final resolution of a Claim including referral to non-binding mediation, unless otherwise agreed in writing, Contractor shall proceed diligently with the performance of the Contract and the City will continue to make payments in accordance with the Contract.

4.3.4.1 Pending final resolution of a Claim including referral to non-binding mediation, Contractor is responsible for safety and protection of physical properties and conditions at site.

4.3.5 *Claims for Concealed or Unknown Conditions:* Concealed or unknown physical conditions include utility lines, other man-made structures, storage facilities, Pollutants and Pollutant Facilities, and the like, but do not include conditions arising from Contractor operations, or failure of Contractor to properly protect and safeguard subsurface facilities. Concealed conditions also include naturally-occurring soil conditions outside the range of soil conditions identified through geotechnical investigations, but do not include conditions arising from groundwater, rain, or flood.

4.3.5.1 If conditions are encountered at the site which are Underground Facilities or otherwise concealed or unknown conditions which differ materially from:

4.3.5.1.1 those indicated by the Contract; or

4.3.5.1.2 conditions which Contractor could have discovered through site inspection, geotechnical testing, or otherwise;

then Contractor will give written notice to City Engineer no later than five days after Contractor's first observation of the condition and before condition is disturbed. Contractor's failure to provide notice constitutes a waiver of a Claim.

4.3.5.2 City Engineer will promptly investigate concealed or unknown conditions. If City Engineer determines that conditions at the site are not materially different and that no change in Contract Price or Contract Time is justified, City Engineer will notify Contractor in writing, stating reasons. If City Engineer determines the conditions differ materially and cause increase or decrease in Contractor's cost or time required for performance of part of the Work, City Engineer will recommend an adjustment in Contract Price or Contract Time, or both, as provided in Article 7. Opposition by a Party to the City Engineer's determination must be made within 21 days after City Engineer has given notice of the decision. If the Parties cannot agree on adjustment to Contract Price or Contract Time, adjustment is subject to further proceedings pursuant to Section 4.4.

4.3.6 *Claims for Additional Cost:* If Contractor wishes to make a Claim for increase in Contract Price, Contractor shall give written notice before proceeding with work for which Contractor intends to submit a Claim. Prior notice is not required for Claims relating to an emergency

endangering life or property arising under Section 10.4.

4.3.6.1 Contractor may file a Claim in accordance with Section 4.4 if Contractor believes it has incurred additional costs, for the following reasons:

- 4.3.6.1.1 written interpretation of City Engineer;
- 4.3.6.1.2 order by City Engineer to stop the Work when Contractor is not at fault;
- 4.3.6.1.3 suspension of the Work by City Engineer;
- 4.3.6.1.4 termination of the Contract by City Engineer; or
- 4.3.6.1.5 The City's non-compliance with another provision of the Contract.

4.3.6.2 No increase in Contract Price is allowed for delays or hindrances to the Work, except for direct and unavoidable extra costs to Contractor caused by failure of the City to provide information and services, or to make land and materials available, when required of the City under the Contract. Any increase claimed is subject to the provisions of Section 4.4 and Article 7.

4.3.6.3 The City is not liable for Claims for delay when Date of Substantial Completion occurs prior to expiration of Contract Time.

4.3.7 *Claims for Additional Time:* If Contractor wishes to make a Claim for an increase in Contract Time, Contractor shall give written notice as provided in Section 8.2. In case of continuing delay, only one Claim is necessary.

4.4 *RESOLUTION OF CLAIMS AND DISPUTES*

4.4.1 City Engineer will review Claims and take one or more of the following preliminary actions within 30 days of receipt of Claim:

- 4.4.1.1 submit a suggested time to meet and discuss the Claim with City Engineer;
- 4.4.1.2 reject Claim, in whole or in part, stating reasons for rejection;
- 4.4.1.3 recommend approval of the Claim by the other Party;
- 4.4.1.4 suggest a compromise; or
- 4.4.1.5 take other actions as City Engineer deems appropriate to resolve the Claim.

4.4.2 City Engineer may request additional supporting data from claimant. Party making Claim shall, within 10 days after receipt of City Engineer's request, submit additional supporting data requested by City Engineer.

4.4.3 At any time prior to rendering a written decision regarding a Claim, City Engineer may refer Claim to non-binding mediation. If Claim is resolved, City Engineer will prepare and obtain all appropriate documentation. If Claim is not resolved, City Engineer will take receipt of Claim and begin a new review under Section 4.4.

4.4.4 If Claim is not referred to or settled in non-binding mediation, City Engineer may conduct a hearing and will render a written decision, including findings of fact, within 75 days of receipt of Claim, or a time mutually agreed upon by the Parties in writing. City Engineer may notify Surety and request Surety's assistance in resolving Claim. City Engineer's decision is final and binding on the Parties.

4.5 *CONDITION PRECEDENT TO SUIT; WAIVER OF ATTORNEY FEES AND INTEREST*

4.5.1 Neither the City nor Contractor may recover attorney fees for any claim brought in connection with this Contract.

4.5.2 Neither the City nor the Contractor may recover interest for any damages claim brought in connection with this Contract except as allowed by TEXAS LOCAL GOVERNMENT CODE Chapter 2251.

4.6 *INTERIM PAYMENT WAIVER & RELEASE*

4.6.1 In accordance with section 4.3, the Contractor shall use due diligence in the discovery and submission of any Claim against the City related to the Contractor's work.

4.6.2 The Contractor shall submit any Claim to the City not later than the 90th day after the occurrence of the event giving rise to the Claim.

4.6.3 Any failure to timely comply with the requirements of section 4.6.2 waives and releases any Claim when the Contractor submits an application for payment after the 90th day.

4.6.4 This waiver does not cover any retainage. In case of any conflict of law, this language shall be revised to the minimum extent necessary to avoid legal conflict. This waiver is made specifically for the benefit of the City.

ARTICLE 5 - SUBCONTRACTORS AND SUPPLIERS

5.1 *AWARD OF SUBCONTRACTS OTHER CONTRACTS FOR PORTIONS OF THE WORK*

5.1.1 Contractor may not contract with a Subcontractor, Supplier, person, or entity that City Engineer has made a reasonable and timely objection to.

5.1.2 If City Engineer has a reasonable objection to person or entity proposed by Contractor, Contractor shall propose another with whom City Engineer has no reasonable objection.

5.1.3 Contractor shall execute contracts with approved Subcontractors, Suppliers, persons, or entities before the Subcontractors or Suppliers begin work under the Contract. All such contracts must be executed and sent to the OBO Director and Contracting Department within 30 days after the date of the Notice to Proceed and must include provisions set forth in Articles 3 and 5 of this Document.

5.1.4 Contractor shall notify City Engineer in writing of any proposed change of Subcontractor, Supplier, person, or entity previously accepted by the City.

5.1.5 Contractor shall make timely payments to Subcontractors and Suppliers for performance of the Contract. Contractor shall protect, defend, and indemnify the City from any claim or liability arising out of Contractor's failure to make the payments. Disputes relating to payment of Business Enterprise Subcontractors or Suppliers will be submitted to arbitration in same manner as other disputes under Business Enterprise subcontracts. Failure of Contractor to comply with decisions of arbitrator may be determined by City Engineer a material breach leading to termination of the Contract.

5.2 *CONTRACTOR RESPONSIBILITY FOR SUBCONTRACTORS*

5.2.1 Contractor is responsible to the City, as may be required by laws and regulations, for all acts and omissions of Subcontractors, Suppliers, and other persons and organizations performing or furnishing any of the Work under direct or indirect contract with Contractor.

5.2.2 Contractor shall make available to each proposed Subcontractor, prior to execution of subcontract, copies of the Contract to which Subcontractor is bound by this Section 5.2. Contractor shall notify Subcontractor of any terms of proposed subcontract which may be at variance with the Contract.

5.2.3 The City's approval of Subcontractor or Suppliers does not relieve Contractor of its obligation to perform, or to have performed to the full satisfaction of the City, the Work required by the Contract.

5.2.4 Unless there is a contractual relationship between Contractor and a Subcontractor or Supplier to the contrary, Contractor shall withhold no more retainage from Subcontractors or Suppliers than City withholds from Contractor under this Agreement. However, once a Subcontractor or Supplier completes performance, Contractor shall release all retainage to that Subcontractor or Supplier regardless if City continues to retain under this Agreement.

5.2.5 Prior to a Subcontractor or Supplier commencing performance for Contractor, Contractor shall meet with that Subcontractor or Supplier to provide instructions on invoicing procedures, dispute resolution procedures, and statutory rights, such as claim filing procedures under the McGregor Act. Subcontractors and Suppliers must certify to the City Engineer that Contractor has fulfilled the requirements of this Section.

ARTICLE 6 - CONSTRUCTION BY THE CITY OR BY SEPARATE CONTRACTORS

6.1 *THE CITY'S RIGHT TO PERFORM CONSTRUCTION AND TO AWARD SEPARATE CONTRACTS*

6.1.1 The City may perform on-site construction operations related to the Work and as part of the Project with the City's workforce or with separate contractors.

6.2 *COORDINATION*

6.2.1 The City will coordinate activities of the City's workforce and of each separate contractor with work of Contractor, and Contractor shall cooperate with the City and separate contractors.

6.2.1.1 Contractor shall participate with other separate contractors and the City in reviewing their construction schedules when directed to do so by the Project Manager. Contractor shall make revisions to construction schedule and Contract Price deemed

necessary after joint review and mutual agreement. Construction schedules shall then constitute schedules to be used by Contractor, separate contractors, and the City, until subsequently revised.

6.2.2 Contractor shall afford to the City and to separate contractors reasonable opportunity for introduction and storage of their materials and equipment, and for performance of their activities.

6.2.3 If part of Contractor's work depends on proper execution of construction or operations by the City or a separate contractor, Contractor shall, prior to proceeding with that portion of the Work, inspect the other work and promptly report to City Engineer apparent discrepancies or defects in the other construction that would render it unsuitable for the proper execution of the Work. Failure of Contractor to report apparent discrepancies or defects in the other construction shall constitute acknowledgment that the City's or separate contractor's completed or partially completed construction is fit and proper to receive Contractor's work, except as to discrepancies or defects not then reasonably discoverable.

6.3 *MUTUAL RESPONSIBILITY*

6.3.1 The responsible party bears the costs caused by delays, by improperly timed activities, or by nonconforming construction.

6.3.2 Contractor shall promptly remedy damage caused by Contractor to completed or partially completed construction or to property of the City or separate contractor.

6.3.3 Claims or disputes between Contractor and other City contractors, or subcontractors of other City contractors, working on the Project must be submitted to binding arbitration in accordance with Construction Industry Arbitration Rules of the American Arbitration Association upon demand by any party to the dispute or by the City.

6.4 *THE CITY'S RIGHT TO CLEAN UP*

6.4.1 If dispute arises among Contractor, separate contractors, and the City as to responsibility under their respective contracts for maintaining premises and surrounding area free from waste materials and rubbish as described in Section 3.21, the City may clean up and allocate cost among those responsible, as determined by City Engineer.

ARTICLE 7 - CHANGES IN THE WORK

7.1 *CHANGES*

7.1.1 Changes in scope of the Work, subject to limitations in Article 7 and elsewhere in the Contract, may be accomplished without invalidating the Contract, or without notifying Surety by:

- 7.1.1.1 Change Order;
- 7.1.1.2 Work Change Directive; or
- 7.1.1.3 Minor Change in the Work.

7.1.2 The following types of Change Orders require City Council approval:

- 7.1.2.1 a single Change Order that exceeds five percent of Original Contract Price,
- 7.1.2.2 a Change Order which, when added to previous Change Orders, exceeds five percent of Original Contract Price,
- 7.1.2.3 a Change Order, in which the total value of increases outside of the general scope of work approved by City Council, when added to increases outside the general scope of work approved by City Council in previous Change Orders, exceeds 40 percent of the Original Contract Price, even if the net increase to the Original Contract Price is five percent or less.

  In this context, "increase" means an increase in quantity resulting from the addition of locations not within the scope of work approved by City Council, or the addition of types of goods or services not bid as unit price items.

Nothing in this Section is intended to permit an increase of the Contract Price in excess of the limit set out in TEX. LOC. GOV'T CODE ANN. §252.048 or its successor statute.

7.1.3 Contractor shall proceed promptly to execute changes in the Work provided in Modifications, unless otherwise stated in the Modification.

7.2 *WORK CHANGE DIRECTIVES*

7.2.1 A Work Change Directive cannot change Contract Price or Contract Time, but is evidence that the Parties agree that a change, ordered by directive, will be incorporated in a subsequently issued Change Order as to its effect, if any, on Contract Price or Contract Time.

7.2.2 Failure by Contractor to commence work identified in a Work Change Directive within the time specified by City Engineer, or to complete the

work in a reasonable period of time, may be determined by City Engineer to be a material breach of Contract.

7.2.3 A Work Change Directive is used in the absence of total agreement of the terms of a Change Order. Interim payments are made in accordance with Paragraph 9.6.1.

7.2.4 If Contractor signs a Work Change Directive, then Contractor agrees to its terms including adjustment in Contract Price and Contract Time or method for determining them. Agreement by the Parties to adjustments in Contract Price and Contract Time are immediately recorded as a Change Order.

7.2.5 City Engineer, by Work Change Directive, may direct Contractor to take measures as necessary to expedite construction to achieve Date of Substantial Completion on or before expiration of Contract Time. When the Work is expedited solely for convenience of the City and not due to Contractor's failure to prosecute timely completion of the Work, then Contractor is entitled to an adjustment in Contract Price equal to actual costs determined in accordance with Article 7.

7.3 *ADJUSTMENTS IN CONTRACT PRICE*

7.3.1 Adjustments in Contract Price are accomplished by Change Order and are based on one of the following methods:

- 7.3.1.1 mutual acceptance of fixed price, properly itemized and supported by sufficient data to permit evaluation;
- 7.3.1.2 unit prices stated in the Contract or subsequently agreed upon;
- 7.3.1.3 cost to be determined in a manner agreed upon by the Parties and mutually acceptable fixed or percentage fee; or
- 7.3.1.4 as provided in Paragraph 7.3.2.

7.3.2 If Contractor does not agree with a change in Contract Price or Contract Time or the method for adjusting them specified in the Work Change Directive within 21 days from date of the Work Change Directive's issuance, method and adjustment are determined by City Engineer. If Project Manager or Contractor disagree with City Engineer's determination they then may file a Claim in accordance with Section 4.4.

7.3.2.1 If City Engineer determines a method and adjustment in Contract Price under Paragraph 7.3.2, Contractor shall provide, in a form as City Engineer may prescribe, appropriate supporting data for items submitted under Paragraph 7.3.2. Failure to submit the data within 21 days of request for the data by City Engineer shall constitute waiver of a Claim.

7.3.2.2 Unless otherwise provided in the Contract, costs for the purposes of this Paragraph 7.3.2 are limited to the following:

- 7.3.2.2.1 costs of labor, including labor burden as stated below for social security, unemployment insurance, customary and usual fringe benefits required by agreement or custom, and Workers' Compensation insurance;
  - 7.3.2.2..1.1 the maximum labor burden applied to costs of labor for changes in the Work is 55 percent;
- 7.3.2.2.2 costs of materials, supplies, and equipment, including cost of transportation, whether incorporated or consumed;
- 7.3.2.2.3 rental costs of machinery and equipment, exclusive of hand tools, whether rented from Contractor or others, with prior approval of City Engineer;
- 7.3.2.2.4 costs of premiums for Bonds and insurance and permit fees related to the change in the Work;
- 7.3.2.2.5 additional costs of direct supervision of work and field office personnel directly attributable to the change; and
- 7.3.2.2.6 allowances for overhead and profit as stated below.
  - 7.3.2.2.6.1 the maximum allowances for overhead and profit on increases due to Change Orders:
  - 7.3.2.2.6.2 for changes in the Work performed by Contractor and Subcontractors, allowance for overhead and profit are applied to an amount equal to cost of all additions less cost of all deletions to the Work. Allowance for overhead to Contractor and first tier Subcontractors on changes performed by Subcontractors are applied to an amount equal to the sum of all increases to the Work by applicable Subcontractors.

	Overhead	Profit
to Contractor for change in the Work performed by Subcontractors:	10 percent	0 percent
to first tier Subcontractors for change in the Work performed by its Subcontractors:	10 percent	0 percent
to Contractor and Subcontractor for change in the Work performed by their respective firms:	10 percent	5 percent

7.3.3 If the City deletes or makes a change, which results in a net decrease in Contract Price, the City is entitled to a credit calculated in accordance with Paragraphs 7.3.1 and 7.3.2 and Subparagraphs 7.3.2.1, and 7.3.2.2.1 through 7.3.2.2.5. When both additions and credits covering related work or substitutions are involved in a change, allowance for overhead and profit is figured on the basis of a net increase, if any, with respect to that change in accordance with Subparagraph 7.3.2.2.6.

7.3.4 When Contractor agrees with the determination made by City Engineer concerning adjustments in Contract Price and Contract Time, or the Parties otherwise reach agreement upon the adjustments, the agreement will be immediately recorded by Change Order.

7.4 *MINOR CHANGES IN THE WORK*

7.4.1 A Minor Change in Work is binding on the Parties. Contractor shall acknowledge, in a written form acceptable to City Engineer, that there is no change in Contract Time or Contract Price and shall carry out the written orders promptly.

ARTICLE 8 - TIME

8.1 *PROGRESS AND COMPLETION*

8.1.1 Time is of the essence in the Contract. By executing the Contract, Contractor agrees that Contract Time is a reasonable period for performing the Work.

8.1.2 *Computation of Time:* In computing any period of time prescribed or allowed by the General Conditions, the day of the act, event, or default after which designated period of time begins to run is not to be included. Last day of the period so computed is to be included, unless it is a Sunday or Legal Holiday, in which event the period runs until end of next day which is not a Sunday or Legal Holiday. Sundays and Legal Holidays are considered to be days and are to be included in all other time computations relative to Contract Time.

8.1.3 Contractor may not commence the Work prior to the effective date of insurance and Bonds required by Article 11.

8.1.4 Contractor shall proceed expeditiously and without interruption, with adequate forces, and shall achieve Date of Substantial Completion within Contract Time.

8.1.5 Should progress of the Work fall behind construction schedule, except for reasons stated in Paragraph 8.2.1, Contractor shall promptly submit at the request of Project Manager, updated construction schedule to City Engineer for approval. Contractor's failure to submit updated schedule may, at City Engineer's discretion, constitute a material breach of the Contract. Contractor shall take action necessary to restore progress by working the hours, including night shifts and lawful overtime operations as necessary, to achieve Date of Substantial Completion within Contract Time.

8.1.6 Except in connection with safety or protection of persons or the Work or property at the site or adjacent to the site, and except as otherwise indicated in the Contract, all the Work at the site will be performed Monday through Saturday between the hours of 7:00 a.m. and 7:00 p.m. Contractor may not perform work between 7:00 p.m. and 7:00 a.m., on a Sunday, or on a Legal Holiday, without giving City Engineer 24-hour prior written notice and receiving written consent of City Engineer.

8.2 *DELAYS AND EXTENSIONS OF TIME*

8.2.1 Contractor may request extension of Contract Time for a delay in performance of work that arises from causes beyond control and without fault or negligence of Contractor. Examples of these causes are:

- 8.2.1.1 acts of God or of the public enemy;
- 8.2.1.2 acts of government in its sovereign capacity;
- 8.2.1.3 fires;
- 8.2.1.4 floods;
- 8.2.1.5 epidemics;
- 8.2.1.6 quarantine restrictions;
- 8.2.1.7 strikes;
- 8.2.1.8 freight embargoes;
- 8.2.1.9 unusually severe weather; and
- 8.2.1.10 discovery of Pollutants or Pollutant Facilities at the site.

8.2.2 For any reason other than those listed in Section 4.3.6.2, if the Contractor's work is delayed in any manner or respect, the Contractor shall have no claim for damages and shall have no right of additional compensation from the City by reason of any delay or increased expense to the Contractor's work, except for an extension of time as provided in this provision.

8.2.3 Contractor may request an extension of Contract Time for delay only if:

8.2.3.1 delay is caused by failure of Subcontractor or Supplier to perform or make progress; and

8.2.3.2 cause of failure is beyond control of both Contractor and Subcontractor or Supplier.

8.2.4 Claims relating to Contract Time must be made in accordance with Paragraph 4.3.7.

8.2.5 Claims for extending or shortening Contract Time are based on written notice promptly delivered by the Party making Claim to other Party. Claim must accurately describe occurrence generating Claim, and a statement of probable effect on progress of the Work.

8.2.6 Claims for extension of Contract Time are considered only when a Claim is filed within the time limits stated in Paragraph 4.3.3.

8.2.6.1 Notwithstanding paragraph 4.3.3, an extension of time for delays under this paragraph may be granted only upon written application by the Contractor within 48 hours from the claimed delay.

8.2.7 Written notice of Claim must be accompanied by claimant's written statement that adjustment claimed is entire adjustment to which claimant is entitled as a result of the occurrence of the event. When the Parties cannot agree, Claims for adjustment in Contract Time are determined by City Engineer in accordance with Section 4.4.

8.2.8 Adjustments to Contract Time are accomplished by Change Order.

ARTICLE 9 - PAYMENTS AND COMPLETION

9.1 *UNIT PRICE WORK*

9.1.1 Where the Contract provides that all or part of the Work is based on Unit Prices, the Original Contract Price includes, for all Unit Price work, an amount equal to the sum of Unit Prices times Unit Price Quantities for each separately identified item of Unit Price work.

9.1.2 Each Unit Price includes an amount to cover Contractor's overhead and profit for each separately identified item.

9.1.3 The Contractor may not make a Claim against the City for excess or deficiency in Unit Price Quantities provided in the Contract, except as provided in Subparagraph 9.1.4. Payment at the prices stated in the Contract is in full for the completed work. Contractor is not entitled to additional payment for materials, supplies, labor, tools, machinery and all other expenditures incidental to satisfactory completion of the Work.

9.1.4 City Engineer may increase or decrease quantities of the Work within limitations stated in Paragraph 7.1.2. Contractor is entitled to payment for actual quantities of items provided at Unit Prices set forth in the Contract.

9.1.5 Where the final quantity of work performed by Contractor on Major Unit Price Work item differs by more than 25 percent from quantity of the item stated in the Contract, a Party may request an adjustment in Unit Price, for the portion that differs by more than 25 percent, by a Change Order under Section 7.3.

9.2 *ESTIMATES FOR PAYMENT, UNIT PRICE WORK*

9.2.1 Following the day of each month indicated in the Contract, Project Manager will prepare a Certificate for Payment for the preceding monthly period based on estimated units of work completed. Prior to preparing Certificate of Payment, Contractor shall have submitted to City Engineer, on a form approved by the Director of the Office of Business Opportunity, evidence satisfactory to the City Engineer of payments made to Subcontractors and Suppliers for the month preceding the month for which the Certificate for Payment is prepared, including evidence of electronic submission of certified payrolls.

9.2.2 Before final completion, City Engineer will review and confirm with Contractor the actual final installed Unit Price quantities. City Engineer's determination of actual final installed Unit Price quantities will be included in the final Certificate for Payment and any previous underpayments and overpayments will be reconciled with the actual final Unit Price quantities. Contractor shall file written notice of intent to appeal, if any, City Engineer's

determination within 10 days of receipt of final Certificate for Payment. Upon expiration of the 10-day period, City Engineer's decision is final and binding on the Parties. If Contractor submits notice within the 10-day period, Contractor shall submit a Claim in accordance with Section 4.4.

9.3 *STIPULATED PRICE WORK*

9.3.1 For work contracted on a Stipulated Price basis, 10 days before submittal of first Application for Payment, Contractor shall submit to City Engineer a Schedule of Values allocated to various portions of the Work, prepared in the form and supported by the data as City Engineer may require to substantiate its accuracy. This schedule, as approved by City Engineer, is used as a basis for approval of Contractor's Applications for Payment.

9.4 *APPLICATIONS FOR PAYMENT, STIPULATED PRICE WORK*

9.4.1 For work contracted on a Stipulated Price basis, Contractor shall submit Applications for Payment to City Engineer each month on a form acceptable to City Engineer in accordance with Schedule of Values. Application must indicate percentages of completion of each portion of the Work listed in Schedule of Values as of the end of the period covered by the Application for Payment.

9.4.2 Applications for Payment must be supported by substantiating data as City Engineer may require and must reflect retainages as provided below. Evidence satisfactory to the City Engineer of payments made to Subcontractors and Suppliers for the month preceding the month for which the Application for Payment is submitted must accompany each Application for Payment on a form approved by the Director of the Office of Business Opportunity. Evidence of electronic submission of certified payrolls must be included. Application must be sworn and notarized.

9.5 *CERTIFICATES FOR PAYMENT*

9.5.1 City Engineer will, within 10 days after the date specified in the Contract for Unit Price work, or upon receipt of Contractor's Application for Payment for Stipulated Price work, issue a Certificate for Payment for work based on amount which City Engineer determines is properly due, with copy to Contractor.

9.5.2 Unless otherwise provided in the Contract, payment for completed work and for properly stored Products is conditioned upon compliance with procedures satisfactory to City Engineer to protect the City's interests. Procedures will include applicable insurance, storage, and transportation to site for materials and equipment stored off-site. Contractor is responsible for maintaining materials and equipment until Date of Substantial Completion.

9.5.3 Contractor shall document its use of Ultra Low Sulfur Diesel Fuel by providing invoices and receipts evidencing Contractor's use.

9.6 *COMPUTATIONS OF CERTIFICATES FOR PAYMENT*

9.6.1 Subject to the provisions of the Contract, the amount of each Certificate for Payment is calculated as follows:

- 9.6.1.1 that portion of Contract Price allocated to completed work as determined by:
  - 9.6.1.1.1 multiplying the percentage of completion of each portion of the Work listed in the Schedule of Values by the value of that portion of the Work, or
  - 9.6.1.1.2 multiplying Unit Price quantities Installed times the Unit Prices listed in the Contract;
- 9.6.1.2 plus progress payments for completed work that has been properly authorized by Modifications;
- 9.6.1.3 less retainage of five percent;
- 9.6.1.4 plus actual costs, properly substantiated by certified copies of invoices and freight bills, of non-perishable materials and equipment delivered and properly stored, if approved in advance by Project Manager, less 15 percent;
- 9.6.1.5 less any previous payments by the City.

9.7 *DECISIONS TO WITHHOLD CERTIFICATION*

9.7.1 City Engineer may decline to certify payment and may withhold payment in whole or in part to the extent reasonably necessary to protect the City if, in City Engineer's opinion, there is reason to believe that:

- 9.7.1.1 nonconforming work has not been remedied;
- 9.7.1.2 the Work cannot be completed for unpaid balance of Contract Price;
- 9.7.1.3 there is damage to the City or another contractor;
- 9.7.1.4 the Work will not be completed within Contract Time and that unpaid balance

will not be adequate to cover actual and liquidated damages;

9.7.1.5 probable evidence that third party claims will be filed in court, in arbitration, or otherwise;

9.7.1.6 Contractor has failed to make payments to Subcontractors or Suppliers for labor, material, or equipment; or

9.7.1.7 Contractor has persistently failed to carry out work in accordance with the Contract.

9.7.1.8 Contractor has not paid Subcontractors or Suppliers because of a payment dispute; or

9.7.1.9 Contractor has failed to provide satisfactory evidence described in Paragraphs 9.2.1, 9.4.2, and 9.8.2.

9.7.2 When the above reasons for withholding certification are removed, certification will be made for amounts previously withheld.

9.7.3 City Engineer may decline to certify payment and may withhold request for payment in whole or in part upon failure of Contractor to submit initial construction schedule or monthly schedule updates, as required in Paragraphs 3.15.1 and 3.15.3.

9.8 *PROGRESS PAYMENTS*

9.8.1 The City will make payment, in an amount certified by City Engineer, within 20 days after City Engineer has issued a Certificate for Payment.

9.8.2 The City has no obligation to pay or to facilitate the payment to a Subcontractor or Supplier, except as may otherwise be required by law. Contractor shall comply with the prompt payment requirements of Chapter 2251 of the Government Code. State law requires payment of Subcontractors and Suppliers by Contractor within 7 calendar days of Contractor's receipt of payment from the City, unless there is a payment dispute between Contractor and a Subcontractor or Supplier evidenced on a form approved by the Director of Mayor's Office of Business Opportunity and submitted to the City Engineer each month with Application for Payment or Estimate for Payment. **CONTRACTOR SHALL DEFEND AND INDEMNIFY THE CITY FROM ANY CLAIMS OR LIABILITY ARISING OUT OF CONTRACTOR'S FAILURE TO MAKE THESE PAYMENTS.**

9.8.2.1 The City may, upon request and at the discretion of City Engineer, furnish to Subcontractor information regarding percentages of completion or the amounts applied for by Contractor, and action taken thereon by the City because of work done by the Subcontractor.

9.8.2.2 Contractor shall prepare and submit to City Engineer a Certification of Payment to Subcontractors and Suppliers form to be attached to each monthly Estimate for Payment or Application for Payment.

9.8.3 A Certificate for Payment, a progress payment, or partial or entire use or occupancy of the Work by the City, does not constitute acceptance of work which is not in accordance with the Contract.

9.9 *DATE OF SUBSTANTIAL COMPLETION*

9.9.1 When Contractor considers the Work, or a portion thereof designated by City Engineer, to be substantially complete, Contractor shall prepare and submit to Project Manager a comprehensive punch list of items to be completed or corrected. Failure to include an item on the punch list does not alter the responsibility of Contractor to comply with the Contract.

9.9.1.1 By submitting the punch list to Project Manager, Contractor represents that work on the punch list will be completed within the time provided for in Subparagraph 9.9.4.3.

9.9.2 Upon receipt of Contractor's punch list, Project Manager will inspect the Work, or designated portion thereof, to verify that the punch list contains all items needing completion or correction. If Project Manager's inspection discloses items not on Contractor's punch list, the items must be added to the punch list of items to be completed or corrected. If Project Manager's inspection reveals that Contractor is not yet substantially complete, Contractor shall complete or correct the deficiencies and request another inspection by Project Manager. The City may recover the costs of re-inspection from Contractor.

9.9.3 Prior to City Engineer's issuing a Certificate of Substantial Completion, Contractor shall also provide:

9.9.3.1 Certificate of Occupancy for new construction, or Certificate of Compliance for remodeled work, as applicable, and

9.9.3.2 compliance with Texas Accessibility Standards through state inspection of the Work, if required. If Contractor calls for inspection in a timely manner and the inspection is delayed through no fault of Contractor, and City Engineer so confirms, City Engineer may, upon request by Contractor, add the inspection to the punch list in Paragraph 9.9.2 and issue a Certificate of Substantial Completion.

9.9.4 When the Work, or designated portion thereof, is determined by City Engineer to be sufficiently complete in accordance with the Contract so the City can occupy or utilize the Work, or designated portion thereof, for the purpose for which it is intended, City Engineer will prepare a Certificate of Substantial Completion that incorporates the punch list in Paragraph 9.9.2 and establishes:

9.9.4.1 Date of Substantial Completion;

9.9.4.2 responsibilities of the Parties for security, maintenance, heating, ventilating and air conditioning, utilities, damage to the Work, and insurance; and

9.9.4.3 fixed time within which Contractor shall complete all items on punch list of items to be corrected accompanying the certificate.

9.9.5 Warranties required by the Contract shall commence on the Date of Substantial Completion unless otherwise provided by City Engineer in Certificate of Substantial Completion. Warranties may not commence on items not substantially completed.

9.9.6 After Date of Substantial Completion and upon application by Contractor and approval by City Engineer, the City may make payment, reflecting adjustment in retainage, if any, as follows:

9.9.6.1 with the consent of Surety, the City may increase payment to Contractor to 96 percent of Contract Price, less value of items to be completed and accrued liquidated damages.

9.9.7 Contractor shall complete or correct the items in Paragraph 9.9.2 within the time period set out in the Certificate of Substantial Completion. If Contractor fails to do so, the City may issue a Notice of Noncompliance and proceed according to Section 2.5.

9.10 *PARTIAL OCCUPANCY OR USE*

9.10.1 The City may occupy or use any completed or partially completed portion of the Work at any stage, provided the occupancy or use is consented to by Contractor and Contractor's insurer and authorized by public authorities having jurisdiction over the Work. Consent of Contractor to partial occupancy or use may not be unreasonably withheld.

9.10.2 Immediately prior to the partial occupancy or use, Project Manager and Contractor shall jointly inspect the area to be occupied or portion of the Work to be used to determine and record condition of the Work.

9.10.3 Partial occupancy or use of a portion of the Work does not constitute acceptance of work not in compliance with requirements of the Contract.

9.11 *FINAL COMPLETION AND FINAL PAYMENT*

9.11.1 Contractor shall review the Contract and inspect the Work prior to Contractor notification to City Engineer that the Work is complete and ready for final inspection. Contractor shall submit affidavit that the Work has been inspected and that the Work is complete in accordance with requirements of the Contract.

9.11.2 Project Manager will make final inspection within 15 days after receipt of Contractor's written notice that the Work is ready for final inspection and acceptance. If Project Manager finds the Work has been completed in accordance with the Contract, Contractor shall submit items set out in Paragraph 9.11.4 and, for stipulated price contracts, a final Application for Payment. City Engineer will, within 10 days, issue Certificate of Final Completion stating that to the best of City Engineer's knowledge, information, and belief, the Work has been completed in accordance with the Contract, and will recommend acceptance of the Work by City Council.

9.11.3 Should work be found not in compliance with requirements of the Contract, City Engineer will notify Contractor in writing of items of noncompliance. Upon inspection and acceptance of the corrections by Project Manager, compliance with all procedures of Paragraph 9.11.2, and Contractor's submission of the items set out in Paragraph 9.11.4, the City Engineer will issue Certificate of Final Completion to Contractor as provided in Paragraph 9.11.2.

9.11.4 Contractor shall submit the following items to City Engineer before City Engineer will issue a Certificate of Final Completion:

9.11.4.1 affidavit that payrolls, invoices for materials and equipment, and other indebtedness of Contractor connected

with the Work, less amounts withheld by the City, have been paid or otherwise satisfied. If required by City Engineer, Contractor shall submit further proof including waiver or release of lien or claims from laborers or Suppliers of Products;

9.11.4.2 certificate evidencing that insurance required by the Contract to remain in force after final payment is currently in effect, will not be canceled or materially changed until at least 30 days written notice has been given to the City;

9.11.4.3 written statement that Contractor knows of no substantial reason that insurance will not be renewable to cover correction and warranty period required by the Contract;

9.11.4.4 consent of Surety to final payment; and

9.11.4.5 copies of record documents, maintenance manuals, tests, inspections, and approvals.

Upon City Engineer's issuance of a Certificate of Final Completion, Contractor may request increase in payment to 99 percent of Contract Price, less accrued liquidated damages.

9.11.5 If Contractor fails to submit required items in Paragraph 9.11.4 within 10 days of Project Manager's inspection of the Work under Paragraph 9.11.2 or Paragraph 9.11.3, City Engineer may, but is not obligated to:

9.11.5.1 deduct liquidated damages accrued from monies held;

9.11.5.2 proceed to City Council for acceptance of the Work, minus some or all of the items Contractor fails to submit under Paragraph 9.11.4; and,

9.11.5.3 upon acceptance by City Council of the portion of the Work completed, make final payment as set out in Paragraph 9.11.8.

9.11.6 If final completion is materially delayed through no fault of Contractor, or by issuance of Change Orders affecting date of final completion, and City Engineer so confirms, the City may, upon application by Contractor and certification by City Engineer, and without terminating the Contract, make payment of balance due for that portion of the Work fully completed and accepted.

9.11.7 If remaining balance due for work not corrected is less than retainage stipulated in the Contract, Contractor shall submit to City Engineer written consent of Surety to payment of balance due for that portion of the Work fully completed and accepted, prior to certification of the payment. The payment is made under terms governing final payment, except that it does not constitute waiver of Claims.

9.11.8 The City will make final payment to Contractor within 30 days after acceptance of the Work by City Council, subject to limitations, if any, as stated in the Contract.

9.11.9 Acceptance of final payment by Contractor shall constitute a waiver of all Claims, whether known or unknown, by Contractor, except those previously made in writing and identified by Contractor as unsettled at time of final Application for Payment.

9.12 *LIQUIDATED DAMAGES*

9.12.1 Contractor, Surety, and the City agree that failure to complete the Work within Contract Time will cause damages to the City and that actual damages from harm are difficult to estimate accurately. Therefore, Contractor, Surety, and the City agree that Contractor and Surety are liable for and shall pay to the City the amount stipulated in Supplementary Conditions as liquidated damages, and that the amount of damages fixed therein is a reasonable forecast of just compensation for harm to the City resulting from Contractor's failure to complete the Work within Contract Time. The amount stipulated will be paid for each day of delay beyond Contract Time until Date of Substantial Completion.

9.12.2 Contractor shall pay the City an amount equal to $1,200.00 per diesel operating vehicle or piece of motorized equipment per incident of high sulfur diesel fuel usage.

ARTICLE 10 - SAFETY PRECAUTIONS

10.1 *SAFETY PROGRAMS*

10.1.1 Contractor is responsible for initiating, maintaining, and supervising all safety precautions and programs in connection with performance of the Contract. Contractor shall submit a safety program to City Engineer prior to mobilizing for the Work, and is solely responsible for safety, efficiency, and adequacy of ways, means, and methods, and for damage which might result from failure or improper construction, maintenance, or operation performed by Contractor.

10.2 *POLLUTANTS AND POLLUTANT FACILITIES*

10.2.1 If Contractor encounters material on-site which it reasonably believes to be a Pollutant or facilities which it reasonably believes to be a Pollutant Facility, Contractor shall immediately stop work in affected area and immediately notify City Engineer, confirming the notice thereafter in writing.

10.2.2 If City Engineer determines that the material is a Pollutant or facility is a Pollutant Facility, work in affected area may not be resumed except by Modification, and only if the work would not violate applicable laws or regulations.

10.2.3 If City Engineer determines that the material is not a Pollutant or a facility is not a Pollutant Facility, work in affected area will be resumed upon issuance of a Modification.

10.2.4 Contractor is not required to perform, unless authorized by Change Order, work relating to Pollutants or Pollutant Facilities except for that work relating to Pollutants or Pollutant Facilities specified in the Contract.

10.3 *SAFETY OF THE ENVIRONMENT, PERSONS, AND PROPERTY*

10.3.1 Contractor shall take reasonable precautions for safety and shall provide reasonable protection to prevent damage, injury, or loss from all causes, to:

10.3.1.1 employees performing work on-site, and other persons who may be affected thereby;

10.3.1.2 work, including Products to be incorporated into the Work, whether in proper storage, under control of Contractor or Subcontractor; and

10.3.1.3 other property at or adjacent to the site, such as trees, shrubs, lawns, walks, pavements, roadways, structures, utilities, and Underground Facilities not designated for removal or replacement in course of construction.

10.3.2 Contractor shall give notices and comply with applicable laws, ordinances, rules, regulations, and lawful orders of public authorities bearing on safety of persons, property, or environment.

10.3.2.1 Contractor shall comply with requirements of Underground Facility Damage Prevention and Safety Act TEX. UTIL. CODE ANN. Ch. 251 (Vernon Supp. 2002).

10.3.2.2 Contractor shall comply with all safety rules and regulations of the Federal Occupational Health and Safety Act of 1970 and subsequent amendments (OSHA).

10.3.3 Contractor shall erect and maintain, as required by existing conditions and performance of the Contract, reasonable safeguards for safety and protection of persons and property, including posting danger signs and other warnings against hazards, promulgating safety regulations, and notifying owners and users of adjacent sites and utilities.

10.3.4 Contractor shall designate responsible member of Contractor's organization at site whose duty is prevention of accidents. This person will be Contractor's Superintendent unless otherwise designated by Contractor in writing to City Engineer.

10.3.5 Contractor shall prevent windblown dust and may not burn or bury trash debris or waste products on-site. Contractor shall prevent environmental pollution, including but not limited to particulates, gases and noise, as a result of the Work.

10.3.6 When use or storage of hazardous materials or equipment, or unusual methods are necessary for execution of the Work, Contractor shall exercise utmost care and carry on the activities under supervision of properly qualified personnel.

10.3.7 Contractor shall promptly remedy damage and loss to property referred to in Subparagraphs 10.3.1.2 and 10.3.1.3, caused in whole or in part by Contractor, or Subcontractors, which is not covered by insurance required by the Contract. Contractor is not required to remedy damage or loss attributable to the City, Design Consultant, or other contractors.

10.4 *EMERGENCIES*

10.4.1 In emergencies affecting safety of persons or property, Contractor shall act at Contractor's discretion to prevent imminent damage, injury, or loss. Additional compensation or extension of time claimed by Contractor because of emergencies are determined as provided in Article 7.

ARTICLE 11 - INSURANCE AND BONDS

11.1 *GENERAL INSURANCE REQUIREMENTS*

11.1.1 With no intent to limit Contractor's liability under indemnification provisions set forth in Paragraphs 3.25 and 3.26, Contractor shall provide and maintain in full force and effect during term of the Contract and all extensions and amendments thereto, at least the following insurance and available limits of liability.

11.1.2 If any of the following insurance is written as "claims made" coverage and the City is required to be carried as additional insured, then Contractor's insurance shall include a two-year extended discovery period after last date that Contractor provides any work under the Contract.

11.1.3 Aggregate amounts of coverage, for purposes of the Contract, are agreed to be amounts of coverage available during fixed 12-month policy period.

11.2 *INSURANCE TO BE PROVIDED BY CONTRACTOR*

11.2.1 *Risks and Limits of Liability:* Contractor shall maintain the insurance coverages in the listed amounts, as set out in Table 1.

11.2.2 If Limit of Liability for Excess Coverage is $2,000,000 or more, Limit of Liability for Employer's Liability may be reduced to $500,000.

11.2.3 *Insurance Coverage*: At all times during the term of this Contract and any extensions or renewals, Contractor shall provide and maintain insurance coverage that meets the Contract requirements. Prior to beginning performance under the Contract, at any time upon the Director's request, or each time coverage is renewed or updated, Contractor shall furnish to the Director current certificates of insurance, endorsements, all policies, or other policy documents evidencing adequate coverage, as necessary. Contractor shall be responsible for and pay (a) all premiums and (b) any claims or losses to the extent of any deductible amounts. Contractor waives any claim it may have for premiums or deductibles against the City, its officers, agents, or employees. Contractor shall also require all subcontractors or consultants whose subcontracts exceed $100,000 to provide proof of insurance coverage meeting all requirements stated above except amount. The amount must be commensurate with the amount of the subcontract, but no less than $500,000 per claim.

11.2.4 *Form of insurance*: The form of the insurance shall be approved by the Director and the City Attorney; such approval (or lack thereof) shall never (a) excuse non-compliance with the terms of this Section, or (b) waive or estop the City from asserting its rights to terminate this Contract. The policy issuer shall (1) have a Certificate of Authority to transact insurance business in Texas, or (2) be an eligible non-admitted insurer in the State of Texas and have a Best's rating of at least B+, and a Best's Financial Size Category of Class VI or better, according to the most current Best's Key Rating Guide. Each insurer is subject to approval by City Engineer in City Engineer's sole discretion as to conformance with these requirements.

11.2.5 *Required Coverage*: The City shall be an Additional Insured under this Contract, and all policies except Professional Liability and Worker's Compensation must name the City as an Additional Insured. Contactor waives any claim or right of subrogation to recover against the City, its officers, agents, or employees, and each of Contractor's insurance policies except professional liability must contain coverage waiving such claim. Each policy, except Workers' Compensation and Professional Liability, must also contain an endorsement that the policy is primary to any other insurance available to the Additional Insured with respect to claims arising under this Contract. If professional liability coverage is written on a "claims made" basis, Contractor shall also provide proof of renewal each year for two years after substantial completion of the Project, or in the alternative: evidence of extended reporting period coverage for a period of two years after substantial completion, or a project liability policy for the Project covered by this Contract with a duration of two years after substantial completion.

11.2.6 *Deductibles:* Contractor assumes and bears any claims or losses to extent of deductible amounts and waives any claim it may ever have for same against the City, its officers, agents, or employees.

11.2.7 *Notice*: **CONTRACTOR SHALL GIVE 30 DAYS' ADVANCE WRITTEN NOTICE TO THE DIRECTOR IF ANY OF ITS INSURANCE POLICIES ARE CANCELED OR NON-RENEWED**. Within the 30-day period, Contractor shall provide other suitable policies in order to maintain the required coverage. If Contractor does not comply with this requirement, the Director, at his or her sole discretion, may immediately suspend Contractor from any further performance under this Agreement and begin procedures to terminate for default.

11.2.8 *Subrogation:* Contractor waives any claim or right of subrogation to recover against the City, its officers, agents, or employees. Each policy,

except professional liability, must contain an endorsement waiving such claim.

11.2.9 *Endorsement of Primary Insurance:* Each policy, except Workers' Compensation policies, must contain an endorsement that the policy is primary insurance to any other insurance available to additional insured with respect to claims arising hereunder.

11.2.10 *Liability for Premium:* Contractor is solely responsible for payment of all insurance premium requirements hereunder and the City is not obligated to pay any premiums.

11.2.11 *Additional Requirements for Workers' Compensation Insurance Coverage:* Contractor shall, in addition to meeting the obligations set forth in Table 1, maintain throughout the term of the Contract Workers' Compensation coverage as required by statute, and Contractor shall specifically comply with requirements set forth in Paragraph 11.2.10. The definitions set out below shall apply only for purposes of this Paragraph 11.2.10.

11.2.12 Definitions:

11.2.12.1 *Certificate of Coverage:* A copy of certificate of insurance, or coverage agreement (TWCC-81, TWCC-82, TWCC-83, or TWCC-84), showing statutory Workers' Compensation insurance coverage for Contractor's, Subcontractor's, or Supplier's employees providing services for the duration of the Contract.

11.2.12.2 *Duration of the Work:* Includes the time from Date of Commencement of the Work until Contractor's work under the Contract has been completed and accepted by City Council.

11.2.12.3 *Persons providing services for the Work (Subcontractor in Texas Labor Code § 406.096):* includes all persons or entities performing all or part of services Contractor has undertaken to perform on the Work, regardless of whether that person contracted directly with Contractor and regardless of whether that person has employees. This includes, without limitation, independent contractors, subcontractors, leasing companies, motor carriers, owner-operators, employees of the entity, or employees of entity which furnishes persons to provide services on the Work. Services include, without limitation, providing, hauling, or delivering equipment or materials, or providing labor, transportation, or other service related to the Work. Services do not include activities unrelated to the Work, such as food/beverage vendors, office supply deliveries, and delivery of portable toilets.

11.2.13 Contractor shall provide coverage, based on proper reporting of classification codes and payroll amounts and filing of coverage agreements, which meets the statutory requirements of TEX. LAB. CODE ANN., Section 401.011(44) for employees of Contractor providing services on the Work, for duration of the Work.

11.2.14 Contractor shall provide a Certificate of Coverage to the City prior to being awarded the Contract.

11.2.15 If coverage period shown on Contractor's original Certificate of Coverage ends during duration of the Work, Contractor shall file new Certificate of Coverage with the City showing that coverage has been extended.

11.2.16 Contractor shall obtain from each person providing services on the Work, and provide to City Engineer:

11.2.16.1 Certificate of Coverage, prior to that person beginning work on the Work, so the City will have on file Certificates of Coverage showing coverage for all persons providing services on the Work; and

11.2.16.2 no later than seven days after receipt by Contractor, new Certificate of Coverage showing extension of coverage, if coverage period shown on current Certificate of Coverage ends during the duration of the Work.

11.2.17 Contractor shall retain all required Certificates of Coverage for the duration of the Work and for one year thereafter.

11.2.18 Contractor shall notify City Engineer in writing by certified mail or personal delivery, within 10 days after Contractor knew or should have known, of any change that materially affects provision of coverage of any person providing services on the Work.

11.2.19 Contractor shall post on-site a notice, in text, form and manner prescribed by Texas Workers'

Compensation Commission, informing all persons providing services on the Work that they are required to be covered, and stating how person may verify coverage and report lack of coverage.

11.2.20 Contractor shall contractually require each person with whom it contracts to provide services on the Work to:

11.2.20.1 provide coverage, based on proper reporting of classification codes, payroll amounts and filing of any coverage agreements, which meets statutory requirements of TEX. LAB. CODE ANN., Section 401.011(44) for all its employees providing services on the Work, for the duration of the Work;

11.2.20.2 provide to Contractor, prior to that person's beginning work on the Work, a Certificate of Coverage showing that coverage is being provided for all employees of the person providing services on the Work, for the duration of the Work;

11.2.20.3 provide Contractor, prior to the end of the coverage period, a new Certificate of Coverage showing extension of coverage, if the coverage period shown on the current Certificate of Coverage ends during the duration of the Work;

11.2.20.4 obtain from each other person with whom it contracts, and provide to Contractor: (1) Certificate of Coverage, prior to other person's beginning work on the Work; and (2) new Certificate of Coverage showing extension of coverage, prior to end of coverage period, if coverage period shown on the current Certificate of Coverage ends during duration of the Work.

11.2.20.5 retain all required Certificates of Coverage on file for the duration of the Work and for one year thereafter;

11.2.20.6 notify City Engineer in writing by certified mail or personal delivery within 10 days after person knew, or should have known, of change that materially affects provision of coverage of any person providing services on the Work; and

11.2.20.7 contractually require each person with whom it contracts to perform as required by Paragraphs 11.2.10.1 through 11.2.10.7, with Certificates of Coverage to be provided to person for whom they are providing services.

11.2.21 By signing the Contract or providing or causing to be provided a Certificate of Coverage, Contractor is representing to the City that all employees of Contractor who will provide services on the Work will be covered by Workers' Compensation coverage for the duration of the Work, that coverage will be based on proper reporting of classification codes and payroll amounts, and that all coverage agreements will be filed with appropriate insurance carrier. Contractor is not allowed to self-insure Workers' Compensation. Contractor may be subject to administrative penalties, criminal penalties, civil penalties, or other civil actions for providing false or misleading information.

11.2.22 Contractor's failure to comply with Paragraph 11.2.10 is a breach of the Contract by Contractor, which entitles the City to declare the Contract void if Contractor does not remedy breach within 10 days after receipt of notice of breach from City Engineer.

11.2.23 *Subcontractor Insurance Requirements:* Contractor shall require Subcontractors and Suppliers to obtain Commercial General Liability, Workers' Compensation, Employer's Liability and Automobile Liability coverage that meets all the requirements of Paragraph 11.2. The amount must be commensurate with the amount of the subcontract, but not less than $500,000 per occurrence. Contractor shall require all Subcontractors with whom it contracts directly, whose subcontracts exceed $100,000, to provide proof of Commercial General Liability and Automobile Liability insurance coverage meeting the above requirements. Contractor shall comply with all requirements set out under Paragraph 11.2.10 as to Workers' Compensation Insurance for all Subcontractors and Suppliers.

REQUIRED COVERAGE

(Coverage)	(Limit of Liability)
.1 Workers' Compensation	• Statutory Limits for Workers' Compensation
.2 Employer's Liability	• Bodily Injury by Accident $1,000,000 (each accident) • Bodily Injury by Disease $1,000,000 (policy limit) • Bodily Injury by Disease $1,000,000 (each employee)
.3 Commercial General Liability: Including Contractor's Protective, Broad Form Property Damage, Contractual Liability, Explosion, Underground and Collapse, Bodily Injury, Personal Injury, Products, and Completed Operations (for a period of one year following completion of the Work).	• Combined single limit of $1,000,000 (each occurrence), subject to general aggregate of $1,000,000; • Products and Completed Operations $1,000,000 aggregate.
.4 Owner's and Contractor's Protective Liability	• $1,000,000 combined single limit each Occurrence/ aggregate
.5 Installation Floater (Unless alternative coverage approved by City Attorney)	• Value of stored material or equipment, listed on Certificates of Payments, but not yet incorporated into the Work
.6 Automobile Liability Insurance: (For automobiles furnished by Contractor in course of his performance under the Contract, including Owned, Non-owned, and Hired Auto coverage)	• $1,000,000 combined single limit each occurrence for (1) Any Auto or (2) All Owned, Hired, and Non-Owned Autos
.7 Excess Coverage	• $1,000,000 each occurrence/combined aggregate in excess of limits specified for Employer's Liability, Commercial General Liability, and Automobile Liability
Aggregate Limits are per 12-month policy period unless otherwise indicated.	

11.3 *PROOF OF INSURANCE*

11.3.1 Prior to commencing services and at time during the term of the Contract, Contractor shall furnish City Engineer with Certificates of Insurance, along with Affidavit from Contractor confirming that Certificate accurately reflects insurance coverage that is available during term of the Contract. If requested in writing by City Engineer, Contractor shall furnish City Engineer with certified copies of Contractor's actual insurance policies. Failure of Contractor to provide certified copies, as requested, may be deemed, at City Engineer's or City Attorney's discretion, a material breach of the Contract.

11.3.2 Notwithstanding the proof of insurance requirements, Contractor shall continuously maintain in effect required insurance coverage set forth in Paragraph 11.2. Failure of Contractor to comply with this requirement does constitute a material breach by Contractor allowing the City, at its option, to immediately suspend or terminate work, or exercise any other remedy allowed under the Contract. Contractor agrees that the City has not waived or is not estopped to assert a material breach of the Contract because of any acts or omissions by the City regarding its review or non-review of insurance documents provided by Contractor, its agents, employees, or assigns.

11.3.3 Contractor shall provide updated certificates of insurance to the Director upon request. The Contractor shall be responsible for delivering a current certificate of insurance in the proper form to the Director as long as Contractor is required to furnish insurance coverage under Paragraph 11.2.

11.3.4 Every certificate of insurance Contractor delivers in connection with this Contract shall

11.3.4.1 be less than 12 months old;

11.3.4.2 include all pertinent identification information for the Insurer, including the company name and address, policy

number, NAIC number or AMB number, and authorized signature;

11.3.4.3 include in the Certificate Holder Box the Project name and reference numbers, contractor's email address, and indicates the name and address of the Project Manager;

11.3.4.4 include the Contractor's email address in the Certificate Holder Box;

11.3.4.5 include the Project reference numbers on the City address so the Project reference number is visible in the envelope window; and

11.3.4.6 be appropriately marked to accurately identify all coverages and limits of the policy, effective and expiration dates, and waivers of subrogation in favor of the City for Commercial General Liability, Automobile Liability, and Worker's Compensation/Employers' Liability.

11.4 *PERFORMANCE AND PAYMENT BONDS*

11.4.1 For Contracts over the value of $25,000, Contractor shall provide Bonds on the City's standard forms covering faithful performance of the Contract and payment of obligations arising thereunder as required in the Contract pursuant to Chapter 2253 of the Government Code. The Bonds must be for 100 percent of Original Contract Price and in accordance with conditions stated on standard City Performance and Payment Bond and Statutory Payment Bond forms. Bonds may be obtained from Contractor's usual source and cost for the Bonds are included in Contract Price.

11.5 *MAINTENANCE BONDS*

11.5.1 *One-year Maintenance Bond:* Contractor shall provide Bond on standard City One-year Maintenance Bond form, providing for Contractor's correction, replacement, or restoration of any portion of the Work which is found to be not in compliance with requirements of the Contract during one-year correction period required in Paragraph 12.2. The Maintenance Bond must be for 100 percent of the Original Contract Price.

11.6 *SURETY*

11.6.1 A Bond that is given or tendered to the City pursuant to the Contract must be executed by a surety company that is authorized and admitted to write surety Bonds in the State of Texas.

11.6.2 If a Bond is given or tendered to the City pursuant to the Contract in an amount greater than 10 percent of Surety's capital and surplus, Surety shall provide certification that Surety has reinsured that portion of the risk that exceeds 10 percent of Surety's capital and surplus. The reinsurance must be with one or more reinsurers who are duly authorized, accredited, or trusted to do business in the State of Texas. The amount reinsured by reinsurer may not exceed 10 percent of reinsurer's capital and surplus. The amount of allowed capital and surplus must be based on information received from State Board of Insurance.

11.6.3 If the amount of a Bond is greater than $100,000, Surety shall:

11.6.3.1 also hold certificate of authority from the United States Secretary of Treasury to qualify as surety on obligations permitted or required under federal law; or,

11.6.3.2 Surety may obtain reinsurance for any liability in excess of $100,000 from reinsurer that is authorized and admitted as a reinsurer in the State of Texas and is the holder of a certificate of authority from the United States Secretary of the Treasury to qualify as surety or reinsurer on obligations permitted or required under federal law.

11.6.4 Determination of whether Surety on the Bond or the reinsurer holds a certificate of authority from the United States Secretary of the Treasury is based on information published in Federal Register covering the date on which Bond was executed.

11.6.5 Each Bond given or tendered to the City pursuant to the Contract must be on City forms with no changes made by Contractor or Surety, and must be dated, executed, and accompanied by power of attorney stating that the attorney in fact executing such the bond has requisite authority to execute such Bond. The Bonds must be dated and must be no more than 30 days old.

11.6.6 Surety shall designate in its Bond, power of attorney, or written notice to the City, an agent resident in Harris County to whom any requisite notices may be delivered and on whom service of process may be had in matters arising out of the suretyship.

11.6.7 Contractor shall furnish information to a payment bond beneficiary as required by TEX. GOV'T CODE ANN. CH. 2253.

11.7 *DELIVERY OF BONDS*

11.7.1 Contractor shall deliver required Bonds to the City within time limits stated in Notice of Intent to Award and prior to Date of Commencement of the Work.

ARTICLE 12 - UNCOVERING AND CORRECTION OF THE WORK

12.1 *UNCOVERING OF THE WORK*

12.1.1 If a portion of the Work has been covered which City Engineer has not specifically requested to observe prior to its being covered, City Engineer may request to see such work and it must be uncovered by Contractor. If such work is in accordance with the Contract, the costs of uncovering and covering such work are charged to the City by Change Order. If such work is not in accordance with the Contract, Contractor shall pay for uncovering and shall correct the nonconforming Work promptly after receipt of Notice of Noncompliance to do so.

12.2 *CORRECTION OF THE WORK*

12.2.1 Contractor shall promptly correct or remove work rejected by City Engineer or work failing to conform to requirements of the Contract, whether observed before or after Date of Substantial Completion and whether fabricated, Installed, or completed.

12.2.2 Contractor bears costs of correcting the rejected or nonconforming work including additional testing and inspections, and compensation for Design Consultant's services and expenses made necessary thereby.

12.2.3 If within one year after Date of Substantial Completion, or after date for commencement of warranties established under Paragraph 9.9.5 or by other applicable special warranty required by the Contract, whichever is later in time, any of the Work is found not to be in accordance with the requirements of the Contract, Contractor shall correct such work promptly after receipt of Notice of Noncompliance to do so.

12.2.4 One-year correction period for portions of the Work completed after Date of Substantial Completion will begin on the date of acceptance of that portion of the Work. This obligation under this Paragraph survives acceptance of the Work under the Contract and termination of the Contract.

12.2.5 The one-year correction period does not establish a duration for the Contractor's general warranty under Paragraph 3.12. The City retains the right to recover damages from the Contractor as long as may be permitted by the applicable statute of limitations.

12.2.6 If Contractor does not proceed with correction of the nonconforming work within time fixed by Notice of Noncompliance, the City may correct nonconforming work or remove nonconforming work and store salvageable Products at Contractor's expense. Contractor shall pay the costs of correction of nonconforming work and removal and storage of salvageable Products to the City. If Contractor does not pay costs of the correction or removal and storage within 10 days after written notice, the City may sell the Products at auction or at private sale. The City will account for proceeds thereof after deducting costs and damages that would have been borne by Contractor, including compensation for services of Design Consultant and necessary expenses. If the proceeds of sale do not cover costs which Contractor should have borne, Contractor shall pay the value of the deficiency to the City.

12.2.7 Contractor bears cost of correcting work originally installed by Contractor, the City, or by separate contractors and damaged by Contractor's correction or removal of Contractor's work.

12.3 *ACCEPTANCE OF NONCONFORMING WORK*

12.3.1 If City Engineer prefers to accept work which is not in accordance with requirements of the Contract, City Engineer may do so only by issuance of Change Order, instead of requiring its removal and correction. City Engineer will determine Contract Price reduction. The reduction will become effective even if final payment has been made.

ARTICLE 13 - MISCELLANEOUS PROVISIONS

13.1 *GOVERNING LAWS*

13.1.1 The Contract is subject to the laws of the State of Texas, the City Charter and Ordinances, the laws of the federal government of the United States, and all rules and regulations of any regulatory body or officer having jurisdiction.

13.1.2 Venue for any litigation relating to the Contract is Harris County, Texas.

13.2 *SUCCESSORS*

13.2.1 The Contract binds and benefits the Parties and their legal successors and permitted assigns; however, this Paragraph 13.2.1 does not alter the restrictions on assignment and disposal of assets set out in Paragraph 13.3.1. The Contract does not create any personal liability on the part of any officer or agent of the City.

13.3 *BUSINESS STRUCTURE AND ASSIGNMENTS*

13.3.1 Contractor may not assign the Contract at law or otherwise, or dispose of all or substantially all of its assets without City Engineer's prior written consent. Nothing in this Section, however, prevents the assignment of accounts receivable or the creation of a security interest as described in §9.406 of the Texas Business & Commerce Code. In the case of such an assignment, Contractor shall immediately furnish the City with proof of the assignment and the name, telephone number, and address of the assignee and a clear identification of the fees to be paid to the assignee.

13.3.2 Any series, as defined by the TEX. BUS. ORG. CODE ANN., affiliate, subsidiary, or successor to which Contractor assigns or transfers assets shall join in privity and be jointly and severally liable under this Contract.

13.4 *WRITTEN NOTICE*

13.4.1 All notices required or permitted by the Contract must be in writing and must be effected by hand delivery; registered or certified mail, return receipt requested; or facsimile with confirmation copy mailed to receiving Party. Notice is sufficient if made or addressed with proper postage to the address stated in the Agreement for each Party ("Notice Address") or faxed to the facsimile number stated in the Agreement for each Party. The notice is deemed delivered on the earlier of:

13.4.1.1 the date the Notice is actually received;

13.4.1.2 the third day following deposit in a United States Postal Service post office or receptacle; or

13.4.1.3 the date the facsimile is sent unless the facsimile is sent after 5:00 p.m. local time of the recipient and then it is deemed received on the following day.

Any Party may change its Notice Address or facsimile number at any time by giving written notice of the change to the other Party in the manner provided for in this Paragraph at least 15 days prior to the date the change is affected.

13.5 *RIGHTS AND REMEDIES*

13.5.1 Duties and obligations imposed by the Contract and rights and remedies available thereunder are in addition to and not a limitation of duties, obligations, rights, and remedies otherwise imposed or available by law.

13.5.2 No act or failure to act by the City or Contractor is a waiver of rights or duties afforded them under the Contract, nor is the act or failure to act constitute approval of or acquiescence in a breach of the Contract. No waiver, approval or acquiescence is binding unless in writing and, in the case of the City, signed by City Engineer.

13.6 *TESTS AND INSPECTIONS*

13.6.1 Contractor shall give City Engineer, Construction Manager, and Design Consultant timely notice of the time and place where tests and inspections are to be made. Contractor shall cooperate with inspection and testing personnel to facilitate required inspections or tests.

13.6.2 The City will employ and pay for services of an independent testing laboratory to perform inspections or acceptance tests required by the Contract except:

13.6.2.1 inspections or tests covered by Paragraph 13.6.3;

13.6.2.2 those otherwise specifically provided in the Contract; or

13.6.2.3 costs incurred in connection with tests or inspections conducted pursuant to Paragraph 12.2.2.

13.6.3 Contractor is responsible for and shall pay all costs in connection with inspection or testing required in connection with City Engineer's acceptance of a Product to be incorporated into the Work, or of materials, mix designs, or equipment submitted for approval prior to Contractor's purchase thereof for incorporation into the Work.

13.6.4 Neither observations by the City, Construction Manager, or Design Consultant, nor inspections, tests, or approvals by others, relieves Contractor from Contractor's obligations to perform the Work in accordance with the Contract.

13.7 *INTEREST*

13.7.1 No interest will accrue on late payments by the City except as provided under Chapter 2251 of the Government Code.

13.8 *PARTIES IN INTEREST*

13.8.1 The Contract does not bestow any rights upon any third party, but binds and benefits the Parties only.

13.9 *ENTIRE CONTRACT*

13.9.1 The Contract merges the prior negotiations and understandings of the Parties and embodies the entire agreement of the Parties. No other agreements, assurances, conditions, covenants, express or implied, or other terms of any kind, exist between the Parties regarding the Contract.

13.10 *WRITTEN AMENDMENT*

13.10.1 Changes to the Contract that cannot be effected by Modifications, must be made by written amendment, which will not be effective until approved by City Council.

13.11 *COMPLIANCE WITH LAWS*

13.11.1 Contractor shall comply with the Americans with Disabilities Act of 1990 as amended (ADA) and Texas Architectural Barriers Act and all regulations relating to either statute.

13.11.2 Contractor shall comply with all applicable federal, state, and city laws, rules and regulations.

13.12 *SEVERABILITY*

13.12.1 If any part of the Contract is for any reason found to be unenforceable, all other parts remain enforceable to the extent permitted by law.

ARTICLE 14 - TERMINATION OR SUSPENSION OF THE CONTRACT

14.1 *TERMINATION BY THE CITY FOR CAUSE*

14.1.1 Each of the following acts or omissions of Contractor or occurrences shall constitute an "Event of Default" under the Contract:

14.1.1.1 Contractor refuses or fails to supply enough properly skilled workers or proper Products;

14.1.1.2 Contractor disregards laws, ordinances, rules, regulations, or orders of a public authority having jurisdiction;

14.1.1.3 Contractor is guilty of material breach of any duty or obligation of Contractor under the Contract, including, but not limited to, failure to submit certified payrolls electronically;

14.1.1.4 Contractor has had any other contract with the City terminated for cause at any time subsequent to the effective date of the Contract as set out in the Agreement; or

14.1.1.5 Contractor fails to utilize Ultra Low Sulfur Diesel Fuel, as required in Paragraph 3.9.1.1.

14.1.2 If an Event of Default occurs, City Engineer may, at his option and without prejudice to any other rights or remedies which the City may have, deliver a written notice to Contractor and Surety describing the Event of Default and giving the Contractor 10 days to cure the Event of Default. If after the cure period, Contractor has failed or refused to cure the Event of Default, then City Engineer may deliver a second written notice to Contractor giving notice of the termination of the Contract or of the termination of Contractor's performance under the Contract ("Notice of Termination"). If City Engineer issues a Notice of Termination, then City Engineer may, subject to any prior rights of Surety and any other rights of the City under the Contract or at law:

14.1.2.1 request that Surety complete the Work; or

14.1.2.2 take possession of the site and all materials, equipment, tools, and construction equipment and machinery on the site owned by Contractor; and

14.1.2.3 finish the Work by whatever reasonable method City Engineer may deem expedient.

14.1.3 After Contractor's receipt of a Notice of Termination, and except as otherwise directed in writing by City Engineer, Contractor shall:

14.1.3.1 stop the Work on the date and to the extent specified in the Notice of Termination;

14.1.3.2 place no further orders or subcontracts for Products or services;

14.1.3.3 terminate all orders and subcontracts to the extent that they relate to performance of work terminated;

14.1.3.4 assign to the City, in the manner, at the times, and to the extent directed by City Engineer, all rights, title, and interest of Contractor, under the terminated supply orders and subcontracts. The City may settle or pay claims arising out of termination of the orders and subcontracts;

14.1.3.5 settle all outstanding liabilities and all claims arising out of the termination of

supply orders and subcontracts with approval of City Engineer;

14.1.3.6 take action as may be necessary, or as City Engineer may direct, for protection and preservation of property related to the Work that is in possession of Contractor, and in which the City has or may acquire an interest; and

14.1.3.7 secure the Work in a safe state before leaving the site, providing any necessary safety measures, shoring, or other devices.

14.1.4 If the City terminates the Contract or terminates Contractor's performance under the Contract for any one or more of the reasons stated in Paragraph 14.1.1, Contractor may not receive any further payment until the Work is complete, subject to Paragraph 14.1.5.

14.1.5 If the unpaid balance of Contract Price exceeds the costs of finishing the Work, including liquidated damages and other amounts due under the Contract, the balance will be paid to Contractor. If the costs of finishing the Work exceed the unpaid balance, Contractor shall, within 10 days of receipt of written notice setting out the amount of the excess costs, pay the difference to the City. The amount to be paid to Contractor or the City will be certified by City Engineer in writing, and this obligation for payment shall survive termination of the Contract or termination of Contractor's performance under the Contract. Termination of the Contractor for cause shall not relieve the Surety from its obligation to complete the project.

14.2 *TERMINATION BY THE CITY FOR CONVENIENCE*

14.2.1 City Engineer may, without cause and without prejudice to other rights or remedies of the City, give Contractor and Surety a Notice of Termination with a seven days written notice.

14.2.2 After receipt of the Notice of Termination, and except as otherwise approved by City Engineer, Contractor shall conform to requirements of Paragraph 14.1.3.

14.2.3 After receipt of the Notice of Termination, Contractor shall submit to the City its termination Claim, in forms required by City Engineer. The Claim will be submitted to the City promptly, but no later than six months from the effective date of termination, unless one or more extensions are granted by City Engineer in writing. If Contractor fails to submit its termination Claim within the time allowed, in accordance with Paragraph 14.2.4, City Engineer will determine, on the basis of available information, the amount, if any, due to Contractor because of termination, and City Engineer's determination is final and binding on the Parties. The City will then pay to Contractor the amount so determined.

14.2.4 City Engineer will determine, on the basis of information available to City Engineer, the amount due, if any, to Contractor for the termination as follows:

14.2.4.1 Contract Price for all work performed in accordance with the Contract up to the date of termination determined in the manner prescribed for monthly payments in Article 9, except no retainage is withheld by the City either for payment determined by percentage of completion or for materials and equipment delivered to the site, in storage or in transit.

14.2.4.2 Reasonable termination expenses, including costs for settling and paying Subcontractor and Supplier claims arising out of termination of the Work, reasonable cost of preservation and protection of the City's property after termination, if required, and the cost of Claim preparation. Termination expenses do not include field or central office overhead, salaries of employees of Contractor, or litigation costs, including attorneys' fees.

No amount is allowed for anticipated profit or central office overhead on uncompleted work, or any cost or lost profit for other business of Contractor alleged to be damaged by the termination.

14.2.5 Contractor shall promptly remove from the site any construction equipment, tools, and temporary facilities, except the temporary facilities which City Engineer may wish to purchase and retain.

14.2.6 Contractor shall cooperate with City Engineer during the transition period.

14.2.7 The City will take possession of the Work and materials delivered to the site, in storage, or in transit, as of date or dates specified in the Notice of Termination, and is responsible for maintenance, utilities, security, and insurance, as stated in Notice of Termination.

14.3 *SUSPENSION BY THE CITY FOR CONVENIENCE*

14.3.1 City Engineer may, without cause, after giving Contractor and Surety 24-hour prior written notice, order Contractor to suspend, delay, or interrupt the Work in whole or in part for a period of time as City Engineer may determine.

14.3.2 An adjustment will be made in Contract Time equivalent to the time of suspension.

14.3.3 Adjustment will be made to Contract Price for increases in the cost of performance of the Work, including profit on increased cost of performance caused by suspension, delay, or interruption of the Work in accordance with Paragraph 7.3. No adjustment will be made to the extent that:

14.3.3.1 performance was, or would have been, suspended, delayed, or interrupted by another cause for which Contractor is responsible; or

14.3.3.2 adjustment is made or denied under another provision of the Contract.

14.4 *TERMINATION BY CONTRACTOR*

14.4.1 Contractor may terminate the Contract if the Work is stopped for a period of 30 days through no act or fault of Contractor, directly related to one of these events:

14.4.1.1 issuance of an order of a court or other public authority having jurisdiction;

14.4.1.2 act of government, such as a declaration of national emergency which makes material unavailable; or

14.4.1.3 if repeated suspensions, delays, or interruptions by the City as described in Paragraph 14.3 constitute, in the aggregate, more than 100 percent of the total number of days scheduled for completion, or 120 days in any 365-day period, whichever is less;

No termination will be effective for the above reasons if Contractor delivers written notice to City Engineer describing the reason for termination, giving the proposed termination date, and granting the City a reasonable opportunity to respond and cure any City default before termination is effective.

14.4.2 If the Contract is terminated pursuant to this Paragraph 14.4, Contractor shall comply with the requirements of Paragraphs 14.2.2 through 14.2.7.

END OF DOCUMENT

Document 00800-T

TxDOT SUPPLEMENTARY CONDITIONS

The following Paragraphs amend and supplement the August 15, 2015 edition of General Conditions. Unaltered portions of General Conditions remain in effect.

ARTICLE 1 - GENERAL PROVISIONS:

1.1 *DEFINITIONS*: *Insert the following Paragraph 1.1.9.1 and 1.1.25 reorder the remaining definitions accordingly. Please insert the amended definition of "Specifications".*

1.1.25 *Incidental Work.* Work described as incidental shall be work defined in Document 01110 - Summary of Work, that do not have a direct pay item listed in the Document 00410B - Bid Form Part B, or less than 1% of the Contract Price and not capable of being measured. If Work is identified as Incidental Work and also covered by Bid Form Part B quantities, then the unit price item quantities in the Bid Form Part B shall govern.

1.1.45 *Specifications.* Divisions 01 through 16 of the documents that are incorporated into the Agreement, consisting of written General Requirements and requirements for Products, standards, and workmanship for the Work, and performance of related services. All specifications are amended to include, under the Measurement and Payment Section, the following sentence: "Work described as Incidental Work shall not be paid as a separate unit price item."

ARTICLE 2 - THE CITY

2.3 *AVAILABILITY OF LAND AND USE OF SITE*: *Insert the following Paragraph 2.3.1*

2.3.1 The City is in the process of acquiring additional Right-Of-Way (ROW) for the proposed underground utilities and roadway improvements along the entire length of the project form Aldine Westfield Road to John F. Kennedy Boulevard. Once the ROW is acquired, the private utilities will be relocated by the respective utility companies. Anticipated completion date for the real estate acquisition is January 2017, and for the utility relocation is December 31, 2017. Therefore, the proposed and existing ROW and land on which the proposed underground work and surface improvement work is to be performed will not be furnished and available until December 31, 2017. From the date of Notice to Proceed to December 31, 2017, a portion of the ROW for Phase 1 construction and as shown in the Contract documents will only be furnished and available. If by December 2017, the ROW is not available the contractor shall

discontinue work and return at a later time as directed by the City of Houston Project Manager and as described in City of Houston Specification Section 01270S Measurement and Payment.

ARTICLE 3 - THE CONTRACTOR

3.5 *LABOR: Insert the following Paragraphs 3.5.3.1.1 and 3.5.3.1.2*

3.5.3.1.1 The Contractor shall make Good Faith Efforts to comply with the State ordinances regarding Disadvantaged Business Enterprises (DBE) participation goals. Overall, the City of Houston goal for DBE contracts is a cumulative goal, with DBE amounts varying from contract to contract. Updated annually in agreement with the Texas Department of Transportation, the goals are currently as follows:

.1 The DBE goal is 6 % percent, with

.2 The race-conscious DBE goal of **6 %** percent

3.5.3.1.2 "Good Faith Efforts" is defined in Document 00806-T, "DISADVANTAGED BUSINESS ENTERPRISE PROGRAM REQUIREMENTS", in accordance with 49 C.F.R. § 26.

3.9 MATERIALS & EQUIPMENT: *Insert the following Paragraph 3.9.4*

3.9.4 Materials produced in a prison facility or by prison labor may not be used on this project.

ARTICLE 8 - TIME

8.1 *PROGRESS AND COMPLETION: Delete Paragraph 8.1.6. and replace with the following 8.1.6. and 8.1.6.1.*

8.1.6.1 Contractor shall credit the City by Change Order for inspection services for overtime work or work performed on Sundays or Legal Holidays. The amount Contractor credits the City will be [$50.00 per hour] [*actual costs*] per inspector for inspection services.

ARTICLE 9 - PAYMENTS AND COMPLETION

9.1 *UNIT PRICE WORK: Delete Section 9.1 in its entirety and insert the following Section 9.1.*

9.1 References to Unit Prices in individual Specification sections are not applicable to the Contract. Include payment for portions of the Work required by these sections in the Stipulated Price for the Contract.

9.12 *LIQUIDATED DAMAGES*: *Insert the following Paragraph 9.12.1.1.*

9.12.1.1 The amount of liquidated damages payable by Contractor or Surety for each and every day of delay beyond Contract Time, are $2000.00 per day.

ARTICLE 11 - INSURANCE AND BONDS

11.2 INSURANCE TO BE PROVIDED BY CONTRACTOR: Insert the following Paragraph 11.2.1.2

11.2.1.2 Contractor shall purchase for the duration of the Contract the insurance set out in Table 2 in addition to the minimum insurance coverage set out in section 11.2.1.

TABLE 2
ADDITIONAL REQUIRED COVERAGE
DEFENSE COSTS EXCLUDED FROM FACE AMOUNT OF POLICY.

Contractor's Pollution Liability: occurrence Including pollution coverage for Contractual Liability, Clean-up costs, Abatement, Transport, and Non-owned disposal sites. Including Bodily Injury Liability, Property Damage Liability, and environmental damage arising from pollution conditions caused in performance of operations. Including Asbestos and Lead if part of operations.	$1,000,000 each
(MCS - 90 endorsement: to Auto Policy and removal of Pollution Exclusion)	$1,000,000 CSL

11.5 MAINTENANCE BONDS: *Delete Section 11.5 in its entirety and insert the following Section 11.5.*

11.5 WARRANTY OF WORK BONDS

11.5.1 ONE-YEAR WARRANTY OF WORK BONDS: One-Year Warranty of Work Bond: Contractor shall provide Bond on standard City One-Year Warranty of Work Bond form, providing for Contractor's correction, replacement, or restoration of any portion of the Work which is found to be not in compliance with requirements of the Contract during one-year correction period required in Paragraph 12.2. The One-Year Warranty of Work Bond must be for 100 percent of the Original Contract Price.

END OF DOCUMENT

Document 00805

EQUAL EMPLOYMENT OPPORTUNITY REQUIREMENTS
(City of Houston Information Requirements
for the Successful Bidder on All Construction Contracts)

DOCUMENTS THAT MUST BE SIGNED AND RETURNED TO THE CITY OF HOUSTON PRIOR TO FINAL EXECUTION OF CONTRACT

Certification by Bidder Regarding Equal Employment Opportunity EEO-3

Total Work Force Composition of the Company..... EEO-6
or in lieu thereof, a copy of the latest Equal Employment Opportunity Commission's EEO-1 form (This information is required only if the Contractor has a work force of 50 or more people and the Contract is $50,000 or more.)

Company's Equal Employment Opportunity Compliance Program EEO-7

INFORMATION THAT MUST BE SUPPLIED DURING THE COURSE OF THE WORK

Certification By Proposed Subcontractor Regarding
Equal Employment Opportunity EEO-26

Subcontractor's Equal Employment Opportunity
Compliance Program EEO-29

Certification by Proposed Material Suppliers, Lessors, and Professional
Service Providers Regarding Equal Employment Opportunity EEO-30

PLEASE COMPLETE PAGES EEO-3 THROUGH EEO-7 AND MAIL TO:

City of Houston
Office of Business Opportunity
Contract Compliance Section
611 Walker, 7th Floor
Houston, Texas 77002
Attention: Director

The remainder of the reports can be mailed at the appropriate time.

EQUAL EMPLOYMENT OPPORTUNITY PROGRAM REQUIREMENTS

The following are Equal Employment Opportunity requirements to be met and documents to be submitted to:

Office of Business Opportunity
Contract Compliance Section
611 Walker, 7th Floor
Houston, Texas 77002

Under the conditions and terms of all City construction contract, the prime contractor is responsible for all Equal Employment Opportunity compliance, including subcontractor compliance.

EQUAL EMPLOYMENT OPPORTUNITY FORMS (EEO Forms)

These forms are submitted by the prime contractors at the beginning of the Project and as requested:

- EEO Forms 3, 6, and 7 by prime contractors.

These forms are submitted by all subcontractors before they begin work on the project.

- EEO Forms 26 - 29 by subcontractors.

This form is submitted by all suppliers, lessors, or professional services providers before they begin work on the project:

- EEO Form 30

POSTING

The following poster should be clearly displayed on each job site, or in case of annual service agreements, in the Contractor's office:

Equal Employment Opportunity is the Law Poster

JOB SITE VISITS

Site visits will be made by a Contract Compliance Officer who will make their presence known to the Project Manager, Supervisor, or Foreman, and will conduct interviews with employees on site.

PAYMENT AND EVALUATION

Upon completion of the Project, as part of the contract-awarding department's total clearance process, the Office of Business Opportunity's Contract Compliance Section must certify to the department that all EEO compliance requirements have been met.

CERTIFICATION BY BIDDER REGARDING
EQUAL EMPLOYMENT OPPORTUNITY

GENERAL

In accordance with Executive Order 11246 (30 F.R. 12319-25), the implementing rules and regulations thereof, and orders of the Secretary of Labor, a certification regarding Equal Opportunity is required of bidders or prospective contractors and their proposed subcontractors prior to the award of contracts or subcontracts.

CERTIFICATION OF BIDDER

Bidder's Name:_____

Address:_____

Telephone Number:_____Fax :_____

Name of the company's EEO Officer: _____

E-mail Address:_____

Web Page/URL Address:_____

IRS Employer Identification Number:_____

Work to be performed:_____

Project No: _____

1. Participation in a previous contract or subcontract.

   a. Bidder has participated in a previous contract or subcontract subject to the Equal Opportunity Clause. ☐ YES ☐NO

   b. Compliance reports were required to be filed in connection with such contract or subcontract. ☐YES ☐NO

   c. Bidder has filed all compliance reports required by Executive Orders 10925, 11114, 11246, or by regulations of the Equal Employment Opportunity Commission issued pursuant to Title VII of the Civil Rights Act of 1964. ☐ YES ☐NO

   d. If answer of Item c. is "No", please explain in detail on reverse side of this certification.

2. Dollar amount of bid:$ _____

3. Anticipated performance period in days: _____

4. Expected total number of employees to perform the proposed construction: _____

5. Nonsegregated facilities.

   a. Notice to prospective federally-assisted construction contractors

      (1) A Certification of Nonsegregated Facilities, as required by the May 9, 1967, Order (32 F.R. 7439, May 19, 1967) on Elimination of Segregated Facilities, by the Secretary of Labor, must be submitted to the recipient prior to the award of a federally-assisted construction contract exceeding $10,000 which is not exempt from the provisions of the Equal Opportunity Clause.

      (2) Contractors receiving federally-assisted construction contract awards exceeding $10,000 which are not exempt from the provisions of the Equal Opportunity Clause will be required to provide the forwarding of the following notice to prospective subcontractors for supplies and construction contracts where the subcontracts exceed $10,000 and are not exempt from the provisions of the Equal Opportunity Clause.

      The federally-assisted construction Contractor certifies that he/she does not maintain or provide any segregated facilities at any of his/her establishments, and does not permit employees to perform their services at any location, under his/her control, where segregated facilities are maintained. The federally-assisted construction Contractor certifies further that he/she will not maintain or provide segregated facilities at any of his/her establishments, and will not permit employees to perform their services at any location, under his/her control, where segregated facilities are maintained. The federally-assisted construction Contractor agrees that a breach of this certification is a violation of the Equal Opportunity Clause in this Contract. As used in this certification, the term "segregated facilities" means any waiting rooms, work areas, restrooms and washrooms, restaurants and other eating areas, time clocks, locker rooms and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing facilities provided for employees which are segregated by explicit directive or are in fact segregated on the basis of race, creed, color, or national origin because of habit, local custom, or otherwise. The federally-assisted construction Contractor agrees that (except where he/she has obtained identical certifications from proposed Subcontractors for specific time periods) he/she will obtain identical certifications in duplicate from proposed Subcontractors prior to the award of subcontracts exceeding $10,000 which are not exempt from the provisions of the Equal Opportunity Clause, and that he/she will retain the duplicate of such certifications in his/her files. The Subcontractor will include the original in his/her bid package.

6. Race or ethnic group designation of bidder. Enter race or ethnic group in appropriate box:

☐ White ☐ Black ☐ Hispanic

☐ Pacific Islander, Asian ☐ American Indian, Aleut.

7. Gender of Owner ☐ Male ☐ Female

REMARKS: _____

Certification - The information above is true and complete to the best of my knowledge and belief.

_____
Company Officer (Please Type)

_____ _____
Signature Date

NOTE: The penalty for making false statements in offers is prescribed in 18 U.S.C. 1001.

CITY OF HOUSTON
Company Wide EEO Report

OBO-01-13-001
Office of Business Opportunity
04/13

1. Check One	2. Name and Address	3. FEID No.
__Prime ___Subcontractor		
4. County		5. TX CSJ DOT Project No. (if Applicable)

6. Contractor's Beginning Work Date on Project	7.City Of Houston Contract No.	8. This Report is based on Pay Period ending MM/DD/YYYY

9. TEXAS CONSTRUCTION EMPLOYMENT

TABLE A

JOB CATEGORIES	TOTAL EMPLOYEES		TOTAL MINORITIES		WHITE (Not of Hispanic Origin)		BLACK (Not of Hispanic Origin)		HISPANIC		AMERICAN INDIAN or ALASKAN NATIVE		ASIAN		NATIVE HAWAIIAN OR OTHER PACIF ISL		TWO OR MORE RACES	
	M	F	M	F	M	F	M	F	M	F	M	F	M	F	M	F	M	F
OFFICIALS (MANAGERS)	0	0	0	0														
SUPERVISORS	0	0	0	0														
FOREMEN/WOMEN	0	0	0	0														
ADMIN SUPPORT	0	0	0	0														
EQUIPMENT OPERATORS	0	0	0	0														
MECHANICS	0	0	0	0														
TRUCK DRIVERS	0	0	0	0														
IRONWORKERS	0	0	0	0														
CARPENTERS	0	0	0	0														
CEMENT MASONS	0	0	0	0														
ELECTRICIANS	0	0	0	0														
PIPEFITTERS, PLUMBERS	0	0	0	0														
PAINTERS	0	0	0	0														
LABORERS, SEMI-SKILLED	0	0	0	0														
LABORERS, UNSKILLED	0	0	0	0														
TOTALS	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

TABLE B

On-The-Job Trainees (OJT)	
M	F

TABLE C

On-The-Job Trainee																

OJT TOTALS	
M	F
0	0

10.IF ANY EMPLOYEES REPORTED IN 'TABLE A' ARE APPRENTICES, NAME OF THE PROGRAM, JOB CATEGORY, COUNT, RACE & SEX.

11. SUMMARIZE ALL HIRES FOR THE ENTIRE ACTIVE MONTH BY JOB CATEGORY, RACE, SEX (USE ADDITIONAL SHEET IF NEEDED).

	PRINTED NAME-FIRST/LAST	EMAIL ADDRESS	PHONE	SIGNATURE	DATE
12. PREPARER					
13. REVIEWER					

EQUAL EMPLOYMENT OPPORTUNITY COMPLIANCE PROGRAM FOR

_____

Name of Company

The Company's Office of Business Opportunity Program shall consist of documented good faith efforts to comply with the goals, timetables, and objectives set forth in the following Affirmative Action steps:

A. City of Houston's Specific Equal Employment Opportunity Policy and Clause as contained in City Council Ordinance No. 78-1538, passed August 9, 1978.

B. Notice of Requirement for Office of Business Opportunity to ensure Equal Employment Opportunity (Executive Order 11246).

C. Standard Federal Equal Employment Opportunity Construction Contract Specifications (Executive Order 11246).

Project: _____

_____

Company Officer (Please Type)

_____ _____

Signature Date

NOTE: The penalty for making false statements in offers is prescribed in 18 U.S.C. 1001.

SPECIAL PROVISIONS
SPECIFIC EQUAL EMPLOYMENT OPPORTUNITY POLICY

1. GENERAL

a. Equal employment opportunity requirements not to discriminate and to take affirmative action to assure equal employment opportunity are required by Executive Order 11246, as amended. The requirements set forth in these Special Provisions shall constitute the specific affirmative action requirements for Project activities under this Contract and shall supplement the notice of requirement for affirmative action to ensure equal employment opportunity and standard federal equal employment opportunity construction contract specifications.

b. The Contractor shall work with the City and the Federal Government in carrying out equal employment opportunity obligations and in their review of his/her activities under the Contract.

c. The prime Contractor and all Subcontractors holding subcontracts of $10,000 or more shall comply with the following minimum specific requirement activities of equal employment opportunity. The Contractor shall include these requirements in every subcontract of $10,000 or more with such modification of language as is necessary to make them binding on the Subcontractor.

2. EQUAL EMPLOYMENT OPPORTUNITY POLICY

The Contractor shall accept as his/her operating policy the following statement which is designed to further the provision of equal employment opportunity to all persons without regard to their race, age, color, religion, sex, or national origin, and to promote the full realization of equal employment opportunity through a positive continuing program:

> It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, color, sex, or national origin. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship.

3. EQUAL EMPLOYMENT OPPORTUNITY OFFICER

The Contractor shall designate and make known to the City contracting officers an equal employment opportunity officer (hereinafter referred to as the EEO Officer) who must be capable of effectively administering and promoting an active Contractor program of equal employment opportunity and who must be assigned adequate authority and responsibilities to do so.

4. DISSEMINATION OF POLICY

a. All members of the Contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement the Contractor's equal employment opportunity policy and contractual responsibilities to provide equal employment opportunity in each grade and classification of employment. To ensure that the above agreement will be met, the following actions shall be taken as a minimum:

(1) Periodic meetings of supervisory and personnel office employees shall be conducted before the start of work and then not less often than once every six months, at which time the Contractor's equal employment opportunity policy and its implementation will be reviewed and explained. The meetings shall be conducted by the EEO Officer or other knowledgeable company official.

(2) All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, or other knowledgeable company official, covering all major aspects of the Contractor's equal employment opportunity obligations, within 30 days following their reporting for duty with the Contractor.

(3) The EEO Officer or appropriate company official shall instruct all employees engaged in the direct recruitment of employees for the Project relative to the methods followed by the Contractor in locating and hiring minorities and females.

b. In order to make the Contractor's equal employment opportunity policy known to all employees, prospective employees, and potential sources of employees, i.e., schools, employment agencies, labor unions (where appropriate), college placement officers, etc., the Contractor shall take the following actions:

(1) Notices and posters setting forth the Contractor's equal employment opportunity policy shall be placed in areas readily accessible to employees, applicants for employment, and potential employees.

(2) The Contractor's equal employment opportunity policy and the procedures to implement such policy shall be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.

5. RECRUITMENT

a. When advertising for employees, the Contractor shall include in all advertisements for employees the notation "An Equal Opportunity Employer". All such advertisements will be published in newspapers, or other publications, having a large circulation among minority groups in the area from which the Project work force would normally be derived.

b. The Contractor shall, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee-referral sources likely to yield qualified minority-group applicants, including, but not limited to, State employment agencies, schools, colleges, minority-group organizations, and female recruitment agencies. To meet this requirement, the Contractor shall, through his/her EEO Officer, identify sources of potential minority and female employees, and establish with such identified sources procedures whereby such group applicants may be referred to the Contractor for employment consideration.
In the event the Contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, he/she is expected to observe the provisions of that agreement to the extent that the system permits the Contractor's compliance with equal employment opportunity Contract provisions. (The U. S. Department of Labor has held that where implementation of such agreements has the effect of discriminating against minorities or women, or obligates the Contractor to do the same, such implementation violates Executive Order 11246 as amended).

c. The Contractor shall encourage his/her present employees to refer female or minority-group applicants for employment by posting appropriate notices or bulletins in areas accessible to all such employees. In addition, information and procedures with regard to referring such applicants will be discussed with employees.

6. PERSONNEL ACTIONS

a. Wage, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff and termination, shall be taken without regard to race, color, religion, sex, national origin, or age. The following procedures shall be followed:

(1) The Contractor shall conduct periodic inspections of Project sites to ensure that working conditions and employee facilities do not indicate discriminatory treatment of Project-site personnel.

(2) The Contractor shall periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.

(3) The Contractor shall periodically review selected personnel actions in depth to determine whether there is evidence of discrimination.

Where evidence is found, the Contractor shall promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.

(4) The Contractor shall promptly investigate all complaints of alleged discrimination made in connection with his/her obligations under this Contract, shall attempt to resolve such complaints, and shall take appropriate corrective action. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the Contractor shall inform every complainant of all avenues of appeal.

7. TRAINING AND PROMOTION

a. The Contractor shall assist in locating, qualifying, and increasing the skills of minority-group and women employees and applicants for employment.

b. Consistent with the Contractor's work force requirements and as permissible under Federal and State regulations, the Contractor shall make full use of training programs, i.e., apprenticeship and on-the-job training programs, for the geographical area of Contract performance.

c. The Contractor shall advise employees and applicants for employment of available training programs and entrance requirements for each.

d. The Contractor shall periodically review the training and promotion potential of minority-group and women employees and shall encourage eligible employees to apply for such training and promotion.

8. UNIONS

If the Contractor relies in whole or in part upon unions as a source of employees, he/she shall use his/her best efforts to obtain the cooperation of such unions to increase minority groups and women within the unions, and to effect referrals by such unions of minority and female employees. Actions by the Contractor, either directly or through a contractor's association acting as his/her agent, will include the procedures set forth below:

a. The Contractor shall use best efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minority-group members and women for membership in the unions and increasing the skills of minority-group employees and women so that they may qualify for higher-paying employment.

b. The Contractor shall use best efforts to incorporate an equal employment opportunity clause into all union agreements to the end that such unions will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, or age.

c. The Contractor is to obtain information as to the referral practices and policies of the labor union, except that to the extent such information is within the exclusive possession of the labor union, and such labor union refuses to furnish such information to the Contractor, the Contractor shall

so certify to the City and shall set forth what efforts have been made to obtain such information.

d. In the event the union is unable to provide the Contractor with a reasonable flow of minority and women referrals within the time limit set forth in the collective bargaining agreement, the Contractor shall, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, age, sex, or national origin, making full efforts to obtain qualified and/or qualifiable minority group persons and women. (The U. S. Department of Labor has held that it shall be no excuse that the union with which the Contractor has a collective bargaining agreement providing for exclusive referral failed to refer minority employees.) In the event the union referral practice prevents the Contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such Contractor shall immediately notify the City.

9. SUBCONTRACTING

a. The Contractor shall use his/her best efforts to solicit bids from and to utilize minority-group and female subcontractors or subcontractors with meaningful minority-group and/or female representation among their employees.

b. The Contractor shall use his/her best efforts to assure Subcontractors' compliance with their equal employment opportunity obligations.

10. RECORDS AND REPORTS

a. The Contractor shall keep such records as are necessary to determine compliance with the Contractor's equal employment opportunity obligations. The records kept by the Contractor will be designed to indicate:

(1) The number of minority and non-minority group members and women employed in each work classification on the Project.

(2) The progress and efforts being made in cooperation with unions to increase employment opportunities for minorities and women (applicable only to contractors who rely in whole or in part on unions as a source of their work force).

(3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minority and female employees.

(4) The progress and efforts being made in securing the services of female and minority subcontractors.

b. All records, including payrolls, must be retained for a period of three years following completion of the Contract work and shall be available at

reasonable times and places for inspection by authorized representatives of the City and/or the appropriate federal agency.

CITY OF HOUSTON, TEXAS

EQUAL EMPLOYMENT OPPORTUNITY CLAUSE

Pursuant to City Council Ordinance No. 78-1538, passed August 9, 1978, all contracts entered into by the City of Houston involving the expenditure of $10,000 or more, shall incorporate the following Equal Employment Opportunity Clause:

1. The Contractor, Subcontractor, vendor, Supplier, or lessee shall not discriminate against any employee or applicant for employment because of race, religion, color, sex, national origin, or age. The Contractor, Subcontractor, vendor, Supplier, or lessee shall take affirmative action to ensure that applicants are employed and that employees are treated during employment without regard to their race, religion, color, sex, national origin, or age. Such action will include, but not be limited to, the following: employment; upgrading; demotion or transfer; recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship. The Contractor, Subcontractor, vendor, Supplier, or lessee agrees to post in conspicuous places available to employees, and applicants for employment, notices to be provided by the City setting forth the provisions of this Equal Employment Opportunity Clause.

2. The Contractor, Subcontractor, vendor, Supplier, or lessee states that all qualified applicants will receive consideration for employment without regard to race, religion, color, sex, national origin, or age.

3. The Contractor, Subcontractor, vendor, Supplier, or lessee shall send to each labor union or representatives of workers with which it has a collective bargaining agreement or other contract or understanding, a notice to be provided by the agency contracting officer advising the said labor union or workers' representative of the Contractor's and Subcontractor's commitments under Section 202 of Executive Order No. 11246, and shall post copies of the notice in conspicuous places available to employees and applicants for employment.

4. The Contractor, Subcontractor, vendor, Supplier, or lessee will comply with all provisions of Executive Order No. 11246 and the rules, regulations, and relevant orders of the Secretary of Labor or other Federal Agency responsible for enforcement of the equal opportunity and affirmative action provisions applicable, and shall likewise furnish all information and reports required by the Mayor and/or Contractor Compliance Officers for purposes of investigation to ascertain and effect compliance with this program.

5. The Contractor, Subcontractor, vendor, Supplier, or lessee shall furnish all information and reports required by Executive Order No. 11246, and by the rules, regulations, and orders of the Secretary of Labor, or pursuant

thereto, and shall permit access to all books, records, and accounts by the appropriate City and Federal officials for purposes of investigation to ascertain compliance with such rules, regulations, and orders. Compliance reports filed at such times as directed shall contain information as to the employment practice policies, program, and work force statistics of the Contractor, Subcontractor, vendor, Supplier, or lessee.

6. In the event of a Contractor's, Subcontractor's, vendor's, Supplier's, or lessee's non-compliance with the non-discrimination clause of this Contract or with any of such rules, regulations, or orders, this Contract may be canceled, terminated, or suspended in whole or in part, and the Contractor, Subcontractor, vendor, Supplier, or lessee may be declared ineligible for further City contracts in accordance with procedures provided in Executive Order No. 11246, and such other sanctions may be imposed and remedies invoked as provided in said Executive Order, or by rule, regulation, or order of the Secretary of Labor, or as may otherwise be provided by law.

7. The Contractor shall include the provisions of paragraphs 1 through 8 of this Equal Employment Opportunity Clause in every subcontract or purchase order unless exempted by rules, regulations, or orders of the Secretary of Labor issued pursuant to Section 204 of Executive Order No. 11246 of September 24, 1965 so that such provisions will be binding upon each Subcontractor or vendor. The Contractor shall take such action with respect to any subcontractor or purchase order as the contracting agency may direct as a means of enforcing such provisions, including sanctions for noncompliance; provided, however, that in the event the Contractor becomes involved in, or is threatened with litigation with a Subcontractor or vendor as a result of such direction by the contracting agency, the Contractor may request the United States to enter into such litigation to protect the interests of the United States.

8. The Contractor shall file and shall cause each of his Subcontractors, if any, to file compliance reports with the City in the form and to the extent as may be prescribed by the Office of Business Opportunity. Compliance reports filed at such times as directed shall contain information as to the practices, policies, programs, employment policies, and employment statistics of the Contractor and each Subcontractor.

NOTICE OF REQUIREMENT FOR AFFIRMATIVE ACTION
TO ENSURE EQUAL EMPLOYMENT OPPORTUNITY
(EXECUTIVE ORDER 11246)

1. The Offeror's or Bidder's attention is called to the "Equal Opportunity Clause" and the "Standard Federal Equal Employment Opportunity Construction Contract Specifications" set forth herein.

2. The goals and timetables for minority and female participation, expressed in percentage terms for the Contractor's aggregate work force in each trade on all construction work in the covered area, are as follows:

Timetables	Goals for Minority Participation for Each Trade	Goals for Female Participation for Each Trade
	26.2% - 27.3%	6.9%

These goals are applicable to all the Contractor's construction work (whether or not it is Federal or Federally-assisted) performed in the covered area.

The Contractor's compliance with the Executive Order and the regulations in 41 CFR Part 60-4 shall be based on its implementation of the Equal Opportunity Clause, specific affirmative action obligations required by the specifications set forth in 41 CFR 60-4.3(a), and its efforts to meet the goals established for the geographical area where the Contract resulting from this solicitation is to be performed. The hours of minority and female employment and training must be substantially uniform throughout the length of the Contract, and in each trade, and the Contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority or female employees or trainees from Contractor to Contractor or from project to project for the sole purpose of meeting the Contractor's goals shall be a violation of the Contract, the Executive Order, and regulations in 41 CFR part 60-4. Compliance with the goals will be measured against the total work hours performed.

3. The Contractor shall provide written notification to the Director of the Office of Federal Contract Compliance Programs within 10 working days of award of any construction subcontract in excess of $10,000 at any tier for construction work under the Contract resulting from this solicitation. The notification shall list the name, address, and telephone number of the Subcontractor; employer identification number; estimated dollar amount of the subcontract; estimated starting and completion dates of the subcontract; and the geographical area in which the Contract is to be performed.

4. As used in this Notice, and in the Contract resulting from this solicitation, the "covered area" is The Houston, Texas Standard Metropolitan Statistical Area.

STANDARD FEDERAL EQUAL EMPLOYMENT OPPORTUNITY
CONSTRUCTION CONTRACT SPECIFICATIONS
(EXECUTIVE ORDER 11246)

1. As used in these specifications:

   a. "Covered area" means the geographical area described in the solicitation from which this Contract resulted;

   b. "Director" means Director, Office of Federal Contract Compliance Programs, United States Department of Labor, or any person to whom the Director delegates authority;

   c. "Employer identification number" means the Federal Social Security number used on the Employer's Quarterly Federal Tax Return, U. S. Treasury Department Form 941.

   d. "Minority" includes:

      (i) Black (all persons having origins in any of the Black African racial groups not of Hispanic origin);

      (ii) Hispanic (all persons of Mexican, Puerto Rican, Cuban, Central or South American, or other Spanish culture or origin regardless of race);

      (iii) Asian and Pacific Islander (all persons having origins in any of the original peoples of the Far East, Southeast Asia, the Indian Subcontinent, or the Pacific Islands); and

      (iv) American Indian or Alaskan Native (all persons having origins in any of the original peoples of North America and maintaining identifiable tribal affiliations through membership and participation or community identification).

2. Whenever the Contractor, or any Subcontractor at any tier, subcontracts a portion of the work involving any construction trade, it shall physically include in each subcontract in excess of $10,000 the provisions of these specifications and the Notice which contains the applicable goals for minority and female participation and which is set forth in the solicitations from which this Contract resulted.

3. If the Contractor is participating (pursuant to 41 CFR 60-4.5) in a Hometown Plan approved by the U. S. Department of Labor in the covered area either individually or through an association, its affirmative action obligations on all work in the Plan area (including goals and timetables) shall be in accordance with that Plan for those trades which have unions participating in the Plan. Contractors must be able to demonstrate their participation in and compliance with the provisions of

any such Hometown Plan. Each Contractor or Subcontractor participating in an approved Plan is individually required to comply with its obligations under the EEO clause, and to make a good faith effort to achieve each goal under the Plan in each trade in which it has employees. The overall good faith performance by other Contractors or Subcontractors toward a goal in an approved Plan does not excuse any covered Contractor's or Subcontractor's failure to take good efforts to achieve the Plan goals and timetables.

4. The Contractor shall implement the specific affirmative action standards provided in Paragraphs 7a through p of these specifications. The goals set forth in the solicitation from which this Contract resulted are expressed as percentages of the total hours of employment and training of minority and female utilization the Contractor should reasonably be able to achieve in each construction trade in which it has employees in the covered area. The Contractor is expected to make substantially uniform progress toward its goals in each craft during the period specified.

5. Neither the provisions of any collective bargaining agreement, nor the failure by a union with whom the Contractor has a collective bargaining agreement to refer either minorities or women, shall excuse the Contractor's obligations under these specifications, Executive Order 11246, or the regulations promulgated pursuant thereto.

6. In order for the non-working training hours of apprentices and trainees to be counted in meeting the goals, such apprentices and trainees must be employed by the Contractor during the training period, and the Contractor must have made a commitment to employ the apprentices and trainees at the completion of their training, subject to the availability of employment opportunities. Trainees must be trained pursuant to training programs approved by the U. S. Department of Labor.

7. The Contractor shall take specific affirmative actions to ensure equal employment opportunity. The evaluation of the Contractor's compliance with these specifications shall be based upon its effort to achieve maximum results from its actions. The Contractor shall document these efforts fully, and shall implement affirmative action steps at least as extensive as the following:

   a. Ensure and maintain a working environment free of harassment, intimidation, and coercion at all sites, and in all facilities at which Contractor's employees are assigned to work. The Contractor, where possible, shall assign two or more women to each construction project. The Contractor shall specifically ensure that all foremen, superintendents, and other on-site supervisory personnel are aware of and carry out the Contractor's obligation to maintain such a working environment, with specific attention to minority or female individuals working at such sites or in such facilities.

   b. Establish and maintain a current list of minority and female recruitment sources, provide written notification to minority and female recruitment sources and to community organizations when the Contractor or its unions

have employment opportunities available, and maintain a record of the organizations' responses.

c. Maintain a current file of the names, addresses, and telephone numbers of each minority and female off-the-street applicant and minority or female referral from a union, a recruitment source, or community organization and of what action was taken with respect to each such individual. If such individual was sent to the union hiring hall for referral and was not referred back to the Contractor by the union or, if referred, not employed by the Contractor, this shall be documented in the file with the reason therefor, along with whatever additional actions the Contractor may have taken.

d. Provide immediate written notification to the Director when the union or unions with which the Contractor has a collective bargaining agreement has not referred to the Contractor a minority person or woman sent by the Contractor, or when the Contractor has other information that the union referral process has impeded the Contractor's efforts to meet its obligations.

e. Develop on-the-job training opportunities and/or participate in training programs for the area which expressly include minorities and women, including upgrading programs and apprenticeship and trainee programs relevant to the Contractor's employment needs, especially those programs funded or approved by the Department of Labor. The Contractor shall provide notice of these programs to the sources compiled under 7b above.

f. Disseminate the Contractor's EEO policy: by providing notice of the policy to unions and training programs and requesting their cooperation in assisting the Contractor in meeting its EEO obligations; by including it in any policy manual and collective bargaining agreement; by publicizing it in the company newspaper, annual report, etc.; by specific review of the policy with all management personnel and with all minority and female employees at least once a year; and by posting the company EEO policy on bulletin boards accessible to all employees at each location where construction work is performed.

g. Review, at least annually, the company's EEO policy and affirmative action obligations under these specifications with all employees having any responsibility for hiring, assignment, layoff, termination, or other employment decisions, including specific review of these items with on-site supervisory personnel such as superintendents, general foremen, etc., prior to the initiation of construction work at any job site. A written record shall be made and maintained identifying the time and place of these meetings, persons attending, subject matter discussed, and disposition of the subject matter.

h. Disseminate the Contractor's EEO policy externally by including it in any advertising in the news media, specifically including minority and female news media, and providing written notification to and discussing the

Contractor's EEO policy with other contractors and subcontractors with whom the Contractor does or anticipates doing business.

i. Direct its recruitment efforts, both oral and written, to minority, female and community organizations, to schools with minority and female students, and to minority and female recruitment and training organizations serving the Contractor's recruitment area and employment needs. Not later than one month prior to the date for the acceptance of applications for apprenticeship or other training by any recruitment source, the Contractor shall send written notification to organizations such as the above, describing the openings, screening procedures, and tests to be used in the selection process.

j. Encourage present minority and female employees to recruit other minority persons and women and, where reasonable, provide after school, summer, and vacation employment to minority and female youth both on the site and in other areas of a Contractor's work force.

k. Validate all tests and other selection requirements where there is an obligation to do so under 41 CFR Part 60-3.

l. Conduct, at least annually, an inventory and evaluation at least of all minority and female personnel for promotional opportunities and encourage these employees to seek or to prepare, through appropriate training, etc., for such opportunities.

m. Ensure that seniority practices, job classifications, work assignments, and other personnel practices do not have a discriminatory effect by continually monitoring all personnel and employment-related activities to ensure that the EEO policy and the Contractor's obligations under these specifications are being carried out.

n. Ensure that all facilities and company activities are nonsegregated except that separate or single-user toilet and necessary changing facilities shall be provided to assure privacy between the sexes.

o. Document and maintain a record of all solicitations of offers for subcontracts from minority and female construction contractors and suppliers, including circulation of solicitations to minority and female contractor associations and other business associations.

p. Conduct a review, at least annually, of all supervisors' adherence to and performance under the Contractor's EEO policies and affirmative action obligations.

8. Contractors are encouraged to participate in voluntary associations which assist in fulfilling one or more of their affirmative action obligations (7a through p). The efforts of a contractor association, joint contractor union, contractor-community, or other similar group of which the Contractor is a member and participant, may be asserted as fulfilling any one or more of its obligations under 7a through p of

these Specifications provided that the Contractor actively participates in the group, makes every effort to assure that the group has a positive impact on the employment of minorities and women in the industry, ensures that the concrete benefits of the program are reflected in the Contractor's minority and female work force participation, makes a good faith effort to meet its individual goals and timetables, and can provide access to documentation which demonstrates the effectiveness of actions taken on behalf of the Contractor. The obligation to comply, however, is the Contractor's and failure of such a group to fulfill an obligation shall not be a defense for the Contractor's noncompliance.

9. A single goal for minorities and a separate single goal for women have been established. The Contractor, however, is required to provide equal employment opportunity and to take affirmative action for all minority groups, both male and female, and all women, both minority and non-minority. Consequently, the Contractor may be in violation of the Executive Order if a particular group is employed in a substantially disparate manner (for example, even though the Contractor has achieved its goals for women generally, the Contractor may be in violation of the Executive Order if a specific minority group of women is under-utilized).

10. The Contractor shall not use the goals and timetables or affirmative action standards to discriminate against any person because of race, color, religion, sex, or national origin.

11. The Contractor shall not enter into any subcontract with any person or firm debarred from Government contracts pursuant to Executive Order 11246.

12. The Contractor shall carry out such sanctions and penalties for violation of these specifications and of the Equal Opportunity Clause, including suspension, termination, and cancellation of existing subcontracts as may be imposed or ordered pursuant to Executive Order 11246, as amended, and its implementing regulations, by the Office of Federal Contract Compliance Programs. Any Contractor who fails to carry out such sanctions and penalties shall be in violation of these specifications and Executive Order 11246, as amended.

13. The Contractor, in fulfilling its obligations under these specifications, shall implement specific affirmative action steps, at least as extensive as those standards prescribed in Paragraph 7 of these Specifications, so as to achieve maximum results from its efforts to ensure equal employment opportunity. If the Contractor fails to comply with the requirements of the Executive Order, the implementing regulations, or these specifications, the Director shall proceed in accordance with 41 CFR 60-4.B.

14. The Contractor shall designate a responsible official to monitor all employment-related activity to ensure that the company EEO policy is being carried out, to submit reports relating to the provisions hereof as may be required by the Government, and to keep records. Records shall at least include for each employee the name, address, telephone number, construction trade, union affiliation, if any, employee identification number when assigned, social security number, race, sex, status (e.g., mechanic, apprentice, trainee, helper, or laborer),

dates of changes in status, hours worked per week in the indicated trade, rate of pay, and locations at which the work was performed. Records shall be maintained in an easily-understandable and retrievable form; however to the degree that existing records satisfy this requirement, contractors shall not be required to maintain separate records.

15. Nothing herein provided shall be construed as a limitation upon the application of other laws which establish different standards of compliance or upon the application of requirements for the hiring of local or other area residents (e.g., those under the Public Works Employment Act of 1977 and the Community Development Block Grant Program).

DESCRIPTION OF JOB CATEGORIES

Officials, Managers, and Administrators

Occupations requiring administrative personnel who set board policies, exercise overall responsibility for the execution of these policies, or provide specialized consultation on a regional, district, area basis, or direct individual departments or special phases of a firm's operations.

Includes: Officials, executives, middle management, plant managers, department managers, superintendents, salaried foremen who are members of management, purchasing agents, buyers, bureau chiefs, directors, deputy directors, wardens, examiners, sheriffs, police and fire chiefs, and kindred workers.

Professionals

Occupations which require specialized and theoretical knowledge which is usually acquired through college or experience of such kind and amount as to provide a comparable background.

Includes: Accountants, auditors, airplane pilots and navigators, architects, artists, chemists, designers, dieticians, editors, engineers, lawyers, librarians, mathematicians, natural scientists, registered professional nurses, personnel and labor relations workers, physical scientists, teachers, social workers, doctors, psychologists, economists, systems analysts, employment and vocational rehabilitation counselors, instructors, police and fire captains and lieutenants, and kindred workers.

Paraprofessionals

Occupations in which workers perform some of the duties of a professional or technician in a supportive role, which usually requires less formal training and/or experience normally required for professional or technical status. Such positions may fall within an identified pattern of a "New Careers" concept.

Includes: Library assistants, medical aides, child support workers, police auxiliary, welfare service aides, recreation assistants, homemakers aides, home health aides, and kindred workers.

Technicians

Occupations requiring a combination of basic scientific knowledge and manual skill which can be obtained through about two (2) years of post high school education, such as is offered in many technical institutes and junior colleges, or through equivalent on-the-job training.

Includes: Computer programmers and operators, draftsmen, engineering aides, junior engineers, mathematical aides, licensed practical or vocational nurses,

photographers, radio operators, scientific assistants, surveyors, technical illustrators, technicians (medical, dental, electronics, physical sciences), police and fire sergeants, and kindred workers.

Protective Service Workers

Occupations in which workers are entrusted with public safety, security, and protection from destructive forces.

Includes: Police patrol officers, fire fighters, guards, deputy sheriffs, bailiffs, correctional officers, detectives, marshals, harbor patrol officers, and kindred workers.

Sales Workers

Occupations engaging wholly or primarily in direct selling.

Includes: Advertising agents and salespersons, insurance agents and brokers, real estate agents and brokers, stock and bond salespersons, demonstrators, salespersons and sales clerks, grocery clerks, cashiers, and kindred workers.

Office and Clerical

Occupations in which workers are responsible for internal and external communications, recording and retrieval of data and/or information and other paper work required in an office predominantly non-manual, though some manual work not directly involved with altering or transporting the products is included.

Includes: Bookkeepers, cashiers, collectors (bills and accounts), messengers and office helpers, office machine operators, shipping and receiving clerks, stenographers, typists and secretaries, telegraph and telephone operators, court transcribers, hearing reporters, statistical clerks, dispatchers, license distributors, payroll clerks, and kindred workers.

Skilled Craft Workers

Occupations in which workers perform jobs which require special manual skill through on-the-job training and experience, or through apprenticeship or other formal training programs. These workers exercise considerable independent judgment and usually receive an extensive period of training.

Includes: The building trades, hourly paid foremen and leadmen who are not members of management, mechanics and repairmen, skilled machining occupations, compositors and typesetters, electricians, engravers, job setters (metal), motion picture projectionists, pattern and model makers, stationary engineers, tailors, heavy equipment operators, carpenters, and kindred workers.

Operatives (semi-skilled)

Workers who operate machine or processing equipment or perform other factory-type duties of intermediate skill level which can be mastered in a few weeks and require only limited training.

Includes: Apprentices (auto mechanics), plumbers, bricklayers, carpenters, electricians, mechanics, building trades, metal workers, machinists, printing trades, operatives, attendants (auto service and parking), blasters, chauffeurs, deliverymen, dressmakers and seamstresses (except factory), dryers, furnacemen, heaters (metal), laundry and dry cleaning operatives, milliners, miners, motormen, oilers, greasers, etc. (except auto), painters (except construction and maintenance), photographic process workers, stationary firemen, truck and tractor drivers, weavers (textile), welders and flame cutters, and kindred workers.

Laborers (unskilled)

Workers in manual occupations which generally require no special training. These workers perform elementary duties that may be learned in a few days and require the application of little or no independent judgment.

Includes: Garage workers, car washers and greasers, gardeners (except farm) and groundskeepers, longshoremen and stevedores, lumbermen, craftsmen, and wood choppers, laborers performing lifting, digging, mixing, loading, and pulling operations, and kindred workers.

Service/Maintenance Workers

Occupations in which workers perform duties which result in or contribute to the comfort, convenience, hygiene, or safety for the general public, or which contribute to the upkeep and care of buildings, facilities or grounds, or public property. Workers in this group may operate machinery.

Includes: Chauffeurs, laundry and dry cleaning operatives, truck drivers, trash collectors, custodial personnel, gardeners and groundskeepers, construction laborers, attendants (hospital and other institutions), professional and personal service, counter and fountain workers, elevator operators, firemen and fire protection, guards, watchmen and doorkeepers, stewards, porters, waiters, and kindred workers.

CERTIFICATION BY PROPOSED SUBCONTRACTOR REGARDING EQUAL EMPLOYMENT OPPORTUNITY

_____

Name of Prime Contractor | Project WBS & OA Number

_____

Address

GENERAL

In accordance with Executive Order 11246 (30 F.R. 12319-25), the implementing rules and regulations thereof, and orders of the Secretary of Labor, a certification regarding Equal Opportunity is required of bidders or prospective contractors and their proposed subcontractors prior to the award of contracts or subcontracts.

SUBCONTRACTOR'S CERTIFICATION

Subcontractor's Name: _____

Address: _____

E-Mail Address: _____

IRS Employer Identification Number: _____

Job Description: _____
(Work performed by your company for this project)

1. Participation in a previous contract or subcontract.

   a. Subcontractor has participated in a previous contract or subcontract subject to the Equal Opportunity Clause. ____YES_____NO

   b. Compliance reports were required to be filed in connection with such contract or subcontract. ____YES_____NO

   c. Subcontractor has filed all compliance reports required by Executive Orders 10925, 11114, 11246, or by regulations of the Equal Employment Opportunity Commission issued pursuant to Title VII of the Civil Rights Act of 1964. ____YES_____NO

   d. If answer of Item c. is "No", please explain in detail on reverse side of this certification.

2. Dollar amount of proposed subcontract: $ _____

3. Anticipated performance period in days: _____

4. Expected total number of employees to perform the proposed subcontract: _____

5. Nonsegregated facilities.

   a. Notice to prospective federally-assisted construction contractors
      (1) A Certification of Nonsegregated Facilities, as required by the May 9, 1967, order (32 F.R. 7439, May 19, 1967) on Elimination of Segregated Facilities, by the Secretary of Labor, must be submitted to the Contractor prior to the award of a subcontract exceeding $10,000 which is not exempt from the provisions of the Equal Opportunity Clause.
      (2) Contractors receiving subcontract awards exceeding $10,000 which are not exempt from the provisions of the Equal Opportunity Clause will be required to provide for the forwarding of this notice to prospective subcontractors for supplies and construction contracts where the subcontracts exceed $10,000 and are not exempt from the provisions of the Equal Opportunity clause.

   b. Certification of non-segregated facilities

      The federally-assisted construction contractor certified that he/she does not maintain or provide any segregated facilities at any of his/her establishments, and does not permit employees to perform their services at any location, under his/her control, where segregated facilities are maintained. The federally-assisted construction Contractor certifies further that he/she will not maintain or provide any segregated facilities at any of his/her establishments, and will not permit employees to perform their services at any location, under his/her control, where segregated facilities are maintained. The federally-assisted construction Contractor agrees that a breach of this certification is a violation of the Equal Opportunity Clause in this Contract. As used in this certification, the term "segregated facilities" means any waiting rooms, work areas, restrooms and washrooms, restaurants, and other eating areas, time clocks, locker rooms and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing facilities provided for employees which are segregated by explicit directive or are in fact segregated on the basis of race, creed, color, or national origin because of habit, local custom, or otherwise. The federally-assisted construction Contractor agrees that (except where he/she has obtained identical certifications from proposed Subcontractors for specific time periods) he/she will obtain identical certifications in duplicate from proposed Subcontractors prior to the award of subcontracts exceeding $10,000 which are not exempt from the provisions of the Equal Opportunity Clause, and that he/she will retain the duplicate of such certifications in his/her files. The Contractor will include the original in his/her Bid Package.

6. Race or ethnic group designation of bidder. Enter race or ethnic group in

appropriate box:

☐ White ☐ Black ☐ Hispanic

☐ Pacific Islander, Asian ☐ American Indian, Aleut.

7. Gender

☐ Male ☐ Female

REMARKS:

Certification - The information above is true and complete to the best of my knowledge and belief.

_____

Company Officer (Please Type)

_____ _____

Signature Date

NOTE: The penalty for making false statements in offers is prescribed in 18 U.S.C. 1001.

CITY OF HOUSTON
Company Wide EEO Report

OBO-01-13-001
Office of Business Opportunity
04/13

1. Check One	2. Name and Address	3. FEID No.
__Prime ___Subcontractor		
4. County		5. TX CSJ DOT Project No. (if Applicable)

6. Contractor's Beginning Work Date on Project	7.City Of Houston Contract No.	8. This Report is based on Pay Period ending MM/DD/YYYY

9. TEXAS CONSTRUCTION EMPLOYMENT

TABLE A

JOB CATEGORIES	TOTAL EMPLOYEES		TOTAL MINORITIES		WHITE (Not of Hispanic Origin)		BLACK (Not of Hispanic Origin)		HISPANIC		AMERICAN INDIAN or ALASKAN NATIVE		ASIAN		NATIVE HAWAIIAN OR OTHER PACIF ISL		TWO OR MORE RACES	
	M	F	M	F	M	F	M	F	M	F	M	F	M	F	M	F	M	F
OFFICIALS (MANAGERS)	0	0	0	0														
SUPERVISORS	0	0	0	0														
FOREMEN/WOMEN	0	0	0	0														
ADMIN SUPPORT	0	0	0	0														
EQUIPMENT OPERATORS	0	0	0	0														
MECHANICS	0	0	0	0														
TRUCK DRIVERS	0	0	0	0														
IRONWORKERS	0	0	0	0														
CARPENTERS	0	0	0	0														
CEMENT MASONS	0	0	0	0														
ELECTRICIANS	0	0	0	0														
PIPEFITTERS, PLUMBERS	0	0	0	0														
PAINTERS	0	0	0	0														
LABORERS, SEMI-SKILLED	0	0	0	0														
LABORERS, UNSKILLED	0	0	0	0														
TOTALS	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

TABLE B

On-The-Job Trainees (OJT)	
M	F

TABLE C

On-The-Job Trainee																		

OJT TOTALS	
M	F
0	0

10.IF ANY EMPLOYEES REPORTED IN 'TABLE A' ARE APPRENTICES, NAME OF THE PROGRAM, JOB CATEGORY, COUNT, RACE & SEX.

11. SUMMARIZE ALL HIRES FOR THE ENTIRE ACTIVE MONTH BY JOB CATEGORY, RACE, SEX (USE ADDITIONAL SHEET IF NEEDED).

	PRINTED NAME-FIRST/LAST	EMAIL ADDRESS	PHONE	SIGNATURE	DATE
12. PREPARER					
13. REVIEWER					

Certification by Proposed Material Suppliers, Lessors, and Professional Service Providers Regarding Equal reemployment Opportunity

Company Name:_____ $_____
(Supplier, Lessor, Professional Service Provider) (Amount of Contract)

Company Address:_____

Company Telephone Number:_____Fax:_____

Goods or Service to be provided:_____

Web Page/URL Address:_____

Company Tax Identification Number:_____

Project No: [*WBS/CIP/AIP/File No.*]_____

Project Name: [*Legal Project Name*]_____

In accordance with the City of Houston Ordinance 78-1538, Supplier/Lessor/Professional Service Provider represents to be an equal opportunity employer and agrees to abide by the terms of the Ordinance. This certification is required of all Suppliers/Lessors/Professional Service Providers (hereinafter " Supplier") with contracts in the amount of $10,000.00 or more.

[ ] YES [ ] NO — Supplier agrees not to discriminate against any employee or applicant for employment because of race, religion, color, sex, national origin, or age.

[ ] YES [ ] NO — Supplier agrees that all qualified applicants will receive consideration for employment without regard to race, religion, color, sex, national origin, or age.

[ ] YES [ ] NO — Supplier will comply with all provisions of Executive Order No. 11246 and rules, regulations and applicable orders of the Department of Labor or other Federal Agency responsible for enforcement of applicable equal opportunity and affirmative action provisions and will likewise furnish all information and reports required by the Mayor or Contract Compliance Officers for the purpose of investigation to ascertain and effect compliance with the City of Houston's Office of Affirmative Action and Contract Compliance.

[ ] YES [ ] NO — The Supplier shall file and cause their sub-tier contractors to file compliance reports with the City in the form and to the extent as may be prescribed by the Mayor or Contract Compliance Offices. Compliance reports filed at such times as directed shall contain information including, but not limited to, the practice, policies, program, and employment policies.

I hereby certify that the above information is true and correct.

_____ _____
COMPANY OFFICER (Signature) Date

_____
NAME AND TITLE (Print or type) E-Mail Address

END OF DOCUMENT

Document 00806-T

DISADVANTAGED BUSINESS ENTERPRISE PROGRAM REQUIREMENTS

(City of Houston Information Requirements
for the Successful Bidder on All Construction Contracts)

1. PURPOSE. 1

2. POLICY. 1

3. DEFINITIONS. 2

4. CONTRACTOR'S RESPONSIBILITIES. 4

5. ELIGIBILITY OF DBEs. 6

6. DETERMINATION OF DBE PARTICIPATION. 7

7. RECORDS AND REPORTS. 10

8. COMPLIANCE OF CONTRACTOR. 12

9. RACE-NEUTRAL DBE PARTICIPATION. 12

DISADVANTAGED BUSINESS ENTERPRISE PROGRAM

FUNDED BY FEDERAL HIGHWAY FUNDS

1. PURPOSE.
The purpose of Document 00806-T is to carry out the U.S. Department of Transportation's policy of ensuring nondiscrimination in the award and administration of DOT assisted contracts and of creating a level playing field on which firms owned and controlled by individuals who are determined to be socially and economically disadvantaged can compete fairly for U.S. Department of Transportation ("USDOT") contracts.

2. POLICY.
It is the policy of the U.S. Department of Transportation that Disadvantaged Business Enterprises ("DBEs") as described in 49 CFR Part 26, Subpart A, shall have the opportunity to participate in the performance of contracts financed in whole or in part with Federal funds. This Document 00806-T implements the Memorandum of Understanding Regarding the Adoption of the Texas Department of Transportation's

Federally-Approved Disadvantaged Business Program by the City of Houston (the "Memorandum of Understanding" or the "MOU") in accordance with 49 CFR Part 26. City Council adopted the Memorandum by Ordinance No. 2010-0800, countersigned October 21, 2010. Consequently, the Disadvantaged Business Enterprise requirements of 49 CFR Part 26 and Memorandum apply to this Contract as follows:

a. The Contractor will solicit DBEs through reasonable and available means, as described in 49 CFR Part 26, Appendix A and the Memorandum, or show a Good Faith Effort to meet the DBE goal for this Contract.

b. The Contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this Contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of USDOT-assisted contracts. Failure by the Contractor to carry out these requirements is a material breach of this Contract, which may result in the termination of this Contract or such other remedy as the City deems appropriate.

c. The Contractor shall physically include all requirements of this Document 00806-T in any subcontract. Sections 1-3 of this Document 00806-T shall apply to this Contract. If this Contract contains a race-conscious DBE participation goal, Sections 4–8 shall apply to this Contract. If this Contract contains a race-neutral participation goal, Sections 6 and 9 shall apply to this Contract.

d. TxDOT DBE forms applicable to this DBE Program are currently available at: http://www.txdot.gov/txdot_library/doing_business/dbe.htm

   If the Contractor encounters difficulties obtaining or completing the required documents, the Contractor shall request assistance from the Liaison Officer. Upon receiving a reasonable, written request, or at the Liaison Officer's sole discretion, the Liaison Officer shall provide documents and administrative assistance to the Contractor.

e. The Contractor or any participating subcontractor shall submit documents and questions concerning this Program to

   DBE Liaison Officer
   City of Houston
   611 Walker, 7th Floor
   Houston, Texas 77002
   (713) 837-9015

3. DEFINITIONS.

Any term defined in 49 CFR Part 26 shall have the same definition and use in this Document 00806-T. The definitions of some key terms from 49 CFR § 26.5 are included in this Document 00806-T merely for convenience. Any term used in this Document 00806-T that is not defined in 49 CFR Part 26 shall have the same meaning

as defined elsewhere in this Contract or the meaning provided below:

a. "Broker" is an intermediary or middleman that does not take possession of a commodity or act as a regular dealer selling to the public.

b. "Disadvantaged Business Enterprise" or "DBE" means a for-profit small business concern

(1) That is at least 51 percent owned by one or more individuals who are both socially and economically disadvantaged or, in the case of a corporation, in which 51 percent of the stock is owned by one or more such individuals; and
(2) Whose management and daily business operations are controlled by one or more of the socially and economically disadvantaged individuals who own it.

c. "DBE Joint Venture" means an association of a DBE firm and 1 or more other firm(s) to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge, and in which the DBE is responsible for a distinct, clearly defined portion of the work of the Contract and whose share in the capital contribution, control, management, risks, and profits of the joint venture are commensurate with its ownership interest.

d. "Federal Aid Contract" is any contract between the City and a Contractor which is paid for in whole or in part with USDOT financial assistance.

e. "Good Faith Effort" means efforts to achieve a DBE goal or other requirement of the DBE program which, by their scope, intensity, and appropriateness to the objective, can reasonably be expected to fulfill the program requirement, as set out in Section 4 below.

f. "Liaison Officer" means the Director of the Mayor's Office of Business Opportunity ("OBO") or an authorized representative.

g. "Manufacturer" is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the contract and of the general character described by the specifications.

h. "Regular Dealer" is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business. To be a Regular Dealer, the firm must be an established, regular business that engages in, as its principal business and under its own name, the purchase and sale or lease of the products in question. A Regular Dealer in such bulk items as steel, cement, gravel, stone, and petroleum products need not keep such products in stock if it owns and operates distribution equipment for the

products. Any supplementing of a Regular Dealer's own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis. Brokers, packagers, manufacturers' representatives, or other persons who arrange or expedite transactions shall not be regarded as a Regular Dealer.

i. "Texas Unified Certification Program" or "TUCP" provides applicants with a consolidated process for DBE certification, such that applicants are required to apply only once for a DBE certification that will be honored by all recipients of federal funds in the state. The TUCP, by Memorandum of Agreement, established six member entities to serve as certifying agents for Texas in specified regions.

j. "TxDOT" means the Texas Department of Transportation.

k. "USDOT" means the U.S. Department of Transportation, including the Office of the Secretary, the Federal Highway Administration (FHWA), the Federal Transit Administration (FTA), and the Federal Aviation Administration (FAA).

4. CONTRACTOR'S RESPONSIBILITIES.

In this Contract, the Contractor must satisfy the following requirements:

a. After conditional award of the Contract, the Contractor shall submit a completed Form SMS.4901 "DBE Commitment Agreement", Form.SMS 4901-T "DBE Trucking Commitment Agreement", or Form SMS.4901-M/S "DBE Material & Supplier Commitment Agreement" for each DBE the Contractor intends to use to satisfy the DBE goal or a Good Faith Effort to explain why the goal could not be reached. The Contractor shall send the completed forms to the Liason Officer. The Contractor shall insure that these documents arrive at the City of Houston, Texas not later than 5:00 p.m. on the 10th business day (excluding national holidays) after the conditional award of the contract. When requested, additional time, not to exceed seven business days (excluding national holidays) may be granted based on documentation submitted by the Contractor.

b. If the Contractor is a DBE prime contractor, it may receive credit toward the DBE goal for work performed by the Contractor's own forces and work subcontracted to DBEs. A DBE prime contractor must make a Good Faith Effort to meet the goals. In the event a DBE prime contractor subcontracts to a non-DBE, that information must be reported on Form SMS.4902.

c. If the Contractor cannot meet the Contract goal, in whole or in part, the Contractor shall make adequate Good Faith Efforts to obtain DBE participation as described in 49 CFR Part 26, Appendix A. The following list is not mandatory but provides non-exhaustive examples of the types of action that Contractor may take and document to show Good Faith Efforts. Other factors or types of efforts may be relevant in appropriate cases.

(1) Soliciting through all reasonable and available means (e.g. attendance at prebid meetings, advertising, and/or written notices) the interest of all certified DBEs who have the capability to perform the work of the contract. The solicitation must be done within sufficient time to allow the DBEs to respond to it. Appropriate steps must be taken to follow up initial solicitations to determine, with certainty, if the DBEs are interested.

(2) Selecting portions of the work to be performed by DBEs in order to increase the likelihood that the DBE goals will be achieved. This includes, where appropriate, breaking out contract work items into economically feasible units to facilitate DBE participation, even when the Contractor might otherwise prefer to perform the work items with its own forces.

(3) Providing interested DBEs with adequate information about the plans, specifications, and requirements of the Contract in a timely manner to assist them in responding to a solicitation.

(4) Facilitating DBE participation by negotiating in good faith with interested DBEs to make a portion of the work available to DBE subcontractors and suppliers. The Contractor may select those portions of the work or material needs that are consistent with the available DBE subcontractors and suppliers. Evidence of such negotiations includes the names, addresses, and telephone numbers of DBEs that were considered; a description of the information provided regarding the plans and specifications for the work selected for subcontracting; and evidence as to why additional agreements could not be reached for DBEs to perform the work.

(5) Considering a number of factors in negotiating with subcontractors, including DBE subcontractors, and taking a firm price, capabilities, and contract goals into consideration. Additional cost involved in finding and using DBEs is not in itself sufficient reason for a Contractor to fail to meet the Contract DBE goal as long as such cost are reasonable. Also, the ability or desire of the Contractor to perform the work of the Contract with its own organization does not relieve the Bidder of the responsibility to make Good Faith Efforts. A Contractor is not required to accept higher quotes from DBEs if the price difference is excessive or unreasonable.

(6) Rejecting DBEs only after a thorough investigation of their capabilities and for sound reasons. The Contractor's standing within its industry, membership in specific groups, organizations, or associations and political or social affiliations (for example union vs. non-union employee status) are not legitimate causes for the rejection or non-solicitation of bids and the Contractor's efforts to meet the project goal.

(7) Making efforts to assist interested DBEs in obtaining bonding, lines of

credit, or insurance as required by the recipient or Contractor.

(8) Making efforts to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services.

(9) Effectively using the services of available minority/women community organizations; minority/women Contractors' groups; local, state, and Federal minority/women business assistance offices; and other organizations as allowed on a case-by-case basis to provide assistance in the recruitment and placement of DBEs.

d. If the Liaison Officer's representative determines that the Contractor has failed to meet the Good Faith Effort requirements, the Contractor shall be given an opportunity for reconsideration by the Liaison Officer.

e. If the Contractor refuses, neglects, or fails to meet the DBE goal or comply with Good Faith Effort requirements, any proposal guaranty or similar security filed with the bid shall become the property of the City, not as a penalty, but as liquidated damages to the City.

f. The preceding information shall be submitted directly to the Liaison Officer, 611 Walker, 7th Floor, Houston, Texas 77002.

g. The Contractor shall not terminate for convenience a DBE subcontractor named in any DBE Commitment Agreement submitted by the Contractor without the prior, written consent of the Liaison Officer.

h. The Contractor shall also make a Good Faith Effort to replace a DBE subcontractor that is unable to perform successfully with another DBE, to the extent needed to meet the contract goal. The Contractor shall submit a completed Form SMS.4901 "DBE Commitment Agreement", Form SMS.4901-T "DBE Trucking Commitment Agreement", or Form SMS.4901-M/S "DBE Material & Supplier Commitment Agreement" for the substitute DBE firm(s). Any substitution of DBEs shall be subject to approval by the Liaison Officer. Prior to approving the substitution, the Liaison Officer's representative will request a statement from the DBE concerning it being replaced. The Contractor shall review the deviation language issued in 2011 for changes to the listed DBE.

i. The Contractor shall designate a DBE liaison representative who will administer the Contractor's DBE program and who will be responsible for maintenance of records of efforts and contacts made to subcontract with DBEs.

j. The Contractor is encouraged to investigate the services offered by banks owned and controlled by disadvantaged individuals and to make use of these banks where feasible.

5. <u>ELIGIBILITY OF DBEs</u>.

a. TxDOT maintains the Texas Unified Certification Program (TUCP) DBE Directory containing the names of firms that have been certified to be eligible to participate as DBE's on DOT financially assisted contracts. This Directory is available from the Liaison Officer or his or her representative. An update of the Directory can be currently found on the Internet at http://www.dot.state.tx.us/business/tucp/default.htm.

b. The member entities of the TUCP, including the City, certify the eligibility of DBEs and DBE joint ventures to perform DBE subcontract work on USDOT financially assisted contracts.

c. The Contractor shall only submit the names of DBE firms that are certified and eligible to perform the work at the time the Contractor submits commitments.

d. For purposes of the DBE participation goal on this project, DBEs will only be allowed to perform work in the categories of work for which they are certified.

e. Only DBE firms certified at the time of execution of a contract/subcontract/purchase order are eligible for DBE goal participation.

6. DETERMINATION OF DBE PARTICIPATION.

When a DBE subcontractor participates in this Contract, only the values of the work actually performed by the DBE subcontractor, as referenced below, shall be counted by the Contractor toward DBE goals:

a. The total amount paid to the DBE subcontractor for work performed with the DBE subcontractor's own forces is counted toward the DBE goal. When a DBE subcontractor subcontracts part of the work of its contract to another firm, the value of the subcontracted work may be counted toward DBE goals only if the subcontractor is itself a DBE. Work that a DBE subcontractor subcontracts to a non-DBE firm does not count toward DBE goals.

b. A Contractor may count toward its DBE goal a portion of the total value of the contract amount paid to a DBE Joint Venture equal to the distinct, clearly defined portion of the work of the contract performed by the DBE subcontractor.

(1) A Contractor may count toward its DBE goal only expenditures to DBE subcontractors that perform a commercially useful function (CUF) in the work of a contract or purchase order. A DBE subcontractor is considered to perform a CUF when it is responsible for execution of the work of the contract and is carrying out its responsibilities by actually performing, managing, and supervising the work involved. To perform a CUF, the DBE subcontractor must also be responsible, with respect to materials and supplies used on the contract, for negotiating price, determining

quality and quantity, ordering the material, and installing (where applicable) and paying for the material itself.

In accordance with 49 CFR Part 26, Appendix A, "Guidance Concerning Good Faith Efforts", contractors may make efforts to assist interested DBE subcontractors in obtaining necessary equipment, supplies, materials, or related assistance or services. Contractors may not however, negotiate the price of materials or supplies used on the contract by the DBE subcontractor, nor may they determine quality and quantity, order the materials themselves, nor install the materials (where applicable), or pay for the material themselves. Contractors, however, may share the quotations they receive from the material supplier with the DBE firm, so that the DBE firm may negotiate a reasonable price with the material supplier.

In all cases, prime or other non-DBE subcontractor assistance will not be credited toward the DBE goal.

(2) A DBE subcontractor does not perform a CUF if its role is limited to that of an extra participant in a transaction, contract, or project through which funds are passed in order to obtain the appearance of DBE subcontractor participation.

Consistent with industry practices, 49 CFR Part 26, and the TxDOT DBE program, a DBE subcontractor may enter into second-tier subcontracts, amounting up to 70% of their contract. Work subcontracted to a non-DBE does not count towards DBE goals. If a DBE subcontractor does not perform or exercise responsibility for at least 30% of the total cost of its contract with its own work force, or the DBE subcontractor subcontracts a greater portion of the work of a contract than would be expected on the basis of normal industry practice for the type of work involved, it will be presumed that the DBE subcontractor is not performing a CUF.

(3) A DBE trucking firm (including an owner operator who is certified as a DBE) is considered to be performing a CUF when the DBE subcontractor is responsible for the management and supervision of the entire trucking operation on a particular contract and the DBE subcontractor owns and operates at least 1 fully licensed, insured, and operational truck used on the contract.

a. The Contractor receives credit for the total value of the transportation services the DBE provides on a contract using trucks it owns, insures, and operates using drivers it employs.

b. The DBE subcontractor may lease trucks from another DBE subcontractor firm, including an owner operator who is certified as

a DBE subcontractor. The DBE subcontractor who leases trucks from another DBE subcontractor receives credit for the total value of the transportation services the lessee DBE provides on the Contract.

c. The DBE subcontractor may also lease trucks from a non-DBE firm, including from an owner-operator. The DBE subcontractor who leases trucks from a non-DBE is entitled to credit for the total value of transportation services provided by non-DBE lessees not to exceed the value of transportation services provided by the DBE-owned trucks on the contract. Additional participation by non-DBE lessees receive credit only for the fee or commission it receives as result of the lease arrangement.

d. A lease must indicate that the DBE subcontractor has exclusive use of and control over the trucks giving the DBE absolute priority for use of the leased trucks. Leased trucks must display the name and identification number of the DBE subcontractor.

e. When a DBE subcontractor is presumed not to be performing a CUF, the DBE subcontractor may present evidence to rebut this presumption.

c. Project materials or supplies acquired from an affiliate of the prime contractor can not directly or indirectly (2nd or lower tier subcontractor) be used for DBE goal credit.

d. Depending on the classification of the DBE subcontractor, the Contractor may count purchases of materials and supplies from DBE subcontractor towards its DBE participation goal in the percentages described below:

(1) materials or supplies purchased from a DBE Manufacturer at 100% of the Contractor's cost of the materials or supplies ("Manufacturer" is defined in Section 3 of this Document 00806-T).

(2) materials or supplies purchased from a DBE Regular Dealer at 60% of the Contractor's cost of the materials or supplies ("Regular Dealer" is defined in Section 3 of this Document 00806-T).

(3) materials or supplies purchased from a DBE firm which is neither a Manufacturer nor a Regular Dealer, at 100% of Contractor's cost paid for fees or commissions charged by the DBE firm for assistance in the procurement of the materials and supplies, provided the fees are reasonable within the applicable market area and not excessive as compared with fees customarily allowed for similar services within the market area. No portion of the cost of the materials and supplies count toward the DBE participation goal.

(4) services, such as professional, technical, consultant or managerial services, or for providing bonds or insurance specifically required for the performance of a DOT-assisted contract, at 100% toward DBE goals, provided the fees are reasonable within the applicable market area and not excessive as compared with fees customarily allowed for similar services within the market area.

e. If the Contractor chooses to assist a DBE firm, other than a manufacturing material supplier or regular dealer, and the DBE firm accepts the assistance, the Contractor may act solely as a guarantor by use of a two-party check for payment of materials to be used on the project by the DBE firm. The material supplier must invoice the DBE firm, who will then present the invoice to the Contractor. The Contractor may issue a joint check to the DBE firm and the material supplier, and the DBE firm must issue the remittance to the material supplier. No funds shall go directly from the Contractor to the material supplier. The DBE firm may accept or reject this joint checking arrangement. The Contractor shall:

(1) obtain approval from the Liaison Officer prior to implementing the use of joint check arrangements with the DBE firm;

(2) submit Joint Check Approval Form 2178 to the Liaison Officer requesting approval; and

(3) provide copies of cancelled joint checks upon request. No DBE goal credit will be allowed for the cost of DBE materials that are paid by the Contractor directly to the material supplier.

f. The Contractor shall receive no DBE participation goal credit for supplies and equipment the DBE subcontractor leases from the Contractor or its affiliates.

g. The Contractor shall receive no DBE participation goal credit for the time the Liaison Officer determines that the DBE firm was not performing a CUF. The denial period of time may occur before or after a determination has been made by the Liaison Officer. In case of the denial of credit for non-performance of a CUF of a DBE, the Contractor shall provide a substitute DBE firm to meet the contract goal or provide an adequate Good Faith Effort when applicable.

7. RECORDS AND REPORTS.

a. While the Contractor is performing work and until all Project work is completed, the Contractor shall submit a "DBE Progress Report", Form SMS.4903, for each month to the Liaison Officer no later than the 15 days after the end of the calendar month. The Contractor shall include on the DBE Progress Report, Form SMS.4903, all payments the Contractor made to

meet the DBE goal within the applicable month, identifying separately payments for DBE or SBE race-neutral participation and non-DBE SBEs participation. The Contractor shall submit a "DBE Final Report," SMS.4904, in the month after all DBE subcontracting work is completed and after the Contractor makes final payment to all DBE firms.

The Contractor shall submit the original final report to the Liaison Officer and a copy to the Project Manager. The Liaison Officer may require the Contractor to provide additional information to ensure final payment of DBE firms. The Contractor shall verify amounts as being paid to DBE firms by providing copies of cancelled checks paid to DBE firms, which the Liaison Officer may select on a random basis. Cancelled checks and invoices should reference the City project number.

b. The Contractor shall identify each DBE firm on the monthly report by Vendor Number, name, and the amount of actual payment made to each during the monthly period. The Contractor shall submit reports stating no activity occurred when the Contractor has not utilized any DBE firms in a monthly period.

c. Prior to receiving final payment, the Contractor shall submit Form SMS.4904, "DBE Final Report". If the DBE goal requirement is not met, the Contractor shall also submit a TxDOT Form 2182 with the Form SMS.4904, "DBE Final Report."

d. While the Contractor is performing work and until all Project work is completed, the Contractor shall submit TxDOT Form 2177, "Prompt Payment Certification (Federal-Aid Projects)" for each month to the Liaison Officer before the last day of the following calendar month.

e. If the Contractor uses a DBE trucker, the Contractor shall submit Form 2371, "DBE Trucking Credit Worksheet," for each month to the Liaison Officer before the last day of the following calendar month.

f. The Contractor shall retain copies of such records for a period of three years following completion of the Contract work and make such records available at reasonable times and places for inspection by authorized representatives of the City. The Contractor shall also provide copies of subcontracts or agreements and other documentation upon request from authorized representatives of the City.

g. If TxDOT changes any of the forms referenced in this Document 00806-T or DBE requirements, the Contractor shall use the newest available, applicable form provided by TxDOT for the purpose described in this Document 00806-T. The Liaison Officer or Project Manager may provide the Contractor with instructions when material changes to the DBE Program occur.

8. COMPLIANCE OF CONTRACTOR.
To ensure that the Contractor complies with USDOT DBE requirements, the Liaison Officer and Project Manager shall monitor the Contractor's efforts involving DBE firms during the performance of this Contract. This will be accomplished by a review of monthly reports submitted to the Project Manager by the Contractor indicating the Contractor's progress in achieving the DBE contract goal, and by compliance reviews conducted on the project site by the Project Manager.

a. The Contractor shall receive credit toward the DBE goal based on actual payments to the DBE subcontractor. The Contractor shall notify the Project Manager if the Contractor withholds or reduces payment to any DBE subcontractor. The Contractor shall submit an affidavit detailing the DBE subcontract payments prior to receiving final payment for the Contract.

b. If the Contractor terminates a DBE subcontractor or reduces the work to be provided by a DBE firm as provided in Contractor's Form SMS.4901, "Commitment Agreement", the Contractor shall make Good Faith Efforts to find another DBE subcontractor to substitute for the original DBE subcontractor. These Good Faith Efforts shall be directed at finding another DBE firm to perform at least the same amount of work under the contract as the DBE subcontractor that was terminated, to the extent needed to meet the contract goal.

c. The Contractor shall submit Form 2228, "DBE Substitution Request", to the Project Manager and a copy to the Liaison Officer prior to substituting a DBE firm on the Project. The Contractor shall receive no DBE participation goal credit for work on those items being substituted unless the Contractor receives prior approval of the substitution from the Project Manager.

d. The Contractor shall receive no DBE participation goal credit for work when the Contractor or the Contractor's affiliate provides the DBE firm with a work crew, equipment, or supplies.

e. A Contractor's failure to comply with the requirements of this Document 00806-T shall constitute a material breach of this Contract. In such a case, the City reserves the right to terminate the contract; to deduct the amount of DBE goal not accomplished by DBE firms from the money due or to become due the Contractor, or to secure a refund, not as a penalty but as liquidated damages to the Department or such other remedy or remedies as the Department deems appropriate.

9. RACE-NEUTRAL DBE PARTICIPATION.
If there is no DBE goal, the DBE requirements of 49 CFR Part 26 apply to this Contract as follows:

a. The Contractor shall offer DBE firms, as described in 49 CFR Part 26, Subpart A, the opportunity to compete fairly for contracts and subcontractors financed in whole or in part with Federal funds. Each month until the Contractor receives final payment from the City, the Contractor shall report Race-Neutral DBE and SBE participation on projects with no DBE goal to the Liaison Officer on Form SMS.4903, "DBE Monthly Progress Report". Payments to DBE firms reported on Form SMS.4903 are subject to the requirements of this Document 00806-T, Section 6, "Determination of DBE Participation."

b. The Contractor shall receive credit toward the DBE goal based on actual payments to the DBE firms. The Contractor shall notify the Project Manager and Liaison Officer if the Contractor withholds or reduces payment to a DBE firm.

c. The Contractor's request for substitutions of DBE firms shall be accompanied by a detailed explanation which should substantiate the need for a substitution. The Department may verify the explanation with the DBE firm being replaced before giving approval of the substitution.

d. A Contractor's failure to meet the DBE goal and failure to demonstrate to the Department's satisfaction sufficient "Good Faith Effort" on the Contractor's part to obtain DBE firm participation shall constitute a breach of contract. In such a case, the City reserves the right to terminate the Contract; to deduct the amount of DBE goal not accomplished by DBEs from the money due or to become due the Contractor, not as a penalty but as damages to the City's DBE program; or such other remedy or remedies as the City deems appropriate.

END OF DOCUMENT

DOCUMENT 00812

WAGE SCALE FOR HEAVY CONSTRUCTION

1.01 Following 29 CFR 5.5 (a) (1) (v), use the rates listed on the Wage Determination Attachment for minimum wage and benefits for the labor classifications applicable to the Work.

1.02 These rates do not prohibit payment of more than the rates stated.

1.03 Apply rates in this Document 00812 to site work greater than five (5) feet from exterior wall of new building under construction or from exterior wall of existing building.

1.04 The Contractor shall submit the "Certificate from Contractor Appointing Officer or Employee to Supervise Payment of Employees" (Exhibit "A") to the Monitoring Authority listed in Document 00495 prior to final execution of the contract.

1.05 During the course of the work, Subcontractors shall submit the "Certificate from Subcontractor Appointing Officer or Employee to Supervise Payment of Employees" (Exhibit "B") to the Monitoring Authority listed in Document 00495.

1.06 Contractor and all subcontractors will submit payrolls electronically to the Department through the online reporting system unless told otherwise by the Office of Business Opportunity.

EXHIBIT "A"

CERTIFICATE FROM CONTRACTOR APPOINTING OFFICER OR EMPLOYEE TO SUPERVISE PAYMENT OF EMPLOYEES

Project Name _____

_____

_____

Project WBS#: _____ Date _____

(I) (We) hereby certify that (I am) (we are) the Prime Contractor for _____

_____
(specify type of job)

in connection with construction of the above-mentioned Project, and that (I) (we) have appointed _____ _____, whose signature appears below, to supervise the payment of (my) (our) employees beginning _____, 20___; that he/she is in a position to have full knowledge of the facts set forth in the payroll documents and in the statement of compliance required by the Copeland Act and the City of Houston, which he/she is to execute with (my) (our) full authority and approval until such time as (I) (we) submit to the City of Houston a new certificate appointing some other person for the purposes hereinabove stated.

_____ Phone:_____
(Identifying Signature of Appointee)

Witness/Attest: _____
(Name of Firm or Corporation)

By: _____ By: _____
(Signature) (Signature)

_____ _____
(Title) (Title)

NOTE: This certificate must be executed by an authorized officer of a corporation or by a member of a partnership, and shall be executed prior to and be submitted with the first payroll. Should the appointee be changed, a new certificate must accompany the first payroll for which the new appointee executes a statement of compliance required by the Copeland Act and the City of Houston.

EXHIBIT "B"

CERTIFICATE FROM SUBCONTRACTOR APPOINTING OFFICER OR EMPLOYEE TO SUPERVISE PAYMENT OF EMPLOYEES

Project Name _____

_____

_____

Project WBS#: _____ Date _____

(I) (We) hereby certify that (I am) (we are) the Subcontractor for _____

_____
(specify type of job)

in connection with construction of the above-mentioned Project, and that (I) (we) have appointed _____ _____, whose signature appears below, to supervise the payment of (my) (our) employees beginning _____, 20___; that he/she is in a position to have full knowledge of the facts set forth in the payroll documents and in the statement of compliance required by the Copeland Act and the City of Houston, which he/she is to execute with (my) (our) full authority and approval until such time as (I) (we) submit to the City of Houston a new certificate appointing some other person for the purposes hereinabove stated.

_____ Phone: _____
(Identifying Signature of Appointee)

Witness/Attest: _____
(Name of Firm or Corporation)

By: _____ By: _____
(Signature) (Signature)

_____ _____
(Title) (Title)

NOTE: This certificate must be executed by an authorized officer of a corporation or by a member of a partnership, and shall be executed prior to and be submitted with the first payroll. Should the appointee be changed, a new certificate must accompany the first payroll for which the new appointee executes a statement of compliance required by the Copeland Act and the City of Houston.

Wage Determination Publication Date:
January 8, 2016
for
General Decision Number **TX160042 01/08/2016 TX42**
Superseded General Decision Number TX20150042

State: TEXAS
Construction Type: HEAVY
County (ies): Harris

HEAVY CONSTRUCTION PROJECTS including work on water and sewer lines. (Does not include flood control.)

Modification Number:	Publication Date:
0	01/08/2016

WAGE DETERMINATION ATTACHMENT:

END OF DOCUMENT

The wage rates listed are those predetermined by the Secretary of Labor and State Statue to be the minimum wages paid. To determine the applicable wage rate zone, a list entitled "TEXAS COUNTIES IDENTIFIED BY WAGE RATE ZONES" is provided in the contract. Any wage rate that is not listed must be submitted to the Engineer for approval. IMPORTANT NOTICE FOR STATE PROJECTS; only the controlling wage rate zone applies to the contract. Effective 4-6-2016.

CLASS. #	CLASSIFICATION DESCRIPTION	ZONE TX07 1/8/16	ZONE TX08 1/8/16	ZONE TX11 1/8/16	ZONE TX12 1/8/16	ZONE TX14 1/8/16	ZONE TX16 1/8/16	ZONE TX18 1/8/16	ZONE TX34 1/8/16	ZONE TX35 1/8/16	ZONE TX37 1/8/16	ZONE TX38 1/8/16	ZONE TX40 1/8/16	ZONE TX41 1/8/16	ZONE TX54 1/8/16	ZONE TX56 1/8/16	ZONE TX63 1/8/16
1428	Agricultural Tractor Operator						$12.69					$12.35			$11.75		
1300	Asphalt Distributor Operator	$14.87	$13.48	$13.88	$15.72	$15.58	$15.55	$15.72	$13.28	$15.32	$15.62	$14.36	$14.25	$14.03	$13.75	$14.06	$14.40
1303	Asphalt Paving Machine Operator	$13.40	$12.25	$12.35	$13.87	$14.05	$14.36	$14.20	$13.26	$13.99	$14.68	$12.92	$13.44	$12.53	$14.00	$14.32	$12.99
1106	Asphalt Raker	$12.28	$10.61	$12.02	$14.21	$11.65	$12.12	$11.64	$11.44	$12.69	$12.05	$11.34	$11.67	$11.40	$12.59	$12.36	$11.78
1112	Batching Plant Operator, Asphalt																
1115	Batching Plant Operator, Concrete																
1214	Blaster																
1615	Boom Truck Operator						$18.36										
1444	Boring Machine Operator																
1305	Broom or Sweeper Operator	$11.21	$10.33	$10.08	$11.99		$11.04	$11.62		$11.74	$11.41	$10.30		$10.23	$10.60	$12.68	$11.05
1144	Communications Cable Installer																
1124	Concrete Finisher, Paving and Structures	$13.55	$12.46	$13.16	$12.85	$12.64	$12.56	$12.77	$12.44	$14.12	$13.04	$13.38	$12.64	$12.80	$12.79	$12.98	$13.32
1318	Concrete Pavement Finishing Machine Operator				$16.05		$15.48			$16.05		$19.31				$13.07	
1315	Concrete Paving, Curing, Float, Texturing Machine Operator											$16.34				$11.71	
1333	Concrete Saw Operator				$14.67					$14.48	$17.33					$13.99	
1399	Concrete/Gunite Pump Operator																
1344	Crane Operator, Hydraulic 80 tons or less				$18.22		$18.36			$18.12	$18.04	$20.21			$18.63	$13.86	
1345	Crane Operator, Hydraulic Over 80 Tons																
1342	Crane Operator, Lattice Boom 80 Tons or Less	$16.82	$14.39	$13.85	$17.27		$15.87			$17.27		$14.67			$16.42	$14.97	$13.87
1343	Crane Operator, Lattice Boom Over 80 Tons				$20.52		$19.38			$20.52		$17.49			$25.13	$15.80	
1306	Crawler Tractor Operator	$13.96	$16.63	$13.62	$14.26		$15.67			$14.07	$13.15	$13.38			$14.60	$13.68	$13.50
1351	Crusher or Screen Plant Operator																
1446	Directional Drilling Locator						$11.67										
1445	Directional Drilling Operator				$20.32		$17.24										
1139	Electrician	$20.96		$19.87	$19.80		$26.35		$20.27	$19.80		$20.92				$27.11	$19.87
1347	Excavator Operator, 50,000 pounds or less	$13.46	$12.56	$13.67	$17.19		$12.88	$14.38	$13.49	$17.19		$13.88			$14.09	$12.71	$14.42
1348	Excavator Operator, Over 50,000 pounds		$15.23	$13.52	$17.04		$17.71			$16.99	$18.80	$16.22				$14.53	$13.52
1150	Flagger	$9.30	$9.10	$8.50	$10.28	$8.81	$9.45	$8.70		$10.06	$9.71	$9.03	$8.81	$9.08	$9.90	$10.33	$8.10
1151	Form Builder/Setter, Structures	$13.52	$12.30	$13.38	$12.91	$12.71	$12.87	$12.38	$12.26	$13.84	$12.98	$13.07	$13.61	$12.82	$14.73	$12.23	$12.25
1160	Form Setter, Paving & Curb	$12.36	$12.16	$13.93	$11.83	$10.71	$12.94			$13.16	$12.54	$11.33	$10.69		$13.33	$12.34	$13.93
1360	Foundation Drill Operator, Crawler Mounted				$17.99					$17.99						$17.43	
1363	Foundation Drill Operator, Truck Mounted		$16.86	$22.05	$21.51		$16.93			$21.07	$20.20	$20.76		$17.54	$21.39	$15.89	$22.05
1369	Front End Loader Operator, 3 CY or Less	$12.28	$13.49	$13.40	$13.85		$13.04	$13.15	$13.29	$13.69	$12.64	$12.89			$13.51	$13.32	$12.17
1372	Front End Loader Operator, Over 3 CY	$12.77	$13.69	$12.33	$14.96		$13.21	$12.86	$13.57	$14.72	$13.75	$12.32			$13.19	$13.17	$13.02
1329	Joint Sealer																
1172	Laborer, Common	$10.30	$9.86	$10.08	$10.51	$10.71	$10.50	$10.24	$10.58	$10.72	$10.45	$10.30	$10.25	$10.03	$10.54	$11.02	$10.15
1175	Laborer, Utility	$11.80	$11.53	$12.70	$12.17	$11.81	$12.27	$12.11	$11.33	$12.32	$11.80	$11.53	$11.23	$11.50	$11.95	$11.73	$12.37
1346	Loader/Backhoe Operator	$14.18	$12.77	$12.97	$15.68		$14.12			$15.18	$13.58	$12.87		$13.21	$14.13	$14.29	$12.90

CLASS. #	CLASSIFICATION DESCRIPTION	ZONE TX07 1/8/16	ZONE TX08 1/8/16	ZONE TX11 1/8/16	ZONE TX12 1/8/16	ZONE TX14 1/8/16	ZONE TX16 1/8/16	ZONE TX18 1/8/16	ZONE TX34 1/8/16	ZONE TX35 1/8/16	ZONE TX37 1/8/16	ZONE TX38 1/8/16	ZONE TX40 1/8/16	ZONE TX41 1/8/16	ZONE TX54 1/8/16	ZONE TX56 1/8/16	ZONE TX63 1/8/16
1187	Mechanic	$20.14	$15.47	$17.47	$17.74	$17.00	$17.10			$17.68	$18.94	$18.58	$17.00	$16.61	$18.46	$16.96	$17.47
1380	Milling Machine Operator	$15.54	$14.64	$12.22	$14.29		$14.18			$14.32	$14.35	$12.86			$14.75	$13.53	$12.80
1390	Motor Grader Operator, Fine Grade	$17.49	$16.52	$16.88	$17.12	$18.37	$18.51	$16.69	$16.13	$17.19	$18.35	$17.07	$17.74	$17.47	$17.08	$15.69	$20.01
1393	Motor Grader Operator, Rough	$16.15	$14.62	$15.83	$16.20	$17.07	$14.63	$18.50		$16.02	$16.44	$15.12	$16.85	$14.47	$17.39	$14.23	$15.53
1413	Off Road Hauler			$10.08	$12.26		$11.88			$12.25		$12.23			$13.00	$14.60	
1196	Painter, Structures					$21.29	$18.34						$21.29			$18.62	
1396	Pavement Marking Machine Operator	$16.42		$13.10	$13.55		$19.17	$12.01		$13.63	$14.60	$13.17		$16.65	$10.54	$11.18	$13.10
1443	Percussion or Rotary Drill Operator																
1202	Piledriver															$14.95	
1205	Pipelayer		$11.87	$14.64	$13.17	$11.17	$12.79		$11.37	$13.24	$12.66	$13.24	$11.17	$11.67		$12.12	$14.64
1384	Reclaimer/Pulverizer Operator	$12.85			$11.90		$12.88			$11.01		$10.46					
1500	Reinforcing Steel Worker	$13.50	$14.07	$17.53	$16.17		$14.00			$16.18	$12.74	$15.83		$17.10		$15.15	$17.72
1402	Roller Operator, Asphalt	$10.95		$11.96	$13.29		$12.78	$11.61		$13.08	$12.36	$11.68			$11.71	$11.95	$11.50
1405	Roller Operator, Other	$10.36		$10.44	$11.82		$10.50	$11.64		$11.51	$10.59	$10.30		$12.04	$12.85	$11.57	$10.66
1411	Scraper Operator	$10.61	$11.07	$10.85	$12.88		$12.27		$11.12	$12.96	$11.88	$12.43		$11.22	$13.95	$13.47	$10.89
1417	Self-Propelled Hammer Operator																
1194	Servicer	$13.98	$12.34	$14.11	$14.74		$14.51	$15.56	$13.44	$14.58	$14.31	$13.83		$12.43	$13.72	$13.97	$14.11
1513	Sign Erector																
1708	Slurry Seal or Micro-Surfacing Machine Operator																
1341	Small Slipform Machine Operator									$15.96							
1515	Spreader Box Operator	$12.60		$13.12	$14.71		$14.04			$14.73	$13.84	$13.68		$13.45	$11.83	$13.58	$14.05
1705	Structural Steel Welder															$12.85	
1509	Structural Steel Worker						$19.29									$14.39	
1339	Subgrade Trimmer																
1143	Telecommunication Technician																
1145	Traffic Signal/Light Pole Worker						$16.00										
1440	Trenching Machine Operator, Heavy						$18.48										
1437	Trenching Machine Operator, Light																
1609	Truck Driver Lowboy-Float	$14.46	$13.63	$13.41	$15.00	$15.93	$15.66			$16.24	$16.39	$14.30	$16.62	$15.63	$14.28	$16.03	$13.41
1612	Truck Driver Transit-Mix				$14.14					$14.14							
1600	Truck Driver, Single Axle	$12.74	$10.82	$10.75	$13.04	$11.61	$11.79	$13.53	$13.16	$12.31	$13.40	$10.30	$11.61		$11.97	$11.46	$10.75
1606	Truck Driver, Single or Tandem Axle Dump Truck	$11.33	$14.53	$11.95	$12.95		$11.68		$14.06	$12.62	$11.45	$12.28		$13.08	$11.68	$11.48	$11.10
1607	Truck Driver, Tandem Axle Tractor with Semi Trailer	$12.49	$12.12	$12.50	$13.42		$12.81	$13.16		$12.86	$16.22	$12.50			$13.80	$12.27	$12.50
1441	Tunneling Machine Operator, Heavy																
1442	Tunneling Machine Operator, Light																
1706	Welder		$14.02		$14.86		$15.97		$13.74	$14.84					$13.78		
1520	Work Zone Barricade Servicer	$10.30	$12.88	$11.46	$11.70	$11.57	$11.85	$10.77		$11.68	$12.20	$11.22	$11.51	$12.96	$10.54	$11.67	$11.76

Notes:

Any worker employed on this project shall be paid at the rate of one and one half (1-1/2) times the regular rate for every hour worked in excess of forty (40) hours per week.

The titles and descriptions for the classifications listed here are further detailed in the AGC of Texas' *Standard Job Classifications and Descriptions for Highway, Heavy, Utilities, and Industrial Construction in Texas* . AGC will make it available on its Web site for any contractor.

TEXAS COUNTIES IDENTIFIED BY
WAGE RATE ZONES: 7, 8, 11, 12, 14, 16, 18, 34, 35, 37, 38, 40, 41, 54, 56, 63

County Name	Zone	County Name	Zone	County Name	Zone	County Name	Zone
Anderson	38	Donley	54	Karnes	37	Reagan	54
Andrews	54	Duval	41	Kaufman	35	Real	54
Angelina	38	Eastland	54	Kendall	16	Red River	38
Aransas	40	Ector	7	Kenedy	41	Reeves	18
Archer	35	Edwards	18	Kent	54	Refugio	37
Armstrong	7	El Paso	34	Kerr	37	Roberts	54
Atascosa	16	Ellis	35	Kimble	54	Robertson	16
Austin	56	Erath	38	King	54	Rockwall	35
Bailey	54	Falls	38	Kinney	18	Runnels	54
Bandera	16	Fannin	38	Kleberg	37	Rusk	11
Bastrop	16	Fayette	37	Knox	54	Sabine	38
Baylor	54	Fisher	54	Lamar	38	San Augustine	38
Bee	37	Floyd	54	Lamb	54	San Jacinto	56
Bell	16	Foard	54	Lampasas	16	San Patricio	40
Bexar	16	Fort Bend	56	LaSalle	41	San Saba	54
Blanco	37	Franklin	38	Lavaca	37	Schleicher	54
Borden	54	Freestone	38	Lee	37	Scurry	54
Bosque	38	Frio	37	Leon	38	Shackelford	54
Bowie	11	Gaines	54	Liberty	56	Shelby	38
Brazoria	56	Galveston	56	Limestone	38	Sherman	54
Brazos	16	Garza	54	Lipscomb	54	Smith	11
Brewster	18	Gillespie	37	Live Oak	37	Somervell	38
Briscoe	54	Glasscock	54	Llano	37	Starr	41
Brooks	41	Goliad	40	Loving	54	Stephens	54
Brown	54	Gonzales	37	Lubbock	7	Sterling	54
Burleson	16	Gray	54	Lynn	54	Stonewall	54
Burnet	37	Grayson	35	Madison	38	Sutton	18
Caldwell	16	Gregg	11	Marion	38	Swisher	54
Calhoun	40	Grimes	38	Martin	54	Tarrant	35
Callahan	35	Guadalupe	16	Mason	37	Taylor	7
Cameron	8	Hale	54	Matagorda	37	Terrell	18
Camp	38	Hall	54	Maverick	41	Terry	54
Carson	7	Hamilton	38	McCulloch	54	Throckmorton	54
Cass	38	Hansford	54	McLennan	16	Titus	38
Castro	54	Hardeman	54	McMullen	41	Tom Green	7
Chambers	56	Hardin	56	Medina	16	Travis	16
Cherokee	38	Harris	56	Menard	54	Trinity	38
Childress	54	Harrison	63	Midland	7	Tyler	38
Clay	35	Hartley	54	Milam	38	Upshur	11
Cochran	54	Haskell	54	Mills	54	Upton	54
Coke	54	Hays	16	Mitchell	54	Uvalde	41
Coleman	54	Hemphill	54	Montague	54	Val Verde	18
Collin	35	Henderson	38	Montgomery	56	Van Zandt	38
Collingsworth	54	Hidalgo	8	Moore	54	Victoria	14
Colorado	37	Hill	38	Morris	38	Walker	38
Comal	16	Hockley	54	Motley	54	Waller	56
Comanche	54	Hood	38	Nacogdoches	38	Ward	54
Concho	54	Hopkins	38	Navarro	38	Washington	38
Cooke	54	Houston	38	Newton	38	Webb	8
Coryell	16	Howard	54	Nolan	54	Wharton	37
Cottle	54	Hudspeth	18	Nueces	40	Wheeler	54
Crane	54	Hunt	35	Ochiltree	54	Wichita	12
Crockett	18	Hutchinson	54	Oldham	54	Wilbarger	54
Crosby	7	Irion	7	Orange	56	Willacy	41
Culberson	18	Jack	38	Palo Pinto	38	Williamson	16
Dallam	54	Jackson	37	Panola	38	Wilson	16
Dallas	35	Jasper	38	Parker	35	Winkler	54
Dawson	54	Jeff Davis	18	Parmer	54	Wise	35
Deaf Smith	54	Jefferson	56	Pecos	18	Wood	38
Delta	35	Jim Hogg	41	Polk	38	Yoakum	54
Denton	35	Jim Wells	37	Potter	7	Young	54
DeWitt	37	Johnson	35	Presidio	18	Zapata	41
Dickens	54	Jones	35	Rains	38	Zavala	41
Dimmit	41			Randall	7		

04-06-2016

Document 00830

TRENCH SAFETY GEOTECHNICAL INFORMATION

1.1 DOCUMENT INCLUDES

A. Trench Safety Geotechnical Information: Geotechnical information obtained for use in design of the trench safety system is included as an attachment to this document.

2.1 RELATED DOCUMENTS

A. Section 02260 - Trench Safety Systems.

END OF DOCUMENT

DOCUMENT 00851

BUY AMERICA REQUIREMENTS

1.0 Contractors shall comply with the latest provisions of Buy America as listed at 23 CFR 635.410 and use steel or iron materials manufactured* in the United States except when:

- the cost of materials, including delivery, does not exceed 0.1% of the total Contract cost or $2,500, whichever is greater;
- the Contract contains an alternate Item for a foreign source steel or iron product and the Contract is awarded based on the alternate Item; or
- the materials are temporarily installed.

2.0 Contractor shall provide a notarized original of the FORM D-9-USA-1 with the proper attachments for verification of compliance. A current version of FORM D-9-USA-1 can be found here:

http://www.txdot.gov/txdoteforms/GetForm?formName=/1818.xdp&appID=/CST&status=/reportError.jsp&configFile=WFServletConfig.xml

* *Manufacturing is any process that modifies the chemical content, physical shape or size, or final finish of a product. Manufacturing begins with initial melting and mixing and continues through fabrication (cutting, drilling, welding, bending, etc.) and coating (paint, galvanizing, epoxy, etc.).*

DOCUMENT 00851

BUY AMERICA REQUIREMENTS

23 Code of Federal Regulations (CFR) Chapter I
§ 635.410 Buy America Requirements

(a) The provisions of this section shall prevail and be given precedence over any requirements of this subpart which are contrary to this section. However, nothing in this section shall be construed to be contrary to the requirements of §635.409(a) of this subpart.

(b) No Federal-aid highway construction project is to be authorized for advertisement or otherwise authorized to proceed unless at least one of the following requirements is met:

(1) The project either: (i) Includes no permanently incorporated steel or iron materials, or (ii) If steel or iron materials are to be used, all manufacturing processes, including application of a coating, for these materials must occur in the United States. Coating includes all processes which protect or enhance the value of the material to which the coating is applied.

(2) The State has standard contract provisions that require the use of domestic materials and products, including steel and iron materials, to the same or greater extent as the provisions set forth in this section.

(3) The State elects to include alternate bid provisions for foreign and domestic steel and iron materials which comply with the following requirements. Any procedure for obtaining alternate bids based on furnishing foreign steel and iron materials which is acceptable to the Division Administrator may be used. The contract provisions must (i) require all bidders to submit a bid based on furnishing domestic steel and iron materials, and (ii) clearly state that the contract will be awarded to the bidder who submits the lowest total bid based on furnishing domestic steel and iron materials unless such total bid exceeds the lowest total bid based on furnishing foreign steel and iron materials by more than 25 percent.

(4) When steel and iron materials are used in a project, the requirements of this section do not prevent a minimal use of foreign steel and iron materials, if the cost of such materials used does not exceed one-tenth of one percent (0.1 percent) of the total contract cost or $2,500, whichever is greater. For purposes of this paragraph, the cost is that shown to be the value of the steel and iron products as they are delivered to the project.

(c)(1) A State may request a waiver of the provisions of this section if;

(i) The application of those provisions would be inconsistent with the public interest; or

(ii) Steel and iron materials/products are not produced in the United States in sufficient and reasonably available quantities which are of a satisfactory quality.

(2) A request for waiver, accompanied by supporting information, must be submitted in writing to the Regional Federal Highway Administrator (RFHWA) through the FHWA Division Administrator. A request must be submitted sufficiently in advance of the need for the waiver in order to allow time for proper review and action on the request. The RFHWA will have approval authority on the request.

(3) Requests for waivers may be made for specific projects, or for certain materials or products in specific geographic areas, or for combinations of both, depending on the circumstances.

(4) The denial of the request by the RFHWA may be appealed by the State to the Federal Highway Administrator (Administrator), whose action on the request shall be considered administratively final.

(5) A request for a waiver which involves nationwide public interest or availability issues or more than one FHWA region may be submitted by the RFHWA to the Administrator for action.

(6) A request for waiver and an appeal from a denial of a request must include facts and justification to support the granting of the waiver. The FHWA response to a request or appeal will be in writing and made available to the public upon request. Any request for a nationwide waiver and FHWA's action on such a request may be published in the FEDERAL REGISTER for public comment.

(7) In determining whether the waivers described in paragraph (c)(1) of this section will be granted, the FHWA will consider all appropriate factors including, but not limited to, cost, administrative burden, and delay that would be imposed if the provision were not waived.

(d) Standard State and Federal-aid contract procedures may be used to assure compliance with the requirements of this section.

[48 FR 53104, Nov. 25, 1983, as amended at 49 FR 18821, May 3, 1984; 58 FR 38975, July 21, 1993]

November 25, 1983 Final Rule
ıy America Requirements

DEPARTMENT OF TRANSPORTATION
Federal Highway Administration
AGENCY: Federal Highway Administration [FHWA], DOT.
23 CFR Part 635
Buy America Requirements
48 FR 53099
November 25, 1983

ACTION: Final rule.

SUMMARY: The Federal Highway Administration (FHWA) is amending its Buy America regulation to implement procedures required by section 165 of the Surface Transportation Assistance Act (STAA) 1982 (Pub. L. 97-424). Section 165 provides with exceptions that funds authorized for Federal-aid highway projects may not be obligated unless the steel, cement, and manufactured products used in such projects are produced in the United States. The amendments are based on a review of comments received in response to an interim final rule (January 17, 1983) (48 FR 1946) and to amendments to that interim final rule (May 26, 1983) (48 FR 23631) which were issued to temporarily implement section 165. The final rule provides for application of the revised Buy America provisions to steel and cement regardless of project cost. The waiver exempting manufactured products other than steel and cement contained in the January 17, 1983, interim final rule is retained.

EFFECTIVE DATE: The final rule is effective December 27, 1983.

FOR FURTHER INFORMATION CONTACT: Mr. P. E. Cunningham, Construction and Maintenance Division, (202) 426-0392, or Ms. Ruth R. Johnson, Office of the Chief Counsel, (202) 426-0781, Federal Highway Administration, 1200 New Jersey Avenue SE, Washington, D.C. 20590. Office hours are from 7:45 a.m. to 4:15 p.m. ET, Monday through Friday.

TEXT: SUPPLEMENTARY INFORMATION:

.ckground

The FHWA is issuing a final rule revising the existing Buy America regulation to implement procedures required by section 165 of the STAA of 1982. Section 165 provides that, with exceptions, funds authorized by the STAA of 1982, title 23 of the United States Code, the Urban Mass Transportation Act of 1964, or the STAA of 1978 may not be obligated for highway projects unless steel, cement, and manufactured products used in such projects are produced in the United States. The legislative language also requires Buy America to apply to all projects as opposed to previous provisions which only applied to projects costing more than $500,000. The STAA of 1982 also permits States to impose more stringent requirements than are imposed by section 165 and revises the total contract cost differential permitting the use of foreign materials from 10 percent to 25 percent.

An interim final rule was issued under emergency procedures on January 17, 1983, with an expiration date of September 30, 1983. Comments were requested on or before July 1, 1983. In that interim rule, the FHWA determined that it was in the public interest and not inconsistent with the legislative intent to temporarily waive the provisions of section 165 as they applied to manufactured products other than cement and steel, as well as to projects estimated to cost less than $450,000. On May 26, 1983, an amendment to the interim final rule was published in consideration of comments which had been received to that date. The primary change was elimination of the $450,000 threshold, thereby making the Buy America provisions applicable to all federally funded highway projects regardless of size. The comment period on the interim final rule as amended was extended to August 1, 1983. On September 30, 1983, an emergency regulation was published which extended the expiration date of the interim final rule as amended, from September 30, 1983, until the date a final rule becomes effective.

Analysis of Comments to the Docket

On August 1, when Docket 83-2 closed, FHWA had received in excess of 560 comments. Members of Congress, foreign governments, manufacturers, suppliers, contractors, State and local agencies, and other parties were represented among the commenters. The FHWA fully considered the issues raised by these commenters as it developed this final regulation.

The principal issues brought out in the docket were that the threshold should be eliminated or lowered, that asphalt should be ·empted in the final rule, and that Canadian clinker/cement imports should be permitted.

In general, domestic manufacturers and suppliers agreed with the interim rule; while importers, users, and transporters of imported products, foreign governments and foreign suppliers believe that the regulation reduces competition, restricts free trade, and is inflationary. The issues raised by the commenters were considered in light of the intent of Congress and how

00851-1

implementation of a Buy America rule would affect the administering agencies, the construction industry, and the general public.

The commenters could be characterized as follows:

- Asphalt Paving Related Organizations -- 175 Commenters
- Steel Fabricators/Suppliers/Erectors -- 114 Commenters
- Ready-Mix Concrete Related Organizations/Cement Transporters -- 56 Commenters
- Domestic Steel Manufacturers/Associations -- 25 Commenters
- Private Citizens -- 18 Commenters
- Cast Iron Related Organizations -- 17 Commenters
- State and Local Highway Agencies/Governments -- 17 Commenters
- Oil Corporations/Refiners/Associations -- 15 Commenters
- Congressional Comments -- 45 Congressmen
- Domestic Cement Manufacturers -- 14 Commenters
- Prestressed Concrete Related Organizations -- 12 Commenters
- Others -- 82 Commenters

The following is a general discussion of the comments received in Docket 83-2:

I. Comments Regarding the $450,000 Threshold

Over 150 respondents commented on the FHWA decision, in the interim final rule published January 17, to temporarily waive the provisions of section 165 as they apply to projects estimated to cost less than $450,000. Most of the commenters on this issue objected to the $450,000 waiver with many noting that there was no legislative support for establishing any threshold of applicability. A number of respondents noted that limiting applicability of the Buy America provisions violates the letter and the spirit of the STAA of 1982.

Generally, respondents in favor of continuing the waiver included State and local highway agencies and groups representing foreign nations or foreign exporters. One of the State highway agencies commented that use of the $450,000 exclusion had been effective in holding down the cost of administering the Buy America regulations. Several commenters stated that the resource limitations of small local highway agencies would make the administration of the Buy America provisions difficult.

Respondents commenting on the waiver recommended a number of different threshold levels: 35 percent recommended total elimination; 20 percent favored a "drastically lower" threshold; 25 percent suggested placing the threshold at $50,000; 15 percent believe $100,000 is appropriate; and the remaining 5 percent suggested retaining the present $450,000 threshold level.

II. Comments Regarding Steel

Respondents who commented on steel related issues were generally concerned with prestressing strand.

A number of commenters, including State highway agencies and domestic manufacturers who produce strand from foreign high carbon steel rod, asked that prestressing strand be excluded from the list of steel products covered by Buy America provisions. Some of these commenters noted that the regulation should be concerned with the process of domestic manufacturing of prestressing strand from rod, rather than being concerned with the exclusive use of U.S. made rod. Other concerns included: disposition of current inventories; future availability of qualified strand; domestic manufacturers would raise prices and slow deliveries if foreign competition was excluded; strikes by domestic employees; and that elimination of some of the major manufacturers might cause supply problems in the event of an economic turnaround.

III. Comments Regarding Cement

Over 80 comments were received from respondents who were concerned with the extent of the Buy America provision as it applied to cement.

Many of the commenters in the northern States specifically asked for a waiver in section 165 to allow Canadian cement. These commenters included State highway agencies, ready-mix contractors, cement transporters and various concrete associations. They argued that: supply by the U.S. domestic cement industry is inconsistent and the Canadian cement industry has provided a stable source of cement; Canadian cement producers have major investments in the U.S. which contribute to local taxes, domestic employment, and local business activity for the purchase of equipment and maintenance; the cost of concrete would increase due to increased prices of the limited domestic cement; additional capital investments would be necessary for domestic concrete producers to handle and store this cement; exclusion of Canadian cement would

disrupt the market and alienate the Canadian producers who for years have been a very stabilizing influence; and, that it would create a hardship on domestic transporters of cement manufactured in Canada.

Domestic cement manufacturers welcomed the Buy America rule. A number of them stated that the regulation should specifically state that cement made in the U.S. does not include cement made with imported clinker.

Comments from domestic manufacturers regarding the importation of foreign cement or clinker indicated that a rise in imports at the expense of an under-utilized domestic capacity could well result in a problem similar to that of the U.S. steel industry attempting to compete against a flood of imports with existing domestic plants and equipment that are functionally obsolete. Approximately 90 percent of the production cycle is complete at the time the clinker has been produced and, therefore, 90 percent of the work force producing cement would be Canadians. Further they believed that the issues of public interest extend beyond the borders of an individual State. States should recognize in reviewing localized waiver requests that for every ton of Canadian clinker brought into this country, less work is available for American workers in the domestic cement industry.

IV. Comments Regarding Manufactured Products

A number of respondents objected to the waiver of the provisions of section 165 as they apply to manufactured products. The following comments were made: since American taxpayers are taxed to build highways, American industries should benefit; contractors should be compelled to use American made products or their bids should be rejected; the waiver is not in accord with the intent of Congress; the Buy America provisions should apply to construction machinery used on all projects funded by the STAA of 1982.

A number of respondents believe that the regulation should not allow imported manhole and drainage structure castings to be used on the new highway program. Their basis for this position was that the FHWA would be circumventing the intent of Congress; that there are a large number of foundries scattered throughout the United States with heavy inventories; and that cast metal products can arguably be defined as steel products within the intent of the legislation.

Because of administrative difficulties, several State highway agencies were opposed to the extension of the regulation to include manufactured products unless one of the following changes is made: (1) "Manufactured product" is defined so that only the final manufacturing process which produces a usable product is considered in the determination of foreign versus domestic character or (2), domestic items determined by the FHWA to be of inferior quality or in short supply should be excluded from the regulation or their application phased in to provide for development of domestic supplies. Several commenters noted that it is virtually impossible for a contracting agency to trace all components of some manufactured products incorporated into highway products; e.g.; signal controllers, glass for the signal heads, almost all electrical equipment, paints, and asphalt.

Comments were received from individual respondents interested in extending Buy America provisions to specific manufactured products; i.e., glass beads, pavement joint sealants, and wick drains. Comments were received from a number of respondents seeking to exempt certain specific manufactured products from Buy America provision based on considerations such as limited domestic availability. These products include fencing, ground rubber, laminated bridge bearings, and steel extrusions.

Miscellaneous comments concerning manufactured products included a recommendation that imported materials already in storage should not be subject to the Buy America regulation. Commenters also recommended that the regulation should exempt material originating in the U.S. which is shipped to a foreign country to undergo additional processing then returned for use in highway construction.

V. Comments Regarding Oil Products

Over 200 comments were received regarding the application of Buy America provisions to oil products. Virtually all the commenters (asphalt paving contractors and associations, State highway agencies, oil companies, etc.) asked that oil and/or petroleum products and/or asphalt be exempted from the final rule. Of those comments received on oil products, 20 percent of the respondents requested an exemption for foreign crude in the final rule; 30 percent of the respondents recommended exempting all petroleum products; approximately 15 percent of the respondents asked for a waiver for asphalt; and approximately 30 percent asked to exempt crude oil and component by-products. Less than 5 percent recommended including petroleum products and/or asphalt.

Respondents asked that the Buy America provisions be waived for crude oil products, noting that the eastern U.S. is almost entirely dependent upon foreign crude for asphalt and related petroleum products. They argued that a ban on the use of foreign crude oil would be counterproductive resulting in prohibitively high prices and the consumption of a disproportionate share of one of the United States' most valuable and rapidly diminishing natural resources.

A limited number of commenters, all oil companies or refiners, asked that petroleum products, in some fashion, be covered under Buy America provisions. Their comments noted that although the refining capacity of the U.S. is more than adequate to supply current requirements for asphalt and other highway project related products, insufficient amounts of crude oil are produced domestically to satisfy demand. These commenters believe that the waiver should therefore apply permanently to the crude oil component of asphalt or other petroleum products used in federally assisted projects, but not to the asphalt and other petroleum products.

VI. Miscellaneous Comments of Interest

Some commenters stated that the 25 percent preference insures that the STAA of 1982 will in fact reinforce American jobs, industry, and tax base, and will revitalize America's roads at the lowest "real" cost to the taxpayer.

Others commented that the allowance of a 25 percent or greater difference in the foreign bid versus native bid is inflationary and very counterproductive.

There was, however, a small number (less than 2 percent) of respondents who expressed philosophical opposition to the Buy America concept. These commenters included a State highway agency, foreign governments, contractors, equipment suppliers, a ready mix concrete association, and others. The comments basically noted that the use or non-use of foreign products should be left to the discretion of the States. They believed that because open trade between countries has been very beneficial in the past, it should not be ruled out completely as these provisions would do. The Canadian authorities view the Buy America provisions of the STAA as possibly in violation of the U.S. General Agreement on Tariffs and Trade (GATT). They believe that the Buy America provisions nullify and impair trade concessions which have been agreed to during multilateral GATT negotiations which the U.S. is obligated to observe. Given the economic climate in Canada, the Canadian authorities noted that this type of U.S. action will significantly add to pressure in Canada for similar protectionist measures.

Discussion of Revisions

A summary of the revisions to the existing provisions in 23 CFR 635.410 follows.

I. Exclusion of Manufactured Products

Most responses from product manufacturers recommended that manufactured products should be excluded from Buy America and/or expressed only a passing interest in the regulation. In evaluating the comments from manufacturers and suppliers who wanted to be covered, the indication was that they favored free trade agreements; however, they protested unfair practices such as foreign subsidized dumping, and foreign import restrictions. Government intervention may well be warranted to protect against these practices, but protectionism in terms of a Buy America regulation on all manufactured products would not serve this purpose.

The FHWA believes the message that Congress, State/local governments, and others sent was not to apply an all-inclusive Buy America rule. Although the earlier Buy America statute, section 401 of the STAA of 1978, provided that both unmanufactured and manufactured "articles, materials, and supplies" were covered under Buy America, the FHWA noted that only foreign structural steel could have a significant nationwide effect on the cost of Federal-aid highway construction projects. Therefore, FHWA determined it was in the public interest to apply section 401 only to structural steel. Section 165 of the STAA of 1982 reinforced congressional intent that Buy America should be applied to steel products. Section 165, however, also specifically cites cement products as covered for the first time and it does not apply at all to raw materials. With respect to manufactured products, Section 165 does not differ in its coverage from section 401 of the STAA of 1978. Since FHWA has never covered all manufactured products under its Buy America regulation and Congress did not specifically direct a change in that policy in enacting section 165, FHWA does not believe that all manufactured products must be covered.

Although asphalt use on Federal-aid highway construction is greater than cement and nearly equal to steel, many comments were received expressing support for an exemption for that manufactured product. It should be noted that the congressional debate on Section 165 was focused on the American steel and cement industries and little or no attention was given to the effect of the provision on the asphalt market [128 Cong. Rec. H8984-8990 (daily ed. December 6, 1982)]. A large number of congressional commenters pointed this out in urging an exemption for asphalt. The FHWA considered the minimal use and economic effect of applying Buy America to manufactured products other than asphalt and noted the potential administrative burdens to the State and contractors if those products were covered.

The materials and products other than steel, cement, asphalt, and natural materials comprise a small percent of the highway construction program. The FHWA agrees with the commenters who noted that it is very difficult to identify the various materials and then trace their origin. A manufactured product such as a traffic controller which has many components is particularly difficult to trace. For these reasons and because unfair practices or other specific problems can

be addressed by import laws such as title VII of the Tariff Act of 1930, as amended (19 U.S.C. 1671 et. seq.) (Imposition of Antidumping Duties), the FHWA finds that it is in the public interest to waive the application of Buy America to manufactured products other than steel and cement manufactured products.

II. Inclusion of Steel Products

Although Congress included steel, cement, and manufactured products in the STAA, the FHWA interim rule which was effective following enactment of the law on January 6 applied only to steel products and cement products. Previous provisions applied only to structural steel and a determination of foreign or domestic character was based upon the place of manufacture and on the origin of more than 50 percent of the components. The determination to include only structural steel was based in part on the word "substantially" in the language of Section 401 (1978-STAA).

By denoting "steel" in Section 165 (1982 STAA), Congress called attention to their intent to make the coverage more encompassing. The legislative history is also clear on this point. Congressional concern that Federal money spent to improve highways should also aid U.S. industry is apparent in the first sentence of Section 165 which requires the Secretary of Transportation to ensure that funds authorized for Federal-aid highway projects would only buy U.S. made steel. The FHWA therefore, has expanded the Buy America rule to include all steel products.

III. Inclusion of Cement Products

The issue of cement coverage under Buy America centered around imports from Canada. Over 90 percent of the letters received on this issue asked that Canadian cement/clinker imports be exempt from Buy America.

The FHWA recognizes that the U.S. plants which currently import clinker and grind that material into cement will have to change their operations if they desire to continue to be a supply source for Federal-aid highway projects. They can do this in several ways. For example, they can expand to perform all manufacturing processes in the U.S. or only use domestically produced clinker. As another alternative, they will be able to segregate their production of cement made from U.S. and non-U.S. clinker either by using separate facilities or producing in separate production runs. The existing domestic industry, which utilizes foreign imports, will have to make some adjustments, to avoid job displacements resulting from Buy America. However, those adjustments should not be major.

Several commenters were concerned that applying Buy America to cement would force concrete batch plants to separate their domestic and foreign cement storage or to use only domestic cement. FHWA does not believe the impact of this requirement will be great. Normally, if a large quantity of concrete will be needed, new batch plants are set up on the site or existing batch plants are dedicated to the project. Therefore, the commenters' concerns would be valid only to a small amount of cement. It is possible that, if a concrete supplier is unwilling to comply with the Buy America requirement by separating its foreign and domestic cement and is dependent on Federal-aid contracts for continued profitability, it could be economically injured. However, Section 165 specifically requires that only domestic produced cement shall be used on Federal-aid highway construction. The congressional debate on section 165 clearly refers to cement [128 Congressional Record S14772 (daily edition December 15, 1982)]. Segregated cement storage is the best way to assure that only domestic cement will be incorporated into the work and the minimal burden this imposes is fully warranted.

Congress was very specific in including the term "cement" in the Buy America rule and in stating that cement products must be produced in the United States. "Produced in the U.S." means that all manufacturing processes whereby a raw material is changed or transformed into an article which, because of the process, is different from the original product, must occur domestically. Congress intended that the funds authorized by the Act would mainly benefit American workers and that increasing the demand for U.S. cement products would help the cement industry. Congress fully recognized that there would be a cost to implementing this rule. Therefore, the shortage of cement in a particular geographical area cannot be used as a justification to allow imports if the material is available anywhere domestically and can be supplied at a reasonable cost differential.

The FHWA, therefore, has included comment products in the Buy America rule. It is noted that administrative procedures are provided in the final rule to apply waivers in accordance with the legislation to afford some relief in those instances where the cement product inclusion creates situations which are not in the public interest or where the cement product is not produced in the United States in sufficient and reasonably available quantities of satisfactory quality.

IV. Program Coverage

The final rule requires that steel products and cement products be produced domestically, and only those products which are brought to the construction site and permanently incorporated into the completed project are covered. Construction materials, forms, etc., which remain in place at the contractor's convenience, but are not required by the contract, are not covered.

00851-5

To further define the coverage, a domestic product is a manufactured steel or cement construction material that was produced in one of the 50 States, the District of Columbia, Puerto Rico, or in the territories and possessions of the United States. Raw materials used in the steel and/or cement product may be imported. All manufacturing processes to produce steel and cement products must occur domestically. Raw materials are materials such as iron ore, limestone, waste products, slag used in cement/concrete, etc., which are used in the manufacturing process to produce the steel or cement products. Waste products would include scrap; i.e., steel no longer useful in its present form from old automobiles, machinery, pipe, railroad tracks and the like. Also steel trimmings from mills or product manufacturing are considered waste. Extracting, crushing, and handling the raw materials which is customary to prepare them for transporting are exempt from Buy America.

V. Threshold

The STAA of 1978 (Public Law 95-599), passed in November of 1978 covered projects whose total cost exceeded $500,000. When FHWA implemented the STAA of 1978, it exempted the Buy America provisions from projects estimated to cost less than $450,000. This allowed the construction cost to exceed the estimate by more than 10 percent before the total project cost would exceed $500,000, thus triggering application of the Act.

The STAA of 1982 did not include a threshold even though there exists legislative colloquy indicating it would be continued. The FHWA, however, retained the threshold from the existing regulation in the interim final rule, noting that it would eliminate the administrative burden of enforcing Buy America on a major percentage of highway projects of small size. Effective June 10, 1983, it was decided that for the remainder of the comment period and until the final rule was published that the threshold should be eliminated. It was hoped that information based on experience without a threshold could be obtained before the final rule was implemented.

The FHWA has determined that the administrative burden of including a Buy America provision in all contracts does not warrant the reimposition of a threshold. Also, although there in no conclusive information, FHWA believes that the contractors' documentation of compliance with Buy America for steel and cement does not place a significant burden on them. The FHWA has eliminated the threshold making Buy America applicable to all projects. However, it should be noted that the final rule does permit a very minimal use of foreign steel and cement. The purpose of this is to eliminate placing an administrative burden on the States for truly minor items.

Waivers

A State may request a waiver of the provisions of this section for specific projects and/or certain materials or products in specific locations. The basis for the request may be either a public interest finding or a determination that the product is not available domestically. An example of public interest would be a finding that applying Buy America would actually reduce rather than create jobs.

If the State finds, that a waiver request is warranted, it may document a justification for that waiver through the FHWA division office in its State and then to the Regional Federal Highway Administrator. There will be circumstances where a waiver should apply to an area larger than a region and possibly nationwide. In those cases, the Federal Highway Administrator will consider the merits of the problem and, if appropriate, approve a waiver which would afford uniform applications throughout the area affected. These cases would be forwarded to the Federal Highway Administrator by the Regional Administrator or arise when the Washington Headquarters ascertains that two regions may be acting on the same request.

VII. Compliance

The State's standard contract control procedures to assure that the contractor meets the terms of the contract shall be applicable to verify compliance with Buy America. It is presumed that a bidder who enters into a contract with a State agrees to comply with the Buy America provision. The States are expected to provide sufficient oversight to ensure compliance with the Buy America provisions. Penalties should be applied as may be appropriate in accordance with the standard State and Federal-aid procedures.

VIII. Legislative Changes

Section 165 sets forth two other requirements which supersede the previous requirements contained in section 401 of the 1978 STAA. The legislative language permits States to impose more stringent requirements than are imposed by section 165. Previously, only those State Buy America provisions which were in effect prior to the enactment of the STAA of 1978 were permitted. The STAA of 1982 also revises the total contract cost differential permitting the use of foreign materials from 10 percent to 25 percent. These two changes are incorporated into the final rule.

IX. Procedural Changes

The final rule implements three procedural changes from the interim final rule. The first involves confusion with the provisions in the STAA of 1982 which permit States to impose more stringent Buy America requirements than are contained in the Federal regulation.

Several comments were received which showed that this provision was being misunderstood. Specifically, State legislatures were considering "Buy-State materials and products preference" for Federal-aid highway work. Such a provision in Federal-aid contracts would be in violation of the longstanding prohibition contained in 23 CFR 635.409(a) against State restrictions on the use of articles or materials made or produced in any other State, territory, or possession of the United States. The issue addressed in section 165 of the STAA of 1982 is that certain materials must be produced in the United States rather than in foreign countries. This is obvious from the inclusion of the words "foreign countries" in the aforementioned provision regarding more stringent State requirements. Section 635.410(a) is being revised to clarify this matter.

The second procedural change is necessary to clarify the application of the alternate bid provisions. The previous regulation required alternate bids for foreign and domestic structural steel. Since the STAA of 1982 permits States to impose more stringent Buy America requirements than are imposed by section 165, it has been pointed out that a State could elect to prohibit the use of foreign steel or cement even on projects which could allow alternate bids under Section 635.410(b)(3). Therefore, the final rule is simplified by replacing the alternate bid requirements with a statement that alternate bids for foreign and domestic materials may be included on any Federal-aid highway project at the State's election. The FHWA still encourages States to consider alternate bids on projects where foreign materials are likely to be competitive even with the 25 percent cost differential.

Third, Section 635.410(b)(2) has been deleted. The paragraph has provided that certification acceptance (CA) procedures would apply to the Buy America provisions. However, section 165 of the STAA of 1982 is not incorporated into title 23 U.S.C. to which CA is applicable.

The FHWA has determined that this document does not contain a major rule under Executive Order 12291. However, under the regulatory policies and procedures of the DOT, this rulemaking action is considered significant based on the public interest involved.

A regulatory evaluation/regulatory flexibility assessment has been prepared and is available for review in the public docket. A copy may be obtained by contacting Mr. P. E. Cunningham at the address provided under the heading "FOR FURTHER INFORMATION CONTACT." The FHWA has determined that this action will not have a significant economic impact on a substantial number of small entities based upon the evaluation prepared.

List of Subjects in 23 CFR Part 635

Buy America, Government contracts, Grants programs -- transportation, Highways and roads.

In consideration of the foregoing, and under the authority of 23 U.S.C. 315, section 165, STAA of 1982, Pub. L. 97-424, 96 Stat. 2136, and 49 CFR 1.48(b), the FHWA amends Part 635, Subpart D, by revising Section 635.410 of 23 CFR to read as set forth below.

(Catalog of Federal Domestic Assistance Program Number 20.205, Highway Research, Planning and Construction. The regulations implementing Executive Order 12372 regarding intergovernmental consultation on Federal programs and activities apply to this program)

Issued on November 21, 1983.
R. A. Barnhart,
Administrator, Federal Highway Administration.

PART 635 -- [AMENDED]

Section 635.410 Buy America requirements.

a. The provisions of this section shall prevail and be given precedence over any requirements of this subpart which are contrary to this section. However, nothing in this section shall be construed to be contrary to the requirements of Section 635.409(a) of this subpart.
b. No Federal-aid highway construction project is to be authorized for advertisement or otherwise authorized to proceed unless at least one of the following requirements is met:
    1. The project either: (i) Includes no permanently incorporated steel or (ii) if cement or steel materials are to be used, all manufacturing processes for these materials must occur in the United States.

00851-7

2. The State has standard contract provisions that require the use of domestic materials and products, including cement and steel materials, to the same or greater extent as the provisions set forth in this section.
3. The State elects to include alternate bid provisions for foreign and domestic steel and/or cement materials which comply with the following requirements. Any procedure for obtaining alternate bids based on furnishing foreign steel and/or cement materials which is acceptable to the Division Administrator may be used. The contract provisions must (i) require all bidders to submit a bid based on furnishing domestic steel and/or cement materials, and (ii) clearly state that the contract will be awarded to the bidder who submits the lowest total bid based on furnishing domestic steel and/or cement materials unless such total bid exceeds the lowest total bid based on furnishing foreign steel and/or cement materials by more than 25 percent.
4. When cement and steel materials are used in a project, the requirements of this section do not prevent a minimal use of foreign cement and steel materials, if the cost of such materials used does not exceed one-tenth of one percent (0.1 percent) of the total contract cost or $2,500, whichever is greater. For purposes of this paragraph, the cost is that shown to be the value of the steel and/or cement products as they are delivered to the project.

c.

1. A State may request a waiver of the provisions of this section if;
   i. The application of those provisions would be inconsistent with the public interest; or
   ii. Steel and cement materials/products are not produced in the United States in sufficient and reasonably available quantities which are of a satisfactory quality.
2. A request for waiver, accompanied by supporting information, must be submitted in writing to the Regional Federal Highway Administrator (RFHWA) through the FHWA Division Administrator. A request must be submitted sufficiently in advance of the need for the waiver in order to allow time for proper review and action on the request. The RFHWA will have approval authority on the request.
3. Requests for waivers may be made for specific projects, or for certain materials or products in specific geographic areas, or for combinations of both, depending on the circumstances.
4. The denial of the request by the RFHWA may be appealed by the State to the Federal Highway Administrator (Administrator), whose action on the request shall be considered administratively final.
5. A request for a waiver which involves nationwide public interest or availability issues or more than one FHWA region may be submitted by the RFHWA to the Administrator for action.
6. A request for waiver and an appeal from a denial of a request must include facts and justification to support the granting of the waiver. The FHWA response to a request or appeal will be in writing and made available to the public upon request. Any request for a nationwide waiver and FHWA's action on such a request may be published in the Federal Register for public comment.
7. In determining whether the waivers described in paragraph (c)(1) of this section will be granted, the FHWA will consider all appropriate factors including, but not limited to, cost, administrative burden, and delay that would be imposed if the provision were not waived.

d. Standard State and Federal-aid contract procedures may be used to assure compliance with the requirements of this section.

(23 U.S.C. 315; sec. 165, Surface Transportation Assistance Act of 1982, Pub. L. 97-424, 96 Stat. 2097; 49 CFR 1.48(b).

[FR Doc. 83-31656 Filed 11-23-83; 8:45 am]

00851-8

DOCUMENT 00852

CHANGED CONDITION CLAUSES

23 CFR § 635.109
Standardized Changed Condition Clauses

(a) Except as provided in paragraph (b) of this section, the following changed conditions contract clauses shall be made part of, and incorporated in, each highway construction project approved under 23 U.S.C. 106:

(1) *Differing site conditions.*

(i) During the progress of the work, if subsurface or latent physical conditions are encountered at the site differing materially from those indicated in the contract or if unknown physical conditions of an unusual nature, differing materially from those ordinarily encountered and generally recognized as inherent in the work provided for in the contract, are encountered at the site, the party discovering such conditions shall promptly notify the other party in writing of the specific differing conditions before the site is disturbed and before the affected work is performed.

(ii) Upon written notification, the engineer will investigate the conditions, and if it is determined that the conditions materially differ and cause an increase or decrease in the cost or time required for the performance of any work under the contract, an adjustment, excluding anticipated profits, will be made and the contract modified in writing accordingly. The engineer will notify the contractor of the determination whether or not an adjustment of the contract is warranted.

(iii) No contract adjustment which results in a benefit to the contractor will be allowed unless the contractor has provided the required written notice

(iv) No contract adjustment will be allowed under this clause for any effects caused on unchanged work. (This provision may be omitted by the STD's at their option.)

(2) *Suspensions of work ordered by the engineer.*

(i) If the performance of all or any portion of the work is suspended or delayed by the engineer in writing for an unreasonable period of time (not originally anticipated, customary, or inherent to the construction industry) and the contractor believes that additional compensation and/or contract time is due as a result of such suspension or delay, the contractor shall submit to the engineer in writing a request for adjustment within 7 calendar days of receipt of the notice to resume work. The request shall set forth the reasons and support for such adjustment.

(ii) Upon receipt, the engineer will evaluate the contractor's request. If the engineer agrees that the cost and/or time required for the performance of the contract has increased as a result of such suspension and the suspension was caused by conditions beyond the control of and not the

fault of the contractor, its suppliers, or subcontractors at any approved tier, and not caused by weather, the engineer will make an adjustment (excluding profit) and modify the contract in writing accordingly. The contractor will be notified of the engineer's determination whether or not an adjustment of the contract is warranted.

(iii) No contract adjustment will be allowed unless the contractor has submitted the request for adjustment within the time prescribed.

(iv) No contract adjustment will be allowed under this clause to the extent that performance would have been suspended or delayed by any other cause, or for which an adjustment is provided or excluded under any other term or condition of this contract.

(3) *Significant changes in the character of work.*

(i) The engineer reserves the right to make, in writing, at any time during the work, such changes in quantities and such alterations in the work as are necessary to satisfactorily complete the project. Such changes in quantities and alterations shall not invalidate the contract nor release the surety, and the contractor agrees to perform the work as altered.

(ii) If the alterations or changes in quantities significantly change the character of the work under the contract, whether such alterations or changes are in themselves significant changes to the character of the work or by affecting other work cause such other work to become significantly different in character, an adjustment, excluding anticipated profit, will be made to the contract. The basis for the adjustment shall be agreed upon prior to the performance of the work. If a basis cannot be agreed upon, then an adjustment will be made either for or against the contractor in such amount as the engineer may determine to be fair and equitable.

(iii) If the alterations or changes in quantities do not significantly change the character of the work to be performed under the contract, the altered work will be paid for as provided elsewhere in the contract.

(iv) The term "significant change" shall be construed to apply only to the following circumstances:

(A) When the character of the work as altered differs materially in kind or nature from that involved or included in the original proposed construction; or

(B) When a major item of work, as defined elsewhere in the contract, is increased in excess of 125 percent or decreased below 75 percent of the original contract quantity. Any allowance for an increase in quantity shall apply only to that portion in excess of 125 percent of original contract item quantity, or in case of a decrease below 75 percent, to the actual amount of work performed.

(b) The provisions of this section shall be governed by the following:

(1) Where State statute does not permit one or more of the contract clauses included in paragraph (a) of this section, the State statute shall prevail and such clause or clauses need not be made applicable to Federal-aid highway contracts.

(2) Where the State transportation department has developed and implemented one or more of the contract clauses included in paragraph (a) of this section, such clause or clauses, as developed by the State transportation department may be included in Federal-aid highway contracts in lieu of the corresponding clause or clauses in paragraph (a) of this section. The State's action must be pursuant to a specific State statute requiring differing contract conditions clauses. Such State developed clause or clauses, however, must be in conformance with 23 U.S.C., 23 CFR and other applicable Federal statutes and regulations as appropriate and shall be subject to the Division Administrator's approval as part of the PS&E.

(c) In the case of a design-build project, STDs are strongly encouraged to use "suspensions of work ordered by the engineer" clauses, and may consider "differing site condition" clauses and "significant changes in the character of work" clauses which are appropriate for the risk and responsibilities that are shared with the design-builder.

[56 FR 37004, Aug. 2, 1991; 57 FR 10062, Mar. 23, 1992, as amended at 67 FR 75925, Dec. 10, 2002]

Document 00910

ADDENDUM NO. _____

Date of Addendum: ____________________
****Enter date by hand when signed for release****

PROJECT NAME: Greens Road Paving and Drainage Improvements from Aldine Westfield to J.F Kennedy Boulevard

PROJECT NO: WBS No. N-000686-0002-4; CSJ 0912-71-739

BID DATE: August 11, 2016 (There is no change to the Bid Date.)

FROM: J. Timothy Lincoln, P.E., City Engineer
City of Houston, Department of Public Works and Engineering
611 Walker Street
Houston, Texas 77002
Attn: *Sudarshan Gouni, P.E.*, Project Manager

TO: Prospective Bidders

This Addendum forms a part of the Bidding Documents and will be incorporated into the Contract documents, as applicable. Insofar as the original Project Manual and Drawings are inconsistent, this Addendum governs.

****

Use the following heading and select the appropriate wording for postponement of the Bid Date. Delete the statement beside Bid Date above which indicates that the Bid Date is unchanged. If change in Bid Date, issue as separate addendum. Delete this section entirely if there is no change in Bid Date.

****

CHANGE IN BID DATE

The Bid Date for this Project has been changed from _____________ to _____________.
Date Date

[Time of day and place for submittal of bid remains the same]. [Time of submittal has been changed from _____________ to _____________. The place for submittal
Time Time

remains the same].

****[OR]****

The bid date for this project has been indefinitely postponed.

****

Delete the following paragraph if the sole purpose of the Addendum is to postpone the Bid Date.

****

This Addendum uses the change page method: remove and replace or add pages, or Drawing sheets, as directed in the change instructions below. Change bars (|) are provided in the outside margins of pages from the Project Manual to indicate where changes have been made; no change bars are provided in added Sections. Reissued Drawing Sheets show the Addendum number below the title block and changes in the Drawing are noted by a revision mark and enclosed in a revision cloud.

****

Number each item of the Addendum beginning with 1 through the total number of change items in the Addendum. Sample entries are provided in brackets.

****

CHANGES TO PREVIOUS ADDENDA

****

Reference Addendum Number and item number to correct clarifications or make minor corrections of changes issued by previous Addenda.

****

ADDENDUM NO. _________
[1. Item 5. Change to read as follows:]

CHANGES TO PROJECT MANUAL

****

Follow this format to sequence changes to the Project Manual.

****

BIDDING REQUIREMENTS

****

Give the individual change instructions for each item of change by Document number and title. List changes in order of

[2. Document 00020 - Notice to Bidders. Replace page 00020-2.]

CONTRACT FORMS

[3. Document 00610 - Replace revised Performance Bond, page 00610-1.]

CONDITIONS OF THE CONTRACT

[4. Document 00800 - Supplementary Conditions. Replace page 00800-4 and add page 00800-5.]

SPECIFICATIONS

[5. Section 02050 - Demolition. Add section including pages 02050-1 through 02050-3.]

CHANGES TO DRAWINGS

[6. Delete Sheet S-9, Beam Schedule, and replace with Sheet S-9-A.]

CLARIFICATIONS

[7. Document 00210 - Supplementary Instructions to Bidders states that no substitutions will be considered during the bidding phase. Substitutions will be considered during the first 15 percent of the Contract Time or first 90 days of the Contract, whichever is less, as stated in Document 00700 - General Conditions.]

END OF ADDENDUM NO. ____

DATED: _____

Ravi Kaleyatodi, P.E., CPM
Senior Assistant Director
Department of Public Works and Engineering

RK:JHK:SG:sdd

END OF DOCUMENT

Document 00912

RIDER NO. _____

PROJECT NAME: Greens Road Paving and Drainage Improvements from Aldine Westfield to J.F Kennedy Boulevard

PROJECT NO: N-000686-0002-4; CSJ 0912-71-739

This Rider is incorporated into the Contract documents. In the event of a conflict with the original Contract documents, this Rider governs.

CHANGES TO PROJECT MANUAL

END OF RIDER NO. _____

DATED: _____ _____
Director of [*Contracting Department*]

DATED: _____ _____
Contractor

END OF DOCUMENT

Section 01110

SUMMARY OF WORK

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Summary of the Work including work covered by the City Contract Documents, Cash Allowances, City-furnished Products, Work Sequence, Contractor use of Premises, TPDES Requirement, Street Cut Ordinance, Warranty, and additional Conditions for Substantial Completion.

1.02 WORK COVERED BY CONTRACT DOCUMENTS

A. The successful bidder shall submit two (2) full-sized bond sets of the Construction Drawings to the City of Houston Floodplain Management Office ("FMO") to complete the Development Permit process. The Successful Bidder shall receive copies of the completed permit application at the Pre-Construction Meeting.

Work of the Contract is for the construction of concrete roadway pavement, curbs, sidewalks, wheelchair ramps, storm sewers, storm sewer leads, bridges, manholes, inlets, water lines, emergency traffic signal, and a detention pond. The contract work includes but is not limited to: removal and replacement of the existing asphalt roadway, base material, concrete curb, concrete bridge, wheelchair ramps, sidewalks, driveways; the removal, abandonment, and replacement of water lines, valves, meters, water line support structure, and fire hydrants; the adjustment of sanitary sewer lines and manholes; the removal and replacement of sod, pavement markings, and permanent signs; the removal and replacement of street lights, the adjustment of traffic control, tree protection, and storm water management devices. Additionally, the project will include installation of storm sewer, storm sewer inlet leads, manholes, inlets, and an off-line detention pond south of Greens Road. Also, included in the project is the replacement of the culvert crossing at Old Hoods Bayou (P240-00-00), the bridge at Hoods Bayou (P140-00-00), and the outfall culvert from P240-00-00 to P140-00-00. All items will be constructed to the specified lines, grades, elevations, and locations shown on the drawings.

The project consists of constructing a four lane concrete curb and gutter divided roadway with 11 foot inside lanes and 15 foot outside shared use lanes constructed within the existing 100-foot right of way. The project consists of approximately 55,504 square yards of 10-inch reinforced concrete pavement with 6-inch curb and 8-inch lime stabilized subgrade. The proposed storm sewer consists of three (3) separate underground drainage systems that will replace the existing roadside ditch drainage system and includes detention to mitigate downstream hydraulic impacts.

Proposed storm sewer appurtenances include manholes, manholes for box sewer, roadside ditch inlets, curb inlets (designed in accordance with COH criteria and TxDOT details). Cash allowances are included for street lighting, street cut permits, a HCFCD permit and a FMO Permit. The City of Houston will provide Nationwide Permits for work within Hoods Bayou (HCFCD Unit P140-00-00) and HCFCD Unit P240-00-00.

The project limits are located within the City of Houston bounded by Aldine-Westfield Road to the west and John F. Kennedy Boulevard to the east, and within the rights-of-way of the project streets, on City of Houston owned land, and provided easements, as stated on the plans.

1. The construction of the pavement will include the removal of the existing pavement with or without base (all types and thicknesses) and replacement with 10-inch reinforced concrete pavement with 6-inch curbs, as shown on the plans. The proposed pavement will have 8-inch lime stabilized subgrade. Existing sidewalks will be removed and replaced with 5-foot wide sidewalks or as indicated on the plans.

Clearing and grubbing work includes removal of lawn timbers, trench drains, street light foundations, existing fences, bollards, wood signs, steel gates, concrete slope paving, and landscaping within the right-of-way or City owned properties included in the work. Removal of traffic signs is incidental to the Traffic Control and regulation pay item.

The demolition items include a bridge and 16-inch water line constructed of or with asbestos. The Contractor shall follow Specification 13281 for Asbestos Abatement when removing and disposing of the asbestos containing materials. Contractor shall examine the asbestos survey in detail for the anticipated extent of asbestos materials.

Contractor will be responsible to reference the Tree Protection Plan and implement as detailed. Curb type retaining walls and/or sidewalk on back of curb with toe walls may be utilized only on areas noted in the plans or as directed by engineer. Pavement cuts and replacement will be in accordance with the City of Houston Street Cut requirements, and will require street cut permits. The condition of the road and/or right-of-way, upon completion of job, shall be as good as or better than the condition prior to starting the work.

The contractor is to obtain all necessary permits related to the proposed construction activities. These include, but are not limited to lane closures, street cut, driveway, and tree removal.

Driveways and sidewalks within the right-of-way shall be replaced with the standard concrete paving as shown in the plans unless otherwise directed by the engineer.

Driveway elevations on plans represent the elevation of the driveway at the right-of-way. Driveways reconstructed past right-of-way will match existing driveway width and elevation to meet necessary driveway grade requirements.

The City of Houston must notify property owners about gate relocation prior to bid. Gate relocation if needed will be at the private owners' expenses. The contractor shall coordinate with the private owners during construction.

Proposed sidewalks and wheelchair ramps shall comply with current City of Houston and Texas Department of Licensing and Regulation ("TDLR") requirements including, but not limited to, construction wheelchair ramps with truncated domes. Reinforced concrete retaining walls will be used along the ROW in areas where the adjoining property/parking lot is at an elevation that cannot be graded to match the proposed elevation at the ROW.

Sidewalks shall be routed around power poles, street lights, and other vertical obstructions at no additional cost.

Removal of the existing 3 span concrete bridge includes removing all concrete columns, slope paving, abutments, wing walls, and similar items associated with the bridge at no additional cost. This bridge contains asbestos and appropriate removal techniques should be in accordance with Document 13281.

Low profile concrete barriers are to be used within the project limits. These barriers are to be where open excavations adjacent to the existing/proposed pavement section exceed 12-inches in depth and as indicated on the plans. All materials and labor to install, remove, and relocate these barriers will be paid in accordance with the provided items as specified in Document 00410 – Bid Form, Parts A & B.

2. The proposed drainage system will include inlet leads which will be standard 24-inch circular reinforced concrete pipe ("RCP") and one 36-inch circular reinforced concrete pipe.

   The storm sewer lines will range from 24-inch RCP to 48-inch RCP and also RCB ranging from 4-foot x 3-foot to 8-foot x 4-foot. The storm water curb inlets will be TxDOT Type PAZD and PCO. The storm sewer manholes will be TxDOT Type PRM manholes. An existing pier and beam bridge over Hoods Bayou will be replaced with two 3-span reinforced concrete box bridge class culverts. An existing 72-inch corrugated metal pipe bayou crossing will be replaced with a triple barrel bridge class culvert consisting of 2 barrels of 6-foot x 4-foot RCB and one barrel of 6-foot x 6-foot RCB with headwalls/wingwalls and slope paving on the upstream and downstream ends. All proposed storm sewers are to be constructed with TxDOT and City of Houston approved materials. Proposed storm sewer manhole rims shall be set to proposed finished grade elevation of the proposed paving and/or finished grade within the medians.

   Concrete collars are to be used for connecting storm sewer into RCBs and at the base of manholes cones constructed on top of RCBs. Details are included in the plans for both situations. The contractor shall note that concrete collars will be incidental to the various bid items requiring collars within Document No. 00410 – Bid Form, Parts A & B.

   All storm sewers receiving drainage from roadside ditches shall include installation of a ring grate on the exposed end of the pipe.

   The construction activities will be conducted such as to ensure proper drainage of the project area for the duration of the project, and any drainage ditch or structure disturbed during construction shall be restored to the satisfaction of the owning authority. All materials and labor to perform and install this work will be paid in accordance with the provided bid items as specified in Document 00410 – Bid Form, Parts A & B.

3. The construction of the sanitary sewers will include the adjustment of the existing manhole tops to match finished grade. Sanitary sewer construction activities shall be conducted such as to maintain continuous service to residents and commercial properties throughout the duration of the project.

4. The construction of the 24-inch water line will include the removal or plugging, and abandonment of existing 6 to 16-inch water lines, along with associated fittings as stated in the plans. The 16-inch water line material is asbestos cement. The contractor shall follow Specification 13281 for asbestos removal and abatement. In addition, the existing 16-inch asbestos cement water line will be removed from its aerial crossing over Hoods Bayou and the 24-inch steel water line will be placed on the proposed north bridge over Hoods Bayou. The bridge and 24-inch water line must be constructed and in service before the existing 16-inch water line and aerial crossing, including concrete column supports, can be removed. Items from the water system to be removed and salvaged such as valves and fire hydrants, shall be delivered to the Southwest Utility Maintenance Facility located at 7101 Renwick. The contractor shall coordinate the delivery of the salvaged fire hydrants and valves with Michael Johnson (phone #713-732-9867) at the Maintenance Facility.

   Water line construction activities shall be conducted such as to maintain continuous service to residents and businesses throughout the duration of the project. Existing fire hydrants will either remain or be salvaged, as stated on the plans. Water meters shall be adjusted to match finished grade, or relocated, as stated on the plans. The

proposed water line adjustments are shown on the plans. The construction methods to be employed for the proposed water line are open cut and auger methods. Trenchless construction methods as specified will be used at certain locations in order to preserve existing features or facilitate construction.

Removal and replacement of pipe vents and protective bollards is part of the pay item for manhole top adjustment.

The trenchless construction limits are stated on the plans. All materials and labor to perform and install this work will be paid in accordance with the provided bid items as specified in Document 00410 – Bid Form, Parts A & B.

5. The contractor will be responsible for coordinating with residents and business owners within the project area on handling of any private features within the right-of-way a minimum of 72-hours prior to any construction activities which may impact these features. These features may include, but are not limited to: existing irrigation systems (including spray and rotary heads and related piping and electrical wiring), mailboxes, landscaping, existing yards drains, amenity ponds, and private signs, electric gates, fences, etc. Contractor shall use caution while working within the proximity of these types of facilities so as to avoid impacts. Should impacts occur, restoration shall be to a condition that is equal to or better than prior to start of construction. The repair or replacement of these types of facilities, necessitated by construction activities, will be the contractor's responsibility and incidental to the project superseding Specification Section No. 01740-Site Restoration **at no additional cost to the City**. Contractor should verify the operation of irrigation systems with the property owner prior to starting construction.

6. The contractor will be responsible to remove and replace the permanent signs and pavement markings, as denoted on the plans. Pavement striping shall be in accordance with standard City of Houston specifications and details. All permanent signs are to be placed on separate poles.

7. The contractor will be responsible for installing approximately 6000 linear feet of street light conduit in areas identified on the street lighting plans. The Streetlight Division at CenterPoint Energy (CNP) has prepared a cost for the streetlights to be removed and re-installed. This cost is contingent upon the City of Houston's (COH) contractor installing approximately 6000 linear feet of 2-inch PVC conduit and 3-pull boxes per CNP specifications. All conduits and pull boxes shall be installed using the conduit layout provided to the COH on 02/18/2016. Additionally, the COH's contractor is to install stub ups at the proposed streetlight locations and where the street light power source is proposed. The warning tape and pull boxes can be provided by CNP when a 45 day notice is received. The total cost is $12,400.00. All materials and labor to perform and install this work, is to be paid on a linear foot basis, as shown in Document 00410 – Bid Form, parts A & B. In addition, a cash allowance is included for a local street light provider to remove the existing street lights and install new street lights as indicated on the plans.

8. The contractor will be responsible to maintain adequate traffic control for the duration of the project, as provided in the plans. Traffic control will be in accordance with the latest version of the Texas Manual of Uniform Traffic Control Devices (TMUTCD).

9. The contractor will be responsible to use caution and due diligence where the proposed improvements are in proximity to existing private utilities including gas lines, buried or overhead cables, etc. so as to avoid adverse impacts to such private utilities inside the project area. The contractor will contact and coordinate with the

private utility agencies whose facilities may be impacted by the proposed improvements, as required.

10. The contractor is to comply with O.S.H.A. regulations and State of Texas law concerning excavation, trenching, and shoring.

11. The contractor will be responsible to implement the Storm Water Pollution Prevention Plan (SWPPP) and use best practices during construction and is responsible for associated permit fees and filing.

12. The contractor will be responsible to obtain all necessary permits including, but not limited to, development permit from City of Houston Floodplain Management Office, permit from the HCFCD for work within Hoods Bayou, lane closures, street cut, and tree removal.

13. The contractor shall note that Project ID Signs and saw-cut are incidental to the various bid items within Document No. 00410.

14. The contractor shall coordinate with the property owner at 2522 Peyton Rd to remove the materials and debris on Peyton Rd. The debris and materials on Peyton Road shall be removed at the private owner's own expenses.

15. AEROTERM owns a 2-inch force main within Greens Rd Right-Of-Way, from approximately station 36+40 to Stephenson Rd and is planning to relocate the force main to resolve potential conflict with the proposed improvements at no additional cost to the City. The contractor shall coordinate with AEROTERM and their design consultant during construction to resolve all conflict issues. AEROTERM's contact person is Faith Galvan Senior Property Manager (Address: 19155 Lee Road, Suite 226, Houston, Texas 77338. Telephone: 281-443-4793. Mobile: 713-545-4208. Email: fgalvan@aeroterm.com or www.aeroterm.com).

16. The City is in the process of acquiring additional Right-Of-Way for the proposed underground utilities and roadway improvements along the entire length of the project from Aldine Westfield to John F Kennedy Blvd. Once the Right-Of-Way is acquired, the private utilities will be relocated by the respective utility companies. Anticipated completion date for the real estate acquisition is January 2017, and for the utility relocation is December 31, 2017. Therefore, the proposed and existing Right-Of-Way and land on which the proposed underground work and surface improvement work is to be performed will not be furnished and available until December 31, 2017. From the date of Notice to Proceed to December 31, 2017, a portion of the Right-Of-Way for Phase 1 construction and as shown in the Contract documents will only be furnished and available. If by December 2017, the ROW is not available the contractor shall discontinue work and return at a later time as directed by the City of Houston Project Manager and as described in City of Houston Specification Section 01270S Measurement and Payment.

17. The existing asphalt roadway shall be maintained pothole free along project length during construction of the project and shall be incidental to bid items.

18. At some locations, the project has limited space between proposed construction activity and ROW, and it is the contractor's responsibility to find and apply suitable methods during construction to get the work done at no additional cost to the City and without obtaining a temporary construction easement. The project areas with limited space are:

1) From Station 29+48.50 to Station 33+73.50 near the South Right-Of-Way line.

2) From Station 30+20.00 to Station 33+55.28 near the North Right-Of-Way line.

3) From Station 34+43.00 to Station 38+15.00 near the North Right-Of-Way line.

4) From Station 36+15.00 to Station 38+22.00 near the South Right-Of-Way line.

5) Proposed eastbound bridge section.

6) Proposed westbound bridge section.

1.03 CASH ALLOWANCES

A. Include the following specific Cash Allowances in Contract Price under provision of General Conditions Paragraph 3.11:

Removal/Relocation/Replacement of streetlights by CenterPoint Energy.
Contact Nora Luna at 713-945-6253 or at
nora.luna@centerpointenergy.com
Cash allowance included in Document No. 00410.

1. Street Cut permit.
   Cash allowance included in Document No. 00410.

2. HCFCD permit for work within Hoods Bayou.
   Cash allowance included in Document No. 00410.

3. City of Houston Floodplain Management Office Development Permit
   Cash allowance included in Document No. 00410.

1.04 CONTRACTOR'S RESPONSIBILITIES

A. Arrange and pay for product delivery to the site.

B. Receive and unload products at the site; jointly with the City, inspect for completeness or damage.

C. Handle, store, install, and finish products.

D. Repair or replace damaged items.

1.05 CITY-FURNISHED PRODUCTS

A. Items Furnished by the City for Installation and final connection by Contractor:

1. None.

1.06 WORK SEQUENCE

A. Construct the Work in Phases during the construction period, coordinate the construction schedule and

operations with the City. The work of the project shall be phased so that impact to the adjacent businesses, subdivisions, commercial development, and airport can be kept to a minimum for the duration of the project. The work in each phase will be conducted in segments as shown within the traffic control plans of this project (Sheets 24 thru 90). All work within Phase 1 Step 1 and each successive phase/step shall be in a "substantially complete condition" prior to beginning the construction of the next phase/step/segment or the contractor may begin a new phase of construction with the consent of the City of Houston Construction Representative.

B. The term 'work' as used below refers to the following construction activities, as applicable: construction of the proposed detention pond, bridge, retaining walls, channel improvements, outfalls, water lines and appurtenances, storm sewer and appurtenances, drainage system and appurtenances, construction of all pavement, sidewalks, traffic signals, and electrical appurtenances. The work also includes tree protection, storm water pollution prevention, traffic control, site restoration, and inspections.

Construction work for this project shall be performed in phases to ensure that excessive disruption in the area is not incurred. The following work sequence is recommended for completion of the project. If the Contractor does not elect to utilize the recommended work sequence, then the Contractor is required to submit an alternate work sequence for review and approval prior to beginning construction. Prior to preparing an alternative work sequence, the contractor shall verify whether or not there are any constraints to implementing the alternate work sequence with the City of Houston Engineer.

Phase 1 Step 1: Contractor to build the detention pond South of Peyton Road, P140/P240 confluence culvert and the detention pond inflow culvert and outfall pipe.

Phase 1 Step 2: Contractor to install advance warning signs and traffic control devices as shown on the plans and construct the south half of the bridge class culvert under Greens Road, including the installation of Junction Box "A", removal of of existing 72" CMP pipe and tie-in to proposed 6'x6' RCB, as shown on the plans for this step. Contractor cannot start Phase 1 Step 2 unless Phase 1 Step 1 is completed or unless otherwise authorized by the City engineer.

Phase 1 Step 3: Contractor to build the Eastbound bridge. Contractor cannot start Phase 1 Step 3 unless Phase 1 Step 2 is completed or unless otherwise authorized by the City engineer.

Phase 2 Step 1: Contractor to install traffic signs, pavement markings, SWPPP devices, low profile concrete barriers, and remove existing median curb and install temporary pavement in the median area along Greens Road between Sta. 14+05 and 18+80 as shown on the plans for this step. Contractor cannot start Phase 2 Step 1 unless Phase 1 Step 3 is completed or unless otherwise authorized by the City engineer.

Phase 2 Step 2: Contractor to build the outfall pipe for system "B" drainage system (30-inch CMP outfall pipe) including junction box "B", the trunk line west of the proposed bridge and under the eastbound lanes including the storm sewer leads, inlets and manholes, the rip rap and channel lining under Hoods Bayou on the South side of Greens Road and retaining walls B1, D1 and B and the headwall on the south side of the proposed bridge class culvert. Contractor cannot start Phase 2 Step 2 unless Phase 2 Step 1 is completed or unless otherwise authorized by the City engineer.

Phase 2 Step 3: <u>Prior to starting this step, contractor must verify status of land acquisition and private utilities relocation with the City engineer.</u> Contractor to install temporary 36" RCP and manhole from approximately sta. 37+93 to sta. 44+76.50 for temporary drainage and as shown on the plans for this step. The proposed 36" RCP pipe under Greens road will be installed using trenchless construction, and the proposed 36" RCP pipe from manhole at Sta. 37+95.05 to Sta. 44+15.05 will be installed by open cut method, then build the trunk line and the storm sewer leads under the eastbound lanes including manholes and inlets from Sta. 44+76.50 to Sta. 90+80.20 as shown on the plans. Contractor cannot start Phase 2 Step 3 unless Phase 2 Step 2 is completed or

unless otherwise authorized or directed by the City engineer.

Phase 2 Step 4: Contractor to build the proposed eastbound lanes pavement from sta. 15+00 to sta. 36+20 including concrete curb, driveways and sidewalks and build temporary driveways from sta. 15+00 to sta. 36+20 to provide access to the south driveways, and half of the temporary driveways within the work area of this step to provide access to the driveways on the north side. Contractor cannot start Phase 2 Step 4 unless Phase 2 Step 3 is completed or unless otherwise authorized or directed by the City engineer.

Phase 2 Step 5: Contractor to build the proposed trunk line, the outfall pipe for system "C" drainage (84" CMP outfall pipe), junction box "C" and the storm sewer leads under the eastbound lanes from sta. 37+71 to sta. 44+76.50, remove the proposed temporary 36" RCP pipe under the proposed eastbound lanes, build the proposed eastbound lanes pavement from sta. 37+71 to sta. 46+00 including concrete curbs, driveways and sidewalks, build temporary driveways from sta. 37+71 to sta. 46+00 to provide access to the south driveways and install retaining wall D. Contractor cannot start Phase 2 Step 5 unless Phase 2 Step 4 is completed or unless otherwise authorized or directed by the City engineer.

Phase 2 Step 6: Contractor to install the fire station signal pole on the south side of Greens Road, build the proposed eastbound lanes pavement from sta. 46+00 to sta. 91+73 including concrete curbs, driveways and sidewalks, and build temporary driveways from sta. 46+00 to sta. 91+73 to provide access to the south driveways. Contractor cannot start Phase 2 Step 6 unless Phase 2 Step 5 is completed or unless otherwise authorized or directed by the City engineer.

Phase 3 Step 1: Contractor to install temporary traffic signs, pavement markings, SWPPP devices and low profile concrete barriers, temporary pavement between Sta. 29+86 and 32+93, between Sta. 41+12 and 43+43 and between Sta. 86+61.55 and 89+11 as shown on the plans for this step and install the second half of the temporary asphalt pavement to provide access to the driveways on the north side of Greens Road from Sta. 14+00 to 33+00. Contractor cannot start Phase 3 Step 1 unless Phase 2 Step 6 is completed or unless otherwise authorized or directed by the City engineer.

Phase 3 Step 2: Contractor to install temporary traffic signs, pavement markings, SWPPP devices and low profile concrete barriers and shift traffic as shown on the plans for this step, construct the storm sewer leads, including inlets, the proposed fire hydrants and the proposed pavement including concrete curbs, driveways and sidewalks from Sta. 15+00 to Sta. 29+56. Contractor cannot start Phase 3 Step 2 unless Phase 3 Step 1 is completed or unless otherwise authorized or directed by the City engineer.

Phase 3 Step 3: Contractor to construct the storm sewer leads, inlets and manholes, the proposed water line and the proposed pavement including concrete curbs, driveways and sidewalks under the from Sta. 46+00 to Sta. 91+73. Contractor shall temporarily plug the proposed water line at Sta. 46+00 for connection at a later time. Plug will be incidental to waterline installation cost. Contractor cannot start Phase 3 Step 3 unless Phase 3 Step 2 is completed or unless otherwise authorized or directed by the City engineer.

Phase 3 Step 4: Contractor to switch traffic to the eastbound lanes as shown on the plans for this step, construct the storm sewer leads, inlets and manholes, under the westbound lanes from Sta. 29+56 to Sta. 46+00, remove the temporary 36" RCP pipe under the westbound lanes and from Sta 37+95.05 to Sta 44+15.05, install the proposed 24" water line and construct the proposed pavement including concrete curbs, driveways and sidewalks from Sta. 29+56 to Sta. 46+00 and install the fire station signal pole on the north side of Greens Road. Also, in this step contractor to construct the proposed westbound bridge section, remove the waterline columns supporting the existing water line at Hoods Bayou, construct the remaining half of the bridge class culvert at

approximately sta. 32+00 including headwall, and retaining walls A1, C1, A & C. Contractor cannot start Phase 3 Step 4 unless Phase 3 Step 3 is completed or unless otherwise authorized by the City engineer.

Phase 4: Contractor to install all the appropriate warning signs, barricades, pavement markings, and the temporary pavement in the median opening areas as shown on the plans, remove temporary pavement on top of permanent pavement installed in phase 3 for driveway access north of Greens Road and switch traffic to the eastbound and westbound lanes as shown on the plans for this phase. Also, contractor to construct median from beginning to end of project using rolling closure in 8 steps; median construction includes concrete curb, pavement, permanent pavement markings, signs, electrical conduit, hydromulch seeding, sod, trees and all other requirements for project completion. As each step is completed, open the step to traffic. Contractor to use single lane closure flagging operation to address punch list items and complete the median crossings, pavement markings, and proposed signage in this phase.

C. Coordination of the Work: Refer to Section 01312 - Coordination and Meetings.

1. The contractor is advised to develop the project construction schedule to anticipate the Right-Of-Way Acquisitions pending and utility relocations, and Bid accordingly. In the event, that the anticipated completion date is deviated and proven to impact the contractor's schedule, contractor shall notify the Construction Manager per Article7- Changes in the work under document 00700 General Conditions. The contractor is advised that it may be necessary to de-mobilize until such time that the work on the remaining portion of the project can be completed. The contractor is invited to review all the information of the potential impact currently on the file with the Engineer.

2. Due to the scope of project the contractor's proposed method, timing, and construction sequence on overall project is very important. Contractor shall submit suitable method and sequence of construction, as well as a list of major construction activities for review and approval by the Project Manager prior construction.

1.07 CONTRACTOR USE OF PREMISES

A. Comply with procedures for access to the site and Contractor's use of rights-of-way as specified in Section 01145 - Use of Premises.

B. Construction Operations: Limited to the City's rights-of-way provided by the City and areas shown or described in the Contract documents.

C. Utility Outages and Shutdown: Provide a minimum of 48 hours notice to the City and private utility companies (when applicable), excluding weekends and holidays, in advance of required utility shutdown. Coordinate all work as required.

D. A field office is required for this project, see section 01520-Temporary Field Office. Cost is incidental to Bid Item for Mobilization.

E. Private Utility Relocations: Pursuant to Section 40-395 of the City of Houston (City) Utility Relocation Ordinance Program (URO) the following private utilities were identified and scheduled for relocation within the scope of the project limits. Based upon the relocation schedules provided by the utility owners, the City anticipates these relocations to be completed by the dates listed below, and unless otherwise stated, clearance to these potential obstructions will be performed by their respective owners.

Utility Owner	Type of Facility	Approximate Location	Estimated Clearance	Anticipated Effect to Construction
AT&T Texas	Poles, Buried Cables and Hand Holds Boxes	Sta. 14+70 to Sta. 91+73	All pending Right-Of-Way (ROW) anticipating acquisition by end of September 2016. Based on AT&T schedule 8 months needed to relocate (End of May 2017)	None Contractor to coordinate with AT&T relocation, if needed
CenterPoint Energy/Electric	Power Poles and Underground Cables	Sta. 23+29 to Sta. 91+03	All pending ROW Acquisition anticipating by end of September 2016. 4 months needed to relocate (January 2017)	None
CenterPoint Energy/Gas	2-inch to 10-inch Gas Lines	Sta. 16+00 to Sta. 93+25	All pending ROW Acquisition anticipating by end of September 2016. 3 months needed to relocate (December 2016)	None
Comcast	Aerial Cables	Sta. 20+82 to Sta. 89+10	After CenterPoint Power Pole relocation 4 weeks estimated (February 2017)	None
Verizon Business/MCI	Fiber Optic Cable attached to Centerpoint Pole line	North of Greens Road	4 weeks estimated, after CenterPoint Power Pole relocation (February 2017)	None
CenturyLink/ Embarq	Buried Fiber Optic Cables	On the South side of Greens Rd from Aldine Westfield Rd to Greenview Dr. on the North side of Greens Rd from Greenview Dr. to JFK Blvd	Conflict and relocation to be determined when ROW is staked	None
Phonoscope	Underground fiber cable and power pole	Morales intersection	4 weeks estimated, after CenterPoint Power Pole relocation (February 2017)	None

Level 3 Communications	Underground and Aerial Cables	Sta. 26+25 to Sta. 49+80 and Sta. 89+06 to Sta. 94+11	4 weeks estimated, after CenterPoint Power Pole relocation (February 2017)	None

The relocation of these facilities is not anticipated to interfere with the Contractor's operations, but the Contractor shall develop the project construction schedule and bid accordingly. In the event that the clearance dates are deviated and proven to impact the contractor's schedule, Contractor shall notify the construction project manager per Article 7 – Changes in the Work under Document 00700 General Conditions. The Contractor is invited to review all information of potential obstructions currently on file with the Engineer.

F. Right-Of-Way Acquisition, Encroachments and permits:

The City of Houston (City) is in final completion of the ROW acquisition with following pending property status which should be considered in completion of this project.

	Parcel #	Anticipated Date of Acquisition	Parcel status
1	AY14-125	09/06/2016	IN CONDEMNATION
2	AY14-126	09/06/2016	IN CONDEMNATION
3	AY14-133	07/06/2016	IN CLOSING-CHECK RECEIVED
4	AY16-092	08/30/2016	TITLE/APPRAISAL PENDING
5	AY14-136	10/11/2016	IN CONDEMNATION
6	AY14-138	10/11/2016	IN CONDEMNATION
7	AY14-143	07/29/2016	IN CLOSING-CHECK RECEIVED
8	AY14-146	07/29/2016	IN CONDEMNATION
9	AY14-147	07/29/2016	IN CONDEMNATION
10	AY16-020	08/30/2016	OFFER PENDING

G. Other persons to contact:

1. Mr. Jeffry K.A Brown, PMP
   Houston Airport System
   16930 John F. Kennedy Blvd
   Houston, TX 77032
   Phone: 281-233-1909

2. Mark W Donovan
   Assistant Fire Chief
   Houston Fire Department
   Phone: 832-394-6745

1.08 STREET CUT ORDINANCE

A. Excavations on or under pavement in the City's right-of-way must have a permit. Comply with City of Houston, Texas Ordinance No. 2000-1115, an ordinance amending Chapter 40 of the Code of

Ordinances, Houston, Texas, relating to excavating in the Public right-of-way.

B. Comply with the latest edition of street cut New Pavement Repair and Pavement Replacement details.

C. Quantities are included for street cut, pavement repair and replacement in applicable Specification sections for Unit Price contracts.

D. For detailed information concerning the ordinances' latest detail drawings and permits related to compliance with excavation in the Public Right-of-Way and Street Cut, visit the City's website at: http://documents.publicworks.houstontx.gov/document-center/engineering-and-construction/index.htm or http://www.gims.houstontx.gov/

1.09 WARRANTY

A. Comply with warranty requirements in accordance with Document 00700 - General Conditions and Document 00800 – Supplementary Conditions.

1.10 ADDITIONAL CONDITIONS FOR SUBSTANTIAL COMPLETION

A. In addition to requirements outlined in Document 00700 – General Conditions, for Contractor to be substantially complete with the Work and call for inspection by the City of Houston Construction Representative to confirm, the following conditions must be met or completed:

1. All testing shall be completed and accepted by City of Houston Construction Representative.

2. All Safety related work including pavement stripping, signing and signalization.

3. All pay items complete report.

4. Contractor shall contact City of Houston Construction Representative to complete Texas Department of Licensing and Regulation Post Construction Inspection of pedestrian elements for Texas Accessibility Standards.

5. All post construction TV inspections turned in for a review.

6. All work related to HCFCD approvals must be completed.

D. No additional condition described in Paragraph 1.10 may be included in Contractor's punch list.

1.11 TPDES REQUIREMENTS

A. Project construction activity defined as a Large Construction Activity that will disturb and area greater than 5 acres or more.

B. TPDES requirements as stated in Document No 01410 shall be followed.

PART 2 P R O D U C T S – Not Used

PART 3 E X E C U T I O N – Not Used

END OF SECTION

CERTIFICATE OF INTERESTED PARTIES

FORM 1295

OFFICE USE ONLY

Complete Nos. 1 - 4 and 6 if there are interested parties.
Complete Nos. 1, 2, 3, 5, and 6 if there are no interested parties.

1 Name of business entity filing form, and the city, state and country of the business entity's place of business.

2 Name of governmental entity or state agency that is a party to the contract for which the form is being filed.

3 Provide the identification number used by the governmental entity or state agency to track or identify the contract, and provide a description of the goods or services to be provided under the contract.

4 Name of Interested Party	City, State, Country (place of business)	Nature of Interest (check applicable)	
		Controlling	Intermediary

5 Check only if there is NO Interested Party. ☐

6 AFFIDAVIT

I swear, or affirm, under penalty of perjury, that the above disclosure is true and correct.

_____
Signature of authorized agent of contracting business entity

AFFIX NOTARY STAMP / SEAL ABOVE

Sworn to and subscribed before me, by the said _____, this the _____ day of _____, 20 _____, to certify which, witness my hand and seal of office.

_____
Signature of officer administering oath | Printed name of officer administering oath | Title of officer administering oath

ADD ADDITIONAL PAGES AS NECESSARY

Must file online at www.ethics.state.tx.us/File

Section 01145

USE OF PREMISES

1.01 SECTION INCLUDES

A. General use of the site including properties inside and outside of rights-of-way, work affecting road, ramps, streets and driveways and notification to adjacent occupants.

1.02 RIGHTS-OF-WAY

A. Confine access, and operations and storage areas to rights-of-way provided by the City as stipulated in Document 00700 - General Conditions; trespassing on abutting lands or other lands in the area is not allowed.

B. Make arrangements, at no cost to the City, for temporary use of private properties. Contractor and Surety shall indemnify and hold harmless the City against claims or demands arising from such use of properties outside of rights-of-way. Submit a copy of agreements between private property owners and Contractor prior to use of the area. Agreements between private property owners and Contractor shall be notarized or bear the signatures of two witnesses.

C. Obtain written permission from City of Houston Parks and Recreation Department for storage of materials on esplanades and other areas within rights-of-way under that department's jurisdiction. Submit copies of written permission prior to use of the area.

D. Restrict total length of distributed materials along the route of construction to 1,000 linear feet unless otherwise approved in writing by City Engineer.

1.03 PROPERTIES OUTSIDE OF RIGHTS-OF-WAY

A. Do not alter the condition of properties adjacent to and along rights-of-way.

B. Do not use ways, means, methods, techniques, sequences, or procedures that result in damage to properties or improvements.

C. Restore damaged properties outside of rights-of-ways at no cost to the city

1.04 USE OF SITE

A. Obtain approvals from governing authorities prior to impeding or closing public roads and streets. Do not close more than two consecutive intersections at one time.

B. Notify Project Manager and Public Works and Engineering Traffic Management Branch at least five working days prior to closing a street or street crossing. Obtain permits for street closures in advance.

C. Maintain 10-foot-wide minimum access lanes for emergency vehicles including access to fire hydrants.

D. Avoid obstructing drainage ditches or inlets. When obstruction is unavoidable due to requirements of the Work, provide grading and temporary drainage structures to maintain unimpeded flow.

E. Locate and protect private lawn sprinkler systems that may exist within the site. Repair or replace damaged systems to condition existing at start of the Work, or better. Test irrigation system prior to construction.

F. Conform to daily clean-up requirements of Article 3 of Document 00700 - General Conditions.

G. Beware of overhead power lines existing in area and in close proximity of the Project. When 10 feet of clearance between energized overhead power line and construction-related activity cannot be maintained, request Center Point Energy (CPE) de-energize or move conflicting overhead power line. Contact CPE representatives at (713) 207-2222. Schedule, coordinate and pay costs associated with de-energizing or moving conflicting overhead power lines. When there is no separate pay item for this effort, include these costs in various items of bid that make such work necessary.

1.05 NOTIFICATION TO ADJACENT OCCUPANTS

A. Notify individual occupants in areas to be effected by the Work of proposed construction and time schedule. Notify not less than 72 hours or more than two weeks prior to work performed within 200 feet of homes or businesses. Follow form and content of sample door hanger provided by Project Manager.

B. Include in notification nature of the Work, and names and telephone numbers of two company representatives for resident contact available on 24-hour call.

C. Submit proposed notification to Project Manager for approval. Consider ethnicity of the neighborhood where English is not the dominant language. Provide notice in an understandable language.

1.06 PUBLIC, TEMPORARY, AND CONSTRUCTION ROADS AND RAMPS

A. Construct and maintain temporary detours, ramps, and roads to provide for normal public traffic flow when it is necessary to close public roads or streets.

B. Provide mats or other means to prevent overloading or damage to existing roadways from tracked equipment, large tandem axle trucks or equipment that will damage the existing roadway surfaces.

C. Construct and maintain access roads and parking areas as specified in Section 01504 - Temporary Facilities and Controls.

1.07 EXCAVATION IN STREETS AND DRIVEWAYS

A. Avoid hindering or inconveniencing public travel on streets or intersecting alleys for more than two blocks at any one time, except by permission of City Engineer.

B. Obtain Traffic Management Branch and City Engineer's approval when nature of the Work requires closure of an entire street. Permits required for street closure are Contractor's responsibility. Avoid unnecessary inconvenience to abutting property owners.

C. Remove surplus materials and debris and open each block for public use, as work in that block is complete.

D. Acceptance of any portion of the Work will not be based on return of street to public use.

E. Avoid obstructing driveways or entrances to private property.

F. Provide temporary crossings or complete excavation and backfill in one continuous operation to minimize duration of obstruction when excavation is required across drives or entrances.

G. Provide barricades and signs in accordance with Section VI of the State of Texas Manual on Uniform Traffic Control Devices.

1.08 TRAFFIC CONTROL

A. Comply with traffic regulation as specified in Section 01555 - Traffic Control and Regulation.

1.09 SURFACE RESTORATION

A. Restore the site including landscaping to the condition existing before construction, or better.

B. Repair paved areas per the requirements of Section 02951 - Pavement Repair and restoration.

C. Repair damaged turf areas, level with bank run sand conforming to Section 02317 - Excavation and Backfill for Utilities, or topsoil conforming to Section 02911 - Topsoil, and re-sod in accordance with Section 02922 - Sodding. Water and level newly sodded areas with adjoining turf using appropriate steel wheel rollers for sodding. Do not use spot sodding or sprigging.

1.10 LIMITS OF CONSTRUCTION

A. Confine operations to lands within construction work limits shown on Drawings. Unless otherwise noted on Drawings adhere to the following:

1. Where utility alignment is within esplanade, and construction limits are shown on Drawings to extend to edge of esplanade, keep equipment, materials, stockpiles a minimum of five feet from back of curb.

2. Where construction limits shown on Drawings extend to property line, keep sidewalks free of equipment, materials, and stockpiles.

1.11 EQUIPMENT AND MATERIAL SALVAGE

A. Upon completion of the Work, carefully remove salvageable equipment and material. Deliver them to City of Houston as directed by Project Manager. Dispose of equipment offsite at no additional cost to the City when Project Manager deems equipment unfit for further use.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01255

CHANGE ORDER PROCEDURES

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Procedures for processing Change Orders, including:

1. Assignment of a responsible individual for approval and communication of changes in the Work;

2. Documentation of change in Contract Price and Contract Time;

3. Change procedures, using proposals and Modifications;

4. Execution of Change Orders;

5. Correlation of Contractor submittals.

1.02 REFERENCES

A. Blue Book is defined as the Rental Rate Blue Book for Construction Equipment (a.k.a. Data Quest Blue Book).

B. Rental Rate is defined as the full-unadjusted base rental rate for the appropriate item of construction equipment.

1.03 RESPONSIBLE INDIVIDUAL

A. Provide a letter indicating the name and address of the individual authorized to execute Modifications, and who will be responsible for informing others in Contractor's employ and Subcontractors of changes to the Work. Provide this information at the pre-construction meeting.

1.04 DOCUMENTATION OF CHANGE IN CONTRACT PRICE AND CONTRACT TIME

A. Maintain detailed records of changes in the Work. Provide full information required for identification and evaluation of proposed changes, and substantiate costs of changes in the Work.

B. Document each proposal for change in Contract Price or Contract Time with sufficient data to allow evaluation of proposal.

C. Include the following minimum information on proposals:

1. Quantities of items in original Document 00410 – Bid Form with additions, reductions, deletions, and substitutions.

2. Quantities and cost of items in original Schedule of Values with additions, reductions, deletions and substitutions.

3. Provide Unit Prices for new items, with supporting information, for inclusion in Schedule of Unit Price Work.

4. Justification for changes in Contract Time.

5. Additional data upon request.

D. For changes in the Work performed on a time-and-material basis, provide the following additional information:

1. Quantities and description of Products.

2. Taxes, insurance and Bonds.

3. Overhead and profit as noted in Document 00700 - General Conditions.

4. Dates, times and by who work was performed.

5. Time records and certified copies of applicable payrolls.

6. Invoices and receipts for Products, rental equipment, and subcontracts, similarly documented.

E. For changes in the Work performed on a time-and-materials basis, rental equipment is paid as follows:

1. Actual invoice cost for duration of time required to complete extra work without markup for overhead and profit. When extra work comprises only a portion of a rental invoice where equipment would otherwise be on site, compute hourly equipment rate by dividing the actual monthly invoice by 176. One day equals eight hours and one week equals 40 hours.

2. Do not exceed estimated operating costs given in Blue Book for items of equipment. Overhead and profit will be allowed on the operating cost.

F. For changes in the Work performed on a time-and-materials basis using Contractor-owned equipment, use Blue Book rates as follows:

1. Contractor-owned equipment will be paid at the Blue Book Rental Rate for the duration of time required to complete extra work without markup for overhead and profit. Utilize lowest cost combination of hourly, daily, weekly or monthly rates. Use 150 percent of Rental Rate for double shifts, one extra shift per day, and 200 percent of Rental Rate for more than two shifts per day. Standby rates shall be 50 percent of the appropriate Rental Rate shown in Blue Book. No other rate adjustments apply.

2. Do not exceed estimated operating costs given in Blue Book. Overhead and profit will be allowed on operating costs. Operating costs will not be allowed for equipment on standby.

1.05 CHANGE PROCEDURES

A. Changes to Contract Price or Contract Time can only be made by issuance of Document 00941 - Change Order. Issuance of Document 00940 - Work Change Directive will be formalized into a Change Order. Changes will be in accordance with requirements of Document 00700 - General Conditions.

B. City Engineer will advise of Minor Changes in the Work as authorized by the Document 00700 - General Conditions by issuing Document 00942 – Minor Change.

C. Request clarification of Drawings, Specifications, Contract documents or other information by using Document 00931- Request for Information. Response by Project Manager to Requests for Information does not authorize Contractor to perform tasks outside scope of the Work. Changes must be authorized as described in this Section.

1.06 PROPOSALS AND CONTRACT MODIFICATIONS

A. Project Manager may issue Document 00932- Request for Proposal, which includes a detailed description of the proposed change with supplementary or revised Drawings and Specifications. Project Manager may also request a proposal in response to a Request for Information. Prepare and submit the proposal within seven days or as specified in request.

B. Submit requests for Contract changes to City Engineer describing proposed change and its full effect on the Work, with a statement describing reason for change and effect on Contract Price and Contract Time including full documentation.

C. Design Consultant may review Change Orders.

1.07 WORK CHANGE DIRECTIVE

A. City Engineer may issue a signed Work Change Directive instructing Contractor to proceed with a change in the Work. Work Change Directive will subsequently be incorporated into a Change Order.

B. Work Change Directives will describe changes in the Work and designate the method of determining change in Contract Price or Contract Time.

C. Proceed promptly to execute changes in the Work in accordance with the Work Change Directive.

1.08 STIPULATED PRICE CHANGE ORDER

A. A Stipulated Price Change Order will be based on an accepted proposal.

1.09 UNIT PRICE CHANGE ORDER

A. Where Unit Prices for affected items of the Work are included in Document 00410 – Bid Form, the Change Order will be based on Unit Prices, subject to Articles 7 and 9 of Document 00700 - General Conditions.

B. Where Unit Prices of the Work are not pre-determined in Document 00410-Bid Form, the Work Change Directive or accepted proposal will specify the Unit Prices to be used.

1.10 TIME-AND-MATERIAL CHANGE ORDER

A. Provide itemized account and supporting data after completion of change, within time limits indicated for claims in Document 00700 - General Conditions.

B. City Engineer will determine the change allowable in Contract Price and Contract Time as provided in Document 00700 - General Conditions.

C. Maintain detailed records for work done on time-and-material basis as specified in Paragraph 1.04 above.

D. Provide full information required for evaluation of changes and substantiate costs for changes in the Work.

1.11 EXECUTION OF CHANGE DOCUMENTATION

A. City Engineer will issue Change Orders, Work Change Directives, or Minor Change in the Work for signatures of Parties as described in Document 00700 - General Conditions.

1.12 CORRELATION OF CONTRACTOR SUBMITTALS

A. For Stipulated Price Contracts, promptly revise Schedule of Values and Application for Payment forms to record authorized Change Orders as separate line item.

B. For Unit Price Contracts, the next monthly estimate of the Work after acceptance of a Change Order will be revised to include new items not previously included with appropriate Unit Prices.

C. Promptly revise progress schedules to reflect change in Contract Time, and to adjust time for other items of work affected by the change, and resubmit for review.

D. Promptly enter changes to on-site and record copies of Drawings, Specifications or Contract documents as required in Section 01785 - Project Record Documents.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01270S

MEASUREMENT AND PAYMENT

The following supplements modify Section 01270 – Measurement and Payment Standard Specification. Where a portion of the Specification is modified or deleted by this Supplementary Specification, the unaltered portions of the Specification shall remain in effect.

1.05 PAYMENT

F. Payment for Bid Item "De-Mobilization and Re-Mobilization" is considered complete compensation if directed by the Project Manager to discontinue work and return at a later date. The direction to remobilize shall be given within the original contract time; however, contract time will be suspended during the time the contractor has demobilized. Payment is on a lump sum basis and includes, but not limited to the following:

1. Remove equipment, materials, waste products, temporary facilities, storage boxes, and other resources from site.
2. Temporary backfill of excavation. Backfill shall comply with applicable specifications, including type of materials and compaction requirements.
3. Reopen roads, curbs, driveways, sidewalks and handicap ramps to the public. Temporary restoration measures shall comply with applicable Federal, State and City regulatory requirements. Temporary restoration shall include but not be limited to temporary asphalt, pavement striping, traffic control signage and street signage.
4. Put back into service public and private utilities, including private irrigation system.
5. Remove temporary traffic control from project area.
6. Temporary regrade disturbed areas to drain properly and restore with sod grass. These areas must be cleaned of debris, swept, scrubbed and washed.

END OF SUPPLEMENT

Approved by:

SG John Kuo
Assistant Director
Department of Public Works & Engineering

9/11/16
Date

Section 01270

MEASUREMENT AND PAYMENT

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Procedures for measurement and payment plus conditions for nonconformance assessment and nonpayment for rejected Products.

1.02 AUTHORITY

A. Measurement methods delineated in Specification sections are intended to complement criteria of this Section. In event of conflict, requirements of the Specification section shall govern.

B. Project Manager will take all measurements and compute quantities accordingly.

C. Assist by providing necessary equipment, workers, and survey personnel.

D. Measurement and Payment paragraphs are included only in those Specification sections of Division 01 where direct payment will be made. Include costs in the total bid price for those Specification sections in Division 01 that do not contain Measurement and Payment paragraphs,

1.03 UNIT QUANTITIES SPECIFIED

A. Quantity and measurement estimates stated in the Agreement are for contract purposes only. Quantities and measurements supplied or placed in the Work and verified by Project Manager will determine payment as stated in Article 9 of Document 00700 - General Conditions.

B. When actual work requires greater or lesser quantities than those quantities indicated in Document 00410 – Bid Form, provide required quantities at Unit Prices contracted, except as otherwise stated in Article 9 of Document 00700 - General Conditions.

1.04 MEASUREMENT OF QUANTITIES

A. Measurement by Weight: Reinforcing steel, rolled or formed steel or other metal shapes are measured by CRSI or AISC Manual of Steel Construction weights. Welded assemblies are measured by CRSI or AISC Manual of Steel Construction or scale weights.

B. Measurement by Volume:

1. Stockpiles: Measured by cubic dimension using mean length, width, and height or thickness.

2. Excavation and Embankment Materials: Measured by cubic dimension using average end area method.

C. Measurement by Area: Measured by square dimension using mean length and width or radius.

D. Linear Measurement: Measured by linear dimension, at item centerline or mean chord.

E. Stipulated Price Measurement: By unit designated in the Agreement.

F. Other: Items measured by weight, volume, area, or linear means or combination, as appropriate, as completed item or unit of the Work.

G. Measurement by Each: Measured by each instance or item provided.

H. Measurement by Lump Sum: Measure includes all associated work.

1.05 PAYMENT

A. Payment includes full compensation for all required supervision, labor, Products, tools, equipment, plant, transportation, services, and incidentals; and erection, application or Installation of an item of the Work; and Contractor's overhead and profit.

B. Total compensation for required Unit Price work shall be included in Unit Price bid in Document 00410 – Bid Form. Claims for payment as Unit Price work, but not specifically covered in the list of Unit Prices contained in Document 00410 – Bid Form, will not be accepted.

C. Interim payments for stored materials will be made only for materials to be incorporated under items covered in Unit Prices, unless disallowed in Document 00800 - Supplementary Conditions.

D. Progress payments will be based on Project Manager's observations and evaluations of quantities incorporated in the Work multiplied by Unit Price.

E. Final payment for work governed by Unit Prices will be made on the basis of actual measurements and quantities determined by Project Manager multiplied by the Unit Price for work which is incorporated in or made necessary by the Work.

1.06 NONCONFORMANCE ASSESSMENT

A. Remove and replace work, or portions of the Work, not conforming to the Contract documents.

B. When not practical to remove and replace work, City Engineer will direct one of the following remedies:

1. Nonconforming work will remain as is, but Unit Price will be adjusted lower at discretion of City Engineer.

2. Nonconforming work will be modified as authorized by City Engineer, and the Unit Price will be adjusted lower at the discretion of City Engineer, when modified work is deemed less suitable than specified.

C. Specification sections may modify the above remedies or may identify a specific formula or percentage price reduction.

D. Authority of City Engineer to assess nonconforming work and identify payment adjustment is final.

1.07 NONPAYMENT FOR REJECTED PRODUCTS

A. Payment will not be made for any of the following:

1. Products wasted or disposed of in an unacceptable manner.

2. Products determined as nonconforming before or after placement.

3. Products not completely unloaded from transporting vehicles.

4. Products placed beyond lines and levels of required work.

5. Products remaining on hand after completion of the Work, unless specified otherwise.

6. Loading, hauling, and disposing of rejected Products.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01292

SCHEDULE OF VALUES

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Preparation and submittal of Schedule of Values for Stipulated Price Contracts or for Major Unit Price Work on Unit Price Contracts.

1.02 PREPARATION

A. For Stipulated Price Contracts, subdivide the Schedule of Values into logical portions of the Work, such as major work items or work in contiguous construction areas. Use Section 01325 - Construction Schedule as a guide to subdivision of work items. Directly correlate Items in the Schedule of Values with tasks in the Construction Schedule. Organize each portion using the Project Manual Table of Contents as an outline for listing value of the Work by Sections. A pro rata share of mobilization, Bonds, and insurance may be listed as separate items for each portion of the Work.

B. For Unit Price Contracts, items should include a proportional share of Contractor's overhead and profit so that total of all items will equal Contract Price.

C. For lump sum equipment items, where submittal of operation and maintenance data and testing are required, include separate items for equipment operation and maintenance data where:

1. submittal of maintenance data is valued at five percent of the lump sum amount for each equipment item and

2. submittal for testing and adjusting is valued at five percent of the lump sum amount for each equipment item.

Round off figures for each item listed to the nearest $100. Set the value of one item, when necessary, to make total of all values equal the Contract Price for Stipulated Price Contracts or the lump sum amount for Unit Price Work.

1.03 SUBMITTAL

A. Submit the Schedule of Values, in accordance with requirements of Section 01330 - Submittal Procedures, at least 10 days prior to processing of the first Certificate for Payment.

B Submit the Schedule of Values in an approved electronic spreadsheet file and an 81/2-inch by 11-inch print on white bond paper.

C. Revise Schedule of Values for items affected by Contract Modifications. After City Engineer has reviewed changes, resubmit at least 10 days prior to the next scheduled Certificate for Payment date.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01312

COORDINATION AND MEETINGS

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. General coordination including pre-construction meeting, site mobilization conference, and progress meetings.

1.02 COORDINATION OF DOCUMENTS

A. Coordination is required throughout documents. Refer to Contract documents and coordinate as necessary.

1.03 CONTRACTOR COORDINATION

A. Coordinate scheduling, submittals, and work of various Specification sections to assure efficient and orderly sequence of Installation of interdependent construction elements.

B. Coordinate completion and clean up of the Work prior to the Date of Substantial Completion and for portions of the Work designated for City's partial occupancy.

C. Coordinate access to the site for correction of nonconforming work to minimize disruption of the City's activities where the City is in partial occupancy.

1.04 PRE-CONSTRUCTION MEETING

A. Project Manager will schedule pre-construction meeting.

B. Attendance Required: City representatives, Design Consultant, special consultants as required by Project Manager, Contractor, and major Subcontractors and Suppliers.

C. Agenda:

1. Distribution of Contract documents.

2. Designation of personnel representing the Parties and Design Consultant.

3. Review of insurance.

4. Discussion of formats for Schedule of Values and Construction Schedule.

5. Procedures and processing of Shop Drawings, substitutions, pay estimates or Applications for Payment, Requests for Information, Requests for Proposal, Modifications, and the Contract closeout, other submittals.

6. Scheduling of the Work and coordination with other contractors.

7. Review of Subcontractors and Suppliers.

8. Appropriate agenda items listed for the site mobilization conference, Paragraph 1.05.C, when pre-construction meeting and site mobilization conference are combined.

9. Procedures for testing.

10. Procedures for maintaining record documents.

1.05 SITE MOBILIZATION CONFERENCE

A. When required by Contract documents, Project Manager will schedule a conference at the Project site prior to Contractor mobilization.

B. Attendance Required: City representatives, Design Consultant, special consultants, Superintendent, and major Subcontractors.

C. Agenda:

1. Use of premises by the City and Contractor.

2. Safety and first aid procedures.

3. Construction controls provided by the City.

4. Temporary utilities.

5. Survey and layout.

6. Security and housekeeping procedures.

7. Field office requirements.

1.06 PROGRESS MEETINGS

A. Hold meetings at Project field office or other location designated by Project Manager. Hold meetings at monthly intervals, or more frequently when directed by Project Manager.

B. Attendance Required: Superintendent, major Subcontractors and Suppliers, City representatives, Design Consultant and its subconsultants as appropriate for agenda topics for each meeting.

C. Project Manager will make arrangements for meetings, and for recording minutes.

D. Project Manager will prepare the agenda and preside at meetings.

E. Provide required information and be prepared to discuss each agenda item.

F. Agenda:

1. Review minutes of previous meetings.

2. Review of construction schedule, pay estimates, cash flow curve, payroll and compliance submittals.

3. Field observations, problems, and necessary decisions.

4. Identification of problems that impede planned progress.

5. Review of submittal schedule and status of submittals.

6. Review of RFI and RFP status.

7. Modification status.

8. Review of off-site fabrication and delivery schedules.

9. Maintenance of Construction Schedule.

10. Corrective measures to regain Construction Schedule.

11. Planned progress during the succeeding work period.

12. Coordination of projected progress.

13. Maintenance of quality and work standards.

14. Effect of proposed Modifications on Construction Schedule and coordination.

15. Review Project Record Contract Drawings.

16. Other item relating to the Work.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01321

CONSTRUCTION PHOTOGRAPHS

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Photographic requirements for construction photographs and submittals.

1.02 DEFINITIONS

A. Pre-construction Photographs: Photographs taken, in sufficient numbers and detail, prior to Date of Commencement of the Work, to show original construction site conditions.

B. Progress Photographs: Photographs, taken throughout the duration of construction at regular intervals and from fixed vantage points, pre-approved by the City, that document progress of the Work.

C. Finished Photographs: Photographs, taken by a professional photographer near Date of Substantial Completion and before City Council's acceptance of the Work, that are suitable for framing and for use in brochures or on the Internet

1.03 SUBMITTALS

A. Refer to Section 01330, Submittal Procedures, for submittal requirements.

B. Format and Media. Film or digital photography may be used. Submit color photographs, unless otherwise specified.

1. Prints. Submit each Progress or Pre-construction Photograph print in a three-hole plastic pocket or sleeve, bound in a three-ring notebook. Produce prints on photographic-quality paper approved by Project Manager. Minimum size for Pre-construction Photograph prints shall be 3-inches by 5-inches. Progress Photograph prints shall be 8-inches by 10-inches.

2. Film. Use 35mm or larger color film. Submit negatives used to make submitted photographs, in 3-hole 8-1/2 inch by 11-inch plastic sheets with sleeves for negatives.

3. Digital Photography. Use 2.1 megapixel density or greater for photographs. Scanned photographs must equal or exceed 400 dots

per inch when scanned from 8-inch by 10-inch prints. Submit digital photographic files on computer disks. Format disks for MS-DOS (Microsoft Disk Operating System) filing system and in JPEG (Joint Photographic Experts Group) format.

C. Submittal Quantities and Frequencies.

1. Pre-construction Photographs:
   a. For Stipulated Price Contracts, submit two sets of Pre-construction Photographs, if required, prior to first Application for Payment.
   b. For Unit Price Contracts, submit two sets of Pre-construction Photographs prior to start of construction operations.

2. Progress Photographs:
   a. For Stipulated Price Contracts, submit three sets of Progress Photographs with each Application for Payment at the times established for submittal of Applications for Payment. Monthly Applications for Payment shall be deemed incomplete if not accompanied by the required Progress Photographs. Contractor's failure or election to not submit a monthly Application for Payment shall not affect the requirement for monthly Progress Photographs.
   b. Progress Photographs are not required for Unit Price Contracts unless otherwise specified.

3. Finished Photographs: For Stipulated Price Contracts submit two sets of Finished Photographs, if required, after Date of Substantial Completion and prior to final payment. Each set shall contain one 11-inch by 14-inch matte finish color photographic print from each of the two vantage points pre-approved by the City. Vantage points for Finished Photographs will be approved separately from vantage points approved for Progress Photographs. Finished Photographs are not required for Unit Price Contracts unless otherwise specified.

D. Labeling. Place a label on the back of each photographic print, applied so as to not to show through on the front. Labels shall contain the following information:

1. Name of Project, address of Project and GFS Number.

2. Name and address of Contractor.

3. Date photograph was taken.

4. Location photo was taken from and short description of photo subject.

5. Name and address of professional photographer who took the photograph, if applicable.

E. Hand-deliver or transmit prints in standard photographic mailers marked "Photographs - Do Not Bend".

F. Photographic prints, negatives, photographic files and disks become the property of the City. Do not be publish photographs without written consent by the City.

1.04 QUALITY ASSURANCE

A. Contractor shall be responsible for the quality of and timely execution and submittal of photographs.

B. For Finished Photographs, Contractor shall use a professional photographer, with five years minimum professional experience in the Houston area. Contractor shall submit name, address and credentials of professional photographer for Project Manager's review and approval.

PART 2 PRODUCTS - Not Used

PART 3 EXECUTION

3.01 PRE-CONSTRUCTION PHOTOGRAPHS

A. Prior to commencement of construction operations, photograph the site to include initial construction corridor, detour routes, and staging or storage areas.

1. For Stipulated Price Contracts, unless specified as a requirement in other Sections, these photographs are optional for Contractor, but are highly recommended for areas bounded by other property owners.

2. Pre-construction photographs are required for Unit Price Contracts. For line projects with scheduled construction segments, take Pre-construction Photographs prior to commencement of work on each segment.

B. Prepare Pre-construction Photographs as follows:

1. Show the following information on a non-reflective chalkboard placed within the picture frame:
   a. Job number.
   b. Project Number.
   c. Date and time photographs were taken (Automatic date/time in negative is acceptable).
   d. Baseline station, direction of view (i.e. N, S, NW, etc.) and house number or street address and street name.

2. Pre-construction Photographs shall indicate condition of the following:
   a. Esplanades and boulevards.
   b. Yards (near side and far side of street).
   c. House walks and sidewalks.
   d. Curbs.
   e. Areas between walks and curbs.
   f. Particular features (e.g. yard lights, shrubs, fences, trees).

3. Show date photographs were taken on negatives.

C. Show the location of vantage points and direction of shots on a key plan of the site.

3.02 PROGRESS PHOTOGRAPHS

A. Progress Photographs document monthly advancement of the Work. Select vantage points for each shot so as to best show status of construction and progress since last photograph submittal. Select camera stations that will require little or no movement or adjustment over the duration of construction.

B. Take monthly Progress Photographs at regular intervals to coincide with cutoff dates associated with each Application for Payment.

3.03 FINISHED PHOTOGRAPHS

A. Finished Photographs shall be "staged" and taken by a professional photographer to depict the most flattering images of a finished facility. Two vantage points, from which Finished Photographs will be taken, shall be agreed to in advance by the City. Photographer shall consider lighting, time of day, height of eye, landscaping and placement of vehicles, people and other props in each picture. Filters and post-photography processing may be utilized to achieve a finished product acceptable to the City.

3.04 LOCATION

A. Vantage points, times and conditions for camera stations and photography for Progress and Finished Photographs shall be mutually agreed upon by the City, Contractor and Photographer. Progress Photograph vantage points may be changed by mutual agreement as the Work progresses, at no additional cost to the City.

END OF SECTION

Section 01325

CONSTRUCTION SCHEDULE

PART 1 G E N E R A L

1.01 GENERAL

A. Provide Construction Schedules for the Work included in this Contract in accordance with requirements in this Section. Create Construction Schedule using Critical Path Method (CPM) computer software capable of mathematical analysis of Precedence Diagramming Method (PDM) plan. Provide printed activity listings and bar charts in formats described in this Section.

B. Combine activity listings and bar charts with narrative report to form Construction Schedule submittal for Project Manager.

1.02 SCHEDULING STAFF

A. Employ or retain services of individual experienced in CPM scheduling for duration of the Contract. Individual shall cooperate with Project Manager and update schedule monthly as required to indicate current status of the Work.

1.03 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. During preconstruction meeting, as described in Section 01312 - Coordination and Meetings, provide sample bar charts and activity listings produced from scheduling software proposed. Scheduling software is subject to review by Project Manager and must meet requirements provided in this Section. Project Manager will provide review of samples within seven days of submittal.

C. Within 21 days of receipt of approval of Contractor's format, or 30 days of Notice to Proceed, whichever is later, submit proposed Construction Schedule for review. Base Construction Schedule submittal on the following:

1. Level of detail and number of activities required in schedule are dependent on project type.
   a. For wastewater projects, categorize work type and area code in schedule.
      1) For wastewater rehabilitation projects, there are six work-type categories. An area code will be assigned for each

Meter Service Area or Basin. Include at least one activity for each unique combination of work type and area code. Normal schedules of wastewater rehabilitation projects contain between 35 and 100 activities, depending on number of basins and work types involved in each basin.

2) For wastewater relief projects (line work), area codes will be assigned geographically.

3) For wastewater plant or facility work, other criteria may apply to assignment of area codes, such as a combination of geographical and craft categories.

b. For projects with multiple types of tasks within scope, indicate types of work separately within schedule.

c. For projects with work at different physical locations or service areas, or different facilities within a site, indicate each location or facility separately within schedule. Show work on each floor of multi-story building as separate tasks.

d. For projects with multiple crafts or significant Subcontractor components, indicate elements separately within schedule. Unless permitted by Project Manager, tasks shall consist of work covered by only one division of Project Manual.

2. Unless permitted by Project Manager, each scheduled task shall be same as Schedule of Values line item, and vice versa.

3. For projects with Major Unit Price Work, indicate Shop Drawing submittal and review, purchase, delivery, and Installation dates on Project schedule. Include activities for testing, adjustment, and delivering O&M manuals.

4. No task except the acquisition of Major Unit Price Work shall represent more than one percent of Original Contract Price for facility projects and three percent of Original Contract Price for other projects. Duration of tasks may not exceed 40 calendar days.

5. For projects where operating facilities are involved, identify each period of work that will impact any process or operation in the schedule and that must be agreed to by Project Manager and facility operator prior to starting work in the area.

D. Construction Schedule submittals shall include:

1. printed bar charts that meet criteria outlined in this Section and are produced by Contractor's approved scheduling software;

2. activity listings that meet criteria outlined in this Section and are produced by Contractor's approved scheduling software; and

3. a predecessor/successor listing sorted by Activity ID that meets criteria outlined in this Section and is produced by Contractor's scheduling software.

4. A logic network diagram is required with the first Construction Schedule submittal for facilities projects.

5. Prepare and submit graphic or tabular display of estimated monthly billings (i.e. a cash flow curve for the Work) with the first schedule submittal. This information is not required in monthly updates, unless significant changes in work require re-submittal of schedule for review. Display shall allocate units indicated in bid schedule or Schedule of Values to Construction Schedule activities. Weighted allocations are acceptable, where appropriate. Dollar value associated with each allocated unit will be spread across the duration of that activity on a monthly basis. Total for each month and cumulative total will be indicated. These monthly forecasts are only for Project Manager's planning purposes. Monthly payments for actual work completed will be made in accordance with Document 00700 - General Conditions.

6. Narrative Report that provides the information outlined in this Section.

E. No payment will be made until Project Manager approves Construction Schedule and billing forecast.

F. If Contractor desires to make changes in its method of operating and scheduling, after Project Manager has reviewed original schedule, notify Project Manager in writing, stating reasons for changes. When Project Manager considers these changes to be significant, Contractor may be required to revise and resubmit for review all or affected portion of Contractor's Construction Schedule to show effect on the Work.

G. Upon written request from Project Manager, revise and submit for review all or any part of Construction Schedule submittal to reflect changed conditions in the Work or deviations made from original schedule.

H. Updated Construction Schedule with actual start and actual finish dates, percent complete, and remaining duration of each activity shall be submitted monthly. Data date used in updating monthly Construction Schedule shall be the same date as used in monthly Payment Application. Monthly update of Construction Schedule is required for monthly Payment Application to be processed for payment.

1.04 SCHEDULING COMPUTER SOFTWARE REQUIREMENTS

A. Contractor's scheduling software shall be capable of creating bar charts and activity listings, which can be sorted by various fields (i.e. Activity ID, Early Start, Total Float, Area Code, Specification Section number, and Subcontractor). Use software capable of producing logic network diagram.

B. Use scheduling software capable of producing activity listings and bar charts with the following information for each activity in the schedule:

1. Activity ID
2. Activity Description
3. Estimated (Original) Duration
4. Remaining Duration
5. Actual Duration
6. Early Start Date
7. Late Start Date
8. Early Finish Date
9. Late Finish Date
10. Free Float
11. Total Float
12. Activity Codes (such as Area Code, Work Type, Specification Section, Subcontractor)

C. Use scheduling software capable of printing calendars using mathematical analysis of schedule, indicating standard workdays of week and scheduled holidays.

D. Use scheduling software capable of printing activity listing that indicates predecessors and successors, lag factors and lag relationships used in creating logic of the schedule.

E. Use scheduling software to provide monthly time in Bar Chart format and scale with 12-month scale not to exceed one page width. Bar charts may be

printed or plotted on 8-1/2 by 11-inch, 8-1/2 by 14-inch or 11 by 17-inch sheet sizes. Over-size plots are not acceptable.

1.05 NARRATIVE SCHEDULE REPORT

A. Narrative schedule report shall list activities started this month, activities completed this month, activities continued this month, activities scheduled to start or complete next month, problems encountered this month, and actions taken to solve these problems.

B. Narrative schedule report shall describe changes made to Construction Schedule logic (i.e. changes in predecessors and lags), activities added to schedule, activities deleted from schedule, any other changes made to the schedule other than addition of actual start dates and actual finish dates and changes of data date and remaining durations for re-calculation of mathematical analysis.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01326

CONSTRUCTION SCHEDULE (BAR CHART)

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Provide an initial Construction Schedule as required by this section for the Work. Do not start construction until Project Manager reviews the schedule.

1.02 FORM AND CONTENT OF INITIAL CONSTRUCTION SCHEDULE

A. Bar Chart:

1. Show major construction activities such as pipe laying, by traffic control phases or other approved key areas; tunnel construction, pavement removal, pavement replacement, pressure testing, chlorination, clean up and punch list as separate activities on the schedule.

2. Show week duration for each activity.

3. Show separate activities for each Shop Drawing and Product Data submittal critical to timely completion. Show submittal dates and dates Project Manager needs to provide approved submittals.

4. Provide separate horizontal bar for each activity. List start and finish date for each activity at left side of diagram.

5. Horizontal Time Scale: Identify first work day of each week.

6. Scale and Spacing: Notes must be legible. Allow space for notations and future revisions.

7. Order of Listings: Order bar chart listings by phases or other approved groups of activities that are contiguous. List activities in chronological order within each phase or group.

B. Narrative Description:

1. Submit narrative descriptions of anticipated work sequences as indicated by the sequence of activities presented in the schedule.

2. Discuss any activity that affects the public (such as phases of traffic control), interaction with specific forces of the City (such as valve operation, chlorination and testing) or other associated contractors.

1.03 PROGRESS REVISIONS

A. Submit progress revisions or necessary information to complete and process Payment Applications. When required, re-submittals for rejected revisions must be submitted and reviewed prior to the following month's processing of a Payment Application. The following month's Payment Application will not be processed until the re-submittal is reviewed and required progress revisions are received.

B. Provide a narrative report to describe:

1. Major changes in scope.

2. Revised projections in progress, completion, or changes in activity duration.

3. Other identifiable changes.

4. Problem areas, anticipated delays, and the impact on schedule.

5. Corrective action recommended and its effect.

6. Effect of changes on schedules or other contractors.

7. Product delivery lead times.

C. Include additional data with Bar Chart described in Paragraph 1.03A of this Section:

1. Show original dates for each activity in the approved initial progress schedule by narrow bar next to a wider bar for the current schedule.

2. Show date each activity actually started or finished when an event has occurred. Clearly identify actual dates in two right-most columns in left portion of an 11 by 17-inch chart.

3. Indicate the percentage progress to the date of submittal for each activity.

1.04 SUBMITTALS

A. Submit the initial progress schedule within 15 days after award of contract. Project Manager will review the schedule and return a reviewed copy within 21 days after receipt.

B. Cut-off dates for progress revisions may be as early as the 20th of the month to avoid delaying processing of Payment Applications. Use the cut-off date for the first approved revision for further revisions.

C. When required, re-submit within seven days after return of review copy.

D. Include connecting lines between bars in the schedule to indicate the sequence that activities will be accomplished. Connecting lines when the activity's start or finish is modified will identify impact of preceding or succeeding activities. Submit a minimum of six copies of the bar chart on 11 by 17-inch opaque reproductions. Project Manager will retain five copies and return the remaining copy.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01330

SUBMITTAL PROCEDURES

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Submittal procedures for:

1. Schedule of Values
2. Construction Schedules and Cash Flow Curve (billing forecast).
3. Shop Drawings, Product Data and Samples
4. Operations and Maintenance (O&M) Data
5. Manufacturer's Certificates
6. Construction Photographs
7. Project Record Documents and monthly certification.
8. Video Tapes
9. Design Mixes

1.02 SUBMITTAL PROCEDURES

A. Scheduling and Handling:

1. Submit Shop Drawings, data and Samples for related components as required by Specifications and Project Manager.
2. Schedule submittals well in advance of need for construction Products. Allow time for delivery of Products after submittal approval.
3. Develop submittal schedule that allows sufficient time for initial review, correction, resubmission and final review of all submittals. Allow a minimum of 30 days for initial review. Project Manager will review and return submittals to Contractor as expeditiously as possible but time required for review will vary depending on complexity and quantity of data submitted.

4. Project Manager's review of submittals covers only general conformity to Drawings, Specifications and dimensions that affect layout. Contractor is responsible for quantity determination. No quantities will be verified by Project Manager. Contractor is responsible for errors, omissions or deviations from Contract requirements; review of submittals does not relieve Contractor from the obligation to furnish required items in accordance with Drawings and Specifications.

5. Submit five copies of documents unless otherwise specified.

6. Revise and resubmit submittals as required. Identify all changes made since previous submittal.

7. Assume risk for fabricated Products delivered prior to approval. Do not incorporate Products into the Work, or include payment for Products in periodic progress payments, until approved by Project Manager.

B. Transmittal Form and Numbering:

1. Transmit each submittal to Project Manager with Transmittal letter which includes:
   a. Date and submittal number
   b. Project title and number
   c. Names of Contractor, Subcontractor, Supplier and manufacturer
   d. Identification of Product being supplied
   e. Location of where Product is to be Installed
   f. Applicable Specification section number

2. Identify deviations from Contract documents clouding submittal drawings. Itemize and detail on separate 8-1/2 by 11-inch sheets entitled "DEVIATIONS FOR _____." When no deviations exist, submit a sheet stating no deviations exist.

3. Have design deviations signed and sealed by an appropriate design professional, registered in the State of Texas.

4. Sequentially number transmittal letters beginning with number one. Use original number for resubmittals with an alphabetic suffix (i.e., 2A for the first resubmittal of submittal 2, or 15C for third resubmittal of submittal 15, etc.). Show only one type of work or Product on each submittal. Mixed submittals will not be accepted.

C. Contractor's Stamp:

1. Apply Contractor's Stamp certifying that the items have been reviewed in detail by Contractor and that they comply with Contract requirements, except as noted by requested variances.

2. As a minimum, Contractor's Stamp shall include:
   a. Contractor's name
   b. Job number
   c. Submittal number
   d. Certification statement Contractor has reviewed submittal and it is in compliance with the Contract
   e. Signature line for Contractor

D. Submittals will be returned with one of the following Responses:

1. "ACKNOWLEDGE RECEIPT" when no response and resubmittal is required.

2. "NO EXCEPTION" when sufficient information has supplied to determine that item described is accepted and that no resubmittal is required.

3. "EXCEPTIONS AS NOTED" when sufficient information has been supplied to determine that item will be acceptable subject to changes, or exceptions, which will be clearly stated. When exceptions require additional changes, the changes must be submitted for approval. Resubmittal is not required when exceptions require no further changes.

4. "REJECTED-RESUBMIT" when submittal does not contain sufficient information, or when information provided does not meet Contract requirements. Additional data or details requested by Project Manager must be submitted to obtain approval.

1.03 MANUFACTURER'S CERTIFICATES

A. When required by Specification sections, submit manufacturers' certificate of compliance for review by Project Manager.

B. Place Contractor's Stamp on front of certification.

C. Submit supporting reference data, affidavits, and certifications as appropriate.

D. Product certificates may be recent or from previous test results, but must be acceptable to Project Manager.

1.04 DESIGN MIXES

A. When required by Specification sections, submit design mixes for review.

B. Place Contractor's Stamp, as specified in this section, on the front of each design mix.

C. Mark each mix to identify proportions, gradations, and additives for each class and type of mix submitted. Include applicable test results from samples for each mix. Perform tests and certifications within 12 months of the date of the submittal.

D. Maintain copies of approved mixes at mixing plant.

1.05 CHANGES TO CONTRACT

A. Changes to Contract may be initiated by completing a Request for Information form. Project Manager will provide a response to Contractor by completing the form and returning it to Contractor.

1. If Contractor agrees that the response will result in no increase in cost or time, a Minor Change in the Work will be issued by City Engineer.

2. If Contractor and Project Manager agree that an increase in time or cost is warranted, Project Manager will forward the Request for Proposal for negotiation of a Change Order.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01340

SHOP DRAWINGS, PRODUCT DATA, AND SAMPLES

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Methods, schedules, and processes to be followed for Shop Drawings, Product Data and Sample submittals.

1.02 REQUIREMENT

A. Submit Shop Drawings, Product Data and Samples as required by Document 00700 - General Conditions and Specification sections, using procedures specified in Section 01330 - Submittal Procedures and the requirements of this Section.

B. Shop Drawings, Product Data and Samples are not considered Contract documents.

1.03 SHOP DRAWING/SUBMITTAL SCHEDULE

A. Submit a separate Shop Drawing submittal schedule at same time the Construction Schedule is submitted. List Products for which Shop Drawings and other submittals are required in the order that they appear in Specifications. Include Product Data and Sample submittals in the schedule. Payment Applications or Certificates for Payment will not be processed until Project Manager has approved the Shop Drawing submittal schedule.

1.04 SHOP DRAWINGS

A. Submit a minimum of seven sets of Shop Drawings and Product Data in a form and quality suitable for microfilming. Review and sign Shop Drawings indicating compliance with the Contract.

B. Place Contractor's Stamp on each drawing as described in Section 01330 - Submittal Procedures.

C. Show the following accurately and distinctly:

1. Field and erection dimensions;

2. Arrangement and section views;

3. Relation to adjacent materials or structure, including complete information for making connections between the Work and work under other contracts;

4. Types of Products and finishes;

5. Parts list and descriptions;

6. Assembly drawings of equipment components and accessories showing respective positions and relationships to the complete equipment package;

7. Identify details by referencing drawing sheet and detail numbers, schedule or room numbers as shown on the Contract drawings, where necessary for clarity.

D. Scale drawings to provide a true representation of the specific equipment or item Furnished.

E. Coordinate and submit components, necessary for Project Manager to adequately review submittal, as a complete package. Reproduction of the Drawings for use in Shop Drawings is not allowed.

F. For major changes to original documents, submit Computer-Aided Design (CAD) drawings on a media acceptable to Project Manager.

1.05 PRODUCT DATA

A. Submit Product Data for review as required in Specifications.

B. Place Contractor's stamp, on each data item submitted, as described in Section 01330 - Submittal Procedures.

C. Mark each copy to identify applicable Products, models, and options to be used in the Work. Where required by Specifications, supplement manufacturers' standard data to provide information unique to the Work.

D. Give manufacturers, trade name, model or catalog designation and applicable reference standard for Products specified only by reference standards.

E. Pre-approved and Pre-qualified Products.

1. For "pre-approved", "pre-qualified" and "approved" Products named in the City standard products list, provide an appropriate list designation,

as described in Section 01630 - Product Substitution Procedures, within 30 days after Notice to Proceed.

2. For Products proposed as alternates to "approved" products, provide information required to demonstrate that the proposed Products meet the level of quality and performance criteria of the "approved" product.

1.06 SAMPLES

A. Submit Samples for review as required by Specifications. Have Samples reviewed and signed by a Registered Professional.

B. Place Contractor's stamp on each Sample or firmly attach a sheet of paper with Contractor's stamp, as described in Section 01330 - Submittal Procedures.

C. Submit the number of Samples specified in Specifications; Project Manager will retain one.

D. Reviewed Samples that may be used in the Work are identified in Specifications.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

SECTION 01351

ENVIRONMENTAL SAFETY AND WORKER PROTECTION

PART 1 GENERAL

1.01 SECTION INCLUDES

Environmental Safety and Worker Protection including monitoring emissions and exposure to workers and providing an appropriate response. The role of the Certified Industrial Hygienist (CIH) is also defined.

1.02 MEASUREMENT AND PAYMENT

No separate measurement and payment for work performed under this Section. The Contractor shall include the cost for this work in the contract bid price for work of which this is a component part.

1.03 REFERENCES

The following is a list of applicable requirements to this project. It is not intended to be a complete listing of all laws and regulations to which the Contractor must comply.

A. Code of Federal Regulations

1. 29 CFR 1910, "Occupational Safety and Health Standards".

   a. 29 CFR 1910.146 "Permit-required confined spaces".

2. 29 CFR 1926, "Safety and Health Regulations for Construction" (Construction Industry Standards).

   a. 29 CFR 1926.33 "Access to Employee Exposure and Medical Records".

   b. 29 CFR 1926.51, "Sanitation Standard".

   c. 29 CFR 1926.59, "Hazard Communication".

   d. 29 CFR 1926.62, "Lead".

   e. 29 CFR 1926.103 "Respiratory Protection".

3. 40 CFR 50, "National Primary and Secondary Ambient Air Quality

Standards"

a. 40 CFR 50 Appendix B, "Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere (High Volume Method)".

b. 40 CFR 50 Appendix G, "Reference Method for the Determination of Lead in Suspended Particulate Matter Collected from Ambient Air".

4. 40 CFR 58, "Ambient Air Quality Surveillance".

5. 40 CFR 60 Appendix A, "Visual Determination of Fugitive Emissions from Material Sources and Smoke Emissions from Fires".

6. 40 CFR 117, "Determination of Reportable Quantities for Hazardous Substances".

7. 40 CFR 122, "Administered Permit Program: The National Pollutant Discharge Elimination System".

B. National Institute for Occupational Health and Safety

NIOSH Method 7082, "Lead" (or equivalent).

C. American Society for Testing and Materials

ASTM D3335, "Test Method for Low Concentrations for Lead, Cadmium, and Cobalt in Paint by Atomic Absorption Spectroscopy."

D. EPA (Environmental Protection Agency) Publications

1. SW-846, "Test Methods for Evaluating Solid Waste - Physical/Chemical Methods".

2. EPA Method 3050, "Acid Digestion of Sediments, Sludges, and Soils".

E. SSPC Guide 6, "Guide for Containing Debris Generated During Paint Removal Operations".

F. SSPC Guide 7, "Guide for the Disposal of Lead Contaminated Surface Preparation Debris".

G. SSPC Publication 91-18, "Industrial Lead Paint Removal Handbook".

H. Texas Commission on Environmental Quality

1. Texas Administrative Code (TAC) 30, Chapter 101, "General Rules".

2. Texas Administrative Code (TAC) 30, Chapter 111, "Control of Air Pollution from Visible Emissions and Particulate Matter".

3. Texas Administrative Code (TAC) 30, Chapter 290, "Water Hygiene".

4. Texas Administrative Code (TAC) 30, Chapter 307, "Surface Water Quality Standards".

5. Texas Administrative Code (TAC) 30, Chapter 309, "Effluent Limitations".

6. Texas Administrative Code (TAC) 30, Chapter 335, "Industrial Solid Waste and Municipal Hazardous Waste".

1.04 SUBMITTALS

A. Submittals shall conform to requirements of Section 01330 – Submittal Procedures.

B. Submittals shall conform to appropriate codes for regulatory requirements.

1.05 DEFINITION

A. Acceptance Criteria: Minimum standards for the content of programs, plans, procedures, and designs required by this specification for the performance of this project. Acceptance criteria will be the basis for judging the responsiveness of Contractors' programs and will also be used as a basis for suspending work, if necessary.

B. Action Level: Employee exposure, without regard to the use of respirators, to an airborne concentration of lead of 30 micrograms per cubic meter of air (µg/m3) calculated as an eight hour time-weighted average (TWA).

C. CERCLA: Comprehensive Environmental Response, Compensation, and Liability Act; commonly called Superfund. Federal laws addressing the clean up of hazardous waste sites. Amended in 1986 by Superfund Amendments and Re-Authorization Act (SARA). EPA implementing regulations are contained in 40 CFR 300-373.

D. Competent Person: One who is capable of identifying existing and predictable lead hazards in the surroundings or working conditions and who has authorization to take prompt corrective measures to eliminate them.

E. Containment System: An enclosure built around lead paint removal areas designed to contain lead paint debris and prevent emissions to the environment.

F. Dust Collection: Mechanical ventilation system designed specifically for the containment, capture, and removal of airborne particulate from the containment. Dust collection systems shall include ductwork, plenums and/or hoppers, and dust collector(s) for the removal of leaded paint dust from the air stream prior to discharging to the atmosphere.

G. Emission: A release of material to the air, water, or ground.

H. Entry/Exit Airlock: An isolated enclosure located at the entrance of the containment in which the workers remove contaminated dust and debris from their work clothes.

I. EPA: The US. Environmental Protection Agency. Regulations are contained in Title 40 of the Code of Federal Regulations (40 CFR).

J. Hazardous Waste (lead paint debris): Waste that is classified as hazardous due to its concentrations of regulated hazardous substances. Paint debris is classified as hazardous waste if, after testing by the Toxicity Characteristic Leaching Procedure (TCLP), the leachate contains any of the 8 metals or other substances in concentrations at or above limits established in 40 CFR 261.

K. HEPA: A high efficiency particulate filter (HEPA) that is 99.97% efficient against particles of 0.3 microns in size or larger.

L. Lead Containing Dust and Debris: Dust and debris generated during the project which contains lead in any amount, including but not limited to pulverized paint, spent abrasive, filters (wet and dry), and containment materials upon which lead is still present.

M. NIOSH: National Institute of Occupational Safety and Health.

N. OSHA: Occupational Safety and Health Administration. Standards are contained in Title 29 of the Code of Federal Regulations, Parts 1910 and 1926 (29 CFR 1910 and 29 CFR 1926).

O. Owner: The City of Houston

P. PEL: Permissible Exposure Limit. An employee exposure, without regard to the use of respirators, to an airborne concentration of lead of 50 µg/m3 over an 8 hour TWA.

Q. POTW: Publicly Owned Treatment Works

R. RCRA: Resource Conservation and Recovery Act. Federal law pertaining to hazardous waste management. EPA implementing regulations are contained in 40 CFR 240-280.

S. Regulated Area: Area established by the Contractor to demarcate the zone(s) beyond which airborne concentrations of lead do not exceed the Action Level.

T. SSPC: Society for Protective Coatings. An independent, non-profit organization of engineers, technical specialists, and Contractors whose goal is research and development of new coatings and methods for removal, application, and disposal of existing coatings on industrial structures.

U. Tarpaulins: Flexible fabric, vinyl, plastic or canvas cover sheets, impenetrable to dust, wind, and water, used to enclose the cable and/or scaffold support system comprising the containment enclosure.

V. TCLP: Toxicity Characteristic Leaching Procedure. Laboratory tests conducted on wastes that determine the amount of hazardous materials that leach out into a test solution. The test is intended to simulate the properties of water as it leaches through a solid waste landfill. TCLP testing is defined in 40 CFR 261, Appendix II.

W. TSP: Total Suspended Particulate

PART 2 PRODUCTS

2.01 MATERIAL AND EQUIPMENT

A. The Contractor is to supply materials and equipment to insure the safety and protection of workers and the environment in accordance with these specifications.

PART 3 EXECUTION

3.01 ENVIRONMENTAL PROTECTION AND MONITORING

NOTE: Section 09971 "Painting and Protective Coatings", 2.04 "Containment System" specifically identifies containment system requirements.

A. Protection of Ambient Air: Visible emissions are to be controlled to meet, as a minimum, TAC 30 Chapter 111," Control of Air Pollution from Visible Emissions and Particulate Matter" requirements and SSPC-Guide 6I (CON), Level 1 Emissions. Air monitoring and analysis may be performed by the City during abrasive blast cleaning operations. Such monitoring will be in accordance with 40

CFR 50, Appendix B, "Reference Method for the Determination of Suspended Particulate Matter in the Atmosphere" and/or 40 CFR 50, Appendix G, "Reference Method for the Determination of Lead in Suspended Particulate Matter Collected from Ambient Air". The limits for down wind pollutant concentrations allowed during blasting operations are as follows:

PM-10: 450 micrograms/cubic meter/ 8 hr.. (40 CFR 50.6)

Lead (Pb): 13.5 micrograms/cubic meter/8 hr.. (40 CFR 50.12)

Visible emissions and/or monitored emissions for PM-10 and TSP lead in excess of the above levels shall be cause for shut down of the project until corrections to control/ containment system or paint removal/ surface preparation operations are made to comply with these requirements.

B. Protection of Surface and Storm Water: The Contractor shall take all necessary precautions to ensure lead contaminants do not enter surface waters or storm water drainage systems.

1. The Contractor shall protect the area around ditches and drainage inlets. Daily verification of proper protection to minimize the potential contaminants reaching the drainage system shall be performed.

2. The Contractor shall collect all potentially contaminated process waters for testing and, as appropriate, treatment. Process water from pressure washing, wet abrasive blast cleaning or hygiene facilities shall not be discharged to drainage systems or surface waters.

3. The Contractor may remove lead or other heavy metals from such waters through filtration, ion exchange or other approved means. Following treatment, water samples must be tested prior to disposal. Discharge to sanitary sewer lines requires authorization, in writing, from a POTW.

C. Protection of Soil and Grounds: The Contractor shall protect the soil around the structure to ensure that the soil does not become contaminated. Where lead is present in the coatings to be removed, as indicated in Section 02136 "Waste Material Handling and Disposal", the Contractor shall provide for the sampling and analysis of soil samples for total lead content.

1. Sampling and analysis shall be performed prior to commencement of paint removal operations to establish a background "base level". Soil samples shall be taken 3 feet from the base of the tank(s), at a distance of 6-10 feet beyond the proposed containment structure and at the property line.

2. Samples from each area shall be taken in a minimum of four directions, at

circular increments of 90^0, one of which shall include the direction of prevailing wind. Samples shall also be obtained, at the direction of the engineer, at the closest points of public access (i.e. housing, park, school).

3. The soil sampling procedure shall be as outlined in SSPC Guide 6 Section 5.5.5. Each sampling point shall be sufficiently identified on a site map to allow return to the exact location upon project completion.

4. Each sample shall be split in two portions, one for immediate analysis and the other sealed, preserved and furnished to the Engineer. The samples shall be analyzed in accordance with EPA Method 3050, "Acid Digestion of Sediments, Sludges and Soils", and shall be performed by a qualified laboratory approved by the Engineer.

5. Samples shall be obtained at the completion of work (post-construction samples) from all locations from which pre-construction samples were obtained. Samples shall be collected, handled and tested in the same manner as described above.

6. Upon completion of the work, soils found to be contaminated with lead in greater quantity than found in the background "base level", established at the start of the work, shall be removed by the Contractor to the depth necessary to achieve a lead content equivalent to, or below, the pre-construction back ground levels. Disposal shall be in accordance with applicable regulations.

7. The Contractor shall replace in-kind (i.e., topsoil, structural fill, etc.) with an equivalent amount of non-contaminated soil, compact in place and grade to pre-existing conditions. The Contractor shall also replace in-kind any surface improvements, such as grass, shrubs, etc. that were damaged or destroyed by the work. The soil removal, replacement and related work is to be performed by the Contractor at no additional cost to the Owner.

3.02 WORKER PROTECTION

A. The Contractor shall develop a written Compliance Program to establish and implement practices and procedures for assuring that no employee is exposed to lead at concentrations greater than 50 micrograms per cubic meter of air ($\mu g/m^3$), the OSHA permissible exposure limit (PEL). This program is in addition to other OSHA hazard communication and safety and health requirements of the project, and shall be revised and updated at least every six months.

1. The program shall establish methods for complying with this specification and the OSHA Construction Industry Lead Standard, 29 CFR 1926.62(e)(2)(ii). The Federal regulation is referred to as the "Lead

Standard" for the purpose of this specification.

2. The program shall apply to all Contractor employees associated with lead on the project, and to subcontractors working under the direct control of the Contractor who are associated with lead on the project.

3. The program shall assign the specific responsibility for implementation and enforcement of the program to the Contractors' company management. The Contractor's Competent Person(s) shall be identified, by name, and qualifications submitted. The Competent Person shall be on-site during any operations which involve the removal, handling or disturbing of lead containing materials.

4. The program shall contain a description of each activity in which lead is emitted (e.g. equipment used, material involved, controls in place, crew size, employee job responsibilities, operating procedures and maintenance practices).

5. The program shall contain a report of the technology considered in meeting the PEL and air monitoring data which documents the source of lead emissions.

6. The program shall contain a work practice program which includes items required in the lead standard such as protective clothing and equipment, housekeeping, and hygiene facilities and practices.

B. Exposure Monitoring: The Contractor shall be responsible for conducting and reporting worker exposure assessments in accordance with 29 CFR 1926.62.

1. Representative personal air samples shall be collected at the beginning of the lead removal work to determine employee lead exposures. Tasks involving potential lead exposure include, but are not limited to, paint removal operations, clean-up, and debris handling operations. Full shift (at least 7 hours) air samples shall be collected for each job classification in the exposure area. The range of exposures for lead removal and cleanup activities shall be determined.

2. During the initial monitoring, workers performing the following activities (or equivalent) shall be protected to the anticipated exposure levels which are dictated by the lead standard:

   a. 500 $\mu g/m^3$: Manual demolition of structures containing lead-containing coatings or paint (e.g., dry wall), manual scraping, manual sanding, heat gun applications, power tool cleaning with dust collection systems, and spray painting with lead paint.

b. 2,500 $\mu g/m^3$: Using lead-containing mortar, lead burning, or conducting the following activities where lead-containing coatings or paint are present: rivet busting, power tool cleaning without dust collection systems, clean-up activities where dry expendable abrasives are used, and the movement and removal of abrasive blasting enclosures.

c. More than 2,500 $\mu g/m^3$: Activities involving lead containing coatings or paint on structures disturbed by abrasive blasting, welding, cutting, and torch burning.

3. Protection requires compliance with the necessary respiratory protection, personal protective clothing and equipment, change areas and washing facilities, blood lead and zinc protoporphyrin monitoring, and employee training. The protection measures shall be modified, as necessary, after the exposure results are received.

4. Where initial monitoring indicates that lead exposures are below the Action Level, and where work activities and conditions remain the same as at the time of initial sampling, additional monitoring need not be repeated for that work activity.

5. Where the initial monitoring of a given work activity indicates that lead exposures are at or above the Action Level, additional exposure monitoring shall be conducted monthly. The monthly monitoring is more frequent than frequencies established in the lead standard which are at least every 6 months if above the Action Level, but below the PEL, or every 3 months if above the PEL.

6. All air samples shall be collected and analyzed according to NIOSH Method 7082, or equivalent. All samples shall be analyzed by laboratories accredited by the American Industrial Hygiene Association for metals analysis.

7. All exposed employees shall be notified in writing of the monitoring results within five (5) days after receiving the results.

8. The Action Level for airborne lead exposure is 30 $\mu g/m^3$, as an 8-hour time weighted average (TWA) concentration, without regard to the use of respirators. Whenever workers' airborne lead exposures exceed the Action Level, the Contractor shall implement the following:

   a. Periodic Exposure Monitoring
   b. Employee Information and Training

c. Employee Medical Surveillance and Medical Removal Protection
d. Housekeeping
e. Record keeping
f. Signs and Regulated Areas

9. The Permissible Exposure Limit (PEL) for airborne lead exposure is 50 $\mu g/m^3$, as an 8-hour TWA concentration. When the work area contains airborne lead levels above the PEL the Contractor shall implement the following in addition to those items listed in 3.02.B.8 of this section:

a. Compliance Program
b. Respiratory Protection
c. Protective Clothing and Equipment
d. Hygiene Facilities and Practices

C. Respiratory Protection: After feasible engineering controls and work practices have been implemented, respiratory protection shall be used to maintain employees' lead exposures below the PEL.

1. Respirators shall be worn by all employees, other Contractors, inspectors, or observers who enter regulated areas.

2. The Contractor shall develop a written Respiratory Protection Program in compliance with 29 CFR 1910.134, paragraphs (b), (d), (e), and (f), and the lead standard. The program shall address the selection, use, maintenance, and inspection of respirators, and qualifications for respirator users.

D. Protective Clothing and Equipment: The Contractor shall provide protective clothing and equipment and ensure they are worn by all employees whose lead exposures exceed the PEL, or who enter regulated areas.

1. Protective clothing shall include washable and/or disposable full body coveralls, gloves, foot coverings, and hoods. Other protective equipment shall include face shields, hard hats, eye protection, and hearing protection as appropriate.

2. Disposable protective clothing shall be used for no more than one work day. Such clothing may have to be disposed of as hazardous waste.

3. Reusable protective equipment shall be cleaned or replaced weekly if exposure levels are less than 200 $\mu g/m^3$, or daily if the exposure levels are greater than or equal to 200 $\mu g/m^3$.

4. Clothing shall not be removed or "cleaned" by any means which could reintroduce the lead dust into the ambient air. This includes brushing,

shaking, and blowing. Vacuums equipped with HEPA filters shall be used for this purpose.

5. Reusable coveralls shall be collected at the end of each work day in closed containers. The containers shall be labeled in accordance with the requirements of 29 CFR 1926.62(g)(2)(vii). Contaminated clothing shall be cleaned in accordance with all applicable Federal, State, or local regulations pertaining to lead-contaminated laundry and water discharge. Laundries shall be informed that the clothing contains lead. If the clothing is washed on site, the discharge water shall be filtered, containerized, and arrangements made with the local POTW or other approved means of proper disposal.

6. Protective clothing and equipment shall be removed in the contaminated section of the change area and shall not be worn into any clean areas.

7. The Contractor shall provide the necessary clothing and equipment for use by the Owner and its designated representatives.

E. Housekeeping: Accumulations of lead-containing dust and debris generated by work activities shall be removed and cleaned daily.

1. All persons doing the cleanup shall be trained in performing lead activities, respirator qualified, and participate in the medical surveillance program. Respirators and protective clothing shall be worn by all persons doing the cleanup.

2. Compressed air may be used for housekeeping if used within containment and in conjunction with a ventilation system designed to capture the dust. Otherwise, HEPA-filtered vacuum cleaners shall be employed.

3. All lead-containing dust and debris shall be collected in sealed containers. The waste shall be tested to determine whether it will be disposed of as hazardous waste.

F. Personal Hygiene Facilities and Practices

1. Clean change areas shall be provided when employees' lead exposures exceed the PEL. The change areas shall be equipped with storage facilities for street clothing and a separate area for the removal and storage of lead-contaminated clothing and equipment. They shall be designed and used so that contamination of street clothing does not occur. Employees shall not leave the project site wearing any clothing worn while performing lead activities. Airborne lead exposures in the change area shall be maintained below the Action Level.

2. Shower facilities shall be provided whenever employees' lead exposures exceed the PEL. Shower facilities shall comply with OSHA Sanitation Standard, 29 CFR 1929.51. All employees whose lead exposures exceed the PEL shall shower at the end of each work shift or before leaving the project area. The shower facilities shall be made available for use by the Owner and its representatives, such as inspectors or observers.

3. Arrangements shall be made with the local POTW for the proper disposal of the shower and wash water after filtration (e.g., through a three stage 100, 50, and 5 micron filtering system), ion exchange, or other approved treatment technology.

4. Clean lunch areas shall be provided for all employees whose lead exposures exceed the PEL. Employees shall remove or clean (by vacuuming) their protective clothing and wash their hands and face before entering the lunch area. Lead exposures in the lunch area shall be maintained as free as practicable from lead contamination.

5. An adequate number of clean lavatory and hand washing facilities shall be provided. These shall comply with the OSHA Sanitation Standard, 29 CFR 1929.51.

6. Eating, drinking, smoking, chewing of food or tobacco products, or the application of cosmetics shall not be permitted in any areas where the lead exposures exceed the PEL. Thorough washing of hands and face is required prior to undertaking any of these activities.

G. Medical Surveillance and Medical Removal Protection

1. All employees who are exposed to lead above the Action Level in a single day during this project shall be provided with initial and periodic medical examinations and blood lead tests as required by the lead standard. A final blood lead test shall be provided for each worker upon completion of the project, or at any time a worker's employment at the project ceases.

2. When blood lead levels over 50 µg/dl are encountered, the Contractor shall provide for the temporary removal of employees from lead exposure above the Action Level. The required medical surveillance and periodic blood lead tests shall be provided in strict accordance with the lead standard throughout the removal.

3. Employees who will be required to wear a respirator or who request one shall be provided with a respirator and the necessary medical examinations to determine their ability to wear a respirator.

4. All examinations shall be provided by the Contractor and shall be performed by or under the direct supervision of a licensed physician.

H. Employee Information and Training

1. The Contractor shall provide lead training for all employees who are exposed to lead above the Action Level for this project.

2. The content of lead training shall include, as a minimum, those items listed in the lead standard.

3. Training shall also include hazard communication in accordance with 29 CFR 1926.59.

4. The Contractor shall notify other employers at the project site of the nature of the lead exposure work, the need to remain out of exposure areas, the warning sign and labeling system in effect, and the potential need for them to take measures to protect their employees.

I. Signs and Regulated Areas

1. The Contractor shall establish a regulated area surrounding activities where lead exposures exceed the Action Level. This includes locations where lead-containing debris is handled or transferred to storage containers.

2. The regulated area shall be demarcated by ropes, tape, walls, or containment's with caution signs posted at all accessible sides. Signs shall contain the legend:

WARNING
LEAD WORK AREA
POISON
NO SMOKING OR EATING

3. The Contractor shall control access of persons into regulated areas. Access shall be limited to individuals with proper training and personal protective equipment, and medical surveillance testing.

4. All persons entering regulated areas shall wear protective clothing and respirators.

5. Eating, drinking, smoking, and chewing of food or tobacco products shall be prohibited in regulated areas and in any area where lead exposures exceed the Action Level.

J. Record keeping: All records relating to training, medical examinations, blood lead monitoring, and exposure monitoring shall be maintained by the Contractor as required by the lead standard. All records shall be available for review by the Owner or its representative upon request.

3.03 CERTIFIED INDUSTRIAL HYGIENIST (CIH)

A. The Contractor shall provide for the services of a Certified Industrial Hygienist (CIH) who must be certified by the American Board of Industrial Hygiene in comprehensive practice.

B. Duties of the CIH shall be as follows:

1. Conduct and/or verify training for contractor employees in accordance with 29 CFR 1926.62 (l).

2. Review and approve Contractor's Written Compliance Plan for conformance to 29 CFR 1926.62(e)(2)(ii) and this Specification.

3. Monitor and evaluate work weekly to assure conformance with the approved plan and that hazardous exposure is adequately controlled in accordance with worker safety and health requirements of these specifications

4. Provide monthly reports of work compliance with control requirements in regards to working in a lead environment.

C. Activities of the CIH shall include:

1. Meet with City to discuss details of Contractor's Written Compliance Plan for lead paint removal.

2. Ensure worker and area air monitoring, testing and reporting are conducted by or under the direction of the CIH.

3. Furnish a detailed worker and area air monitoring schedule coordinated with Contractor's proposed production schedule.

4. Directing, monitoring and inspecting lead paint removal work to ensure that the requirements of the Contract have been satisfied during the entire lead paint removal operation.

5. Report results of air monitoring samples to the Engineer, signed by the CIH within 48 hours after the air samples are taken.

6. The CIH shall review sampling data, collected on a day when lead paint

removal operations occur, to determine if conditions require any change in work methods. Removal work shall not continue until approval is given by the CIH.

7. The CIH shall verify in writing and submit monitoring data to verify that:

   a. Air borne lead levels at and beyond the lead control (regulated) area were and remained less than 30 mg/m^3 of air

   b. Contractor conformance to 29 CFR 1926.62 and Item 3.02, above

   c. There were no visible accumulations of lead contaminated paint, dust or debris on the work site. Adjacent areas that may have become contaminated were properly cleaned and inspected.

   d. The CIH shall verify that the work area and contractor's equipment have been adequately cleaned of lead contamination prior to demobilization from the work site.

3.04 DEMOBILIZATION

The Contractor shall not remove the lead control area, boundaries, warning signs, etc. prior to proper removal of all hazardous wastes, debris and materials from the site and the City's receipt and acceptance of the CIH's verification.

END OF SECTION

Section 01410

TPDES REQUIREMENTS

1.01 SECTION INCLUDES

A. Documentation to be prepared and signed by Contractor/Operator before conducting construction operations, in accordance with the Texas Pollutant Discharge Elimination System (TPDES) Construction General Permit Number TXR 150000 issued February 15, 2008 (the Construction General Permit).

B. Implementation, maintenance inspection, and termination of storm water pollution prevention control measures including, but not limited to, erosion and sediment controls, storm water management plans, waste collection and disposal, off-site vehicle tracking, and other appropriate practices shown on the Drawings or specified elsewhere in the Contract.

C. Review of the Storm Water Pollution Prevention Plan (SWP3) implementation in a meeting with Project Manager prior to start of construction.

1.02 DEFINITIONS

A. Commencement of Construction Activities: The exposure of soil resulting from activities such as clearing, grading, and excavation activities, as well as other construction related activities (e.g., stock piling of fill material, demolition).

B. Large Construction Activity: Project that:o

1. disturbs five acres or more, or

2. disturbs less than five acres but is part of a larger common plan of development that will disturb five acres or more of land.

C. Small Construction Activity: Project that:

1. disturbs one or more acres but less than five acres, or

2. disturbs less than one acre but is part of a larger common plan of development that will ultimately disturb one or more acres but less than five acres.

D. TPDES Operator:

Operator - The person or persons associated with a large or small construction activity that is either a primary or secondary as defined below:

Primary Operator – the person or persons associated with a large or small construction activity that meets either of the following two criteria:

(a) the persons have operational control over construction plans and specifications, including the ability to make modifications to those plans and specifications; or

(b) the person or persons have day-to-day operational control of those activities at a construction site that are necessary to ensure compliance with a storm water pollution prevention plan (SWP3) for the site or other permit conditions (e.g., they are authorized to direct workers at a site to carry out activities required by the SWP3 or comply with other permit conditions).

Secondary Operator – The person whose operational control is limited to the employment of other operators or to the ability to approve or disapprove changes to plans and specifications. A secondary operator is also defined as a primary operators if there are no other operators if there are no other operators at the construction site.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N

3.01 SITE SPECIFIC STORM WATER POLLUTION PREVENTION PLAN (SWP3)

A. Prepare a SWP3 following Part III of the Construction General Permit and the Storm Water Management Handbook for Construction Activities issued under City Ordinance Section 47-695(b). If conflicts exist between the Construction General Permit and the handbook, the more stringent requirements will apply.

B. Update or revise the SWP3 as needed during the construction following Part III, Section E of the Construction General Permit.

C. Submit the SWP3 and any updates or revisions to Project Manager for review and address comments prior to commencing, or continuing, construction activities.

3.02 NOTICE OF INTENT For Large Construction Activity

A. Fill out, sign, and date TCEQ Form 20022 (03/05/2008) Notice of Intent (NOI) for Storm Water Discharges Associated with Construction Activity under the TPDES Construction General Permit (TXR 150000), **ATTACHMENT 1** of this Section 01410.

B. Transmit the signed Contractor's copy of TCEQ Form 20022 (03/05/2008), along with a $325.00 check, made out to Texas Commission on Environmental Quality, and the completed Payment Submittal Form to Project Manager.

C. Project Manager will complete a separate TCEQ Form 20022 (03/05/2008) for City's Notice of Intent, and will submit both Notices, along with checks for application fees, to the TCEQ.

D. Submission of the Notice of Intent form by both the City and Contractor to TCEQ if mailing is required a minimum of seven days before Commencement of Construction Activities.

3.03 CONSTRUCTION SITE NOTICE FOR SMALL CONSTRUCTION ACTIVITY

A. Fill out, sign, and date the Construction Site Notice, Attachment 2 to TPDES General Permit TXR 150000, "Construction Site Notice", **ATTACHMENT 2** of this Section 01410.

B. Transmit the signed Construction Site Notice to Project Manager at least seven days prior to Commencement of Construction Activity.

3.04 CERTIFICATION REQUIREMENTS

A. Fill out TPDES Operator's Information form, **ATTACHMENT 3** of this Section 01410, including Contractor's name, address, and telephone number, and the names of persons or firms responsible for maintenance and inspection of erosion and sediment control measures. Use multiple copies as required to document full information.

B. Contractor and Subcontractors shall sign and date the Contractor's / Subcontractor's Certification for TPDES Permitting, **ATTACHMENT 4** of this Section 01410. Include this certification with other Project certification forms.

C. Submit properly completed certification forms to Project Manager for review before beginning construction operations.

D. Conduct inspections in accordance with TCEQ requirements. Ensure persons or firms responsible for maintenance and inspection of erosion and sediment control measures read, fill out, sign, and date the Erosion Control Contractor's Certification for Inspection and Maintenance. Use the City of Houston Storm Water Pollution Prevention Plan, Construction Site Inspection Report, **ATTACHMENT 5** of this Section 01410 to record maintenance inspections and repairs.

3.05 RETENTION OF RECORDS

A. Keep a copy of this document and the SWP3 in a readily accessible location at the construction site from Commencement of Construction Activity until submission of the Notice of Termination (NOT) for Storm Water Discharges Associated with Construction Activity under TPDES Construction General Permit (TXR 150000). Contractors with day-to-day operational control over SWP3 implementation shall have a copy of the SWP3 available at a central location, on-site, for the use of all operators and those identified as having responsibilities under the SWP3. Upon submission of the NOT, submit all required forms and a copy of the SWP3 with all revisions to Project Manager.

3.06 REQUIRED NOTICES

A. Post the following notices from effective date of the SWP3 until date of final site stabilization as defined in the Construction General Permit:

1. Post the TPDES permit number for Large Construction Activity, with a signed TCEQ Construction Site Notice for large or Small Construction Activity. Signed copies of the City's and Contractor's NOI must also be posted.

2. Post notices near the main entrance of the construction site in a prominent place where it is safely and readily available for viewing by General Public, Local, State, and Federal Authorities. Post name and telephone number of Contractor's local contact person, brief project description and location of the SWP3.

   a. If posting near a main entrance is not feasible due to safety concerns, coordinate posting of notice with Project Manager to conform to requirements of the Construction General Permit.

   b. If Project is a linear construction project (e.g.: road, utilities, etc.), post notice in a publicly accessible location near active construction. Move notice as necessary.

3. Post a notice to equipment and vehicles operators, instructing them to stop, check, and clean tires of debris and mud before driving onto traffic lanes. Post at each stabilized construction access area.

4. Post a notice of waste disposal procedures in a readily visible location on site.

3.07 ON-SITE WASTE MATERIAL STORAGE

A. On-site waste material storage shall be self-contained and shall satisfy appropriate local, state, and federal rules and regulations.

B. Prepare list of waste material to be stored on-site. Update list as necessary to include up-to-date information. Keep a copy of updated list with the SWP3.

C. Prepare description of controls to reduce pollutants generated from on-site storage. Include storage practices necessary to minimize exposure of materials to storm water, and spill prevention and response measures consistent with best management practices. Keep a copy of the description with the SWP3.

3.08 NOTICE OF TERMINATION

A. Submit a NOT, **ATTACHMENT 7** of this Section 01410, to Project Manager within 30 days after:

1. Final stabilization has been achieved on all portions of the site that are the responsibility of the Contractor; or

2. Another operator has assumed control over all areas of the site that have not been stabilized; and

3. All silt fences and other temporary erosion controls have either been removed, scheduled to be removed as defined in the SWP3, or transferred to a new operator if the new operator has sought permit coverage.

B. Project Manager will complete City's NOT and submit Contractor and City's notices to the TCEQ and MS4 entities.

END OF SECTION

PAGE LEFT INTENTIONALLY BLANK

ATTACHMENT 1

TCEQ

Notice of Intent (NOI) for Storm Water Discharges Associated with Construction Activity under the TPDES Construction General Permit (TXR150000)

For help completing this application, read the TXR150000 NOI Instructions (TCEQ-20022 Instructions).

TCEQ Office Use Only
TPDES Permit Number: TXR15 __|__|__|__| - NO
GIN Number: |__|__|__|__|__|__|

A. Construction Site Operator ☐ New ☐ No Change Customer Reference Number: CN _____
Name: _____
Mailing Address: _____ City: _____ State: ____ Zip Code: _____
Country Mailing Information (*if outside USA*) Territory _____ Country Code: _____ Postal Code: _____
Phone Number: _____ Extension: _____ Fax Number: _____
E-mail Address: _____
Type of Operator: ☐ Individual ☐ Sole Proprietorship - D.B.A. ☐ Partnership ☐ Corporation ☐ Federal Government
☐ State Government ☐ County Government ☐ City Government ☐ Other: _____
Independent Operator? ☐ Yes ☐ No Number of Employees: ☐ 0-20 ☐ 21-100 ☐ 101-250 ☐ 251-500 ☐ 501 or higher
Federal Tax ID: _____ State Franchise Tax ID Number: _____ DUNS Number: _____

B. Billing Address
Name: _____
Mailing Address: _____ City: _____ State: ____ Zip Code: _____
Country Mailing Information (*if outside USA*) Territory: _____ Country Code: _____ Postal Code: _____

C. Project / Site Information ☐ New ☐ No Change Regulated Entity Reference Number: RN _____
Name: _____
Mailing Address: _____ City: _____ State: ____ Zip Code: _____
Physical Address: _____ City: _____ County: _____ Zip Code: _____
Location Access Description: _____
Latitude: ___ ° ___ ' ___ " N Longitude: ___ ° ___ ' ___ " W Degrees (°), Minutes ('), and Seconds (")
Latitude: _____ Longitude: - _____ Decimal Form
Standard Industrial Classification (SIC) code: _____ Also, describe the construction activity at this site *(do not repeat the SIC code)*:
_____
Has a storm water pollution prevention plan been prepared as specified in the general permit (TXR150000)? ☐ Yes ☐ No
Estimated area of land disturbed (to the nearest acre): _____ Is the project / site located on Indian Country Lands? ☐ Yes ☐ No
Does this project / site discharge storm water into a municipal separate storm sewer system (MS4)? ☐ Yes ☐ No
If yes, provide the name of the MS4 operator: _____
Provide the name or segment number of the water body that receives storm water from this project / site: _____

D. Contact - If the TCEQ needs additional information regarding this application, who should be contacted?
Name: _____ Title: _____
Phone Number: _____ Extension: _____ Fax Number: _____
E-mail Address: _____

E. Payment Information - Check / Money Order Number: _____ Name on Check / Money Order: _____

F. Certification
I certify under penalty of law that this document was prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.
Construction Site Operator:
Prefix: _____ First: _____ Middle: _____
Last: _____ Suffix _____ Title: _____
Signature: _____ Date: _____

If you have questions on how to fill out this form or about the storm water program, please contact us at (512) 239-4671.
Individuals are entitled to request and review their personal information that the agency gathers on its forms. They may also have any errors in their information corrected. To review such information, contact us at (512) 239-3282.

The completed NOI must be mailed to the following address. Use the attached document to submit the $100 application fee. Please note that the NOI and application fee are submitted separately to different addresses.

Texas Commission on Environmental Quality
Storm Water & General Permits Team; MC - 228
P.O. Box 13087
Austin, Texas 78711-3087

TCEQ-20022 (05/03) **Page 1 of 2**

ATTACHMENT 1

Texas Commission on Environmental Quality
Payment Submittal Form

The storm water application fee shall be sent under separate cover to the Texas Commission on Environmental Quality.

This form must be used to submit your Storm Water Application Fee. Please complete the following information, staple your check in the space provided at the bottom of this document, and mail it to:

BY REGULAR U.S. MAIL

Texas Commission on Environmental Quality
Financial Administration Division
Cashier's Office, MC-214
P.O. Box 13088
Austin, TX 78711-3088

BY OVERNIGHT/EXPRESS MAIL

Texas Commission on Environmental Quality
Financial Administration Division
Cashier's Office, MC-214
12100 Park 35 Circle
Austin, TX 78753

Fee Code: GPA

Storm Water General Permit: TXR150000

Check / Money Order No: _____

Amount of Check/Money Order: _____

Date of Check or Money Order: _____

Name on Check or Money Order: _____

Facility / Site Name: _____

Facility / Site Physical Address: _____

City: _____

Zip Code: _____

Staple Check In This Space

ATTACHMENT 1

Completing the Notice of Intent for Storm Water Discharges Associated with Construction Activity under the TPDES Construction General Permit (TXR150000)

A. Construction Site Operator Information

Check boxes and Customer Reference Number
These boxes designate the operator's status as a TCEQ "customer"—in other words, an individual or business that is involved in an activity that we regulate. We assign each customer a number that begins with "CN" followed by nine digits. ***This is not a permit number, registration number, or license number.*** In the remainder of this section, we will use "this customer" to mean the operator for Part A of the form.

- If this customer has not been assigned a Customer Reference Number or if this number is unknown, check "New" and leave the space for the Customer Reference Number blank.
- If this customer has already been assigned this number, enter the operator's Customer Reference Number and:
  - Check "No Change" if all the remaining customer information is the same as previously reported. However, you must still complete most blanks in this form for this notice of intent to be valid.
  - If this customer's information has changed since the last time it was reported to the TCEQ, check neither box and complete the remainder of this notice of intent.
- ***Do not enter a permit number, registration number, or license number in place of the Customer Reference Number.***

Name
Enter the legal name of this customer as authorized to do business in Texas. Include any abbreviations (LLC, Inc., etc.).

Mailing Address
Enter a central and general mailing address for this customer to receive mail from the TCEQ. For example, if this customer is a large company, this address might be the corporate or regional headquarters. On the other hand, for a smaller business, this address could be the same as the site address.

If this is a street address, please follow US Postal Service standards. In brief, these standards require this information in this order:

- the "house" number—for example, the 1401 in 1401 Main St.
- if there is a direction before the street name, the one- or two-letter abbreviation of that direction (N, S, E, W, NE, SE, SW, or NW)
- the street name (if a numbered street, do not spell out the number—for example, 6th St, not Sixth St)
- an appropriate abbreviation of the type of street—for example, St, Ave, Blvd, Fwy, Exwy, Hwy, Cr, Ct, Ln
- if there is a direction after the street name, the one- or two-letter abbreviation of that direction (N, S, E, W, NE, SE, SW, or NW)
- if there is a room number, suite number, or company mail code

City, State, *and* ZIP Code
Enter the name of the city, the two-letter USPS abbreviation for the state (for example, TX), and the ZIP Code. (Enter the full ZIP+4 if you know it.)

Country Mailing Information
If this address is ***outside*** the United States, enter the territory name, country code, and any non-ZIP mailing codes or other non-U.S. Postal Service features here. If this address is ***inside*** the United States, leave these spaces blank.

Phone Number *and* Extension
This number should correspond to this customer's mailing address given earlier. Enter the area code and phone number here. Leave "Extension" blank if this customer's phone system lacks this feature.

Fax Number
This number should correspond to this customer's mailing address given earlier. Enter the area code and fax number here.

E-mail Address
As with the mailing address, this should be a general address that is appropriate for e-mail to this customer's central or regional headquarters, if applicable.

If "No Change" was checked for this customer, you may skip the rest of the fields in this part of the form and continue to the next part of the NOI.

Type of Operator
Check ***only one*** box.

Check ...	*if this customer ...*
Individual	is a person and has not established a business to do whatever causes them to be regulated by us.
Sole Proprietorship—D.B.A.	is a business that is owned by only one person and has not been incorporated. This business may: • be under the person's name • have its own name ("doing business as" or d.b.a.) • have any number of employees
Partnership	is a business that is established as a partnership as defined by the Texas Secretary of State's Office.
Corporation	meets all of these conditions: • is a legally incorporated entity under the laws of any state or country • is recognized as a corporation by the Texas Secretary of State • has proper operating authority to operate in Texas
Federal, state, county, or city government (as appropriate)	is either an agency of one of these levels of government or the governmental body itself (if a utility district, water district, tribal government, college district, council of governments, or river authority, check "Other" and write in the specific type of government.)
Other	fits none of the above descriptions. Enter a short description of the type of customer in the blank provided.

Independent Operator?
Check "No" if this customer is a subsidiary or part of a larger company. Otherwise, check "Yes."

Number of Employees
Check one box to show the number of employees for this customer's entire company, at all locations. ***This is not necessarily the number of employees at the site named in this NOI.***

Federal Tax ID
All businesses, except for some small sole proprietors, should have a federal taxpayer identification number (TIN). Enter this number here. Use no prefixes, dashes, or hyphens. Individuals and sole proprietors do not need to provide a federal tax ID.

State Franchise Tax ID
Corporations and limited liability companies that operate in Texas are issued a franchise tax identification number. If this customer is a corporation or limited liability company, enter this number here.

DUNS Number
Most businesses have a DUNS (Data Universal Numbering System) number issued by Dun and Bradstreet Corp. If this customer has one, enter it here.

B. Billing Address

We will mail the annual fee invoice for this site to the address entered in this section.

Name
Enter the legal name of the person or business to which we should mail this site's fee invoice each year.

Mailing Address
Enter the specific mailing address to which we should mail this site's fee invoice each year. If this is a street address, please follow the US Postal Service standards as described under "A. Construction Site Operator Information" on page 1 of these instructions.

City, State, *and* ZIP Code
Enter the name of the city, the two-letter USPS abbreviation for the state (for example, TX), and the ZIP Code. (Enter the full ZIP+4 if you know it.)

Country Mailing Information
If this address is ***outside*** the United States, enter the territory name, country code, and any non-ZIP mailing codes or other non-U.S. Postal

ATTACHMENT 1

Service features here. If this address is *inside* the United States, leave these spaces blank.

C. Project / Site Information

Check boxes *and* Regulated Entity Reference Number
These boxes designate this site's status as a TCEQ "regulated entity"—in other words, a location where an activity that we regulate occurs. We assign each regulated entity a number that begins with "RN," followed by nine digits. ***This is not a permit number, registration number, or license number.***

- If this site has not been assigned a Regulated Entity Reference Number or if this number is unknown, check "New" and leave the space for the Regulated Entity Reference Number blank.
- If this site has already been assigned this number, enter the Regulated Entity Reference Number and:
  - Check "No Change" if all the remaining information is the same as previously reported. However, even if there has been no change, you must complete this section at least through "E-mail Address" for this NOI to be valid.
  - If this site's information has changed since the last time it was reported to the TCEQ, check neither box and complete the remainder of this notice of intent.
- ***Do not enter a permit number, registration number, or license number in place of the Regulated Entity Reference Number.***

Name
Enter the name by which you want this site to be known to the TCEQ.

Mailing Address
Enter the specific mailing address for this site. If this is a street address, please follow the US Postal Service standards as described under "A. Construction Site Operator Information" on page 1 of these instructions. If the project / site's mailing address is the same as what is provided in Section A, you may enter "Same as Section A".

City, State, *and* ZIP Code
Enter the name of the city, the two-letter USPS abbreviation for the state (for example, TX), and the ZIP Code. (Enter the full ZIP+4 if you know it.)

Physical Address
Enter the physical address of the site itself. TCEQ staff should be able to use this address to find the site. Please follow the US Postal Service standards as described under "A. Construction Site Operator Information" on page 1 of these instructions. If the project / site does not have a physical address, enter "No Address".

City, County, *and* ZIP Code
Enter the name of the city, the county, and the ZIP Code. (Enter the full ZIP+4 if you know it.) This information must be provided even if you have entered "No Address" in the previous field.

Location Access Description
Enter a physical description of the location of the site based on highway intersections and/or permanent landmarks.

Latitude *and* Longitude
Enter the latitude and longitude of the site in *either* degrees, minutes, and seconds *or* decimal form.

For help obtaining the latitude and longitude, go to:
http://www.tnrcc.state.tx.us/gis/drgview.html

Standard Industrial Classification (SIC) Code and Activity Description

Provide the SIC code that best describes the construction activity being conducted at the site.

For help with SIC codes, go to:
http://www.osha.gov/oshstats/sicser.html

In addition to the SIC code, you must also provide a description of the construction activity being conducted at the site. This may include such descriptions as: "Apartment Building Construction" or "Shopping Center Construction."

Storm Water Pollution Prevention Plan
This plan identifies the areas and activities that could produce contaminated runoff at your site and then tells how you will ensure that this contamination is mitigated. For example, in describing your mitigation measures, your site's plan might identify the devices that collect and filter storm water, tell how those devices are to be maintained, and tell how frequently that maintenance is to be carried out. ***You must develop this plan before you complete this NOI.*** This plan must be available for a TCEQ investigator to review on request. Specific requirements for the development of the plan can be found in the *Texas Pollutant Discharge Elimination System Construction General Permit (TXR150000)*.

Estimated Area of Land Disturbed
Provide the approximate number of acres that the construction site will disturb. It is appropriate to enter a value less than 5 only if the project is part of a larger common plan that disturbs five or more acres. If the acreage is less than 1, enter 1. "Disturb" means any clearing, grading, excavating, or other similar activities.

Is the site located on Indian Country Lands?
Check "Yes" only if the site is on a reservation or other areas designated by the federal government as Indian Country Lands. If not, check "No."

Destination of Storm Water Discharge
The storm water from your site eventually reaches a receiving water body such as a local stream or lake, possibly via a drainage ditch. The discharge may initially be into a municipal separate storm sewer system (MS4). Check the appropriate boxes for whether storm water is discharged into an MS4. If you checked "Yes" to "An MS4?", then enter the name of the entity that operates the storm sewer—often a city, town, or utility district, but possibly another form of government.

You must also provide the name of the water body that receives the discharge from the construction site (a local stream or lake). Storm water may be discharged directly to a receiving stream or via a storm sewer system. If known, please include the segment number if the discharge is to a classified water body.

For a map that includes segment numbers, go to:
http://www.tnrcc.state.tx.us/water/quality/data/index.html

D. Contact

Give all the relevant information for the person whom TCEQ can contact if there are questions about any of the information on this form—perhaps the same person who completed the form.

E. Payment Information

Provide the number and account holder name from the check or money order used to pay the $100 application fee.

F. Certification

The operator must sign and date this statement to validate this NOI. Be sure to enter the full legal name of the person signing the form and the relevant title—for example, "Operator," "Vice-President," or "Partner." Use the "Prefix" blank for such titles as Dr., Mr., or Ms., as desired. Use the "Suffix" blank for such designations as Ph.D., Jr., Sr., III, or J.D., if applicable.

For a corporation, the application shall be signed by a responsible corporate officer. A responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation, or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding $25 million (in second-quarter 1980 dollars). If authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this application, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the United States Environmental Protection Agency).

Questions?

If you have questions about any of the information on this form, contact our Storm Water Program at 512/239-4671 or look for "Storm Water" on our Web site.

www.tceq.state.tx.us

ATTACHMENT 2

CONSTRUCTION SITE NOTICE

FOR THE
Texas Commission on Environmental Quality (TCEQ)
Storm Water Program

TPDES GENERAL PERMIT TXR150000

The following information is posted in compliance with **Part II.D.2.** of the TCEQ General Permit Number TXR150000 for discharges of storm water runoff from construction sites. Additional information regarding the TCEQ storm water permit program may be found on the internet at:
www.tnrcc.state.tx.us/permitting/waterperm/wwperm/tpdestorm

Contact Name and Phone Number:	
Project Description: (Physical address or description of the site's location, estimated start date and projected end date, or date that disturbed soils will be stabilized)	
Location of Storm Water Pollution Prevention Plan :	

For Construction Sites Authorized Under Part II.D.2. (Obtaining Authorization to Discharge) the following certification must be completed:

I _____ (Typed or Printed Name Person Completing This Certification) certify under penalty of law that I have read and understand the eligibility requirements for claiming an authorization under Part II.D.2. of TPDES General Permit TXR150000 and agree to comply with the terms of this permit. A storm water pollution prevention plan has been developed and implemented according to permit requirements. A copy of this signed notice is supplied to the operator of the MS4 if discharges enter an MS4 system. I am aware there are significant penalties for providing false information or for conducting unauthorized discharges, including the possibility of fine and imprisonment for knowing violations.

_____ _____
Signature and Title Date

PAGE LEFT INTENTIONALLY BLANK

ATTACHMENT 3

TPDES OPERATOR'S INFORMATION

Owner's Name and Address: City of Houston

Mr. _____
(City Official)

_____
(Department)
P. O. Box 1562
Houston, Texas 77251-1562
(713) 247-1000

Contractors' Names and Addresses:

General Contractor: _____
_____
_____
_____
Telephone: _____

Site Superintendent: _____
_____
_____
_____
Telephone: _____

Erosion Control and
Maintenance Inspection: _____
_____
_____
_____
Telephone: _____

Subcontractors' Names and Addresses:

_____ _____
_____ _____
_____ _____
_____ _____
Phone: _____ Phone: _____

Note: Insert name, address, and telephone number of person or firms

PAGE LEFT INTENTIONALLY BLANK

ATTACHMENT 4

CONTRACTOR'S / SUBCONTRACTOR'S

CERTIFICATION FOR TPDES PERMITTING

I certify under penalty of law that I understand the terms and conditions of TPDES General Permit No. TXR150000 and the Storm Water Pollution Prevention Plan for the construction site identified as part of this certification.

Signature: _____

Name: (printed or typed) _____

Title: _____

Company: _____

Address: _____

Date: _____

Signature: _____

Name: (printed or typed) _____

Title: _____

Company: _____

Address: _____

Date: _____

Signature: _____

Name: (printed or typed) _____

Title: _____

Company: _____

Address: _____

Date: _____

PAGE LEFT INTENTIONALLY BLANK

ATTACHMENT 5

EPA NPDES Construction Inspection Form

The following inspection is being performed in compliance with Part IV.D.4. of the NPDES Region 6 Storm Water Construction General Permit [63 Fed. Reg. 36502] and being retained in accordance with Part V of the Permit. Qualified personnel (provided by the permittee or cooperatively by multiple permittees) shall inspect disturbed areas of the construction site that have not been finally stabilized, areas used for storage of materials that are exposed to precipitation, placement and effectiveness of structural control measures, and locations where vehicles enter or exit the site. Inspections shall be performed at least once every 14 days and within 24 hours of the end of a storm event of 0.5 inches or greater. Where sites have been temporarily stabilized, runoff is unlikely due to winter conditions, or during seasonal arid periods in arid areas (0-10 inches of rainfall annually) and semi-arid areas (10-20 inches annually) such inspections shall be conducted at least once every month. This form is primarily intended for use with construction projects in Texas and New Mexico. Permittees on Indian Country lands in Oklahoma, Louisiana and Arkansas and some oil and gas facilities in Oklahoma may use this form if they are eligible for this permit. Other facilities need to check with their NPDES authority before using this form.

If you do not know your NPDES Permit Number, contact the NOI Processing Center at (301)495-4145. This form was prepared as an example and it is not a required form for use with the permit. Alternative forms may be used if they contain all of the required information as set forth in the permit. This form and additional information regarding the NPDES Region 6 storm water program may be found on the Internet at http://www.epa.gov/region6/sw/. Any person with a complaint about the operation of this facility in regards to this permit should contact EPA Region 6 at (214)665-7112.

Permit Number(s) covered by this inspection (e.g. owners, developers, general contractor, builders)	
Signature and Certification in accordance with Part VI.G of the permit:	I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations. Signature_____Date_____
Date of Inspection	
Inspector Name	
Is there a copy of the permit language with the SWPPP?	❒ YES ❒ NO
Is the inspector qualified and are the qualifications documented in the SWPPP?	❒ YES ❒ NO
Is an NPDES storm water construction sign posted at the entrance for all permittees?	❒ YES ❒ NO

You may want to use EPA Region 6 construction checklist to assure components of the SWPPP are complete. This form, the construction sign, and the checklist are available on the Region 6 NPDES Storm Water Forms and Documents web page which may be found on the internet at http://www.epa.gov/earth1r6/6en/w/formsw.htm. In addition to the checklist, you should provide a narrative (see next page) on the existing Best Management Practices and Structural Controls found during each inspection. Any problems identified in an inspection should be corrected within 7 days. The inspection should cover all components of the SWPPP and all potential pollutants. While eroded soil is the primary pollutant of concern, do not forget to inspect for other pollutant sources such as fuel tanks, paints, solvents, stabilization materials, concrete hardner, batch plants, and construction debris. The inspector will need to update the SWPPP to reflect findings of the inspection. The site map should be updated after an inspection to show controls that have been added or removed, to ensure the site map is kept current in accordance with Part IV.C of the permit.

Revision 4, March 1, 2000

ATTACHMENT 5

Narrative Findings of the inspection:

Observations should include any findings of Best Management Practices or controls that are not in accordance with the SWPPP. If a control is not in place or failed, observe the reason why. A control removed temporarily for work is not necessarily a violation if properly recorded in the SWPPP. If it has been removed, record why it was removed and, if applicable, when it will be reinstalled. If the control has failed, observe the conditions so a conclusion may be made as to wether the control failed for improper maintenance or improper design. The qualified inspector will know when a failed control is inadequate and should be replaced by an improved control mechanism. Qualified inspectors are to have authority to make changes to the SWPPP to assure compliance. Controls that have not been installed should be given a reason why they are not installed and/or a scheduled date for installation if they are designed for a later phase of construction. After the inspection, the SWPPP and its site map should be updated to reflect current conditions of controls and Best Management Practices at the time of the inspection. This includes removing uninstalled controls from the site map or otherwise denoting on the site map if they are no longer installed if the controls have been removed because they are no longer necessary (e.g. stabilization has been achieved in that area).

ATTACHMENT 6

City of Houston

Storm Water Pollution Prevention Plan
Construction Site Inspection Report

TPDES/EPA Permit Number _____

COH Storm Water Quality Permit Number _____

DATE _____

No exceptions noted.

The following must be corrected prior to continuing work:

Public Notice improperly posted

Initial Construction Site Inspection Report information requires updating

Copy of NOI not on site

Storm water pollution prevention plan not on site

Erosion and sediment controls improperly installed

Erosion and sediment control devices improperly maintained

Fueling or washout areas not properly protected

Portocan or other sanitary facilities not properly protected

Self-inspection and maintenance records incomplete

Sediment from site outside area of construction

Other (see description below)

_____

_____

Please contact the Storm Water Quality Engineer at
611 Walker, RA-257, Houston TX 77002
713-837-7383 fax 713-837-0570

Once the above items have been corrected, call to arrange for reinspection. No further inspections for any construction related activity shall be made until the above items have been corrected.

_____	_____
Inspector's Signature	Contractor's Signature
_____	_____
Inspector's Name	Contractor's Name

not present

Distribution Stormwater Quality Engineer, Code Enforcement, Inspector, Operator
(Operator is Contractor)

Form _____ (10-01-01)

PAGE LEFT INTENTIONALLY BLANK

ATTACHMENT 7

Notice of Termination (NOT) for Storm Water Discharges Associated with Construction Activity under the TPDES Construction General Permit (TXR150000)

TCEQ Office Use Only
TPDES Permit Number: TXR15 __|__|__|__| - NO
GIN Number: __|__ __|__ __|__|__|

For help completing this application, read the TXR150000 NOI Instructions (TCEQ-20023-Instructions).

A. TPDES Permit Number: TXR15_____

B. Construction Site Operator Customer Reference Number CN _____
Name: _____
Mailing Address: _____
City: _____ State: -- _____ Zip Code: _____
Country Mailing Information (*if outside USA*) Territory: _____ Country Code: _____ Postal Code: _____
Phone Number: _____ Extension: _____ Fax Number: _____
E-mail Address: _____

C. Project / Site Information Regulated Entity Reference Number RN _____
Name: _____
Physical Address: _____
Location Access Description: _____
City: _____ County: -- _____ Zip Code: _____

D. Contact - If the TCEQ needs additional information regarding this termination, who should be contacted?
Name: _____ Title: _____
Phone Number: _____ Extension: _____ Fax Number: _____
E-mail Address: _____

E. Certification
I certify under penalty of law that authorization under the TPDES Construction General Permit (TXR150000) is no longer necessary based on the provisions of the general permit. I understand that by submitting this Notice of Termination, I am no longer authorized to discharge storm water associated with construction activity under the general permit TXR150000, and that discharging pollutants in storm water associated with construction activity to waters of the U.S. is unlawful under the Clean Water Act where the discharge is not authorized by a TPDES permit. I also understand that the submittal of this Notice of Termination does not release an operator from liability for any violations of this permit or the Clean Water Act.

Construction Site Operator Representative:

Prefix: _____ First: _____ Middle: _____
Last: _____ Suffix: _____
Title: _____

Signature: _____ Date: _____

If you have questions on how to fill out this form or about the storm water program, please contact us at (512) 239-4671. Individuals are entitled to request and review their personal information that the agency gathers on its forms. They may also have any errors in their information corrected. To review such information, contact us at (512) 239-3282.

The completed NOT must be mailed to the following address:

Texas Commission on Environmental Quality
Storm Water & General Permits Team; MC - 228
P.O. Box 13087
Austin, Texas 78711-3087

PAGE LEFT INTENTIONALLY BLANK

ATTACHMENT 7

Completing the Notice of Termination for Storm Water Discharges Associated with Construction Activity under the TPDES Construction General Permit (TXR150000)

Who May File a Notice of Termination (NOT) Form
Permittees disturbing 5 acres or more (or part of a larger common plan of development or sale disturbing 5 acres or more) who are presently covered under the Texas Pollutant Discharge Elimination System (TPDES) Construction General Permit must submit a Notice of Termination (NOT) when final stabilization has been achieved on all portions of the site that is the responsibility of the permittee; or another permitted operator has assumed control over all areas of the site that have not been finally stabilized and all silt fences and other temporary erosion controls have either been removed, scheduled for removal as defined in the SWP3, or transferred to a new operator if the new operator has sought permit coverage. Erosion controls that are designed to remain in place for an indefinite period, such as mulches and fiber mats, are not required to be removed or scheduled for removal.

Final Stabilization occurs when either of the following conditions are met:

(a) All soil disturbing activities at the site have been completed and a uniform (e.g, evenly distributed, without large bare areas) perennial vegetative cover with a density of 70% of the native background vegetative cover for the area has been established on all unpaved areas and areas not covered by permanent structures, or equivalent permanent stabilization measures (such as the use of riprap, gabions, or goetextiles) have been employed.

(b) For individual lots in a residential construction site by either:

(1) the homebuilder completing final stabilization as specified in condition (a) above; or

(2) the homebuilder establishing temporary stabilization for an individual lot prior to the time of transfer of the ownership of the home to the buyer and after informing the homeowner of the need for, and benefits of, final stabilization.

(c) For construction activities on land used for agricultural purposes (e.g. pipelines across crop or range land), final stabilization may be accomplished by returning the disturbed land to its preconstruction agricultural use. Areas disturbed that were not previously used for agricultural activities, such as buffer strips immediately adjacent to a surface water and areas which are not being returned to their preconstruction agricultural use must meet the final stabilization conditions of condition (a) above.

A. TPDES Permit Number
Provide the TPDES permit number assigned to the operator of the construction site.

B. Construction Site Operator Information
Customer Reference Number
This number designates the operator's status as a TCEQ "customer"—in other words, an individual or business that is involved in an activity that we regulate. We assign each customer a number that begins with "CN," followed by nine digits. ***This is not a permit number, registration number, or license number.*** In the remainder of this section, we will use "this customer" to mean the operator for Part B of the form.

- If this customer has not been assigned a Customer Reference Number, leave the space for the Customer Reference Number blank.
- If this customer has already been assigned this number, enter the operator's Customer Reference Number.
- ***Do not enter a permit number, registration number, or license number in place of the Customer Reference Number.***

Name
Enter the legal name of this customer as authorized to do business in Texas. Include any abbreviations (LLC, Inc., etc.).

Mailing Address
Enter a central and general mailing address for this customer to receive mail from the TCEQ. For example, if this customer is a large company, this address might be the corporate or regional headquarters. On the other hand, for a smaller business, this address could be the same as the site address.

If this is a street address, please follow US Postal Service standards. In brief, these standards require this information in this order:

- the "house" number—for example, the 1401 in 1401 Main St
- if there is a direction before the street name, the one- or two-letter abbreviation of that direction (N, S, E, W, NE, SE, SW, or NW)
- the street name (if a numbered street, do not spell out the number—for example, 6th St, not Sixth St)
- an appropriate abbreviation of the type of street—for example, St, Ave, Blvd, Fwy, Exwy, Hwy, Cr, Ct, Ln
- if there is a direction after the street name, the one- or two-letter abbreviation of that direction (N, S, E, W, NE, SE, SW, or NW)
- if there is a room number, suite number, or company mail code

City, State, *and* ZIP Code
Enter the name of the city, the two-letter USPS abbreviation for the state (for example, TX), and the ZIP Code. (Enter the full ZIP+4 if you know it.)

ATTACHMENT 7

Country Mailing Information
If this address is ***outside*** the United States, enter the territory name, country code, and any non-ZIP mailing codes or other non–U.S. Postal Service features here. If this address is ***inside*** the United States, leave these spaces blank.

Phone Number *and* Extension
This number should correspond to this customer's mailing address given earlier. Enter the area code and phone number here. Leave "Extension" blank if this customer's phone system lacks this feature.

Fax Number
This number should correspond to this customer's mailing address given earlier. Enter the area code and fax number here.

E-mail Address
As with the mailing address, this should be a general address that is appropriate for e-mail to this customer's central or regional headquarters, if applicable.

C. Project / Site Information

Regulated Entity Reference Number
This number designates this site's status as a TCEQ "regulated entity"—in other words, a location where an activity that we regulate occurs. We assign each regulated entity a number that begins with "RN," followed by nine digits. ***This is not a permit number, registration number, or license number.***

- If this site has not been assigned a Regulated Entity Reference Number, leave the space for the Regulated Entity Reference Number blank.
- If this site has already been assigned this number, enter the Regulated Entity Reference Number.
- ***Do not enter a permit number, registration number, or license number in place of the Regulated Entity Reference Number.***

Name
Enter the name by which you want this site to be known to the TCEQ.

Physical Address
Enter the physical address of the site itself. TCEQ staff should be able to use this address to find the site.

Location Description
Enter a physical description of the location of the site based on highway intersections and/or permanent landmarks.

City, County, *and* ZIP Code
Enter the name of the city, the county, and the ZIP Code. (Enter the full ZIP+4 if you know it.)

D. Contact

Give all the relevant information for the person whom TCEQ can contact if there are questions about any of the information on this form—perhaps the same person who completed the form.

E. Certification

The operator must sign and date this statement to validate this NOI. Be sure to enter the full legal name of the person signing the form and the relevant title—for example, "Operator," "Operator's attorney," or "Senior Site Manager." Use the "Prefix" blank for such titles as Dr., Mr., or Ms., as desired. Use the "Suffix" blank for such designations as Ph.D., Jr., Sr., III, or J.D., if applicable.

For a corporation, the application shall be signed by a responsible corporate officer. A responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding $25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this application, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g. regional administrator of the United States Environmental Protection Agency).

Questions?

If you have questions about any of the information on this form, contact our Storm Water Program at 512/239-4671 or look for "Storm Water" on our Web site:
www.tceq.state.tx.us

Section 01422

REFERENCE STANDARDS

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Section includes general quality assurance as related to Reference Standards and a list of references.

1.02 QUALITY ASSURANCE

A. For Products or workmanship specified by association, trade, or Federal Standards, comply with requirements of the standard, except when more rigid requirements are specified or are required by applicable codes.

B. Conform to reference standard by date of issue current on the date as stated in the General Conditions.

C. Request clarification from Project Manager before proceeding should specified reference standards conflict with Contract documents.

1.03 SCHEDULE OF REFERENCES

AASHTO	American Association of State Highway and Transportation Officials 444 North Capitol Street, N.W. Washington, DC 20001
ACI	American Concrete Institute P.O. Box 9094 Farmington Hills, MI 48333-9094
AGC	Associated General Contractors of America 333 John Carlyle Street Alexandria, VA 22314
AI	Asphalt Institute Research Park Drive P.O. Box 14052 Lexington, KY 40512

AITC	American Institute of Timber Construction 7012 S. Revere Parkway, Suite 140 Englewood, CO 80112
AISC	American Institute of Steel Construction One East Wacker Dr. Chicago, IL 60601
AISI	American Iron and Steel Institute 1101 17th Street NW, Suite 1300 Washington, DC 20036
ASME	American Society of Mechanical Engineers Three Park Avenue New York, NY 10016
ANSI	American National Standards Institute 1819 L Street NW Sixth Floor Washington, D.C. 20036
APA	American Plywood Association Box 11700 Tacoma, WA 98411
API	American Petroleum Institute 1220 L Street, N.W. Washington, DC 20005
AREA	American Railway Engineering and Maintenance-of-Way-Association 8201 Corporate Drive, Suite 1125 Landover, Maryland 20785
ASTM	American Society for Testing and Materials 100 Barr Harbor Drive West Conshohocken, PA 19428
AWPA	American Wood-Preservers' Association P.O. Box 5690 Granbury, TX 76049
AWS	American Welding Society 550 NW 42nd Avenue Miami, FL 33126

AWWA	American Water Works Association 6666 West Quincy Avenue Denver, CO 80235
COH	City of Houston P.O. Box 1562 Houston, TX 77251-1562
CLFMI	Chain Link Fence Manufacturers Institute 9891 Broken Land Parkway, Suite 300 Columbia, MD 21046
CRSI	Concrete Reinforcing Steel Institute 933 Plum Grove Road Schaumburg, IL 60173-4758
EJMA	Expansion Joint Manufacturers Association 25 North Broadway Tarrytown, NY 10591
FS	Federal Standardization Documents General Services Administration Specifications Unit (WFSIS) 7th and D Streets, S.W. Washington, DC 20406
ICEA	Insulated Cable Engineer Association P.O. Box 440 S. Yarmouth, MA 02664
IEEE	Institute of Electrical and Electronics Engineers 445 Hoes Lane P.O. Box 440 Piscataway, NJ 08855-459
ISA	International Society of Arboriculture P.O. Box 3129 Champaign, IL 61826-3129
MIL	Military Specifications General Services Administration Specifications Unit (WFSIS) 7th and D Streets, S.W. Washington, DC 20406

NACE	National Association of Corrosion Engineers 1440 South Creek Drive Houston, TX 77084-4906
NEMA	National Electrical Manufacturers' Association 1300 North 17th Street, Suite 1847 Rosslyn, VA 22209
NFPA	National Fire Protection Association 1 Batterymarch Park P.O. Box 9101 Quincy, MA 02269-9101
OSHA	Occupational Safety Health Administration U.S. Department of Labor Office of Public Affairs – Room N3647 Washington, DC 20210
PCA	Portland Cement Association 5420 Old Orchard Road Skokie, IL 60077-1083
PCI	Prestressed Concrete Institute 209 W. Jackson Blvd. Chicago, IL 60606
SDI	Steel Deck Institute P.O. Box 25 Fox River Grove, IL 60021
SSPC	Society for Protective Coatings (Steel Structures Painting Council) 40 24th Street, Sixth Floor Pittsburgh, PA 15222
TAC	Texas Administrative Code Texas Water Resources Conservation Commission P. O. Box 13087 Library MC-196 Austin, TX 78711-3087
TxDOT	Texas Department of Transportation 125 East 11th Street Austin, TX 78701-2483

UL	Underwriters' Laboratories, Inc. 333 Pfingston Road Northbrook, IL 60062
UNI-BELL	UNI-BELL Pipe Association 2655 Villa Creek Drive, Suite 155 Dallas, TX 75234

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01450

CONTRACTOR'S QUALITY CONTROL

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Quality assurance and control of Installation and manufacturers' field services and reports.

1.02 QUALITY ASSURANCE AND CONTROL OF INSTALLATION

A. Monitor quality control over Suppliers, manufacturers, Products, services, site conditions and workmanship, to produce work of specified quality at no additional cost to the City.

B. Comply fully with manufacturers' Installation instructions, including each step in sequence.

C. Request clarification from Project Manager before proceeding when manufacturers' instructions conflict with the Contract.

D. Comply with specified standards as minimum requirements for the Work except when more stringent tolerances, codes, or specified requirements indicate higher standards or more precise workmanship.

E. Perform the Work by persons qualified to produce a specified level of workmanship.

1.03 REFERENCES

A. Obtain copies of standards and maintain at job site when required by individual Specification sections.

1.04 MANUFACTURERS' FIELD SERVICES AND REPORTS

A. When specified in individual Specification sections, or as required by Project Manager, provide Product suppliers' or manufacturers' technical representative to observe site conditions, conditions of surfaces and Installation, quality of workmanship, start-up of equipment, operator training, testing, adjusting and balancing of equipment as applicable and to initiate required operation. Conform to minimum time requirements for start-up operations and operator training when provided in Specification sections.

B. At Project Manager's request, submit qualifications of manufacturers' representative to Project Manager 15 days in advance of required representatives' services. Representative is subject to approval by Project Manager.

C. Manufacturer's representatives shall report observations and site decisions or instructions given to applicators or installers that are supplemental or contrary to a manufacturer's written instructions. Submit report within 14 days of observation to Project Manager for review.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01452

INSPECTION SERVICES

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Inspection services and references

1.02 INSPECTION

A. City Engineer will appoint an Inspector to represent the City and perform inspections, tests, and other services specified in individual Specification sections.

B. City Engineer may also appoint, employ, and pay an independent firm to provide additional inspection or construction management services as indicated in Section 01454 - Testing Laboratory Services.

C. The independent firm will submit reports to Project Manager, indicating observations and results of tests and indicating compliance or noncompliance with Contract requirements.

D. Contractor shall assist and cooperate with the Inspector; furnish samples of materials, design mix, equipment, tools, and storage.

E. Contractor shall notify Project Manager 24 hours prior to expected time for operations requiring services.

F. Contractor shall sign and acknowledge reports for Inspector.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01454

TESTING LABORATORY SERVICES

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Testing laboratory services and Contractor responsibilities related to those services.

1.02 REFERENCES

A. ASTM C 1077 - Standard Practice for Laboratories Testing Concrete and Concrete Aggregates for Use in Construction and Criteria for Laboratory Evaluation.

B. ASTM D 3666 - Standard Specification for Minimum Requirements for Agencies Testing and Inspecting Bituminous Paving Materials.

C. ASTM D 3740 - Standard Practice for Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Soil and Rock as Used in Engineering Design and Construction.

D. ASTM E 329 - Standard Specification for Minimum Requirements for Agencies Engaged in the Testing and/or Inspection of Materials Used in Construction.

E. ISO/TEC Guide 25 - General Requirements for the Competence of Calibration and Testing Laboratories.

1.03 SELECTION AND PAYMENT

A. The City will select, employ, and pay for services of an independent testing laboratory to perform inspection and testing identified in Part 3 of individual Specification sections.

B. Contractor shall employ and pay for services of an independent testing laboratory or laboratories to perform inspection and testing identified in Part 2 of individual Specification sections.

C. Employment of a testing laboratory by the City shall not relieve Contractor of its obligation to perform work in accordance with requirements of Contract documents.

D. The City will deduct a minimum two-hour charge for testing laboratory time from periodic progress payment when operations requiring testing or inspection are canceled without prior notification.

E. The City will deduct cost of retesting from periodic progress payment whenever failed work is removed, replaced and retested.

1.04 QUALIFICATION OF LABORATORY

A. Meet laboratory requirements of ASTM E 329 and applicable requirements of ASTM C 1077, ASTM D 3666, and ASTM D 3740.

B. Meet ISO/TEC Guide 17025 conditions for accreditation by the American Association for Laboratory Accreditation (A2LA) in specific fields of testing required in individual Specification sections.

C. If laboratory subcontracts are part of the testing services, such work will be placed with a laboratory complying with the requirements of this Section.

1.05 LABORATORY REPORTS

A. Testing laboratory shall provide and distribute copies of laboratory reports to the distribution list Project Manager provides at the pre-construction conference.

B. Keep one copy of each laboratory report distributed or faxed at the site field office for duration of the Work.

C. Laboratory will fax material supplier, Contractor and Project Manager reports that indicate failing test results by no later than close of business on the working day following test completion and review.

1.06 LIMITS ON TESTING LABORATORY AUTHORITY

A. Laboratory may not release, revoke, alter, or enlarge requirements of the Contract.

B. Laboratory may not approve or accept any portion of the Work.

C. Laboratory may not assume Contractor duties.

D. Laboratory has no authority to stop the Work.

1.07 CONTRACTOR RESPONSIBILITIES

A. Provide safe access to the Work and to manufacturer's facilities for Project Manager and for testing laboratory personnel.

B. Provide testing laboratory with a copy of the Construction Schedule and a copy of each update to Construction Schedule.

C. Notify Project Manager and testing laboratory during normal working hours of the day previous to expected time for operations requiring inspection and testing services. When Contractor fails to make timely prior notification, do not proceed with the operations requiring inspection and testing services.

D. Notify Design Consultant 24 hours in advance when Specification requires presence of Design Consultant for sampling or testing.

E. Request and monitor testing as required to provide timely results and to avoid delays to the Work. Provide samples to laboratory in sufficient time to allow required test to be performed in accordance with specified test methods before intended use of the Product.

F. Cooperate with laboratory personnel in collecting samples on site. Provide incidental labor and facilities for safe access to the Work to be tested, to obtain and handle samples at site or at source of Products to be tested, and to facilitate tests and inspections including storage and curing of test samples.

G. Make arrangements with laboratory through Project Manager. Payment for additional testing will be made in accordance with Document 00700 - General Conditions:

1. Re-testing required for failed tests.

2. Re-testing for nonconforming work.

3. Additional sampling and tests requested beyond specified requirements.

4. Insufficient notification of cancellation of tests for work scheduled but not performed.

PART 2 P R O D U C T S - Not Used

PART 3 EXECUTION

3.01 CONDUCTING TESTING

A Conform to laboratory sampling and testing methods specified in individual Specification sections to the latest issues of ASTM standards, TxDOT methods, or other recognized test standards as approved by Project Manager.

B Requirements of this Section shall also apply to those tests for approval of materials, for mix designs, and for quality control of materials as performed by employed testing laboratories.

END OF SECTION

Section 01502

MOBILIZATION

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Mobilization of construction equipment and facilities onto the site.

1.02 MEASUREMENT AND PAYMENT

A. Unit Price Contracts. If Contract is Unit Price Contract, measurement for mobilization is on a lump sum basis.

B. Stipulated Price (Lump Sum) Contract. If Contract is Stipulated Price Contract, payment for Work in this Section is included in total Stipulated Price.

C. Mobilization payments will be included in monthly payment estimates upon written application by Contractor subject to the following provisions:

1. Authorization for payment of 50 percent of that portion of Contract Price designated for mobilization will be made upon receipt and approval by Project Manager of the following items, as applicable:

   a. Safety Program (Document 00700, Paragraph 10.1.1).

   b. Site Utilization Plan (Section 01145).

   c. Schedule of Values (Section 01292), if any.

   d. Initial Construction Photographs (Section 01321), if needed.

   e. Preliminary Construction Schedule and Billing Forecast (Section 01325).

   f. Construction Schedule (Section 01325 or Section 01326, as applicable).

   g. Submittal Schedule (Section 01330).

   h. Site specific Storm Water Pollution Prevention Plan (SWPPP) and Notice of Intent (NOI) along with storm water application fee (Section 01410), if required.

   i. Contractor's Quality Control Plan (Section 01450), if required.

j. Establishment of a Field Office for Project Manager meeting requirements of Section 01520 - Temporary Field Office.

k. Traffic Control Plan (Section 01555), if required.

l. Plan for Control of Ground and Surface Water (Section 01578), if required.

m. Project Signs Submittal (Section 01580).

n. Trench Safety Program (Section 02260), if required.

o. Dewatering plan, when required.

2. Authorization for payment of the balance of that portion of Contract Price designated for mobilization will be made upon completion of the Work amounting to five percent of Original Contract Price. The amount of Contract Price designated for mobilization may not be applied in computing whether or not five percent of the Original Contract Price has been obtained.

3. Mobilization payments will be subject to retainage amounts stipulated in Document 00700 – General Conditions.

PART 2 P R O D U C T S -Not Used

PART 3 E X E C U T I O N -Not Used

END OF SECTION

Section 01504

TEMPORARY FACILITIES AND CONTROLS

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Temporary facilities and necessary controls for the Project, including utilities, telephone, sanitary facilities, storage sheds and building, safety requirements, first aid equipment, fire protection, security measures, protection of the Work and property, access roads and parking, environmental controls, pest and rodent control and disposal of trash, debris and excavated material.

B. Facilities and controls specified in this section are considered minimum for the Project. Provide additional facilities and controls for proper execution of the Work and to meet Contractor's responsibilities for protection of persons and property.

1.02 MEASUREMENT AND PAYMENT

A. UNIT PRICES

1. No separate payment will be made for any temporary facilities and controls required under this section. Include cost of such work in contract price listed for mobilization.

1.03 CONTRACTOR'S RESPONSIBILITY

A. Comply with applicable requirements specified in other sections of Specifications.

1. Maintain and operate temporary facilities and systems to assure continuous service.

2. Modify and extend systems as the Work progress requires.

3. Completely remove temporary materials and equipment when no longer required.

4. Restore existing facilities used for temporary services to specified or original condition.

PART 2 P R O D U C T S - NOT USED

PART 3 EXECUTION

3.01 TEMPORARY UTILITIES

A. Obtaining Temporary Service:

1. Make arrangements with utility service companies for temporary services.

2. Abide by rules and regulations of the utility service companies or authorities having jurisdiction.

3. Be responsible for utility service costs until Date of Substantial Completion. Included are fuel, power, light, heat, and other utility services necessary for execution, completion, testing, and initial operation of work.

B. Water:

1. Provide water required for and in connection with work to be performed and for specified tests of piping, equipment, devices, or for other use as required for proper completion of the Work.

2. Water to be drawn from public fire hydrants. Obtain transit meter from City of Houston, Department of Public Works and Engineering, Taps and Meters Section. Pay required deposit based on rates established by latest ordinance.

3. Provide and maintain an adequate supply of potable water for domestic consumption by Contractor personnel, Project Manager and representatives of the City.

C. Electricity and lighting:

1. Provide electric power service required for the Work including required testing, lighting, operation of equipment, and other Contractor use.

2. Electric power service includes temporary power or generators required to maintain plant operations during scheduled shutdowns.

3. Minimum lighting level shall be 10 foot-candles for open areas; 20-foot-candles for stairs and shops. Provide a minimum of one 300-watt lamp for each 200 square feet of work area.

D. Temporary Heat and Ventilation:

1. Provide temporary heat necessary for protection or completion of the Work.

2. Provide temporary heat and ventilation to assure safe working conditions; maintain enclosed areas at a minimum of 50 degrees F.

E. Telephone:

1. Provide emergency telephone service at Project site for use by Contractor personnel and others performing work or furnishing services at the site.

2. Provide Houston-Metro lines, allowing unlimited calls, without charge in Greater Houston Metropolitan area with "call waiting" and "call forwarding" options. Provide one telephone answering machine with beeperless remote message retrieval capability.

F. Sanitary Facilities:

1. Provide and maintain sanitary facilities for persons on the site; comply with regulations of State and local departments of health.

2. Enforce use of sanitary facilities by construction personnel at site. Enclose sanitary facilities. Pit-type toilets are not permitted. No discharge will be allowed from these facilities. Collect and store sewage and waste so as not to cause nuisance or health problems. Haul sewage and waste off-site and properly dispose in accordance with applicable regulations.

3. Locate toilets near the Work site and secluded from view insofar as possible. Keep toilets clean and supplied throughout the course of the Work.

3.02 STORAGE SHEDS AND BUILDINGS

A. Provide adequately ventilated, watertight storage facilities with floor above ground level for Products susceptible to weather damage.

B. Storage of Products not susceptible to weather damage may be on blocks off the ground.

C. Store Products in a neat and orderly manner. Place Products to permit easy access for identification, inspection and inventory.

D. Fill and grade site for temporary structures to provide drainage away from temporary and existing buildings.

3.03 SAFETY REQUIREMENTS

A. Submit a safety program at the pre-construction meeting and follow the program in accordance with Document 00700 – General Conditions. Include documented response to trench safety requirements of Section 02260 - Trench Safety System.

B. Conduct operations in strict accordance with applicable Federal, State and local safety codes and statutes and with good construction practice. Establish and maintain procedures for safety of all work, personnel and equipment involved in the Work.

C. Observe and comply with Texas Occupational Safety Act (Art. 5182a, V.C.S.) and with all safety and health standards promulgated by Secretary of Labor under Section 107 of Contract Work Hours and Standards Act, published in 29 CFR Part 1926 and adopted by Secretary of Labor as occupational safety and health standards under Williams-Steiger Occupational Safety and Health Act of 1970, and to other legislation enacted for safety and health of Contractor employees. Safety and health standards apply to Subcontractors and Suppliers as well as to the Contractor.

D. Observance of and compliance with safety regulations is Contractor's responsibility without reliance or superintendence of or direction by Project Manager. Immediately advise Project Manager of investigation or inspection by Federal Safety and Health inspectors of Contractor's or Subcontractor's work or place of work on site under the Contract, and after investigation or inspection, advise Project Manager of results. Submit one copy of accident reports to Project Manager within 10 days of occurrence.

E. Protect areas occupied by workmen using the best available devices for detection of lethal and combustible gases. Test devices frequently to assure functional capability. Constantly observe infiltration of liquids into the Work area for visual or odor evidence of contamination, and immediately take appropriate steps to seal off entry of contaminated liquids to the Work area.

F. Implement safety measures, including but not limited to safety personnel, first-aid equipment, ventilating equipment and other safety equipment specified or detailed on Drawings.

G. Maintain required coordination with City Police and Fire Departments during entire period covered by the Contract.

H. Include Project safety analysis in safety plan. Itemize major tasks and potential safety hazards. Plan to eliminate hazards or protect workers and public from each hazard.

3.04 FIRST AID EQUIPMENT

A. Provide a first aid kit throughout the construction period. List telephone numbers for physicians, hospitals, and ambulance services in each first aid kit.

B. Have at least one person thoroughly trained in first aid and CPR procedures present on the site when work is in progress. Contractor to conform to protocols and requirements for training and protection against "blood borne pathogens".

3.05 FIRE PROTECTION

A. Conform to specified fire protection and prevention requirements established by Federal, State, or local governmental agencies and as provided in Safety Program.

3.06 SECURITY MEASURES

A. Protect the Work, materials, equipment, and property from loss, theft, damage, or vandalism. Protect City property used in performance of the Contract.

B. If existing fencing or barriers are breached or removed for purposes of construction, provide and maintain temporary security fencing equal to existing.

3.07 PROTECTION OF UTILITIES AND PIPELINES

A. Prevent damage to existing public utilities during construction. Approximate locations of known utilities are shown on Drawings, but all lines may not be shown. Excavate with caution and repair lines damaged by construction operations.

B. Use the Utility Coordinating Committee One Call System, telephone number, (713) 223-4567, which must be called 48 hours in advance. The toll free telephone number is 1-800-669-8344, Texas One Call System.

C. Before excavating, locate underground utilities by appropriate means including the use of metal detection equipment, and probes, or by excavation or surveys. Repair damage caused by investigative work and by failure to locate or to preserve underground utilities.

D. Give utility owners a minimum five days notice before commencing excavation to allow time to locate utilities and make adjustments or

relocations when they conflict with the Work. Include cost for temporary relocation of water, wastewater, and storm drainage lines, necessary to accommodate construction, in unit prices for utility construction unless otherwise noted. Bypassing of sanitary waste to storm drainage facilities is not allowed.

E. Prior to excavation near pipelines, request a representative of the pipeline company to meet with Contractor and Project Manager at the site to discuss procedures to be used. Request pipeline company's representative to locate the pipelines in at least three locations: at each side and at centerline of proposed excavation of proposed utility. Also request representative and Project Manager to be present to observe Contractor operations when excavation is conducted within 15 feet of pipeline.

F. Utility service lines are not shown on the construction document drawings. Contractor should anticipate that such service lines exit and should exercise extreme caution during construction. The utility service lines should be repaired and restored immediately as per the specification, if damaged due to any construction activities. No separate payment will be made for this repair and restoration work. Include payment in unit price for work in appropriate sections.

G. Prior to abandonment of utility, make appropriate arrangements with City and owner of utility to terminate service, remove meters, tranformers, and poles as may be required by site conditions.

3.08 PROTECTION OF THE WORK AND PROPERTY

A. Preventive Actions

1. Take necessary precautions and actions to prevent damage, injury, or loss to the Work or public and private property, including:

   a. Storage of apparatus, supplies, and Products in an orderly, safe manner to limit interference with progress of the Work or work of other contractors, utility service companies, or the City's operations.

   b. Suitable storage for Products subject to damage by exposure to weather, theft, breakage, etc.

   c. Limitation of loading pressures imposed upon portions of the Work.

   d. Frequent clean up of refuse, scrap materials, and debris from construction operations, necessary to maintain the site in a safe and orderly condition.

e. Provision of barricades and guard rails to protect pedestrian and traffic around openings, scaffolding, temporary stairs and ramps, excavations, elevated walkways, and other hazardous areas.

2. Protect public and private property adjacent to the site. Obtain written consent before entering or occupying privately-owned land except on easements provided for construction. Restore property damaged by construction operations to condition equal to or better than that existing before the damage.

B. Barricades and Warning Systems

1. Where work is performed on or adjacent to roadways, rights-of-ways, or public land, provide barricades, fences, lights, warning signs, danger signals, and other precautionary measures necessary for protection of persons or property and for protection of the Work.

a. Erect sufficient barricades to keep vehicles and pedestrians from entering the Work. Paint barricades to be visible at night. From sunset to sunrise, provide at least one light at each barricade.

b. Maintain barricades, signs, lights, and provide watchmen until Project Manager approves removal. Whenever work creates encroachment onto public roadways, station flagmen to manage traffic flow in accordance with approved traffic control plan.

c. Conform to requirements of section 01555 – Traffic Control and regulation.

C. PROTECTION OF EXISTING STRUCTURES

1. Underground Facilities

a. Known Underground Facilities are shown on the Drawings but all Facilities may not be shown. Explore sufficiently ahead of trenching and excavation work to locate Underground Facilities in order to prevent damage to them and to prevent interruption of utility services. Restore damage to Underground Facilities to original condition at no additional cost to the City.

b. If necessary to avoid unanticipated Underground Facilities, Project Manager may make changes in location of the Work.

c. If permanent relocation of an Underground Facility is required

and not provided for in the Contract documents, City Engineer will direct Contractor in writing to perform the Work under Modification provisions in Document 00700 - General Conditions.

2. Surface Structures include buildings, tanks, walls, bridges, roads, dams, channels, open drainage, piping, poles, wires, posts, signs, markers, curbs, walks, guard cables, fencing, and other facilities that are visible above the ground level.

3. Protection of Underground Facilities and Surface Structures:

   a. Support in place and protect Underground Facilities and Surface Structures located within or adjacent to the limits of the Work from damage. Install supports as required by the owner of the structure. Satisfy Project Manager that the owner of the facility or structure has approved methods and procedures before installing structure supports.

   b. Avoid moving or changing public utility or private corporation property without prior written consent of a responsible official of the facility or structure. Allow representatives of utilities to enter the construction site for maintenance and repair purposes or to make necessary changes.

   c. Notify utility and pipeline owners and operators of the nature of construction operations and dates when operations will be performed. When construction operations are required in immediate vicinity of existing structures, pipelines, or utilities, give a minimum of five working days advance notice. Probe and flag location of Underground Facilities prior to commencement of excavation. Keep flags in place until construction operations uncover the facility.

   d. Assume risk for damages and expenses to Underground Facilities and Surface Structures within or adjacent to the Work.

D. Employ a structural engineer to ensure protection measures are adequate for the safety and integrity of structures and facilities.

E. PROTECTION OF INSTALLED PRODUCTS:

1. Provide protection of Installed Products to prevent damage from subsequent operations. Remove protection facilities when no longer needed, prior to completion of the Work.

2. Control traffic to prevent damage to Products and surfaces.

3. Provide coverings to protect Products from damage. Cover projections, wall corners, jambs, sills, and exposed sides of openings in areas used for traffic and passage of materials in subsequent work.

3.09 ROADS AND PARKING

A. Prevent interference with traffic and operations of the City on existing roads.

B. Designate temporary parking areas to accommodate construction and City personnel. When site space is not adequate, provide additional off-site parking. Locate as approved by Project Manager.

C. Minimize use by construction traffic on existing streets and driveways.

D. Do not allow heavy vehicles or construction equipment in existing parking areas.

3.10 ENVIRONMENTAL CONTROLS

A. Use methods, equipment, and temporary construction necessary for control of environmental conditions at the site and adjacent areas.

B. Comply with statutes, regulations, and ordinances relating to prevention of environmental pollution and preservation of natural resources including National Environmental Policy Act of 1969, PL 91-190, Executive Order 11514.

C. Minimize impact to the surrounding environment. Do not use construction procedures that cause unnecessary excavation and filling of terrain, indiscriminate destruction of vegetation, air or stream pollution, or harassment or destruction of wildlife.

D. Limit disturbed areas to boundaries established by the Contract. Do not pollute on-site streams, sewers, wells, or other water sources.

E. Do not burn rubbish, debris or waste materials.

3.11 POLLUTION CONTROL

A. Provide methods, means, and facilities necessary to prevent contamination of soil, water or the atmosphere by discharge of Pollutants from construction operations.

B. Provide equipment and personnel to perform emergency measures to contain spillage, and to remove contaminated soils or liquids. Excavate and dispose of contaminated earth off-site in accordance with laws and regulations, and

replace with suitable compacted fill and topsoil.

C. Provide systems necessary for control of Pollutants.

1. Prevent toxic concentrations of chemicals.

2. Prevent harmful dispersal of Pollutants into the environment.

D. Use equipment that conforms to current Federal, State, and local laws and regulations.

3.12 PEST AND RODENT CONTROL

A. Provide rodent and pest control as necessary to prevent infestation of construction or storage areas.

B. Employ methods and use materials that will not adversely affect conditions at site or on adjoining properties.

3.13 NOISE CONTROL

A. Provide vehicles, equipment, and use construction activities that minimize noise to the greatest degree practicable. Conform to noise levels of Chapter 30 –Noise and Sound Level Regulation, City Code of Ordinances, and latest OSHA standards. Do not permit noise levels to interfere with the Work or create a nuisance to surrounding areas.

B. Conduct construction operations during daylight hours except as approved by Project Manager.

C. Select construction equipment that operates with minimum noise and vibration. When directed by Project Manager, correct objectionable noise or vibration produced by operation of equipment at no additional cost to the City. Sound Power Level (PWL) of equipment shall not exceed 85 dbA (re: 10^{-12} watts) measured five feet from the equipment, or at a lower level if prescribed by City Ordinances. Equipment noise requirements are contained in equipment specifications.

3.14 DUST CONTROL

A. Use water or other methods approved by Project Manager to control amount of dust generated by vehicle and equipment operations.

3.15 WATER RUNOFF AND EROSION CONTROL

A. Comply with requirements of section 01410 – TPDES Requirements.

B. Conduct fill, grading and ditching operations and provide adequate methods necessary to control surface water, runoff, subsurface water, and water from excavations and structures in order to prevent damage to the Work, the site, or adjoining properties.

1. Plan and execute construction and earthwork by methods that control surface drainage from cuts and fills, and from borrow and waste disposal areas.

2. Minimize area of bare soil exposed at one time.

3. Provide temporary control measures, such as berms, dikes, and drains.

4. Provide, operate, and maintain equipment and facilities of adequate size to control surface water.

5. Construct fill and waste areas by selective placement of materials to eliminate erosion of surface silts or clays that may erode.

6. Direct water away from excavations, pits, tunnels, and other construction areas to prevent erosion, sedimentation or damage.

7. Maintain existing drainage patterns adjacent to the site by constructing temporary earth berms, sedimentation basins, retaining areas, and temporary ground cover.

8. Dispose of drainage water in a manner to prevent flooding, erosion, or other damage to the site or adjoining areas, in conformance with environmental requirements.

9. Inspect earthwork periodically to detect any evidence of erosion. Take corrective measures as required to control erosion.

END OF SECTION

Section 01506

DIVERSION PUMPING

PART 1 G E N E R A L

1.01 DEFINITIONS

A. Diversion-pumping: Installation and operation of bulkheads, plugs, hoses, piping, and pumps required to maintain sewer flow and prevent backups and overflows.

1.02 SYSTEM DESCRIPTION

A. Provides continuous sewer service to users of sewer systems while maintenance or construction operations are in progress, by diverting flow around construction locations. Maintain sewer flow to prevent backup or overflow onto streets, yards and unpaved areas or into buildings, adjacent ditches, storm sewers, and waterways. Do not divert sewage outside of sanitary sewer system.

B When pumps are operating, have an experienced operator on site to monitor operation, adjust pumps, make minor repairs to system, and report problems.

1.03 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittals Procedures.

B. For systems that bypass sanitary sewer line segments of 42-inch diameter or larger, submit a Diversion Pumping Plan prior to installation. Show location, number and size of pumps, number, location, size and type of hoses or rigid piping, and location of downstream discharge; and special features where pipes or hoses cross roadways, temporary trenches, support bridges.

1.04 SCHEDULING

A. When the City operates or maintains diversion pumping in construction areas, coordinate construction activities with Project Manager.

B. Cease operation of diversion pumping when approved by Project Manager.

PART 2 PRODUCTS

2.01 MATERIALS

A. Design piping, joints and accessories to withstand at least twice maximum system pressure or 50 psi, whichever is greater.

B. Use self-priming type or submersible electric pumps, with a working pressure gauge on the discharge. Pumps shall meet requirements of City of Houston Noise and Sound Level Regulations.

PART 3 EXECUTION

3.01 FIELD QUALITY CONTROL

A. During diversion pumping, do not allow sewage to leak, dump, or spill into or onto areas outside of existing sanitary sewer systems.

B. In the event of an accidental spill or overflow, immediately stop discharge and take action to clean up and disinfect spill. Promptly notify Project Manager so required reporting can be made to the Texas Commission on Environmental Quality (TCEQ) and the Environmental Protection Agency (EPA).

3.02 CLEANING

A. When diversion-pumping operations are complete, drain sewage within piping into sanitary sewers prior to disassembly.

END OF SECTION

Section 01520

TEMPORARY FIELD OFFICE

PART 1 GENERAL

1.01 SECTION INCLUDES

A Temporary field office building and associated parking area.

1.02 FACILITY DESCRIPTION

A Temporary field office to be utilized by authorized representatives of the City to coordinate and monitor daily construction activities performed by Contractor.

B. Field office shall be a non-smoking facility.

PART 2 PRODUCTS

2.01 FIELD OFFICE

A General:

1. Locate office in vicinity of the Work at a location approved by Project Manager or where indicated on Drawings.

2. Furnish, Install and maintain field office for exclusive use of authorized representatives of the City. Provide sufficient room for Project meetings and Inspector's office.

3. Provide office within 10 days of Date of Commencement of the Work.

4. Construct two all-weather, hard surfaced parking spaces for exclusive use of authorized representatives of the City. Provide all-weather surfaced walk between parking spaces and field office.

B. Minimum Construction:

1 Structurally sound foundation and superstructure.

Weather tight with insulated roof, walls and 7-foot ceiling (minimum).

3. Stairs or walkway with handrail and covered entrance platform (minimum 4 feet by 4 feet) with mud scraper at door.

4. Resilient floor covering.

5. Screened windows with area equal to approximately 10 percent of floor area sufficient for light, view of the site, and ventilation. Provide each window with operable sash and burglar bars.

6. Secure exterior doors with dead-bolt cylinder locks and burglar bars.

C. Minimum Services:

1. Exterior entrance light.

2. Interior lighting of 75 foot-candles minimum at desktop height

3. Automatic heating to maintain 65 degrees F in winter.

4. Automatic cooling to maintain 75 degrees F in summer.

5. Electric power service.

6. Three telephone service lines one for voice, one for data, and one for fax, for exclusive use of authorized representatives of the City.

7. Sanitary facilities in field office with one water closet, one lavatory, and one medicine cabinet for exclusive use of authorized representatives of the City.

D. Minimum Furnishings:

1. One 5-drawer desk

2. Two swivel desk chairs with casters.

3. One plan table.

4. One drawing plan rack.

5. One 4-drawer legal file cabinet complete with fifty legal-size hanging folders and two full-sized carriers.

6. One marker board with cleaner and markers.

7. Two waste baskets.

8. One 30-inch by 36-inch tack board.

9. One all-purpose fire extinguisher.

10. Six protective helmets (hard hats) with ratchet adjustment for exclusive use of authorized representatives of the City.

11. Conference table and chairs to accommodate 10 persons.

12. All in one printer, copier, plain paper fax machine.

13. Telephone instrument separate from fax machine.

E. Provide adequate space for one set of Contract documents for ready reference.

PART 3 EXECUTION

3.01 MAINTENANCE

A Maintain all-weather surface driveway and parking areas, buildings, walkways, stairs and required furnishings and equipment for duration of the Contract.

B. Provide janitorial services for duration of the Contract consisting of twice weekly sweeping and mopping floors, trash removal, weekly restroom cleaning, and weekly dusting of furniture and equipment.

C. Provide soap, paper towels, toilet paper, cleansers and other necessary consumables.

D. Immediately repair damage, leaks or defective service.

3.02 PROJECT CLOSEOUT

A Remove temporary field office and signs and restore site as specified in Section 01770 - Closeout Procedures.

END OF SECTION

SECTION 01554

TRAFFIC CONTROL AND STREET SIGNS

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Materials, hardware and installation of Traffic Signs.

1.02 SUBMITTALS

A. Contractor shall submit a list of intended suppliers and products to be used for all signs, posts, and associated hardware. City reserves the right to request actual product samples prior to approval.

1.03 MEASUREMENT AND PAYMENT

A. Signs installed or replaced will be measured by the each sign. Signs refurbished will be measured by each sign.

B. Payment for installation of traffic signs will be on the basis of each sign installed.

C. The price is full compensation for furnishing and installing new signs and hardware. Cost of associated posts, footings, and miscellaneous mounting hardware will not be paid for directly but is to be included in the unit price bid for installation of each traffic sign.

D. Non-standard signs installed or replaced will be measured by the square foot of the sign face. Non-standard signs shall not be installed without prior approval from the City.

PART 2 PRODUCTS

2.01 MATERIALS

A. The following ASTM Standards and documents, of the issue in effect on the date of Invitation for Bid, form a part of this specification to the extent herein.

1. ASTM B 209 Specification for Aluminum and Aluminum Alloy Sheet and Plate

2. ASTM D 523 Standard Method for Test for Specular Gloss

3. ASTM D 4956 Standard Specification for Retroreflective Sheeting for Traffic Control

4. ASTM E 284 Standard Definition of Terms Relating to Appearance of Materials

5. ASTM E 308 Computing the Colors of Objects by Using the CIE System

6. ASTM E 810 Standard Test Method for Coefficient of Retroreflection of Retroreflective Sheeting

7. ASTM E 1164 Standard Practice for Obtaining Spectrophotometric Data for Object-Color Evaluation

B. Substrate (Sign Blanks). This shall be aluminum alloy 5052-H38 and otherwise in conformance with ASTM B-209 and have gold chromate finish. The size, shape and thickness of the sign blanks are as indicated on the standard detail sheet in the plans or as specified by the Engineer.

1. Metal working. The aluminum shall be free of burrs and pits on both sides, including
edges and holes, and shall be made ready for applications of the sheeting.

2. Surface Preparation. The aluminum shall be thoroughly cleaned and degreased with solvent and alkaline emulsions cleaner by immersion, spray, or vapor degreasing and dried prior to application of the gold chromate sheeting coat. The aluminum shall be new and corrosion-free with holes drilled or punched, corners rounded to the radii shown in the standard detail sheet, and all edges smoothed prior to application of sheeting. The heavy or medium chromate coating shall conform in color and corrosion resistance to that imparted by the Alodine 1200F treatment.

3. Size. The dimensions of substrate applications for regulatory, warning, and guide signs shall be as specified by the Engineer and as shown on the plans.

C. Sign Face (Background, Legends, Symbols, and Colors). These shall be in accordance with the Standard Highway Sign Designs (SHSD) for Texas and with the Texas Manual of Uniform Traffic Control Devices (TMUTCD).

1. The sign face, made of electronic film and retro-reflective sheeting shall comply with the appearance, specification, and good workmanship designated by the using agency for sign faces constructed of screen processed retro-reflective sheeting of the same type.

2. All sign blanks shall be covered with appropriate retro-reflective sheeting.

   a. All ground mounted stop signs, warning signs, and other regulatory signs, shall use at a minimum High Intensity Prismatic Reflective Sheeting.

   b. All overhead signs shall use Diamond Grade Reflective Sheeting.

   c. All other signs shall use Super Engineer Grade Sheeting

3. Application Methods. The method of application of sheeting, letters, numbers, and symbols shall be precisely as prescribed in writing by the manufacturer.

   a. Legend Spacing and Layout. Spacing and layout for all traffic control signs shall conform to the SHSD.

   b. Tolerance for Horizontal Alignment. Letters, numerals, and symbols shall be horizontally aligned to a tolerance of 1/16 inch.

   c. Tolerance for Vertical Alignment. Letters, numerals, and symbols shall be vertically aligned to a tolerance of 1/16 on each letter in each line.

D. Sign Posts. Steel post shall conform to the standard specification for hot rolled carbon sheet steel, structural quality, ASTM designation A570, Grade 50. Average minimum yield strength after cold forming is 60,000 psi. The cross section of the post shall be square tube formed steel, carefully rolled to size and shall be welded directly in the corner by high frequency resistance welding or equivalent process and externally scarified to agree with corner radii. Sign posts shall be hot dipped galvanized conforming to ASTM A653, G90.

1. Installation. The square end of the post shall not be modified or pointed.

   a. Flange. When sign post installation is required over building basements, bridges and cavities, a galvanized cast iron pipe flange shall be used. The base shall be 8 inches in diameter with six 5/16 inch holes drilled equidistant around the circumference, ⅝ inch from the outer edge. The neck of the flange shall be 3inches in diameter, drilled and threaded to receive a 2 inch diameter galvanized post.

   b. Hardware. All ground mounted signs shall be attached to posts using 5/16" nut and bolt assembly, the bolt being 2 ½" in length. Stainless steel banding material, brackets and clips will be used for signs installed on light standards or mast arms.

c. Construction. Anchors shall be anchored in a minimum of one cubic foot of class "C" concrete, 28 inches deep, with a 6 inch long, ⅜ inch diameter pin inserted through the pre-drilled hole 3 inches from the bottom of the pole. Where the pole installation requires surface mounting, an 8 inch flange with a 2 inch threaded collar shall be used. The pole shall be galvanized, two inches in diameter and threaded to fit the flange. Sign placement and orientation shall be as specified in the construction plans.

E. Each finished sign shall have the following sticker affixed to the back in a location where it will be visible when the sign is installed:

CITY OF HOUSTON

VERNON CIVIL STATUTES
ART 6701d / ARTICLE III, SEC. 37
Unlawful to Deface, Remove, Knockdown, or Alter Any Traffic Control Device
MAXIMUM FINE $200.00
Date of Sign Manufacture: 00/04
Sheeting Manufacturer: XYZ, Inc.
Sheeting Lot No.: 12345-678

The sticker shall be Zebra Technologies Z-Ultimate 3000 White or approved equal. Finished product shall be weather and fade resistant for the expected life of the sign.

F. Warranty. The Contractor shall warrant the materials and workmanship of each sign in accordance with the maximum limits of material warranties extended by manufacturers of raw materials, subject to the conditions they specify. The retro-reflective sheeting will be considered unsatisfactory if it has deteriorated due to natural causes to the extent that: (1) the sign is ineffective for its intended purpose when viewed from a moving vehicle under normal day and night driving conditions; or (2) the coefficient of retro-reflection is less than the minimum specified for that sheeting. When sign failure occurs prior to the minimum years indicated and an inspection demonstrates that the failure is caused by materials warranted to contractor to endure at least that long, the sign will be replaced or repaired free of materials charges. When failure occurs and inspection demonstrates that such failure is due to poor workmanship, the sign will be replaced or repaired at Contractor's expense, including shipping charges.

PART 3 EXECUTION

3.01.1 EQUIPMENT

A. The contractor shall provide machinery, tools, and equipment necessary for proper execution of the work.

3.01.2 CONSTRUCTION

A. Construction shall be high quality with no visible defects in the finished product. Fabrication shall be in accordance with these specifications. Street name signs shall always be supplied and installed at each project intersection whether signs previously existed at the location or not.

B. The removal of existing signs shall be coordinated with the Traffic Operations Section of the Public Works Department (713-803-3054) and arrangements made for a convenient time to deliver City signs and poles. All salvaged traffic signs shall be delivered to the Traffic Operations Center located at 2200 Patterson Street. All deliveries to the Traffic Operations Center requires a minimum notice of two (2) working days prior to returning or delivering any sign and/or sign related material.

3.03 RESPONSIBILITIES

A. The contractor is responsible for providing and supplying aluminum traffic signs covered with retro-reflective sheeting, applying standard legends (or special legends if shown in the plans) to the covered sign blanks, galvanized steel sign poles, pole anchors, all hardware for installing the signs and poles, and for installing traffic signs, poles and anchors as shown in the plans or call for in the contract documents, complete and ready for field installations.

END OF SECTION

Section 01555

TRAFFIC CONTROL AND REGULATION

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Requirements for signs, signals, control devices, traffic barriers, flares, lights and traffic signals; construction parking control, designated haul routes, and bridging of trenches and excavations.

B. Qualifications and requirements for use of flagmen.

1.02 MEASUREMENT AND PAYMENT

A. Unit Price Contracts.

1. Traffic control and regulation. Payment for traffic control and regulation is on a lump sum basis. Include preparation and submittal of traffic control plan if different than shown on Drawings, and provision of traffic control devices, equipment, and personnel necessary to protect the Work and public. Payment will be based on Contractor's Schedule of Values for traffic control and regulation.

2. Payment for traffic control will be authorized by Project Manager in three (3) parts. Partial payment will be made according to following schedule:

   a. Payment of 25 percent of traffic control amount will be authorized when permanent control devices and necessary temporary markings, sufficiently deployed along job site as required to maintain progress of work, are installed at job site and approved. This limiting percentage will be prorated based upon extent of Contractor's setup.

   b. A payment of 50 percent of traffic control amount will be authorized when pavement replacement commences. This limiting percentage will be prorated based upon linear footage, as measured along centerline axis of water main, of pavement replaced.

   c. A payment of 25 percent of traffic control amount will be authorized when permanent pavement markings are restored and all unnecessary permanent and temporary control devices removed. This limiting percentage will be prorated based upon the extent of restoration.

3. Flagmen: Measurement is on a lump sum basis for flagmen as required for the project. The amount invoiced shall be determined based on the schedule of value submitted for flagmen.

4. New Portable Concrete Low Profile Traffic Barrier Provided. Payment is on a unit price basis for each linear foot of low profile traffic barrier provided, installed with hardware assemblies and connected together in accordance with the approved traffic control plan.

5. Portable Concrete Low Profile Traffic Barrier picked up from City of Houston Stockpile. Payment is on a unit price basis for each linear foot of low profile traffic barrier picked up from designated stockpile, moved onto the project, set at location and connected together.

6. Portable Concrete Low Profile Traffic Barrier Installed. Payment is on a unit price basis for each linear foot of low profile traffic barrier delivered to the project location, installed with hardware assemblies and connected together in accordance with the approved traffic control plan.

7. Portable Concrete Low Profile Traffic Barrier Moved and Reset. Payment is on a unit price basis for each linear foot of low profile traffic barrier disassembled, moved on the project, reset at the new locations and connected together. Include cost to repair roadway in the unit price.

8. Portable Concrete Low Profile Traffic Barrier Removed. Payment is on a unit price basis for each linear foot of low profile traffic barrier removed from the project, including hardware assemblies, and stockpiling at location listed in Section 01110 – Summary of Work. Include cost to repair roadway in the unit price.

9. Refer to Section 01270 - Measurement and Payment for unit price procedures.

B. Stipulated Price Contracts. Include payment for work under this section in the total Stipulated Price.

1.03 REFERENCES

A. Texas Manual on Uniform Traffic Control Devices (TMUTCD)

B. Article 4413 (29bb), commonly referred to as Private Investigators and Private Security Agencies Act, and Article 2.12, Texas Code of Criminal Procedure.

C. Code of Ordinances, City of Houston, Texas.

1. Chapter 10 Buildings And Neighborhood Protection, Article X Cleanup After Demolition Or Removal Of Structures

2. Chapter 40 Streets and Sidewalks, Article XVII Pedestrian Way Impairments

1.04 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Traffic control plan:

1. If using traffic control plan contained in the Contract without modification, submit a letter confirming use of the plan.

2. If using a different traffic control plan, submit the plan for approval. The plan must conform to TMUTCD requirements and be sealed by a Registered Texas Professional Engineer.

C. Submit copies of approved lane closure permits issued by City Traffic Engineering Branch.

D. Submit Schedules of Values for traffic control plan and flagmen within 30 days following Notice to Proceed.

E. Submit records verifying qualifications of Uniformed Peace Officers and Certified Flagmen proposed for use on the Work.

F. When working in the central business district, submit copies of approved Pedestrian Way permits issued by the City's Traffic Engineering Branch.

1.05 FLAGMEN

A. Use Uniformed Peace Officers and Certified Flagmen to control movement of vehicular and pedestrian traffic when construction operations encroach on public traffic lanes. Unless otherwise approved by Project Manager, use Uniformed Peace Officer for work along major thoroughfares, schools, churches, hospitals and Work at signalized intersections.

B. Uniformed Peace Officer: Individual employed full-time as a peace officer who receives separate compensation as a privately employed flagman. Private employment may be an employee-employer relationship or on an individual basis. Flagman may not be in the employ of another peace officer nor be a reserve peace officer.

1. Uniformed Peace Officers may be:

   a. sheriffs and their deputies;

   b. constables and deputy constables;

   c. marshals or police officers of an incorporated city, town or village; or

   d. as otherwise provided by Article 2.12, Code of Criminal Procedure.

2. The Uniformed Peace Officer must be a full-time peace officer, must work a minimum average of 32 paid hours per week, and must be paid a rate not less than the prevailing minimum hourly wage rate set by the federal Wage and Hour Act. The individual must be entitled to vacation, holidays, and insurance and retirement benefits.

C. Certified Flagman: Individual who receives compensation as a flagman and meets the following qualifications:

1. Formally trained and certified in traffic control procedures by the City s E. B. Cape Center.

2. Speaks English. Ability to speak Spanish is desirable but not required.

3. Paid for flagman duty at an hourly rate not less than the wage rate set for Rough Carpenter under the City's Wage Scale for Engineering Construction.

D. Certified Flagmen must wear a distinctive uniform, bright-colored vest, and be equipped with appropriate flagging and communication devices while at the Work site. They must also have in their possession while on duty, a proof of training identification card issued by the appropriate training institute.

PART 2 PRODUCTS

2.01 SIGNS, SIGNALS, AND DEVICES

A. Comply with TMUTCD requirements.

B. Traffic cones and drums, flares and lights: Conform to local jurisdictions' requirements.

C. When working in the Central business district, provide pedestrian pathway

signage approved by the City's Traffic Engineering Branch.

2.02 PORTABLE LOW PROFILE CONCRETE BARRIERS

A. The low profile concrete barrier is a patented design. Information concerning this barrier may be obtained from Texas Transportation Institute, Texas A&M University System, College Station, Texas 77843-3135, (409) 845-1712.

PART 3 E X E C U T I O N

3.01 PUBLIC ROADS

A. Submit requests forms for lane closure and sidewalk closure to the City's Traffic Engineering Branch at least three working days prior to need for blocking vehicular lanes or sidewalks. Do not block lanes or sidewalks without approved permits. Obtain application from the City's Traffic Engineering Branch at 611 Walker, 5th floor or at the following internet address: http://www.ci.houston.tx.us/pwe/mrow/laneclosure.htm.

B. Follow laws and regulations of governing jurisdictions when using public roads. Pay for and obtain permits from jurisdiction before impeding traffic or closing lanes. Coordinate activities with Project Manager.

C. Give Project Manager one-week notice before implementing approved traffic control phases. Inform local businesses of impending traffic control activities.

D. Notified police department, fire department, METRO, and local schools, churches, and businesses in writing a minimum of five business days prior to beginning work.

E. Maintain 10-foot wide all-weather lanes adjacent to the Work for emergency vehicle use. Keep all-weather lanes free of construction equipment and debris.

F. Do not to obstruct normal flow of traffic from 7:00 a.m. to 9:00 a.m. and 4:00 p.m. to 6:00 p.m. on designated major arterials or as directed by Project Manager.

G. Maintain local driveway access to residential and commercial properties adjacent to work areas at all times. Use all-weather materials approved by Project Manager to maintain temporary driveway access to commercial and residential driveways.

H. Keep streets entering and leaving job site free of excavated material, debris, and foreign material resulting from construction operations in compliance with

applicable ordinances.

I. Remove existing signage and striping that conflict with construction activities or that may cause driver confusion.

J. Provide safe access for pedestrians along major cross streets.

K. Alternate closures of cross streets so that two adjacent cross streets are not closed simultaneously.

L. Do not close more than two consecutive esplanade openings at a time without prior approval from Project Manager.

3.02 CONSTRUCTION PARKING CONTROL

A. Control vehicular parking to prevent interference with public traffic and parking, access by emergency vehicles, and the City's operations.

B. Monitor parking of construction personnel's vehicles in existing facilities. Maintain vehicular access to and through parking areas.

C. Prevent parking on or adjacent to access roads or in non-designated areas.

3.03 FLARES AND LIGHTS

A. Provide flares and lights during hours of low visibility to delineate traffic lanes and to guide traffic.

3.04 HAUL ROUTS

A. Utilize haul routes designated by authorities or shown on drawings for construction traffic.

B. Confine construction traffic to designated haul routes.

C. Provide traffic control at critical areas of haul routes to regulate traffic and minimize interference with public traffic.

3.05 TRAFFIC SIGNS AND SIGNALS

A. Construct necessary traffic control devices for temporary signals required to complete the Work including loop detectors, traffic signal conduits, traffic signal wiring and crosswalk signals. Notify the City's Traffic Engineering Branch a minimum of 60 days in advance of need for control boxes and switchgear. The City will perform necessary service, programming or adjustments, to signal boxes and switchgear if required during construction.

B. Install and operate traffic control signals to direct and maintain orderly traffic flow in areas under Contractor's control affected by Contractor's operations. Post notices, signs and traffic controls before moving into next phase of traffic control.

C. Relocate traffic signs and signals as the Work progresses to maintain effective traffic control.

D. Unless otherwise approved by Project Manager, provide driveway signs with name of business that can be accessed from each crossover. Use two signs for each crossover.

E. Replace existing traffic control devices in Project area.

F. Project Manager may direct Contractor to make minor adjustments to traffic control signage to eliminate driver confusion and maintain orderly traffic flow during construction at no additional cost to the City.

3.06 BRIDGING TRENCHES AND EXCAVATIONS

A. When necessary, construct bridges over trenches and excavation to permit an unobstructed flow of traffic across construction areas and major drives. Use steel plates of sufficient thickness to support H-20 loading and install to operate with minimum noise.

B. Shore trench or excavation to support bridge and traffic.

C. Secure bridging against displacement with adjustable cleats, angles, bolts or other devices when:

1. bridging is placed over existing bus routes,

2. more than five percent of daily traffic is comprised of commercial or truck traffic,

3. more than two separate plates are used for bridging, and

4. when bridge is to be used for more than five consecutive days.

D. Extend steel plates used for bridging a minimum of 1 foot beyond edges of trench or excavation. Use temporary paving materials such as premix to feather edges of plates to minimize wheel impact on secured bridging.

3.07 REMOVAL

A. Remove equipment and devices when no longer required.

B. Repair damage caused by installation.

C. Remove post settings to a depth of 2 feet.

3.08 TRAFFIC CONTROL, REGULATION AND DIRECTION

A. Use Flagmen to control, regulate and direct an even flow and movement of vehicular and pedestrian traffic, for periods of time as may be required to provide for public safety and convenience, where:

1. multi-lane vehicular traffic must be diverted into single lane vehicular traffic,

2. vehicular traffic must change lanes abruptly,

3. construction equipment must enter or cross vehicular traffic lanes and walks,

4. construction equipment may intermittently encroach on vehicular traffic lanes and unprotected walks and crosswalk,

5. traffic regulation is needed due to rerouting of vehicular traffic around the Work site, and

6. where construction activities might affect public safety and convenience.

B. Use of Flagmen to assist in the regulation of traffic flow and movement does not relieve Contractor of responsibility to take other means necessary to protect the Work and public.

3.09 INSTALLATION STANDARDS

A. Place temporary pavement for single lane closures, in accordance with TMUTCD.

B. Reinstall temporary and permanent pavement markings as approved by Project Manager. When weather conditions do not allow application according to manufacturer's requirements, alternate markings may be considered. Submit proposed alternate to Project Manager for approval prior to installation. No additional payment will be made for use of alternate markings.

3.10 MAINTENANCE OF EQUIPMENT AND MATERIAL

A. Submit name, address and telephone number of individual designated to be

responsible for maintenance of traffic handling at construction site to Project Manager. Individual must be accessible at all times to immediately correct deficiencies in equipment and materials used to handle traffic including missing, damaged, or obscured signs, drums, barricades, or pavement markings.

B. Inspect signs, barricades, drums, lamps and temporary pavement markings daily to verify that they are visible, in good working order, and conform with traffic handling plans as approved by Project Manager. Immediately repair, clean, relocate, realign, or replace equipment or materials that are not in compliance.

C. Keep equipment and materials, signs and pavement markings, clean and free of dust, dirt, grime, oil, mud, or debris.

D. Obtain approval of Project Manager to reuse damaged or vandalized signs, drums, and barricades.

END OF SECTION

Section 01562

TREE AND PLANT PROTECTION

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Tree and plant protection.

B. Minimum qualifications of Arborist and Urban Forester.

1.02 MEASUREMENT AND PAYMENT

A. Payment for Tree Protection, including tree pruning or tree removal, shall be paid as a Lump Sum basis that shall include all items specified in this section unless payment is specified otherwise in this section

B Payment for Zero Curb Cutback will be on a per linear foot basis.

C. Payment for Checker Plate will be on a square foot basis.

D. Refer to Section 01270-Measurement and Payment for unit price procedures.

1.03 SUBMITTALS

A. Conform to requirements of Section 01330 – Submittal Procedures.

B. Submit name and experience of qualified Arborist, proposed for use on the Work, to Project Manager.

1.04 PROJECT CONDITIONS

A. Preserve and protect existing trees and plants to remain from foliage, branch, trunk, or root damage that could result from construction operations.

B. Prevent following types of damage:

1. Compaction of root zone by foot or vehicular traffic, or material storage.

2. Trunk damage from equipment operations, material storage, or from nailing or bolting.

3. Trunk and branch damage caused by ropes or guy wires.

4. Root or soil contamination from spilled solvents, gasoline, paint, lime slurry, and other noxious materials.

5. Branch damage due to improper pruning or trimming.

6. Damage from lack of water due to:

   a. Cutting or altering natural water migration patterns near root zones.

   b. Failure to provide adequate watering

7. Damage from alteration of soil pH factor caused by depositing lime, concrete, plaster, or other base materials near roots zones.

8. Cutting of roots larger than one inch in diameter.

1.05 DAMAGE ASSESSMENT

A. When trees other than those designated for removal are destroyed or damaged as result of construction operations, remove and replace with same size, species, and variety up to and including 8 inches in trunk diameter. Trees larger than 8 inches in diameter shall be replaced with an 8 inch diameter tree of the same species and variety and total contract amount will be reduced by an amount determined from the following formula and paid to Tree Fund 0.7854 x D2 x $13.25 where D is diameter in inches of tree or shrub trunk measured 12 inches above grade for that portion of the tree which is greater than 8 inches in diameter. A permit must be applied for and approved by the City of Houston, Urban Forestry Division prior to removal of any tree not scheduled for removal in the tree treatment schedule. Contractor shall contact City of Houston, Urban Forestry, at 832-395-8459 to apply for tree removal permit when needed.

PART 2 PRODUCTS

2.01 MATERIALS

A. Pruning Paint: Black latex, water based paint, free of all petroleum products.

B. Fertilizer: Fertilizer shall be a root stimulant that contains at a minimum the following ingredients: Ectomycorrhizal Fungi, VA Mycorrhizal (VAM) Fungi, Rhizosphere Bacillus spp., Kelp Meal Humic Acid, and Soluble Yucca.

C. Tree Protection Fencing: Orange, plastic mesh fenching, 4 feet in height with 6 feet high "t" bar posts installed 10 feet on centers as per drawings.

D. Plastic Root/Soil Protection: Clear polyethylene sheeting, minimum 6 mil, thickness.

PART 3 EXECUTION

3.01 PROTECTION OF EXISTING TREES AND SHRUBS

A. Site preparation work and/or construction work shall not begin in any area where tree preservation measures have not been completed and approved.

B. Protect exposed roots and root zone areas from contamination from stabilization materials and concrete using polyethylene.

C. Cover exposed roots within 4 hours to reduce damage caused by desiccation. Roots may be covered with soil, mulch, polyethylene, or wet burlap to help protect them from drying.

D. Designate limited areas as concrete washout areas. Locate concrete washout areas away from root zones.

E. Install root pruning trenching where designated in tree treatment schedule and shown on the tree protection drawings. Trees scheduled for root pruning are called out specifically in the treatment schedule. Trench shall be located 2 ft. from the edge of proposed waterline or sanitary sewer for trees called out for root pruning for water or fittings, or sanitary sewer in the treatment schedule, 2 ft. from edge of proposed storm sewer pipe for trees called out for root pruning for storm in the treatment schedule, 30" back of proposed curb for trees called out for root pruning for street, and at edge of sidewalk for trees called out for root pruning for sidewalk. Root pruning shall not be performed where there is not adequate space to be located sufficiently away from tree to prevent damage. All pruning must be evaluated by Contractor's Certified Arborist and reviewed and approved by City Forester before being performed. Trench locations shown on tree preservation plan are drawn to scale and should be located in field as drawn on plan. Exact locations shall be approved in the field by engineer and/or project urban forester prior to installation. Trenching depth shall be a minimum of 2 ft. deep and a maximum of 6 inches wide for water, fittings, sanitary sewer, storm, and street. Trenching depth shall be to the anticipated bottom of sidewalk and base material for sidewalk root pruning, roots lower than sidewalk shall not be pruned. All roots shall be cut by trencher, chainsaw, or handsaw to the specified depth. Roots shall be cut cleanly, and or not ripped, torn, or chopped. Trench shall be backfilled and compacted immediately after trenching. Trench shall be installed prior to any clearing and grubbing, excavation for underground, or any other site work.

F. Install tree protection fencing around each tree to be preserved as indicated in the tree treatment schedule and on the tree protection plan.

1. Each tree to be preserved shall be protected with a tree protection fence. The fencing shall be continuous between posts, shall be pulled taut prior to securing to posts, and shall be firmly attached to the posts with a minimum of 4 wire ties.

2. All tree protection fencing shall be installed prior to site work or construction activity. The fence shall be placed in a continuous alignment as shown on the tree protection plan. Fences shown on tree protection plan are drawn to scale and shall be installed as drawn, in the field. In general fences shall be placed 30" back of existing curb or edge of pavement where root pruning or zero curb cutback is not specified, and 6" back of root pruning trench where root pruning is specified and immediately back of curb where zero curb cutback is specified. Exact locations shall be approved by the project urban forester and/or engineer in the field. The Fences shall be placed to protect roots, trunks, and foliage. The contractor shall not remove or relocate tree protection fencing and shall not operate within the limits shown without direct approval of the project urban forester. In areas where the proposed waterline is located in the existing road side ditch and where tree protection fencing can not be installed across the ditch, the fencing shall be installed at the top of outside ditch bank and no bore pits, peep holes, service taps, or any excavation should occur in the area immediately in front of the tree protection fencing for trees called out with "bore" in the Tree Treatment Schedule. The "bore" limits shall be the same as the limits of the tree protection fencing.

3. Storage of equipment or materials will not be allowed inside a fence. Entryways and access into a protected area shall not be provided unless approved by the project urban forester.

4. Damage to tree fences occurring during the progress of the work shall be repaired immediately at no additional cost to owner. Workmen shall be clearly instructed to exercise caution in performance of work near trees being preserved.

5. Tree protection fencing shall be removed by contractor, at no additional costs, upon completion of all construction activity in each work zone area. Tree protection fencing materials used in the first two work zone areas shall be removed and utilized in subsequent work zone areas. Materials and labor shall be paid for each linear foot of fencing installed in first two work areas. All fencing installed in subsequent work zone areas shall be paid for labor only.

G. Boring/Auguring of water lines or sanitary sewer lines

1. Water line or sanitary sewer line shall be bored/augured/ horizontally drilled under

critical root zones areas of trees designated with auger or bore in the tree treatment schedule. The entire area protected with tree protection fencing shall be bored. No bore pits, come through holes, peep holes, push pits, or long or short side service taps shall be allowed in the areas protected by tree protection fencing. The tree protection plan takes into consideration the limits of augering equipment, there should be room for adequately spaced bore pits, peep holes, come through holes, and push pits. Any changes to the location of the tree protection fencing shall be authorized by the project Urban Forester and City Engineer.

H. Hand digging of Service taps and leads

1. Trees called out for Hand dig short side service tap are located in very close proximity to existing short side water meters. Excavating the service tap with machinery would significantly impact the tree and be in violation of the City of Houston's Street Tree Ordinance. These short side service taps shall be excavated with manual labor to expose any roots 1" in diameter and larger. The first 24" of excavation shall be completed manually to expose the roots. Any root 1" in diameter and larger shall remain undamaged, the roots shall not be cut , nor shall the bark and cambium layer be scraped or damaged. Once the roots are exposed, if there is adequate room to utilize a mini-excavator without damaging the roots, the mini-excavator can be utilized to complete the excavation down to the water line. 1" plywood shall be placed on grade to provide root protection in the area of access of the mini-excavator. If roots 1" diameter or larger are cut or damaged, responsible party will be subject to a citation under the Street Tree Ordinance, and may also be required to incur the cost of tree removal and replacement of damaged tree on an inch for inch basis, if required by City of Houston Urban Forestry Division.

2. Trees called out for Hand dig short side or long side service lead are located in very close proximity to existing water meters. Excavating the service lead with machinery would significantly impact the tree and be in violation of the City of Houston's Street Tree Ordinance. Short side leads shall be excavated with manual labor to expose any roots 1" in diameter and larger from the service tap of the meter. Come out hole and excavation required for long service leads shall be excavated with manual labor to expose roots 1" in diameter and larger, from the come out hole to the meter. In each case, all roots 1" in diameter and larger shall remain undamaged, the roots shall not be cut, nor shall the bark and cambium layer be scraped or damaged. If roots 1" diameter or larger are cut or damaged, responsible party will be subject to a citation under the cost of tree removal and replacement of damaged tree on an inch by inch basis, if required by City of Houston Urban Forestry Division.

3. Trees called out for Hand dig sanitary stub up are located in very close proximity to proposed service lead. Excavating the service lead with machinery would significantly impact the tree and be in violation of the City of Houston's Street Tree

Ordinance. Excavation for sanitary stub up shall be completed with manual labor to expose any roots 1" in diameter and larger. The lead shall be bored from face of curb to stub up hole when called out in the tree treatment schedule. Come out and stub up holes shall be excavated with manual labor to expose roots 1" in diameter and larger. In case, all roots 1" in diameter and larger shall remain undamaged, the roots shall not be cut, nor shall the bark and cambium layer be scraped or damaged. If roots 1" diameter or larger are cut or damaged, responsible party will be subject to a citation under the Street Tree Ordinance, and may be required to incur the cost of tree removal and replacement of damaged tree on an inch by inch basis, if required by City of Houston Urban Forestry Division.

4. Long side service taps shall not be located in an area specified to be bored in the tree treatment schedule. Should it be absolutely necessary to locate a long side service tap in an area specified to be bored, the excavation shall be completed as specified in paragraph 1 of this section-Hand digging short side service taps.
5. All water meters and sanitary service leads called out on P&P drawings and visible in the field have been addressed in the Tree Protection Plan. Should any additional meters or lead be found during construction, or in any new meters or leads installed beneath the canopy of any tree, fenced for tree protection, the excavation shall be completed as specified in paragraph 1 and/or 2 of this section and paid for at the unit cost for each included in contract.

I. Pruning of Trees

1. Trees shall be pruned in accordance with the American National Standard for tree pruning, ANSI A300 (Part 1) – 2001 Pruning Revision of ANSI A300-1995 Tree, Shrub and Other Woody Plant Maintenance – Standard Practices. Pruning shall be completed by professional arborists who has received training in proper pruning techniques.

2. Clearance prune designated trees for public streets, sidewalks, and construction areas. Provide minimum 14 feet and maximum of 18 feet of vertical clearance over proposed water trunk lines. Provide minimum of 14 feet and maximum of 16 feet of vertical clearance over proposed street construction, from 24" back of curb on one side to 24" back of curb on the other side. Provide 20' of vertical clearance over proposed storm sewer up to 38" in size, and 30' of vertical clearance for storm sewer larger than 38" in size. Pruning to be installed prior to any construction activity. Contractor shall notify property owner prior to trimming or pruning any trees with trunks located on private property. Exceptions will be made for trees determined to be arboriculturally significant by City of Houston Urban Forestry. Pruning of trees identified will be completed with approval and supervision of City of Houston Urban Forestry.

3. All cuts should be made sufficiently close to the parent limb or trunk without cutting into the branch collar or leaving a protruding stub, so that closure can readily start under normal conditions. All lateral cuts shall be made to a lateral that is least 1/3 the diameter of the parent limb. Clean cuts shall be made at all times.

4. Trees shall be pruned in a manner that will not destroy or alter the natural shape and character of the tree. Apply black latex paint to all fresh wounds on Oak (Quercus) species immediately after each cut is made.

5. Crown cleaning prune designated trees shall include selective removal of dead, diseased, and/or broken limbs.

J. Tree Removal

1. Trees scheduled for removal shall be sawed down and debris hauled from the site the same day. The stump shall be ground to 6" below grade and excess grindings shall be hauled from the site the same day, so that a pile of grindings is not left where the stump was ground. Enough grindings should be left so that an open hole does not remain.

2. Only those trees called out for removal in the Tree Treatment Schedule shall be removed, or otherwise damaged. Should it be determined that any additional trees must be removed, a permit must be applied for and approved from the City of Houston Urban Forestry Division prior to removal. Contractor shall contact Urban Forestry at 832-395-8459.

K. Root Stimulation

1. Deep root stimulate designated trees. Mix fertilizer with wetting agent per label instructions.

2. Stimulate entire root zone area within the dripline of the tree and continue 10 feet beyond the dripline, leaving out areas of anticipated root loss (construction areas).

3. Mixture shall be injected into the top 10 inches of soil under pressure of 150 to 200 psi as soil conditions warrant.

4. Mix in a tank with agitation capability per label instructions. Inject the mixture on a 2.5 ft. square grid at 4 lbs, actual nitrogen per 1,000 sq. ft.

L. Regularly water trees which have received root damage, to eliminate additional stress caused by lack of moisture. Water during periods without adequate rainfall. For example, should 1.0" of rain not be received within a week period, the trees should be thoroughly watered.

March through September, water once every two weeks. October through February, water every three weeks. Water thoroughly to saturate the entire root zone area.

M. Chemically treat tree trunks with evidence of borer activity with the appropriate approved insecticide mixed and applied per the manufacturer's product application recommendations. Trees shall be sprayed within 24 hours after observance of borer activity.

N. Grading and filling around trees.

1. Maintain existing grade within the dripline of trees, unless otherwise indicated.

2. Where existing grade around trees is above new finish grade, under supervision of project urban forester, carefully hand excavate within the dripline to make transition to new finish grade.

3. Where existing grade is below new finish grade, place clean bank sand in a single layer to make the transition to new grade. Do not compact; hand grade to required elevation. Specifically to areas where proposed curb is higher than existing and backfill will be required.

O. Demolition, Forming and Pouring Sidewalks (Sidewalk on Grade)

1. Demolition of existing sidewalks, located in or adjacent to the limits of tree protection fencing, shall be completed without disturbing, cutting, or otherwise damaging tree roots and soil located beneath them.

2. The new sidewalk shall be formed at or above the elevation of the existing sidewalk, without disturbing, cutting or otherwise damaging tree roots. Every effort has been made to address tree root and sidewalk elevation issues with information available in the field and on plan and profile sheets. The elevation of every tree root was not available, if tree roots are found to be in conflict with proposed sidewalk, project engineer and urban forester shall be consulted as to how to install sidewalks with minimal impacts to adjacent trees.

3. Checkerplate shall be installed in areas called out only if tree root elevations prohibit construction of ADA compliant sloped concrete sidewalks. Checkerplate shall be installed per detail.

P. Zero curb cutback

1. Disturbance of tree roots or soil behind the existing and/or proposed curb within root zones of trees designated for zero curb cutback shall be prohibited. If the curb can not be removed without disturbing soil or damaging roots back of curb when using

equipment for demolition, the curb shall be broken using a hand held jackhammer and removed by hand.

2. The exposed roots and soil shall be covered immediately after demolition with 6 mil polyethylene in order to avoid desiccation, and contamination by the lime used for road bed stabilization. The polyethylene shall be placed so that it covers the vertical face of soil back of curb and laid back onto the grade 12 inches back of curb. The polyethylene should remain in place, across the entire area specified for zero curb cutback, from the time the existing curb is demolished until the time when the new curb is formed and backfilled. The polyethylene can be pulled up from the vertical face while the road bed is being graded or mixed, to avoid catching the plastic with machinery, but shall be replaced immediately after equipment has completed. The vertical face shall not be exposed for more than 8 hours in any 24 hour period.

3. There shall be no stabilization back of curb in the zero curb cutback areas, or forming with steel forms. The existing grade and roots back of existing curb shall not be disturbed. This may require forming of the new street with wooden forms with stakes inside forms, which may require leaving the forms in place after the street is poured. Should wooden forms be utilized, the wood shall be at minimum a 2x6. The new curb may require hand finishing, as a slip curb machine may not have adequate clearance without disturbing the roots that are to be protected with the zero curb cutback.

4. Roots extending into the street, or on top of the existing curb, in areas to paved shall be cut and removed by hand prior to disturbance or removal with equipment. Roots shall be pruned flush with the proposed back of curb. Roots one inch in diameter and larger shall be cut in a manner to provide a smooth, clean cut surface. Cuts shall be made with the appropriate pruning shears or pruning saws. Roots shall not be chopped or broken.

5. In areas where proposed curb will be may be lower than existing top of curb and tree roots 2" diameter or larger are present, the soil and roots shall not be graded or laid back. The existing elevation shall be maintained and the curb formed to meet elevation or a short elevation difference roots and top of curb maintained.

Q. Demolition, Forming and Pouring of Drive Way Approaches

1. Demolition of existing driveway approaches located beneath the dripline of any tree shall be completed without disturbing, cutting, or otherwise damaging tree roots and soil located beneath them.

2. The new approach shall be formed at or above the elevation of the existing approach where tree roots 2" diameter or larger are present, without disturbing, cutting or

otherwise damaging tree roots. Maximum drive slopes may be needed at bottom of apron to allow forming of drive over tree roots at top of drive. As with sidewalks, the elevation of every tree roots was not available in design. If tree roots are found to be in conflict with proposed approach, project engineer and urban forester shall be consulted as to how to install drive way with minimal impacts to adjacent trees.

R. Replacement Trees for Tree Removals under Ordinance

1. Location, species, and size of replacement trees are indicated on the drawings. Contractor shall layout individual trees at locations shown on drawings. Contractor shall layout individual trees at locations shown on drawings and be responsible for utility locate requirements. In case of conflicts, notify City Engineer and City Urban Forestry before proceeding with work. Trees shall be laid out and locations approved by City Engineer prior to planting.

2. Trees shall meet and be planted according to City of Houston Standard Specification 02915.

S. Arborist and Urban Forester Qualifications

1. Arborist – Employ qualified arborist acceptable to City's Parks and Recreation Department to complete all tree treatments. Arborist shall be normally engaged in the field and have a minimum of 5 years experience. Qualifications of the selected arborist shall be submitted for review and approval by the project engineer and City of Houston.

2. Urban Forester – An Urban forester shall be hired to monitor and assist with field layout (exact locations of fencing, root pruning, and zero curb cutback) of the tree preservation program during demolition and construction to ensure tree protection procedures and techniques are practiced as specified to address concerns and conditions which occur in the field. At a minimum, the individual responsible for monitoring and field layout of the tree protection shall have a minimum of 5 years of experience as a consultant, and shall not be affiliated with a tree care contractor in the Houston area. Qualifications of the selected urban forester shall be submitted for review and approval by the project engineer and City of Houston Urban Forestry Department.

END OF SECTION

Section 01570

STORM WATER POLLUTION PREVENTION CONTROL

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Implementation of Storm Water Pollution Prevention Plans (SWP3) described in Section 01410 – TPDES Requirement.

B. Installation, maintenance and removal, of storm water pollution prevention structures: diversion dikes, interceptor dikes, diversion swales, interceptor swales, down spout extenders, pipe slope drains, paved flumes and level spreaders. Structures are used during construction and prior to final development of the site.

C. Filter Fabric Barriers:

1. Type 1: Temporary filter fabric barrier for erosion and sediment control in non-channelized flow areas.

2. Type 2: Temporary reinforced filter fabric barrier for erosion and sediment control in channelized flow areas.

D. Hay Bale Fence.

E. Drop Inlet Basket

F. Inlet Sediment Traps

G. Brush Berm

H. Sand Bag Barrier

I. Bagged Gravel Barrier

J. Sediment Basin

K. Inlet Protection Barrier

1.02 MEASUREMENT AND PAYMENT

A. UNIT PRICES

1. Payment for filter fabric barrier is on a linear foot basis measured between limits of beginning and ending of stakes.

2. Payment for reinforced filter fabric barrier is on a linear foot basis measured between limits of beginning and ending of stakes.

3. Payment for drop inlet baskets is on a unit price basis for each drop inlet basket.

4. Payment for storm inlet sediment traps is on a unit price basis for each storm inlet sediment trap.

5. Payment for storm water pollution prevention structures is on a lump sum basis for the project. Earthen structures with outlet and piping include diversion dikes, interceptor dikes, diversion swales, interceptor swales, and excavated earth-outlet sediment trap, embankment earth-outlet sediment trap, down spout extenders, pipe slope drains, paved flumes, stone outlet sediment trap, and level spreaders.

6. Payment for hay bale barrier, if included in Document 00410 - Bid Form, is on a linear foot of accepted bale barriers, if not include in cost of storm water pollution prevention structures.

7. Payment for brush berm, if included in Document 00410 - Bid Form, is on a linear foot of accepted brush berm, if not include in cost of storm water pollution prevention structures.

8. Payment for sandbag barrier, if included in Document 00410 - Bid Form, is on a linear foot basis measured between limits of beginning and ending of sandbags, if not include in cost of storm water pollution prevention structures.

9. Payment for bagged gravel barrier, if included in Document 00410 - Bid Form, is on a linear foot basis measured between limits of beginning and ending of bagged gravel barrier, if not include in cost of storm water pollution prevention controls.

10. Payment for inlet protection barriers, if included in Document 00410 - Bid Form, is on a linear foot basis measured along outside face of inlet protection barrier, if not include in cost of storm water pollution prevention structures.

11. Refer to Section 01270 - Measurement and Payment for unit price procedures.

B. Stipulated Price (Lump Sum) Contract. If Contract is Stipulated Price Contract, payment for Work in this Section is included in total Stipulated

1.03 REFERENCE STANDARDS

A. ASTM

1. A 36 – Standard Specification for Carbon Structural Steel.

2. D698 – Standard Test Methods for Laboratory Compaction Characteristics of Soil Using Standard Effort (12,400 ft-lbf/ft3 (600kN-m/m3)).

3. D3786 – Standard Test Method for Hydraulic Bursting Strength for knitted Goods and Nonwoven Fabrics.

4. D 4355 - Standard Test Method for Deterioration of Geotextiles from Exposure to Ultraviolet Light and Water (Xenon-Arc Type Apparatus).

5. D 4491 - Standard Test Methods for Water Permeability of Geotextiles by Permittivity.

6. D 4632 - Standard Test Method for Grab Breaking Load and Elongation of Geotextiles.

7. D 4833 - Standard Test Method for Index Puncture Resistance of Geotextiles, Geomembranes, and Related Products.

8. D 6382 - Standard Practice for Dynamic Mechanical Analysis and Thermogravimetry of Roofing and Waterproofing Membrane Material.

B. Storm Water Management Handbook for Construction Activities prepared by City of Houston, Harris County and Harris County Flood Control District.

1.04 SYSTEM DESCRIPTIONS

A. Filter Fabric Barrier Type 1 and Type 2: Install to allow surface or channel runoff percolation through fabric in sheet-flow manner and to retain and accumulate sediment. Maintain Filter Fabric Barriers to remain in proper position and configuration at all times.

B. Hay Bale Fence: Install to allow surface runoff percolation through hay in sheet-flow manner and to retain and accumulate sediment. Maintain Hay Bale Fence to remain in proper position and configuration at all times.

C. Interceptor Dikes and Swales: Construct to direct surface or channel runoff around the project area or runoff from project area into sediment traps.

D. Drop Inlet Baskets: Install to allow runoff percolation through the basket and to retain and accumulate sediment. Clean accumulation of sediment to prevent clogging and backups.

E. Sediment Traps: Construct to pool surface runoff from construction area to allow sediment to settle onto the bottom of trap.

F. Sand Bags: Are used during construction activities in unstabilized minor swales, ditches, or streambeds when the contributing drainage area is no greater than 2 acres. It is also sediment barrier for stage one Inlet.

G. Bagged Gravel Barrier: Are used during construction activities in unstabilized minor swales, ditches, or streambeds when the contributing drainage area is no greater than 2 acres. It is also sediment barrier for stage two Inlet.

H. Drop Inlet Insert Basket: Is a temporary barrier placed within a storm drain inlet (Lower Portion of Stage I and Upper Portion of Stage II Inlets) consisting of a filter fabric supported by a metal frame work to prevent sediment and other pollutants from entering convey system.

I. Brush Berm: Brush Berm is constructed at the perimeter of a distribute site within the developing area.

1.05 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Submit manufacturer's literature for product specifications and installation instructions.

C. Submit manufacturer-s catalog sheets and other product data on geotextile or filter fabrics, outlet pipe, perforated riser and connectors.

D. Submit proposed methods, equipment, materials, and sequence of operations for storm-water pollution prevention structures.

E. Submit shop drawings for Drop Inlet Baskets.

PART 2 P R O D U C T S

2.01 CONCRETE

A. Concrete: Class B in accordance with Section 03315 – Concrete for Utility Construction or as shown on the Drawings.

2.02 AGREGATE MATERIALS

A. Use poorly graded cobbles with diameter greater than 3 inches and less than 5 inches.

B. Provide gravel lining in accordance with Section 2320 – Utility Backfill Materials or as shown on the drawings.

C. Provide clean cobbles and gravel consisting of crushed concrete or stone. Use clean, hard crushed concrete or stone free from adherent coatings, salt, alkali, dirt, clay, loam, shale, soft or flaky materials, or organic matter.

D. Sediment Pump Pit Aggregate: Use nominal 2-inch diameter river gravel.

2.03 PIPE

A. Polyethylene culvert pipe or PVC sewer pipe in accordance with Section 02505- High Density Polyethylene (HDPE) Solid and Profile Wall Pipe and Section 02506 Polyvinyl Chloride Pipe or as shown on the Drawings.

B. Inlet Pipes: Galvanized steel pipe in accordance with Section 02642 Corrugated Metal Pipe or as shown on the Drawings.

C. Standpipe for Sediment Pump Pits: Galvanized round culvert pipe or round PVC pipe, minimum of 12-inch and a maximum of 24-inch diameter, perforate at 6 to 12 inch centers around circumference.

2.04 GEOTEXTILE FILTER FABRIC

A. Woven or nonwoven geotextile filter fabric made of either polypropylene, polyethylene, ethylene, or polyamide material, in continuous rolls of longest practical length.

B. Grab Strength: 100 psi in any principal direction (ASTM D-4632), Mullen burst strength >200 psi (ASTM D-3786), and equivalent opening size between 50 and 140.

C. Furnish ultraviolet inhibitors and stabilizers for minimum 6 months of expected usable construction life at temperature range of 0 degrees F to 120 degrees F.

D. Mirafi, Inc., Synthetic Industries, or equivalent

2.05 BARRIER

A. Wire Barrier: Woven galvanized steel wire, 14 gauge by 6-inch square mesh spacing, minimum 24 inch roll or sheet width of longest practical length.

B. Barrier Stakes: Nominal 2 by 2 inch moisture-resistant treated wood or steel posts (min. of 1.25 lbs. per linear foot and Brinell Hardness greater than 140) with safety caps on top; length as required for minimum 8 inch bury and full

height of filter fabric.

2.06 SANDBAGS

A. Provide woven material made of polypropylene, polyethylene, or polyamide material.

1. Minimum unit weight of four ounces per square yard.

2. Minimum grab strength of 100 lbs in any principal direction (ASTM D4632)

3. Mullen burst strength exceeding 300 lbs (ASTM D4833).

4. Ultraviolet stability exceeding 70 percent. After 500 hours of exposure (ASTM 4355).

5. Size: Length:18 to 24 inches. Width: 12 to 18 inches. Thickness: 6 to 8 inches. Weight: Approximately 40 to 50 pounds not to exceed 75 pounds.

2.07 Bagged gravel Barrier

1. Minimum unit weight of four ounces per square yard.

2. Minimum grab strength of 100 lbs in any principal direction (ASTM D4632)

3. Mullen burst strength exceeding 300 lbs (ASTM D4833).

4. Ultraviolet stability exceeding 70 percent. After 500 hours of exposure (ASTM 4355).

5. Size: Length:18 to 24 inches. Width: 12 to 18 inches. Thickness: 6 to 8 inches. Weight: Approximately 40 to 50 pounds not to exceed 75 pounds.

2.08 DROP INLET BASKET

A. Provide steel frame members in accordance with ASTM A36.

B. Construct top frame of basket with two short sides of 2 inch by 2 inch and single long side of 1 inch by 1 inch, 1/8 inch angle iron. Construct basket hangers of 2 inch by 1/4 inch iron bars. Construct bottom frame of 1 inch by 1/4 inch iron bar or 1/4 inch plate with center 3 inches removed. Use minimum 1/4 inch diameter iron rods or equivalent for sides of inlet basket.

Weld minimum of 14 rods in place between top frame/basket hanger and bottom frame. Exact dimensions for top frame and insert basket will be determined based on dimensions of type of inlet being protected.

2.09 HAY BALE

A. Hay: Standard-baled agricultural hay bound by wire, nylon, or polypropylene rope. Do not use jute or cotton binding.

B. Hay Bale Stakes (applicable where bales are on soil): No. 3 (3/8 diameter) reinforcing bars, deformed or smooth at Contractor's option, length as required for minimum 18 inch bury and full height bales.

PART 3 E X E C U T I O N

3.01 PREPARATION, INSTALLATION AND MAINTEINANCE

A. Provide erosion and sediment control structures at locations shown on the Drawings.

B. Do not clear, grub or rough cut until erosion and sediment control systems are in place unless approved by Project Manger to allow installation of erosion and sediment control systems, soil testing and surveying.

C. Maintain existing erosion and sediment control systems located within project site until acceptance of Project or until directed by Project Manger to remove and discard existing system.

D. Regularly inspect and repair or replace damaged components of erosion and sediment control structures. Unless otherwise directed, maintain erosion and sediment control structure until project area stabilization is accepted. . Redress and replace granular fill at outlets as needed to replenish depleted granular fill. Remove erosion and sediment control structures promptly when directed by Project Manger. Dispose of materials in accordance with Section 01576 - Waste Material Disposal.

E. Remove and dispose sediment deposits at the designated spoil site for the Project. If a project spoil site is not designated on Drawings, dispose of sediment off site at approved location in accordance with Section 01576 - Waste Material Disposal.

F. Unless otherwise shown on the Drawings, compact embankments, excavations, and trenches in accordance with Section 02315 Roadway

Excavation or Section 2317 Excavation and Backfill for Utilities.

G. Prohibit equipment and vehicles from maneuvering on areas outside of dedicated right of way and easements for construction. Immediately repair damage caused by construction traffic to erosion and sediment control structures.

H. Protect existing trees and plants in accordance with Section 1562 – Tree and Plant Protection.

3.02 SEDIMENT TRAPS

A. Install sediment traps so that surface runoff shall percolate through system in sheet flow fashion and allow retention and accumulation of sediment.

B. Inspect sediment traps after each rainfall, daily during periods of prolonged rainfall, and at a minimum once each week. Repair or replace damaged sections immediately.

C. Use fill material for embankment in accordance with Section 02320 – Utility Backfill Materials.

D. Excavation length and height shall be as specified on Drawings. Use side slopes of 2:1 or flatter.

E. Stone outlet sediment traps:

1. Maintain minimum of 6 inches between top of core material and top of stone outlet, minimum of 4 inches between bottom of core material and existing ground and minimum of 1 foot between top of stone outlet and top of embankment.

2. Embed cobbles minimum of 4 inches into existing ground for stone outlet. Core shall be minimum of 1 foot in height and in width and wrapped in triple layer of geotextile filter fabric.

F. Sediment Basin with Pipe Outlet Construction Methods: Install outlet pipe and riser as shown on the Drawings.

G. Remove sediment deposits when design basin volume is reduced by one-third or sediment level is one foot below principal spillway crest, whichever is less.

3.03 FILTER FABRIC BARRIER CONSTRUCTION METHODS

A. Fence Type 1: Filter Fabric: Barrier

1. Install stakes 3 feet on center maximum and firmly embed minimum 8 inches in soil. If filter fabric is factory preassembled with support netting, then maximum support spacing is 8 feet. Install wood stakes at a slight angle toward the source of anticipated runoff.

2. Trench in the toe of the fence lines so the downward face of the trenches is flat and perpendicular to direction of flow. V-trench configuration as shown on Drawings may also be used.

3. Lay fabric along edges of trenches in longest practical continuous runs to minimize joints. Make joints only at a support post. Splice with minimum 6-inch overlap and seal securely.

4. Staple filter fabric to stakes at maximum 3 inches on center. Extend fabric minimum 18 inches and maximum 36 inches above natural ground.

5. Backfill and compact trench.

B. Barrier Type 2: Reinforced Filter Fabric Barrier

1. Layout barrier same as for Type 1.

2. Install stakes at 6 feet on center maximum and at each joint in wire fence, firmly embedded 1-foot minimum, and inclined it as for Type 1.

3. Tie wire fence to stakes with wire at 6 inches on center maximum. Overlap joints minimum one bay of mesh.

4. Install trench same as for Type 1.

5. Fasten filter fabric wire fence with tie wires at 3 inches on center maximum.

6. Layout fabric same as for Type 1. Fasten to wire fence with wire ties at 3 inches on center maximum and, if applicable, to stakes above top of wire fence it as for Type 1.

7. Backfill and compact trench.

8. Attach filter fabric to wooden fence stakes spaced a maximum of 6 feet apart or steel fence stakes spaced a maximum of 8 feet apart and embedded a minimum of 12 inches. Install stakes at a slight angle toward source of anticipated runoff.

9. Trench in toe of filter fabric barrier with spade or mechanical trencher so that downward face of trench is flat and perpendicular to direction of flow. A V-trench configuration may also be used. Lay filter fabric along edges of trench. Backfill and compact trench upon completion of Construction.

10. Filter fabric fence shall have a minimum height of 18 inches and a maximum height of 36 inches above natural ground.

11. Cut length of fence to minimize use of joints. When joints are necessary, splice fabric together only at support post with minimum 6 inch overlap and seal securely.

12. When used in swales, ditches or diversions, elevation of barrier at top of filter fabric at flow line location in channel shall be lower than bottom elevation of filter fabric at ends of barrier or top of bank, whichever is less, in order to keep storm water discharge in channel from overtopping bank.

C. Triangular Filter Fabric Barrier Construction Methods

1. Attach filter fabric to wire fencing, 18 inches on each side. Provide a fabric cover and skirt with continuous wrapping of fabric. Skirt should form continuous extension of fabric on upstream side of fence.

2. Secure triangular fabric filter barrier in place using one of the following methods:
   a. Toe-in skirt 6 inches with mechanically compacted material;
   b. Weight down skirt with continuous layer of 3-inch to 5-inch graded rock; or
   c. Trench-in entire structure 4 inches.

3. Anchor triangular fabric filter barrier structure and skirt securely in place using 6-inch wire staples on 2-foot centers on both edges and on skirt, or staked using 18-inch by 3/8-inch diameter re-bar with tee ends.

4. Lap fabric filter material by 6 inches to cover segment joints. Fasten joints with galvanized shoat rings.

3.04 DIKE AND SWALE

A. Unless otherwise indicated, maintain minimum dike height of 18 inches, measured from cleared ground at up slope toe to top of dike. Maintain side slopes of 2:1 or flatter.

B. Dike and Swale Stabilization: When shown on the Drawings, place gravel lining 3 inches thick and compacted into the soil or 6 inches thick if truck crossing is expected. Extend gravel lining across bottom and up both sides of swale minimum height of 8 inches vertically, above bottom. Gravel lining on dike side shall extend up the up slope side of dike a minimum height of 8 inches, measured vertically from interface of existing or graded ground and up slope toe of dike, as shown on Drawings.

C. Divert flow from dikes and swales to sediment basins, stabilized outlets, or sediment trapping devices of types and at locations shown on Drawings. Grade dikes and swales as shown on Drawings, or, if not specified, provide positive drainage with maximum grade of 1 percent to outlet or basin.

D. Clear in accordance with Section 2233 – Clearing and Grubbing Compact embankments in accordance with Section 2315 – Roadway Excavation.

E. Carry out excavation for swale construction so that erosion and water pollution is minimal. Minimum depth shall be 1 foot and bottom width shall be 4 feet, with level swale bottom. Excavation slopes shall be 2:1 or flatter. Clear, grub and strip excavation area of vegetation and root material.

3.05 DOWN SPOUT EXTENDER

A. Down spout extender shall have slope of approximately 1 percent. Use pipe diameter of 4 inches or as shown on the Drawings. Place pipe in accordance with Section 2317 - Bedding and Backfill for Utilities.

3.06 PIPE SLOPE DRAIN

A. Compact soil around and under drain entrance section to top of embankment in lifts appropriately sized for method of compaction utilized.

B. Inlet pipe shall have slope of 1 percent or greater. Use pipe diameter as shown on the Drawings.

C. Top of embankment over inlet pipe and embankments directing water to pipe shall be at least 1 foot higher at all points than top of inlet pipe.

D. Pipe shall be secured with hold-down grommets spaced 10 feet on centers.

E. Place riprap apron with a depth equal to pipe diameter with 2:1 side slopes.

3.07 PAVED FLUME

A. Compact soil around and under the entrance section to top of the embankment in lifts appropriately sized for method of compaction utilized.

B. Construct subgrade to required elevations. Remove and replace soft sections and unsuitable material. Compact subgrade thoroughly and shape to a smooth, uniform surface.

C. Construct permanent paved flumes in accordance with Drawings.

D. Remove sediment from riprap apron when sediment has accumulated to depth of one foot.

3.08 LEVEL SPREADER

A. Construct level spreader on undisturbed soil and not on fill. Ensure that spreader lip is level for uniform spreading of storm runoff.

B. Maintain at required depth, grade, and cross section as specified on Drawings. Remove sediment deposits as well as projections or other irregularities which will impede normal flow.

3.09 INLET PROTECTION BARRIER

A. Place sandbags for Stage I, Bagged gravel for Stage II and filter fabric barriers at locations shown on the SWP3. Maintain to allow minimal inlet in flow restrictions / blockage during storm event.

3.10 DROP INLET BASKET CONSTRUCTION METHODS

A. Fit inlet insert basket into inlet without gaps around insert at locations shown on the SWP3.

B. Support for inlet insert basket shall consist of fabricated metal as shown on Drawings.

C. Push down and form filter fabric to shape of basket. Use sheet of fabric large enough to be supported by basket frame when holding sediment and extend at least 6 inches past frame. Place inlet grates over basket/frame to serve as fabric anchor.

D. Remove sediment deposit after each storm event and whenever accumulation exceeds 1-inch depth during weekly inspections.

3.11 HAY BALE FENCE CONSTRUCTION METHODS

A. Place bales in row with ends tightly abutting adjacent bales. Place bales with bindings parallel to ground surface.

B. Embed bale in soil a minimum of 4 inches.

C. Securely anchor bales in place with Hay Bale Stakes driven through bales a minimum of 18-inches into ground. Angle first stake in each bale toward previously laid bale to force bales together.

D. Fill gaps between bales with straw to prevent water from channeling between bales. Wedge carefully in order not to separate bales.

E. Replace with new hay bale fence every two months or as required by Project Manager.

3.12 BRUSH BERM CONSTRUCTION METHODS

A. Construct brush berm along contour lines by hand placing method. Do not use machine placement of brush berm.

B. Use woody brush and branches having diameter less than 2-inches with 6-inches overlap. Avoid incorporation of annual weeds and soil into brush berm.

C. Use minimum height of 18-inches measured from top of existing ground at upslope toe to top of berm. Top width shall be 24 inches minimum and side slopes shall be 2:1 or flatter.

D. Embed brush berm into soil a minimum of 4-inches and anchor using wire, nylon or polypropylene rope across berm with a minimum tension of 50 pounds. Tie rope securely to 18-inch x 3/8-inch diameter rebar stakes driven into ground on 4-foot centers on both sides of berm.

3.13 STREET AND SIDEWALK CLEANING

A. Keep areas clean of construction debris and mud carried by construction vehicles and equipment. If necessary, install stabilized construction exits at construction, staging, storage, and disposal areas, following Section 01575-Stabilized Construction Exit.

B. In lieu of or in addition to stabilized construction exits, shovel or sweep pavements as required to keep areas clean. Do not waterhose or sweep debris and mud off street into adjacent areas, except, hose sidewalks during off-peak hours, after sweeping.

3.14 WASTE COLLECTION AREAS

A. Prevent water runoff from passing through waste collection areas, and prevent water runoff from waste collection areas migrating outside collection areas.

3.15 EQUIPMENT MAINTENANCE AND REPAIR

A. Confine maintenance and repair of construction machinery and equipment to areas specifically designated for that purpose, so fuels, lubricants, solvents, and other potential pollutants are not washed directly into receiving streams or storm water conveyance systems. Provide these areas with adequate waste disposal receptacles for liquid and solid waste. Clean and inspect maintenance areas daily.

B. Where designated equipment maintenance areas are not feasible, take precautions during each individual repair or maintenance operation to prevent potential pollutants from washing into streams or conveyance systems. Provide temporary waste disposal receptacles.

3.16 VEHICLE/ EQUIPMENT WASHING AREAS

A. Install wash area (stabilized with coarse aggregate) adjacent to stabilized construction access, as required to prevent mud and dirt run-off. Release wash water into drainage swales or inlets protected by erosion and sediment controls. Build wash areas following Section 01575- Stabilized Construction access. Install gravel or rock base beneath wash areas.

B. Wash vehicles only at designated wash areas. Do not wash vehicles such as concrete delivery trucks or dump trucks and other construction equipment at locations where runoff flows directly into waterways or storm water conveyance systems.

C. Locate wash areas to spread out and evaporate or infiltrate wash water directly into ground, or collect runoff in temporary holding or seepage basins.

3.17 WATER RUNOFF AND EROSION CONTROL

A. Control surface water, runoff, subsurface water, and water from excavations and structures to prevent damage to the Work, the site, or adjoining properties. Follow environment requirements.

B. Control fill, grading and ditching to direct water away from excavations, pits, tunnels, and other construction areas, and to direct drainage to proper runoff courses to prevent erosion, sedimentation or damage.

C. Provide, operate, and maintain equipment and facilities of adequate size to control surface water.

D. Retain existing drainage patterns external to the site by constructing temporary earth berms, sedimentation basins, retaining areas, and temporary ground cover as required to control conditions.

E. Plan and execute construction and earth work to control surface drainage from cuts and fills, and from borrow and waste disposal areas, to prevent erosion and sedimentation.

1. Hold area of bare soil exposed at one time to a minimum.

2. Provide temporary controls such as berms, dikes, and drains.

F. Construct fill and waste areas by selective placement to eliminate surface silts or clays which will erode.

G. Inspect earthwork periodically to detect start of erosion. Immediately apply corrective measures as required to control erosion.

H. Dispose of sediments offsite, not in or adjacent to waterways or floodplains, nor allow sediments to flush into streams or drainage ways. Assume responsibility for offsite disposal location.

I. Unless otherwise indicated, compact embankments, excavations, and trenches by mechanically blading, tamping, and rolling soil in maximum of 8-inch layers. Provide compaction density at minimum 90 percent Standard Proctor ASTM D-698-78 density. Make at least one test per 500 cubic yards of embankment.

J. Prohibit equipment and vehicles from maneuver on areas outside of dedicated rights-of-way and easements for construction. Immediately repair damage to erosion and sedimentation control systems caused by construction traffic.

K. Do not damage existing trees intended to remain.

3.18 REMOVAL OF CONTROLS

A. Remove erosion and sediment controls when the site is finally stabilized or as directed by Project Manager.

B. Dispose of sediments and waste products following Section 01505-Temporary Facilities.

END OF SECTION

Section 01575

STABILIZED CONSTRUCTION ACCESS

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Installation and removal of erosion and sediment control for stabilized construction access used during construction and prior to final development of site, as shown in City of Houston Standard Construction details, DWG No. 01571-01.

1.02 MEASUREMENT AND PAYMENT

A. Unit Price Contracts. If Contract is Unit Price Contract, payment for work in this Section will be based on the following:

1. Stabilized construction roads, parking areas, access and wash areas: per square yard of aggregate/recycled concrete without reinforcing placed in 8-inch layers. No separate payment will be made for street cleaning necessary to meet TPDES requirements. Include cost of work for street cleaning under related Specification section.

B. Stipulated Price (Lump Sum) Contracts. If the Contract is a Stipulated Price Contract, include payment for work under this Section in the total Stipulated Price.

1.03 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Submit manufacturers catalog sheets and other Product Data on geotextile fabric.

C. Submit sieve analysis of aggregates conforming to requirements of this Specification.

1.04 REFERENCES

A. ASTM D 4632 - Standard Test Method for Grab Breaking Load and Elongation of Geotextiles.

B. Storm Water Quality Management Handbook For Construction Activities prepared by the City of Houston, Harris County and Harris County Flood Control District.

PART 2 PRODUCTS

2.01 GEOTEXTILE FABRIC

A. Provide woven or non-woven geotextile fabric made of polypropylene, polyethylene, ethylene, or polyamide material.

B. Geotextile fabric: Minimum grab strength of 200 lbs in any principal direction (ASTM D-4632) and equivalent opening size between 50 and 140.

C. Geotextile and threads: Resistant to chemical attack, mildew, and rot and contain ultraviolet ray inhibitors and stabilizers to provide minimum of six months of expected usable life at temperature range of 0 to 120 degrees F.

D. Representative Manufacturers: Mirafi, Inc. or equal.

2.02 COARSE AGGREGATES

A. Coarse aggregate: Crushed stone, gravel, crushed blast furnace slag, or combination of these materials. Aggregate shall be composed of clean, hard, durable materials free from adherent coatings of, salt, alkali, dirt, clay, loam, shale, soft or flaky materials, or organic and injurious matter.

B. Coarse aggregates to consist of open graded rock 2" to 8" in size.

PART 3 EXECUTION

3.01 PREPARATION AND INSTALLATION

A. Provide stabilized construction roads and access at construction, staging, parking, storage,
and disposal areas to keep street clean of mud carried by construction vehicles and equipment. Construct erosion and sediment controls in accordance with Drawings and Specification requirements.

B. Do not clear grub or rough cut until erosion and sediment control systems are in place, unless approved by Project Manager to allow soil testing and surveying.

C. Maintain existing construction site erosion and sediment control systems until acceptance of the Work or until removal of existing systems is approved by Project Manager.

D. Regularly inspect, repair or replace components of stabilized construction access. Unless otherwise directed, maintain stabilized construction roads and

access until the City accepts the Work. Remove stabilized construction roads and access promptly when directed by Project Manager. Discard removed materials off-site.

E. Remove and dispose of sediment deposits at designated spoil site for Project. If a spoil site is not designated on Drawings, dispose of sediment off-site at a location not in or adjacent to stream or flood plain. Assume responsibility for off-site disposal.

F. Spread compacted and stabilized sediment evenly throughout site. Do not allow sediment to flush into streams or drainage ways. Dispose of contaminated sediment in accordance with existing federal, state, and local rules and regulations.

G. Prohibit equipment and vehicles from maneuvering on areas outside of dedicated rights-of-way and easements for construction. Immediately repair damage to erosion and sediment control systems caused by construction traffic.

H. Conduct construction operations in conformance with erosion control requirements of Specification 01570 – Storm Water Pollution Control.

3.02 CONSTRUCTION MAINTENANCE

A. Provide stabilized access roads, subdivision roads, parking areas, and other on-site vehicle transportation routes where shown on Drawings.

B. Provide stabilized construction access and vehicle washing areas, when approved by Project Manager, of sizes and at locations shown on Drawings or as specified in this Section.

C. Clean tires to remove sediment on vehicles leaving construction areas prior to entering public right-of-ways. Construct wash areas needed to remove sediment. Release wash water into drainage swales or inlets protected by erosion and sediment control measures.

D. Details for stabilized construction access are shown on Drawings. Construct other stabilized areas to same requirements. Maintain minimum roadway widths of 14 feet for one-way traffic and 20 feet for two-way traffic and of sufficient width to allow ingress and egress. Place geotextile fabric as a permeable separator to prevent mixing of coarse aggregate with underlaying soil. Limit exposure of geotextile fabric to elements between laydown and cover to a maximum 14 days to minimize potential damage.

E. Grade roads and parking areas to provide sufficient drainage away from stabilized areas. Use sandbags, gravel, boards, or similar materials to prevent sediment from entering public right-of-ways, waterways or

storm water conveyance systems.

F. Inspect and maintain stabilized areas daily. Provide periodic top dressing with additional coarse aggregates to maintain required depth. Repair and clean out damaged control systems used to trap sediment. Immediately remove spilled, dropped, washed, or tracked sediment from public right-of-ways.

G. Maintain lengths of stabilized areas as shown on Drawings or a minimum of 50 feet. Maintain a minimum thickness of 8 inches. Maintain minimum widths at all points of ingress or egress.

H. Stabilize other areas with the same thickness, and width of coarse aggregate required for stabilized construction access, except where shown otherwise on Drawings.

I. Stabilized areas may be widened or lengthened to accommodate truck washing areas when authorized by Project Manager.

J. Clean street daily before end of workday. When excess sediments have tracked onto streets, Project Manager may direct Contractor to clean street as often as necessary. Remove and legally dispose of sediments.

K. Use other erosion and sediment control measures to prevent sediment runoff during rain periods and non-working hours and when storm discharges are expected.

END OF SECTION

Section 01576

WASTE MATERIAL DISPOSAL

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Disposal of waste material and salvageable material.

1.02 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Submit copy of approved "Development Permit", as defined in Chapter 19 of Flood Plain Ordinance (City Ordinance Number 81-914 and Number 85-1705), prior to disposal of excess material in areas designated as being in "100-year Flood Hazard Area" within the City. Contact the City of Houston Flood Plain Manager, 3300 Main Street, at (713) 525-7605 for flood plain information.

C. Obtain and submit disposal permits for proposed disposal sites, if required by local ordinances.

D. Submit copy of written permission from property owner, with description of property, prior to disposal of excess material adjacent to Project. Submit written and signed release from property owner upon completion of disposal work.

E. Describe waste materials expected to be stored on-site and a description of controls to reduce Pollutants from these materials, including storage practices to minimize exposure of materials to storm water; and spill prevention and response measures in the Project's Storm Water Pollution Prevention Plan (SWPPP). Refer to Section 01410 – TPDES Requirements.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N

3.01 SALVAGEABLE MATERIAL

A. Excavated Material: When indicated on Drawings, load, haul, and deposit excavated material at location or locations shown on Drawings outside limits of Project.

B. Base, Surface, and Bedding Material: Load shell, gravel, bituminous, or other base and surfacing material designated for salvage into City trucks.

C. Pipe Culvert: Load culverts designated for salvage into City trucks.

D. Other Salvageable Materials: Conform to requirements of individual Specification Sections.

E. Coordinate loading of salvageable material on City trucks with Project Manager.

3.02 EXCESS MATERIAL

A. Remove and legally dispose of vegetation, rubble, broken concrete, debris, asphaltic concrete pavement, excess soil, and other materials not designated for salvage from job site.

B. Excess soil may be deposited on private property adjacent to Project when written permission is obtained from property owner. See Paragraph 1.02 D above.

C. Verify flood plain status of any proposed disposal site. Do not dispose of excavated materials in area designated as within 100-year Flood Hazard Area unless "Development Permit" has been obtained. Remove excess material placed in "100-year Flood Hazard Area" within the City, without "Development Permit", at no additional cost to the City.

D. Remove waste materials from site daily, in order to maintain site in neat and orderly condition.

END OF SECTION

Section 01578

CONTROL OF GROUND AND SURFACE WATER

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Dewatering, depressurizing, draining, and maintaining trenches, shaft excavations, structural excavations and foundation beds in stable condition, and controlling ground water conditions for tunnel excavations.

B. Protecting work against surface runoff and rising floodwaters.

C. Trapping suspended sediment in the discharge form the surface and ground water control systems.

1.02 MEASUREMENT AND PAYMENT

A. UNIT PRICES

1. When noted, dewatering of trench or excavation during course of project shall be measured per linear foot and paid for at contract unit prices for dewatering, when directed to perform such work by Project Manager. Dewatering must be fully detailed in submittal and submittal must be approved prior to performing dewatering work before payment will be made for dewatering. No payment will be made for work unless directed to perform work by Project Manager.

2. Presence of a pump on project does not constitute dewatering for payment under bid item "Ground Water Control for Open Cut Construction."

3. Dewatering required during course of project to lower water table for other utility installation less than 24 inches in diameter, construction of structures, removal of standing water, surface drainage seepage, or to protect against rising waters or floods shall be considered incidental to Work unless otherwise noted.

4. No separate payment will be made for groundwater control associated with augering, tunnels or casing. Include cost in unit price for augering.

5. Refer to Section 01270 - Measurement and Payment for unit price procedures.

B. Stipulated Price (Lump Sum) Contract. If the Contract is a Stipulated Price Contract, include payment for work under this section in the total Stipulated

Price.

1.03 REFERENCES

A. ASTM D 698 - Standard Test Methods for Laboratory Compaction of Soils Using Standard Effort (12,400 ft-lbf/ft3 (600kN-m/m3)

B. Federal Regulations, 29 CFR Part 1926, Standards-Excavation, Occupational Safety and Health Administration (OSHA)

C. Storm Water Management Handbook for Construction Activities prepared by City of Houston, Harris County and Harris County Flood Control District.

1.04 DEFINITIONS

A. Ground water control system: system used to dewater and depressurize water-bearing soil layers.

1. Dewatering: lowering the water table and intercepting seepage that would otherwise emerge from slopes or bottoms of excavations, or into tunnels and shafts; and disposing of removed water. Intent of dewatering is to increase stability of tunnel excavations and excavated slopes, prevent dislocation of material from slopes or bottoms of excavations, reduce lateral loads on sheeting and bracing, improve excavating and hauling characteristics of excavated material, prevent failure or heaving of bottom of excavations, and to provide suitable conditions for placement of backfill materials and construction of structures and other installations.

2. Depressurization: includes reduction in piezometric pressure within strata not controlled by dewatering alone, necessary to prevent failure or heaving of excavation bottom or instability of tunnel excavations.

B. Excavation drainage: includes keeping excavations free of surface and seepage water.

C. Surface drainage: includes use of temporary drainage ditches and dikes and installation of temporary culverts and sump pumps with discharge lines necessary to protect Work from any source of surface water.

D. Monitoring facilities for ground water control system: includes piezometers, monitoring wells and flow meters for observing and recording flow rates.

1.05 PERFORMANCE REQUIREMENTS

A. Conduct subsurface investigations to identify groundwater conditions and to

provide parameters for design, installation, and operation of groundwater control systems. Submit proposed method and spacing of readings for review prior to obtaining water level readings.

B. Design ground water control system, compatible with requirements of Federal Regulations 29 CFR Part 1926 and Section 02260 - Trench Safety Systems, to produce following results:

1. Effectively reduce hydrostatic pressure affecting:

   a. Excavations

   b. Tunnel excavation, face stability or seepage into tunnels

2. Develop substantially dry and stable subgrade for subsequent construction operations

3. Preclude damage to adjacent properties, buildings, structures, utilities, installed facilities and other work

4. Prevent loss of fines, seepage, boils, quick condition, or softening of foundation strata

5. Maintain stability of sides and bottom of excavations

C. Provide ground water control systems that include single-stage or multiple-stage well point systems, eductor and ejector-type systems, deep wells, or combinations of these equipment types.

D. Provide drainage of seepage water and surface water, as well as water from other sources entering excavation. Excavation drainage may include placement of drainage materials, crushed stone and filter fabric, together with sump pumping.

E. Provide ditches, berms, pumps and other methods necessary to divert and drain surface water from excavation and other work areas.

F. Locate ground water control and drainage systems so as not to interfere with utilities, construction operations, adjacent properties, or adjacent water wells.

G. Assume sole responsibility for ground water control systems and for any loss or damage resulting from partial or complete failure of protective measures and settlement or resultant damage caused by ground water control operations. Modify ground water control systems or operations if they cause or threaten to cause damage to new construction, existing site improvements, adjacent property, adjacent water wells, or potentially contaminated areas. Repair damage caused by ground water control systems or resulting from

failure of system to protect property as required.

H. Install an adequate number of piezometers installed at proper locations and depths, necessary to provide meaningful observations of conditions affecting excavation, adjacent structures and water wells.

I. Install environmental monitoring wells at proper locations and depths necessary to provide adequate observations of hydrostatic conditions and possible contaminant transport from contamination sources into work area or ground water control system.

1.06 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittals Procedures.

B. Submit Ground Water and Surface Water Control Plan for review by Project Manager prior to start of excavation work. Include the following:

1. Results of subsurface investigations and description of extent and characteristics of water bearing layers subject to ground water control

2. Names of equipment Suppliers and installation Subcontractors

3. Description of proposed ground water control systems indicating arrangement, location, depth and capacities of system components, installation details and criteria and operation and maintenance procedures

4. Description of proposed monitoring facilities indicating depths and locations of piezometers and monitoring wells, monitoring installation details and criteria, type of equipment and instrumentation with pertinent data and characteristics

5. Description of proposed filters including types, sizes, capacities and manufacturer's application recommendations

6. Design calculations demonstrating adequacy of proposed systems for intended applications. Define potential area of influence of ground water control operation near contaminated areas.

7. Operating requirements, including piezometric control elevations for dewatering and depressurization

8. Excavation drainage methods including typical drainage layers, sump pump application and other means

9. Surface water control and drainage installations

10. Proposed methods and locations for disposing of removed water

C. Submit following records upon completion of initial installation:

1. Installation and development reports for well points, eductors, and deep wells

2. Installation reports and baseline readings for piezometers and monitoring wells

3. Baseline analytical test data of water from monitoring wells

4. Initial flow rates

D. Submit the following records weekly during control of ground and surface water operations:

1. Records of flow rates and piezometric elevations obtained during monitoring of dewatering and depressurization. Refer to Paragraph 3.02, Requirements for Eductor, Well Points, or Deep Wells.

2. Maintenance records for ground water control installations, piezometers and monitoring wells

1.07 ENVIRONMENTAL REQUIREMENTS

A. Comply with requirements of agencies having jurisdiction.

B. Comply with Texas Commission on Environmental Quality regulations and Texas Water Well Drillers Association for development, drilling, and abandonment of wells used in dewatering system.

C. Obtain necessary permits from agencies with jurisdiction over use of groundwater and matters affecting well installation, water discharge, and use of existing storm drains and natural water sources. Since review and permitting process may be lengthy, take early action to obtain required approvals.

D. Monitor ground water discharge for contamination while performing pumping in vicinity of potentially contaminated sites.

PART 2 P R O D U C T S

2.01 EQUIPMENT AND MATERIALS

A. Select equipment and materials necessary to achieve desired results for dewatering. Selected equipment and materials are subject to review by Project Manager through submittals required in Paragraph 1.06, Submittals.

B. Use experienced contractors, regularly engaged in ground water control system design, installation, and operation, to furnish and install and operate educators, well points, or deep wells, when needed

C. Maintain equipment in good repair and operating condition.

D. Keep sufficient standby equipment and materials available to ensure continuous operation, where required.

E. Portable Sediment Tank System: Standard 55-gallon steel or plastic drums, free of hazardous material contamination.

1. Shop or field fabricate tanks in series with main inlet pipe, inter-tank pipes and discharge pipes, using quantities sufficient to collect sediments from discharge water.

PART 3 EXECUTION

3.01 GROUND WATER CONTROL

A. Perform necessary subsurface investigation to identify water bearing layers, piezometric pressures and soil parameters for design and installation of ground water control systems. Perform pump tests, if necessary to determine draw down characteristics. Present results in the Ground Water and Surface Water Control Plan. submittal

B. Provide labor, material, equipment, techniques and methods to lower, control and handle ground water in manner compatible with construction methods and site conditions. Monitor effectiveness of installed system and its effect on adjacent property.

C. Install, operate, and maintain ground water control systems in accordance with the Ground Water and Surface Water Control Plan. Notify Project Manager in writing of changes made to accommodate field conditions and changes to Work. Provide revised drawings and calculations with notification.

D. Provide continuous system operation, including nights, weekends, and holidays. Arrange appropriate backup if electrical power is primary energy source for dewatering system.

E. Monitor operations to verify systems lower ground water piezometric levels at rate required to maintain dry excavation resulting in stable subgrade for

subsequent construction operations.

F. Depressurize zones where hydrostatic pressures in confined water bearing layers exist below excavations to eliminate risk of uplift or other instability of excavation or installed works. Define allowable piezometric elevations in the Ground Water and Surface Water Control Plan.

G. Removal of ground water control installations.

1. Remove pumping system components and piping when ground water control is no longer required.

2. Remove piezometers, including piezometers installed during design phase investigations and left for Contractor's use, upon completion of testing, as required in accordance with Part 3 of applicable specification.

3. Remove monitoring wells when directed by Project Manager.

4. Grout abandoned well and piezometer holes. Fill piping that is not removed with cement-bentonite grout or cement-sand grout.

H. During backfilling, maintain water level a minimum of 5 feet below prevailing level of backfill. Do not allow the water level to cause uplift pressures in excess of 80 percent of downward pressure produced by weight of structure or backfill in place. Do not allow water levels to rise into cement-stabilized sand until at least 48 hour after placement.

I. Provide uniform pipe diameter for each pipe drain run constructed for dewatering. Remove pipe drains when no longer required. If pipe removal is impractical, grout connections at 50-foot intervals and fill pipe with cement-bentonite grout or cement-sand grout after removal from service.

J. The extent of ground water control for structures with permanent perforated underground drainage systems may be reduced, for units designed to withstand hydrostatic uplift pressure. Provide a means to drain affected portions of underground systems, including standby equipment. Maintain drainage systems during construction operations.

K. Remove systems upon completion of construction or when dewatering and control of surface or ground water is no longer required.

L. Compact backfill to not less than 95 percent of maximum dry density in accordance with ASTM D 698.

M. Foundation Slab: Maintain saturation line at least 3 feet below lowest elevations where concrete is to be placed. Drain foundations in areas where

concrete is to be placed before placing reinforcing steel. Keep free from water for 3 days after concrete is placed.

3.02 REQUIREMENTS FOR EDUCTOR, WELL POINTS, OR DEEP WELLS

A. For aboveground piping in ground water control system, include a 12-inch minimum length of clear, transparent piping between each eductor well or well point and discharge header to allow visual monitoring of discharge from each installation.

B. Install sufficient piezometers or monitoring wells to show that trench or shaft excavations in water bearing materials are pre-drained prior to excavation. Provide separate piezometers for monitoring of dewatering and for monitoring of depressurization. Install piezometers and monitoring wells for tunneling as appropriate for selected method of work.

C. Install piezometers or monitoring wells at least one week in advance of the start of associated excavation.

D. Dewatering may be omitted for portions of under drains or other excavations, where auger borings and piezometers or monitoring wells show that soil is pre-drained by existing systems and that ground water control plan criteria are satisfied.

E. Replace installations that produce noticeable amounts of sediments after development.

F. Provide additional ground water control installations, or change method of control if, ground water control plan does not provide satisfactory results based on performance criteria defined by plan and by specifications. Submit revised plan according to Paragraph 1.06B.

3.03 SEDIMENT TRAPS

A. Install sediment tank as shown on approved plan.

B. Inspect daily and clean out tank when one-third of sediment tank is filled with sediment.

3.04 SEDIMENT SUMP PIT

A. Install sediment sump pits as shown on approved plan.

B. Construct standpipe by perforating 12 inch to 24-inch diameter corrugated metal or PVC pipe.

C. Extend standpipe 12 inches to 18 inches above lip of pit.

D. Convey discharge of water pumped from standpipe to sediment trapping device.

E. Fill sites of sump pits, compact to density of surrounding soil and stabilize surface when construction is complete.

3.05 EXCAVATION DRAINAGE

A. Use excavation drainage methods if well-drained conditions can be achieved. Excavation drainage may consist of layers of crushed stone and filter fabric, and sump pumping, in combination with sufficient ground water control wells to maintain stable excavation and backfill conditions.

3.06 MAINTENANCE AND OBSERVATION

A. Conduct daily maintenance and observation of piezometers or monitoring wells while ground water control installations or excavation drainage is operating at the site, or water is seeping into tunnels, and maintain systems in good operating condition.

B. Replace damaged and destroyed piezometers or monitoring wells with new piezometers or wells as necessary to meet observation schedules.

C. Cut off piezometers or monitoring wells in excavation areas where piping is exposed, only as necessary to perform observation as excavation proceeds. Continue to maintain and make specified observations

D. Remove and grout piezometers inside or outside of excavation area when ground water control operations are complete. Remove and grout monitoring wells when directed by Project Manager.

3.07 MONITORING AND RECORDING

A. Monitor and record average flow rate of operation for each deep well, or for each wellpoint or eductor header used in dewatering system. Also, monitor and record water level and ground water recovery. Record observations daily until steady conditions are achieved and twice weekly thereafter.

B. Observe and record elevation of water level daily as long as ground water control system is in operation, and weekly thereafter until Work is completed or piezometers or wells are removed, except when Project Manager determines more frequent monitoring and recording are required. Comply with Project Manager's direction for increased monitoring and recording and

take measures necessary to ensure effective dewatering for intended purpose.

3.08 SURFACE WATER CONTROL

A. Intercept surface water and divert it away from excavations through use of dikes, ditches, curb walls, pipes, sumps or other approved means. Requirement includes temporary works required to protect adjoining properties from surface drainage caused by construction operations.

B. Divert surface water and seepage water into sumps and pump it into drainage channels or storm drains, when approved by agencies having jurisdiction. Provide settling basins when required by agencies.

END OF SECTION

Section 01580

PROJECT IDENTIFICATION SIGNS

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Project identification sign description.

B. Project sign installation.

C. Maintenance and removal of Project sign.

1.02 SYSTEM DESCRIPTION

A. Sign Construction: Construct signs of new materials in accordance with Standard Detail provided at the Pre-construction Conference.

B. Appearance: Maintain signs to present a clean and neat look throughout contract duration.

C. Sign Manufacturer: Experienced professional sign company.

D. Sign Placement: At locations shown in Drawings unless otherwise specified by Project Manager at pre-construction meeting.

1. Provide one sign at each end of a linear Project involving paving, overlay, sewer line, storm drainage, or water main construction located in rights-of-ways.

2. Provide one sign for site or building construction Contracts

3. Provide one sign at each site for Contracts with multiple sites.

4. Sign Relocation: As work progresses, relocate signs if directed by Project Manager in writing. Include cost for one relocation of post-mounted signs in Contract Price. Subsequent relocations, if directed by Project Manager in writing, will be subject to Change Order.

E. Skid-mounted signs: Use for projects with noncontiguous locations where work progresses from one location to another. Design skid structure to withstand a 60 mile-per-hour wind load to the face or back of sign using stakes, straps, or ballast. Contractor shall be responsible for security of signs at each site.

1.03 SUBMITTALS

A. Submit Shop Drawings under provisions of Section 01330 - Submittal procedures.

B. Show content, layout, lettering style, lettering size, and colors. Make sign and lettering to scale, clearly indicating condensed lettering, if used.

PART 2 P R O D U C T S

2.01 SIGN MATERIALS

A. Structure and Framing: Use new sign materials.

1. Sign Posts: 4-inch by 4-inch pressure treated wood posts, 9 feet long for skid mounting and 12 feet long minimum for in-ground mounting.

2. Skid Bracing: 2-inch by 4-inch wood framing material.

3. Skid Members: 2-inch by 6-inch wood framing material.

4. Fasteners:
   a. Galvanized steel.
   b. Attach sign to posts with 1/2-inch by 5-1/2 inch button head carriage bolts and secure with nuts and flat head washers.
   c. Cover button heads with white reflective film or paint to match sign background.
   d. Use metal brackets and braces and 3/4-inch wood screws to attach sign header.

B. Sign and Sign Header: 3/4-inch thick marine plywood. Use 4-foot by 8 -foot sheet for the sign and a single piece for the header to minimize joints. Do not piece wood sheets to fabricate sign face.

C. Paint and Primers: White industrial grade, fast-drying, oil-based paint with gloss finish for structural and framing members, sign, and sign header material surfaces. Paint all sign surfaces prior to adding adhesive applications.

D. Colors:

1. Sign Background: Reflective white 3M Scotchlite Engineer Grade, Pressure Sensitive Sheeting (White), or approved equal.

2. Border: For red border around area, which designates project name and project amount, use reflective red 3M Scotchlite Engineer Grade, Pressure Sensitive Sheeting (Red), or approved equal.

3. Sign Film: 3M Scotchcal Pressure Sensitive Films, or approved equal for legends, symbols, lettering, and artwork. Match colors to 3M Scotchcal Pressure Sensitive Films.

a.	Lettering Below Seal:	Black
b.	Lettering Above Project Name:	Vivid Blue
c.	Lettering on Blue Background:	White
d.	Background Behind Project Name:	Vivid Blue

E. City Seal: Project Manager will provide City seals to Contractor, as needed.

2.02 SIGN LAYOUT

A. Lettering:

1. Style, Size, and Spacing: Helvetica Regular lettering.

2. Condensed Style: Text may be condensed if needed to maintain sign composition.

B. Composition:

1. Lines with Standard Text
   a. Top line shall read "BUILDING TOGETHER FOR THE FUTURE".
   b. Use lower left below City Seal to list names and titles for Mayor, Controller and Council Members. Place as shown on Drawings with indicated size and spacing.
   c. Center telephone number of the Customer Response Center, "311", near the bottom of the area with the blue background.

2. Lines with Variable Text. Use blue background space for Project name and dollar amount.
   a. Project Manager will provide Project name and dollar amount of Project for preparation of sign. Center name on one or two lines, and dollar amount immediately below Project name, in area with blue background. Use condensed lettering if necessary.

2.03 LAYOUT AND COMPOSITION FOR HEADER

A. City of Houston Seal:
   1. A space of approximately 24 inches in diameter is provided for the City seal, the top 6 inches of which extends above the sign on the sign header.

   2. Construct sign header of same material as sign face. Cut material to match curve of the City seal.

   3. Project Manager will provide the seal to be affixed to the sign by sign maker.

PART 3 E X E C U T I O N

3.01 INSTALLATION

A. Install Project identification signs within seven days after Date of Commencement of the Work.

B. Erect signs at locations shown in Drawings unless otherwise designated by Project Manager at pre-construction meeting. Position sign so it is fully visible and readable to general public.

C. Erect sign level and plumb.

D. If mounted on posts, sink posts 3 to 4 feet below grade and stabilize posts to minimize lateral motion. Leave a minimum of 8 feet of post above existing grade for mounting of sign.

E. Erect sign so that top edge of sign is at a nominal 8 feet above existing grade.

3.02 MAINTENANCE AND REMOVAL

A. Keep signs and supports clean. Repair deterioration and damage.

B. Remove signs, framing, supports, and foundations to a depth of at least 2 feet upon completion of Project. Restore area to a condition equal to or better than before construction.

PROJECT No.: (FILE NO:)	CONTRACT No.:	REVIEWED BY:

*INSTRUCTIONS TO SIGN MAKER (LIST COMPANY NAME):		
QTY.	**ACTION ITEMS:**	
	Make new sign(s)	
	Follow City standards attached	
	Provide submittal (drawing) to the City for project sign showing content, layout, lettering style, lettering size, and colors	
VARIABLE TEXT		
Line 1	Project Name:	
Line 2	Project Amount (rounded to nearest $1000):	
ATTACHMENTS INCLUDED		
QTY.	**SEALS / LOGOS**	
	City of Houston - 24" diameter	
	STANDARDS	
	Standard Specification Section 01580 - Project Identification Signs	
	Standard Detail 01580-03 Construction Sign	

(Instructions on reverse.)

INSTRUCTIONS

Contractor produces this form. Contractor shall insert the information and provide the form to the sign maker with Contractor's purchase order.

List PROJECT No., (FILE No.), CONTRACT No., and name of City's Project Manager REVIEWED BY.

INSTRUCTIONS TO SIGN MAKER:

- Give COMPANY NAME of sign maker.
- Indicate QUANTITY of new signs to be made.
- Direction for sign maker to follow City Standards in making signs.
- Require submittals from sign maker, who provides Shop Drawing of Project sign showing content, layout, lettering style, lettering size, and colors.

VARIABLE TEXT:

- Give PROJECT NAME. Write it out in all caps and suggest line break. Lines are required.
- Give Project amount to be listed on sign. Round off to nearest $1000.

ATTACHMENTS INCLUDED:

- **Seals**

  City provides the quantity of City seals required one for each Project sign.

- **Standards**

  Contractor provides set of Standards to sign maker, including (Specification Section 01580 - Project Identification Signs, and Standard Detail No. 01580-03 - Construction Sign.

Section 01581

EXCAVATION IN PUBLIC WAY PERMIT SIGNS

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Project sign installation.

B. Maintenance and removal of Project sign.

1.02 SYSTEM DESCRIPTION

A. Sign Construction: Construct signs of new materials.

B. Appearance: Maintain signs to present a clean and neat look throughout the Contract duration.

C. Sign Placement: Place signs at each street entrance to street cut excavation.

1.03 SUBMITTALS

A. Submit Shop Drawings under provisions of Section 01330 - Submittal Procedures.

B. Show content, layout, lettering style, lettering size and colors. Make sign and lettering to scale, clearly indicating condensed lettering, if used.

PART 2 P R O D U C T S

2.01 SIGN LAYOUT

A. Conform to Texas Manual on Uniform Traffic Control Devices. Minimum size: 36 inches by 36 inches.

B. Lettering: Uppercase Helvetica Regular lettering.

C. Composition: Include on sign copy of street cut permit, title "City of Houston", contracting department's name, address, and emergency telephone number and Contractor's name. Project Manager will provide department name, address, and emergency telephone number for preparation of sign.

PART 3 EXECUTION

3.01 INSTALLATION

A. Install Project signs before commencement of pavement excavation in Public Way.

B. Position sign so it is fully visible and readable to general public.

C. Erect sign level and plumb.

D. Erect sign so that top edge of sign is at a nominal 8 feet above existing grade.

3.02 MAINTENANCE AND REMOVAL

A. Keep signs and supports clean. Repair deterioration and damage.

B. Remove signs, framing, supports and foundations to depth of at least 2 feet upon completion of the Work. Restore area to condition equal to or better than before construction.

END OF SECTION

Section 01610

BASIC PRODUCT REQUIREMENTS

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Requirements for transportation, delivery, handling, and storage of Products.

1.02 PRODUCTS

A. Products: Defined in Document 00700 – General Conditions. Does not include machinery and equipment used for preparation, fabrication, conveying and erection of the Work. Products may also include existing materials or components designated for reuse.

B. For material and equipment specifically indicated or specified to be reused in the work:

1. Use special care in removal, handling, storage and reinstallation, to assure proper function in completed work.

2. Arrange for transportation, storage and handling of products which require off-site storage, restoration or renovation. Include cost in unit price for related items.

C. When contract documents require that installation of work comply with manufacturer's printed Instructions, obtain and distribute copies of such instructions to parties involved in installation, including two copies to Project Manager. Maintain one set of complete instructions at job site during installation until completion.

D. Provide Products from the fewest number of manufacturers as practical, in order to simplify spare parts inventory and to allow for maximum interchangeability of components. For multiple components of the same size, type or application, use the same make and model of component throughout the Work.

1.03 TRANSPORTATION

A. Make arrangements for transportation, delivery, and handling of Products required for timely completion of the Work.

B. Transport and handle Products in accordance with manufacturer's instructions.

C. Consign and address shipping documents to proper party giving name of the Project and its complete street address. Shipments shall be delivered to

Contractor.

1.04 DELIVERY

A. Arrange deliveries of Products to accommodate short-term site completion schedules and in ample time to facilitate inspection prior to Installation. Avoid deliveries that cause lengthy storage or overburden of limit storage space.

B. Coordinate deliveries to avoid conflict with the Work and conditions at the site and to accommodate the following:

1. Work of other contractors or the City.

2. Limitations of storage space.

3. Availability of equipment and personnel for handling Products.

4. The City's use of premises.

C. Have Products delivered to the site in manufacturer's original, unopened, labeled containers.

D. Immediately upon delivery, inspect shipment to assure:

1. Product complies with requirements of the Contract.

2. Quantities are correct.

3. Containers and packages are intact; labels are legible.

4. Products are properly protected and undamaged.

1.05 PRODUCT HANDLING

A. Coordinate off-loading of Products delivered to the site. If necessary during construction, move and relocate stored Products at no additional cost to the City.

B. Provide equipment and personnel necessary to handle Products, including those provided by the City, by methods to prevent damage to Products or packaging.

C. Provide additional protection during handling as necessary to prevent breaking, scraping, marring, or otherwise damaging Products or surrounding areas.

D. Handle Products by methods to prevent over-bending or overstressing.

E. Lift heavy components only at designated lifting points.

F. Handle Products in accordance with manufacturer's recommendations.

G. Do not drop, roll, or skid Products off delivery vehicles. Hand-carry or use Suitable materials handling equipment.

1.06 STORAGAE OF PRODUCTS

A. Store and protect Products in accordance with manufacturer's recommendations and requirements of these Specifications.

B. Make necessary provisions for safe storage of Products. Place Products so as to prevent damage to any part of the Work or existing facilities and to maintain free access at all times to all parts of the Work and to utility service company installations in the vicinity of the Work. Keep Products neatly and compactly stored in locations that will cause minimum inconvenience to other contractors, public travel, adjoining owners, tenants, and occupants. Arrange storage in a manner so as to provide easy access for inspection.

C. Restrict storage to areas available on the site for storage of Products as shown on Drawings or approved by Project Manager.

D. Provide off-site storage and protection when on-site storage is not adequate. Provide addresses of, and access to, off-site storage locations for inspection by Project Manager.

E. Do not use lawns, grass plots, or other private property for storage purposes without written permission of owner or other person in possession or control of premises.

F. Protect stored Products against loss or damage.

G. Store in manufacturers' unopened containers.

H. Neatly, safely, and compactly stack Products delivered and stored along the line of the Work to avoid inconvenience and damage to property owners and general public, and maintain at least 3 feet clearance around fire hydrants. Keep public, private driveways and street crossings open.

I. Repair or replace damaged lawns, sidewalks, streets or other improvements to satisfaction of Project Manager. Total length that Products may be distributed along route of construction at one time is 1000 linear feet, unless otherwise approved in writing by Project Manager.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01630

PRODUCT SUBSTITUTION PROCEDURES

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Options for making Product or process selections.

B. Procedures for proposing equivalent Products or processes, including pre-approved, pre-qualified, and approved Products or processes.

1.02 DEFINITIONS

A. Product: As defined in Document 00700 – General Conditions. Product does not include machinery and equipment used for production, fabrication, conveying, and erection of the Work. Products may also include existing materials or components designated for reuse.

B. Process: Any proprietary system or method for installing system components resulting in an integral, functioning part of the Work. For this Section, the word Products includes Processes.

1.03 SELECTION OPTIONS

A. Pre-approved Products: Construction products of certain manufacturers or Suppliers designated in Specifications as "pre-approved." The City maintains a list of pre-approved products. Pre-approved Products for this Project are designated as pre-approved in Specifications. Products of other manufacturers or suppliers are not acceptable for this Project and will not be considered under the submittal process for approving alternate products.

B. Pre-qualified Products: Construction products of certain manufacturers or Suppliers designated in Specifications as "pre-qualified." Pre-qualified Products for this Project are designated as pre-qualified in Specifications. Products of other manufacturers or suppliers are not acceptable for this Project and will not be considered under the submittal process for approving alternate products.

C. Approved Products: Construction products of certain manufacturers or Suppliers designated in Specifications followed by words "or approved equal." Approval of alternate products not listed in Specifications may be obtained through provisions for product options and substitutions in Document 00700 - General Conditions, and by following submittal procedures specified in

Section 01330- Submittal Procedures. The procedure for approval of alternate products is not applicable to pre-approved or pre-qualified products.

D. Product Compatibility: To the maximum extent possible, provide Products that are of the same type or function from a single manufacturer, make, or source. Where more than one choice is available, select Product that is compatible with other Products already selected, specified, or in use by the City.

1.04 CONTRACTOR'S RESPONSIBILITY

A. Responsibility related to Product options and substitutions is defined in Document 00700 - General Conditions.

B. Furnish information Project Manager deems necessary to judge equivalency of alternate Product.

C. Pay for laboratory testing, as well as any other review or examination costs, needed to establish equivalency between products in order to obtain information upon which Project Manager can base a decision.

D. If Project Manager determines alternate product is not equal to that named in Specifications, Furnish one of the specified Products.

1.05 CITY REVIEW

A. Use alternate Products only when approved in writing by Project Manager. Project Manager's determination regarding acceptance of proposed alternate Product is final.

B. Alternate Products shall be accepted if Products are judged by Project Manager to be equivalent to specified Product or to offer substantial benefit to the City.

C. The City retains the right to accept any Product deemed advantageous to the City, and similarly, to reject any product deemed not beneficial to City.

1.06 SUBSTITUTION PROCEDURE

A. Collect and assemble technical information applicable to the proposed Product to aid in determining equivalency as related to the approved Product specified.

B. Submit a written request for a construction Product to be considered as an alternate Product.

C. Submit Product information after the effective date of the Contract and within the time period allowed for substitution submittals given in Document 00700 - General Conditions. After the submittal period has expired, requests for alternate Products shall be considered only when specified Product becomes unavailable because of conditions beyond Contractor's control.

D. Submit five copies of each request for alternate Product approval. Include the following information:

1. Complete data substantiating compliance of proposed substitution with the Contract.

2. For Products:
   a. Product identification, including manufacturer's name and address.
   b. Manufacturer's literature with Product description, performance and test data, and reference standards.
   c. Samples, as applicable.
   d. Name and address of similar projects on which Product was used and date of installation. Include names of Owner, design consultant, and installing contractor.

3. For construction methods:
   a. Detailed description of proposed method.
   b. Drawings illustrating methods.

4. Itemized comparison of proposed substitution with Product or method specified.

5. Data relating to changes in Construction Schedule.

6. Relation to separate contracts, if any.

7. Accurate cost data on proposed substitution in comparison with Product or method specified.

8. Other information requested by Project Manager.

E. Approved alternate Products will be subject to the same review process as the specified Product would have been for Shop Drawings, Product Data, and Samples.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01725

FIELD SURVEYING

PART 1 GENERAL

1.01 QUALITY CONTROL

A. Conform to State of Texas laws for surveys requiring licensed surveyors. Employ a surveyor acceptable to Project Manager if required by the Contract.

1.02 MEASUREMENT AND PAYMENT

A. UNIT PRICES

1. No separate payment will be made for field surveying. Include cost in unit price for related items.

1.03 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Submit name, address, and telephone number of Surveyor to Project Manager before starting survey work.

C. Submit documentation verifying accuracy of survey work on request.

D. Submit certificate signed by Surveyor, that elevations and locations of the Work are in conformance with the Contract.

1.04 PROJECT RECORD DOCUMENTS

A. Maintain a complete and accurate log of control and survey work as it progresses.

B. Prepare a certified survey setting forth dimensions, locations, angles, and elevations of construction and site work upon completion of foundation walls and major site improvements.

C. Submit record documents under provisions of Section 01785 - Project Record Documents.

1.05 EXAMINATION

A. Verify locations of survey control points prior to starting the Work.

B. Notify Project Manager immediately if any discrepancies are discovered.

1.06 SURVEY REFERENCE POINTS

A. The City will establish survey control datum as provided in Document 00700 - General Conditions and as indicated on Drawings. Inform Project Manager in Advance of time horizontal and vertical control points will be established so

verification deemed necessary by Project Manager may be done with minimum inconvenience to the City or Contractor.

B. Locate and protect survey control points prior to starting site work; preserve permanent reference points during construction.

C. Notify Project Manager a minimum of 48 hours before relocation of reference points is needed due to changes in grades or other reasons.

D. Promptly report loss or destruction of reference points to Project Manager.

E. Reimburse the City for cost of reestablishment of permanent reference points disturbed by construction operations.

1.07 SURVEY REQUIREMENTS

A. Utilize recognized engineering survey practices.

B. Establish a minimum of two permanent benchmarks on site, referenced to established control points. Record horizontal and vertical location data on Project record documents.

C. Establish elevations, lines and levels to provide quantities required for measurement and payment and for appropriate controls for the Work. Locate and lay out the following with appropriate instruments:

1. Site improvements including grading, fill and topsoil placement, utilities, and footings and slabs

2. Grid or axis for structures

3. Building foundation, column locations, and ground floor elevations

D. Periodically verify layouts.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01731

CUTTING AND PATCHING

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Cutting, patching and fitting of the Work or work under construction. Coordinating Installation or connection of the Work to existing facilities, or uncovering work for access, inspection or testing and related submittals.

1.02 MEASUREMENT AND PAYMENT

A. UNIT PRICES

1. No separate payment will be made for cutting and patching. Include cost in unit price for related items.

1.03 CUTTING AND PATCHING

A. Perform activities to avoid interference with facility operations and work of others in accordance with Document 00700 - General Conditions of Contract.

B. Execute cutting and patching, including excavation, backfill and fitting to:

1. Remove and replace defective work or work not conforming to Drawings and Specifications;

2. Take samples of installed work as required for testing;

3. Remove construction required to provide for specified alterations or additions to existing work;

4. Uncover work to allow inspection or reinspection by Project Manager or regulatory agencies having jurisdiction;

5. Connect uninstalled work to completed work in proper sequence;

6. Remove or relocate existing utilities and pipes that obstruct work;

7. Make connections or alterations to existing or new facilities;

8. Provide openings, channels, chases and flues and cut, patch, and finish; if required; or

9. Provide protection for other portions of the Work.

C. Restore existing work to a condition equal to or better than that which existed Prior to cutting and patching, and to standards required by Specifications.

D. Support, anchor, attach, match, trim and seal materials to work of others. Unless otherwise specified, Furnish and Install sleeves, inserts, and hangers required for execution of the Work.

E. Provide shoring, bracing and support necessary to maintain structural integrity and to protect adjacent work from damage during cutting and patching. Request written approval from Project Manager, before cutting structural members such as beams, anchors, lintels, or other supports. Follow approved submittals, as applicable.

F. Match new materials to existing materials by bonding, lapping, mechanically tying, anchoring or other effective means in order to prevent cracks and to minimize evidence of patching. Conceal effects of demolition and patching by blending new construction to existing surfaces. Avoid obvious breaks, joints or changes of surface appearance unless shown on Drawings or authorized by Project Manager.

1.04 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Submit a written request to Project Manager for consent to proceed, before conducting cutting operations that might affect structural integrity, design function, City operations, or work of another contractor.

C. Include the following in submittal:

1. Identification of Project

2. Description of affected work

3. Necessity for cutting

4. Effect on other work and on structural integrity

5. Describe the proposed work including:
   a. Scope of cutting and patching
   b. Contractor, Subcontractor or Supplier who will execute the work
   c. Proposed Products
   d. Extent of refinishing
   e. Schedule of operations

6. Alternatives to cutting and patching

D. When work conditions or schedules dictate the need for change of materials or methods, submit a written recommendation to Project Manager that includes:

1. conditions necessitating the change;

2. recommendations for alternative materials or methods; and

3. submittals required for proposed substitutions

E. Notify Project Manager in writing when work will be uncovered for observation. Do not begin cutting or patching operations until authorized by Project Manager.

1.05 CONNECTIONS TO EXISTING FACILITIES

A. Perform construction operations necessary to complete connections and tie-ins to existing facilities. Keep existing facilities in continuous operation unless otherwise permitted in the Specifications or approved in writing by Project Manager.

B. Coordinate interruption of service requiring connection to existing facilities with Project Manager. Do not bypass wastewater or sludge to waterways. Provide temporary pumping facilities to handle wastewater if necessary. Use temporary bulkheads to minimize disruption. Provide temporary power and piping to facilitate construction where necessary.

C. Submit a detailed schedule of proposed connections, including shut-downs and tie-ins. Include proposed time and date as well as anticipated duration of work. Coordinate the connection schedule with the construction schedule.

1. Submit specific times and dates to Project Manager at least 48 hours in advance of proposed work.

D. Procedures and Operations:

1. Operate existing pumps, valves and gates in required sequence under supervision of Project Manager. Do not operate valves, gates or other items of equipment without Project Manager's knowledge.

2. If possible, test equipment under operating conditions before making final tie-ins to connect equipment to existing facility.

3. Coordinate work and schedules. Notify Project Manger at least 48 Hours before shutdowns or bypasses are required.

PART 2 P R O D U C T S Not Used

PART 3 E X E C U T I O N Not Used

END OF SECTION

Section 01732

PROCEDURE FOR WATER VALVE ASSISTANCE

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Operation of valves. City of Houston employees will operate existing valves. Contractor's employees may operate new valves included in the Project prior to acceptance by the City.

1.02 PROCEDURE

A. Perform activities listed in Exhibit A attached to this Section.

1.03 SUBMITTALS

A. Submit request for work order planning meetings in accordance with Exhibit A. Include information listed in Step 1 of Exhibit A, attached to this Section.

1.04 CANCELLATION

A. Contractor, Project Manager, or Public Utilities Division may cancel a scheduled valve assistance appointment at no extra cost or payment to Contractor. Contractor shall notify City's appointed Project Inspector ("Inspector") 24 hours in advance of cancellation. Inspector shall notify Central Operation Service (COS) immediately upon receipt of cancellation notice. Cancellation may be caused by bad weather, preparation work taking longer than anticipated, or unforeseen delays by one or more of the three parties.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

PAGE LEFT INTENTIONALLY BLANK

EXHIBIT A

PROCEDURE FOR VALVE ASSISTANCE

The following procedure will be used by Utility Maintenance Branch personnel when completing a service request from individual Contractors, through Inspector, for operation of existing water valves.

ROUTINE VALVE ASSISTANCE REQUEST (NON-EMERGENCY JOBS):

Step 1. a. When notified by Contractor, Inspector will schedule a work order planning meeting by calling Central Operation Service (COS) at **(713) 295-5521** and providing information shown below. The work order planning meeting shall be conducted a minimum of three days after the request; excluding weekends, holidays, inclement weather days, and the day of the call.

Location of Work (Street Intersection)	Project #
Project Description	Contractor (Company Name)
Job Superintendent's Name	Superintendent's Office #/Mobile #/Pager #
Contractor's Emergency Information	Name and Phone #/Mobile #/Pager #
Inspector/Senior Inspector	Name, Phone #/Mobile #/Pager #
Date & Time assistance is requested	

b. COS will create a work order for each wet connection, cut and plug, etc. that will be designated as a "Code 40" (Private Contractor).

c. COS will give Inspector the work order number. This work order number must be used as a reference in all communications regarding this request for Valve Assistance.

d. Valve personnel must have the work order number on their route sheet. When valve personnel arrive at the job site for the Work Order Planning Meeting between Inspector, Contractor, and Utility Maintenance valve personnel, they will verify the street intersection and work order number with the Inspector before beginning Work Order Planning Meeting.

e. During Work Order Planning Meeting, the work to be performed will be outlined and the actual date work will be performed will be mutually determined by Inspector, Contractor and City's Utility Maintenance Division valve personnel, based upon relevant factors such as preparatory work needed, customer requirements, etc.

f. Valve personnel will perform work specifically outlined in the work order requested. Also, Utility Maintenance Branch valve personnel will only operate existing water valves. Inspector must contact COS and request a new work order for additional work.

g. Valve personnel will contact the dispatcher and advise when the job is complete. Valve personnel will list all appropriate information on the Crew Activity Report.

Step 2. Should valve personnel not be able to keep an appointment to provide valve assistance, Utility Maintenance Branch will provide notification to appropriate Inspector by phone at least 24 hours prior, with that fact and rescheduling information, if available.

Step 3. Inspector will notify COS if valve personnel have not arrived at the site within 30 minutes of scheduled appointment. If Contractor is not ready when valve operator arrives to provide valve assistance, the City shall charge Contractor $50.00 per hour, starting 15 minutes after the scheduled appointment time, minimum one hour charge.

Step 4. Contractor will not be due delay claims or downtime if Utility Maintenance Branch has notified Inspector that they will not be able to provide valve assistance as scheduled.

Step 5. Test installed new valves in the presence of Inspector before substantial completion inspection is scheduled. Place new valves in open position on or before the Date of Substantial Completion.

Step 6. Project Manager will notify, in writing, Utility Maintenance Branch two months before the warranty expires to report any problems they have with new water lines. Project Manager will notify Contractor about these problems.

EMERGENCY REQUEST FOR VALVE ASSISTANCE PROCEDURE:

Step 1. When notified by Contractor, Inspector will request emergency Valve Assistance due to a broken line/service, etc. by calling COS at **(713) 295-5521** and providing the following information:

Location of Work (Street Intersection)	Project #
Project Description	Superintendent's Office #/Mobile #/Pager #
Contractor (Company Name)	Name and Phone #/Mobile #/Pager #
Job Superintendent's Name	Name, Phone #/Mobile #/Pager #
Contractor's Emergency Information	
Inspector/Senior Inspector	
Date & Time assistance is requested	

Step 2. COS will create an emergency work order number and describe the work to be performed.

Step 3. COS will give Inspector the emergency work order number. Reference work order number in all communications regarding request for Valve Assistance.

Step 4. COS will contact designated valve personnel and assign emergency work order. Dispatcher will follow standard COS procedures if this situation occurs after normal working hours.

Step 5. Valve personnel must have the emergency work order number on the route sheet. When valve personnel arrive at the job site for emergency work, they will verify the street intersection and emergency work order number with Inspector prior to beginning work requested for operating existing water valves. Valve personnel will coordinate verification of street intersection and work order number with Inspector prior to performing work.

Section 01740

SITE RESTORATION

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Restoration of site affected by the Work in public or private property, including pavement, esplanades, sidewalks, driveways, fences, lawns and landscaping.

1.02 MEASUREMENT AND PAYMENT

A. Unit Prices.

1. Payment for restoration of Project site disturbed by utility construction operations is on a linear foot basis. Measurement will be as provided for corresponding utility in each Specification section. No separate payment made for branch pipe, valves and, other associated work for utilities. Measurement for restoration with multiple utilities within the same right-of-way will be on a linear foot basis for only one utility.

2. No separate payment made for facility or roadway projects. Include cost in the surface improvements associated with the facility or roadway construction.

3. Payment includes required site restoration within the right-of-way or easement regardless of size or type of pipe, method of construction, paved or unpaved areas or thickness and width of pavement.

4. No separate payment made for site restoration for service connections under this Section. Include cost in appropriate utility section.

5. Refer to Section 01270 – Measurement and Payment for Unit Price procedures.

B. Stipulated Price (Lump Sum) Contracts. If Contract is Stipulated Price Contract, include payment for work under this section in total Stipulated Price.

1.03 DEFINITIONS

A. Phase: Locations identified on the plans and listed in Section 1110 – Summary of Work under Work Sequence.

B. Site Restoration: Replacement or reconstruction of Site Improvements located in rights-of-way, easements, public property, and private property affected or altered by the Work.

C. Site Improvement: Includes pavement, curbs and gutters, esplanades, sidewalks, driveways, fences, lawns, irrigation systems, landscaping, and other improvements in existence at the Project site before commencement of construction operations.

1.04 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Schedule of testing, service connections, abandonment, backfill, and site restoration.

C. Sample of notices to residents outlining their responsibility for maintenance of site improvements adjacent to the Project that are not disturbed by construction operations

1.05 SCHEDULING

A. Schedule testing, service connections, abandonment, backfill and site restoration immediately following completion of pipe laying work or paving within each block or line segment.

B. Phased Construction:

1. Commencement of subsequent Phase will follow scheduling of site restoration of prior Phase. Limit work to a maximum of two Phases of the project.

C. Construction of Projects with no Phases listed in Section 01110- Summary of Work:

1. Complete site restoration prior to disturbing over 50% of total project linear feet or 2,000 linear feet, whichever is greater, of right-of-way or easement.

2. Limit work to a maximum of 50% of total project linear feet or 2,000 linear feet, whichever is greater, of right-of-way and easement. Commence work in additional right-of-way or easement after completion of site restoration.

PART 2 PRODUCTS

2.01 MATERIALS

A. Pavement, Sidewalks and Driveways: Materials specified in Section 02951 - Pavement Repair and Resurfacing.

B. Seeding and Sodding: Sod specified in Section 02922 - Sodding and Seed specified in Section 02921 - Hydromulch Seeding.

C. Trees, Shrubs and Plantings: Conform to requirements of Section 01562 – Tree and Plant Protection.

PART 3 EXECUTION

3.01 Preparatory Work

A. Provide cleanup and restoration crews to work closely behind pipe laying and roadway construction crews, and where necessary, during testing, service restoration, abandonment, backfill and surface restoration.

B. Water Lines: Unless otherwise approved by Project Manager, comply with the following:

1. Once Project Manager approves work within a Phase, immediately begin preparatory work for disinfection effort.

2. No later than three days after completing disinfection preparatory work, submit to City appropriate request for disinfection.

3. If City fails to perform initial disinfection of lines in accordance with Section 2514 - Disinfection of Water Lines, within seven days from submission of appropriate request, and if approved by Project Manager, pipe laying operations may continue beyond approved limits until the City responds.

4. Immediately after transfer of services, begin abandonment of old water lines and site restoration.

C. Wastewater Lines:

1. Once Project Manager approves work within a Line Segment, immediately begin preparatory work for testing effort.

2. No later than three days after completing preparatory work for testing, initiate testing work.

3. Immediately after transfer of service connections, begin abandonment of old wastewater lines, and site restoration.

D. Street Construction and Paving Projects

1. Once Project Manager approves work within a Line Segment or block, immediately begin preparatory work for testing effort.

2. No later than three days after completing preparatory work for testing, initiate testing work.

3. Immediately after testing begin site restoration.

E. Street Construction and Paving Projects

1. Once Project Manager approves work within a block, immediately begin preparatory work for sidewalk construction, sodding and hydromulching and tree planting.

2. No later than seven days after completing preparatory work, initiate construction.

3.02 CLEANING

A. Remove debris and trash to maintain a clean and orderly site in accordance with requirements of General Conditions and Section 01576 - Waste Material Disposal.

3.03 LANDSCAPING AND FENCES

A. Seeding and Sodding.

1. Remove construction debris and level area with bank sand so that new grass surface matches level of existing grass and maintains pre-construction drainage patterns. Level and fill minor ruts or depressions caused by construction operations with bank sand, where grass is still viable.

2. Restore previously existing turfed areas with sod and fertilize in accordance with Section 02922 - Sodding. Sod to match existing turf.

3. Restore unpaved areas not requiring sodding with hydromulch seeding conforming to Section 02921 - Hydromulch Seeding.

B. Trees, Shrubbery and Plants.

1. Remove and replant trees, shrubs, and plants in accordance with requirements of Section 01562 – Tree and Plant Protection.

C. Fence Replacement.

1. Replace removed or damaged fencing to equal or better condition than existed prior to construction, including concrete footings and mow strips. Provide new wood posts, top and bottom railing and panels. Metal fencing material, not damaged by the Work, may be reused.

2. Remove and dispose of damaged or substandard material.

3.04 MAINTENANCE

A. Maintain shrubs, plantings, sodded areas and seeded areas.

B. Replace shrubs, plantings and seeded or sodded areas that fail to become established.

C. Refer to Section 01562 - Tree and Plant Protection, Section 02921 - Hydromulch Seeding and Section 02922 - Sodding for maintenance requirements.

END OF SECTION

Section 01755

STARTING SYSTEMS

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Starting systems.

B. Demonstration and instructions.

C. Testing, adjusting and balancing.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N

3.01 PREPARATION

A. Coordinate schedule for start-up of various equipment and systems.

B. Notify Project Manager seven days prior to startup of each item.

C. Verify each piece of equipment or system has been checked for proper lubrication, drive rotation, belt tension, control sequence, or other damage-causing conditions.

D. Verify tests, meter readings, and specified electrical characteristics agree with those required by equipment or system manufacturer.

E. Verify wiring and support components for equipment are complete and tested.

F. Execute start-up under supervision in accordance with manufacturer's instructions.

G. When specified in individual Specification sections, require manufacturer to provide an authorized representative to be present at the site to inspect, check and approve equipment or system installation prior to start-up, and to supervise placing equipment or system in operation.

H. Submit written report indicating that equipment or system has been properly installed and is functioning correctly.

3.02 DEMONSTRATION AND INSTRUCTIONS

A. Demonstrate operation and maintenance of Products to Project Manager two weeks prior to Date of Substantial Completion.

B. Utilize O&M Manuals as the basis for instruction. Review contents of manual with Project Manager in detail to explain aspects of operation and maintenance.

C. Demonstrate start-up, operation, control, adjustment, trouble-shooting, servicing, maintenance, and shutdown of each item of equipment at agreed-upon times, at the equipment location.

D. Prepare and insert additional data in O&M Manuals when the need for additional data becomes apparent during instruction.

E. At a minimum, Contractor will demonstrate the following:

1. Products and procedures to be used in maintaining various surfaces, e.g., counter tops, toilet partitions, tile floors and carpeting;

2. procedures to set and maintain landscape irrigation system;

3. procedures to set and maintain security and fire alarm systems; and

4. procedures to set and maintain HVAC systems.

3.03 TESTING, ADJUSTING AND BALANCING

A. Contractor shall appoint, employ and pay for the services of an independent firm to perform testing, adjusting and balancing.

B. Submit reports by the independent firm to Project Manager describing observations and results of tests and signifying compliance or non-compliance with specified requirements and requirements of the Contract.

END OF SECTION

Section 01770

CLOSEOUT PROCEDURES

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Procedures to establish Date of Substantial Completion.

B. Closeout procedures for final submittals, O&M data, warranties, spare parts and maintenance materials.

C. Texas Department of Licensing and Regulation (TDLR) inspection for Texas Accessibility Standards (TAS) compliance.

1.02 SUBSTANTIAL COMPLETION

A. Comply with Document 00700 - General Conditions regarding Date of Substantial Completion when Contractor considers the Work, or portion thereof designated by Project Manager, to be substantially complete.

B. Insure the following items have been completed when included in the Work, prior to presenting a list of items to be inspected by Project Manager for issuance of a Certificate of Substantial Completion:

1. cutting, plugging, and abandoning of water, wastewater, and storm sewer lines, as required by Contract documents for each item;

2. construction of, and repairs to, pavement, driveways, sidewalks, and curbs and gutters;

3. sodding and hydromulch seeding, unless waived by Project Manager in writing;

4. general clean up including pavement markings, transfer of services, successful testing and landscape;

5. additional requirements contained in Section 01110 - Summary of Work.

C. Assist Project Manager with inspection of Contractor's list of items and complete or correct the items, including items added by Project Manager, within specified time period.

D. Should Project Manager's inspection show failure of Contractor to comply with requirements to obtain Date of Substantial Completion, including those items in Paragraph 1.02 B. of this section, Contractor shall complete or correct the items, before requesting another inspection by Project Manager.

1.03 CLOSEOUT PROCEDURES

A. Comply with Document 00700 - General Conditions regarding final completion and final payment when the Work is complete and ready for Project Manager's final inspection.

B. Provide Project Record Documents in accordance with Section 01785 - Project Record Documents.

C. Complete or correct items on punch list, with no new items added. Address new items during warranty period.

D. The City will occupy portions of the Work as specified in other sections.

1.04 FINAL CLEANING

A. Execute final cleaning prior to final inspection.

B. For facilities, clean interior and exterior glass and surfaces exposed to view; remove temporary labels, stains and foreign substances, polish transparent and glossy surfaces, vacuum carpeted and soft surfaces.

C. Clean equipment and fixtures to sanitary condition.

D. Clean or replace filters of operating equipment.

E. Clean debris from roofs, gutters, down spouts, and drainage systems.

F. Clean site; sweep paved areas, and rake clean landscaped surfaces.

G. Remove waste and surplus materials, rubbish, and temporary construction facilities from site following final test of utilities and completion of the Work.

1.05 ADJUSTING

A. Adjust operating equipment to ensure smooth and unhindered operation. Value of this testing and adjusting is five percent of Lump Sum Price in the Schedule of Values for item being tested.

1.06 OPERATION AND MAINTENANCE DATA

A. Submit O&M data as noted in Section 01330 - Submittal Procedures.

B. Five percent of lump sum amount of each piece of equipment as indicated in Schedule of Unit Price Work or Schedule of Values will be paid after the required O&M data submittals are received and approved by Project Manager.

1.07 WARRANTIES

A. Provide one original of each warranty from Subcontractors, Suppliers, and manufacturers.

B. Provide Table of Contents and assemble warranties in a 3-ring/D binder with durable plastic cover.

C. Submit warranties prior to final progress payment.

D. Warranties shall commence in accordance with the requirements in Document 00700 - General Conditions.

1.08 SPARE PARTS AND MAINTENANCE MATERIALS

A. Provide Products, spare parts, maintenance and extra materials in quantities specified in individual Specification sections.

B. Deliver to a location within the City limits as directed by Project Manager. Applicable items must be delivered prior to issuance of a final Certificate for Payment.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01782

OPERATIONS AND MAINTENANCE DATA

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Submittal requirements for equipment and facility Operations and Maintenance (O&M) Manuals

1.02 MEASUREMENT AND PAYMENT

A. Measurement for equipment O&M Manuals is on a lump sum basis equal to five percent of the individual equipment value contained in Schedule of Unit Prices or Schedule of Values. The lump sum amount may be included in the first Progress Payment following approval of the O&M Manuals by Project Manager.

1.03 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures. Submit a list of O&M Manuals and parts manuals for equipment to be incorporated into the Work.

B. Submit documents with 8-1/2 x 11-inch text pages, bound in 3-ring/D binders with durable plastic covers.

C. Print "OPERATION AND MAINTENANCE INSTRUCTIONS", Project name, and subject matter of binder on covers when multiple binders are required.

D. Subdivide contents with permanent page dividers, logically organized according to the Table of Contents, with tab titling clearly printed under reinforced laminated plastic tabs.

E. O&M Manual contents: Prepare a Table of Contents for each volume, with each Product or system description identified.

1. Part 1 - Directory: Listing of names, addresses, and telephone numbers of Design Consultant, Contractor, Subcontractors, and major equipment Suppliers.

2. Part 2 - O&M instructions arranged by system. For each category, identify names, addresses, and telephone numbers of Subcontractors and Suppliers and include the following:
   a. Significant design criteria.
   b. List of equipment.
   c. Parts list for each component.
   d. Operating instructions.
   e. Maintenance instructions for equipment and systems.
   f. Maintenance instructions for special finishes, including recommended cleaning methods and materials and special precautions identifying detrimental agents.

3. Part 3 - Project documents and certificates including:
   a. Shop Drawings and relevant data.
   b. Air and water balance reports.
   c. Certificates.
   d. Photocopies of warranties.

F. Submit two copies of O&M Manuals and parts manuals, for review, within one month prior to placing the equipment or facility in service.

G. Submit one copy of completed volumes in final form 10 days prior to final inspection. One copy with Project Manager comments will be returned after final inspection. Revise content of documents based on Project Manager's comments prior to final submittal.

H. Revise and resubmit three final volumes within 10 days after final inspection.

1.04 EQUIPMENT O&M DATA

A. Furnish O&M Manuals, prepared by manufacturers for all equipment. Manuals must contain, as a minimum, the following:

1. Equipment functions, normal operating characteristics, and limiting conditions.

2. Assembly, Installation, alignment, adjustment, and checking instructions.

3. Operating instructions for start-up, normal operation, regulation and control, normal shutdown, and emergency shutdown.

4. Detailed drawings showing the location of each maintainable part and lubrication point with detailed instructions on disassembly and reassembly of the equipment.

5. Troubleshooting guide.

6. Spare parts list, predicted life of parts subject to wear, lists of spare parts recommended to be on hand for both initial start-up and for normal operating inventory, and local or nearest source of spare parts availability.

7. Outline, cross-section, and assembly drawings with engineering data and wiring diagrams.

8. Test data and performance curves.

B. Furnish parts manuals for all equipment, prepared by the equipment manufacturer, which contain, as a minimum, the following:

1. Detailed drawings giving the location of each maintainable part.

2. Spare parts list with predicted life of parts subject to wear, lists of spare parts recommended on hand for both initial start-up and for normal operating inventory, and local or nearest source of spare parts availability.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 01785

PROJECT RECORD DOCUMENTS

PART 1 G E N E R A L

1.01 SECTION INCLUDES

A. Maintenance and submittal of record documents and Samples.

1.02 MAINTENANCE OF DOCUMENTS AND SAMPLES

A. Maintain one record copy of documents at the site in accordance with Document 00700 - General Conditions.

B. Store record documents and Samples in field office, if a field office is required by the Contract, or in a secure location. Provide files, racks, and secure storage for record documents and Samples.

C. Label each document "PROJECT RECORD" in neat, large, printed letters.

D. Maintain record documents in a clean, dry, and legible condition. Do not use record documents for construction purposes. Do not use permit drawings to record Modifications to the Work.

E. Keep record documents and Samples available for inspection by Project Manager.

F. Bring record documents to progress review meetings for viewing by Project Manager and, if applicable, Design Consultant.

1.03 RECORDING

A. Record information legibly with red ink pen on a set of blueline opaque drawings, concurrently with construction progress. Maintain an instrument on site at all times for measuring elevations accurately. Do not conceal work until required information is recorded

B. Contract Drawings and Shop Drawings: Mark each item to record completed Modifications, or when minor deviations exist, the actual construction including:

1. Measured depths of elements of foundation in relation to finish first floor datum.
2. Measured horizontal locations and elevations of Underground Facilities and appurtenances, referenced to permanent surface improvements.

3. Elevations of Underground Facilities referenced to City of Houston benchmark utilized for the Work.

4. Measured locations of internal utilities and appurtenances concealed in construction, referenced to visible and accessible features of the Work.

5. Dimensions and details of field changes

6. Changes made by Modifications.

7. Details not on original Drawings.

8. References to related Shop Drawings and Modifications.

C. Survey all joints of water mains at the time of construction. Record on Drawings, water main invert elevation, elevation top of manway, and centerline horizontal location relative to baseline.

D. For large diameter water mains, mark specifications and addenda to record:

1. Manufacturer, trade name, catalog number and Supplier of each Product actually Installed.

2. Changes made by Modification or field order.

3. Other matters not originally specified.

E. Annotate Shop Drawings to record changes made after review.

1.04 SUBMITTALS

A. At closeout of the Contract, deliver Project record documents to Project Manager.

PART 2 P R O D U C T S - Not Used

PART 3 E X E C U T I O N - Not Used

END OF SECTION

Section 02105

CHEMICAL SAMPLING AND ANALYSIS

PART 1 GENERAL

1.1 SECTION INCLUDES

A. Preparatory work related to site remediation and excavation in a Potentially Petroleum Contaminated Area (PPCA).

B. Sampling and analysis of site material.

1.2 MEASUREMENT AND PAYMENT

A. Unit Prices

1. Preparatory work is paid on a lump sum basis. Item includes hiring environmental consultants, preparing Environmental Health and Safety Plan, preparing Environmental Work Plan, training personnel, and obtaining permits and additional insurance.

2. Underground Utility Construction in PPCA.

   a. Underground utility construction and appurtenances in areas identified within PPCA limits is on a linear foot basis, each basis, or lump sum basis, as shown in Document 00410 – Bid Form.

   b. Payment includes compensation for labor, equipment, and supervision for mobilization, environmental monitoring and field screening, handling, sampling, and testing of contaminated soil and groundwater. Contaminated soil may be Category I or II. Contaminated groundwater will be that encountered during excavation for underground utilities and flowing at a rate not greater than 20 gallons per minute. Included in this pay item is incremental cost for upgraded piping, gaskets, and appurtenant materials.

   c. Limits of measurement under this section are noted on Drawings as 'Begin PPCA Excavation' and 'End PPCA Excavation' and other areas determined by Project Manager during the course of the work.

d. Payment will be made upon receipt of field test reports from approved analytical laboratory.

3. A force account for Extra Work for PPCA Handling will be used to compensate for time and materials required for additional work associated with PPCA when directed by Project Manager to perform such work and for which there is no bid item. Authorization and compensation for this work will be in accordance with Document 00700 - General Conditions.

4. Refer to Section 01270 - Measurement and Payment for unit price procedures.

B. Stipulated Price (Lump Sum). If the Contract is a Stipulated Price Contract, payment for work in this Section is included in the total Stipulated Price.

1.3 REFERENCE STANDARDS

A. ASTM D 5092 - Practice for Design and Installation of Groundwater Monitoring Wells.

B. Code of Federal Regulation (CFR), Title 40, Section 261.24. - Protection of the Environment.

C. CFR, Title 29, Section 1910.120. - Occupational Safety and Health Administration, Department of Labor.

D. CFR, Title 29, Section 1926. - Occupational Safety and Health Administration, Department of Labor.

E. CFR, Title 40, Section 261, Appendix II. - Protection of the Environment.

F. Texas Administrative Code (TAC), Title 30, Chapter 335. - Industrial Solid Waste and Municipal Hazardous Waste.

G. TAC, Title 30, Chapter 334. - Underground and Aboveground Storage Tanks.

H. TAC, Title 30, Chapter 106.533. - Exemptions from Permitting, Subchapter X. Waste Processes and Remediation.

I. U.S. Environmental Protection Agency (EPA), (SW-846) Test Methods for Evaluating Solid Waste, Office of Solid Waste and Emergency Response, Washington, D.C. (P1388-239223, November 1986).

J. Texas Commission on Environmental Quality (TCEQ) Interoffice Memo, dated 4/12/94, by Chris Chandler, RPR Section, PST Division, regarding

'Revised Procedures for Classifying and Assigning Waste Codes for Underground and Aboveground Petroleum Storage Tank Wastes' (text attached following this section).

1.4 DEFINITIONS

A. Petroleum: Crude oil, natural gas, natural gas liquids, liquefied natural gas, and synthetic gas usable for fuel, as well as distillates of crude oil including gasoline, kerosene, diesel oil, motor oil, waste oil, jet fuels, and fuel oil.

B. Potentially Petroleum Contaminated Area (PPCA): An area within station-to- station locations identified on Drawings where petroleum contamination has been detected in the soil or groundwater. PPCA also includes areas where contamination is suspected or encountered during utility installation outside areas identified on Drawings, and such contamination has been verified by Project Manager.

C. Category I Soil: Soil containing visual or physical evidence of contamination, as described in paragraph 3.01, and that is not Category II Soil.

D. Category II Soil: Soil that contains petroleum contamination in excess of levels identified in paragraph 3.04, and is consistent with a classification as Special Waste-PST as defined by TCEQ in their interoffice memo dated 4/12/94, or soil that contains visible free product or is impacted with non-petroleum compounds detected above Risk Reduction Standard Number 2 levels as defined in Texas Administrative Code, Title 30, Chapter 335.

E. Potentially Contaminated Groundwater: Water recovered in a groundwater control system located in PPCA or groundwater that contains visual or physical evidence of contamination, as described in paragraph 3.01, and such contamination has been verified by Project Manager.

1.5 SUBMITTALS

A. Conform to requirements of Section 01330 - Submittal Procedures.

B. Submit an Environmental Work Plan within 30 days after issuance of Notice to Proceed.

1. The Environmental Work Plan shall be prepared by a Corrective Action Project Manager licensed in Texas, who has completed 40-hours of Health and Safety Training and the required annual refresher training, and in the employment of a registered Corrective Action Specialist firm.

2. The Environmental Work Plan shall include the following items. Compile and arrange in a format that can be reviewed by TCEQ.

   a. Proposed sequence of construction through PPCA;

   b. Procedures for screening soil in PPCA, identifying Category I or II Soil;

   c. Procedures for handling material from PPCA;

   d. Proposed location of stockpile areas;

   e. Proposed reuse of Category I Soil as trench backfill below depths of 30 inches;

   f. Proposed methods for disposal or recycling of Category I or II Soil;

   g. Proposed carriers of Category I or II Soil or potentially contaminated groundwater with verification each is properly licensed;

   h. Proposed recycle/disposal sites for Category I or II Soil or potentially contaminated groundwater with verification that each is properly licensed;

   i. Copy of permit required for discharge of potentially contaminated groundwater in sanitary sewer system, if to be disposed in sanitary sewer;

   j. Name and qualifications of Corrective Action Project Manager and professional environmental consultants for health, environmental, and safety issues regarding operations within PPCA; and,

   k. Proposed analytical laboratory with verification it is accredited by A2LA or other recognized association, or it is a participant in the EPAs Performance Evaluation Program.

3. Do not commence work in PPCA until Environmental Work Plan has been reviewed and accepted by Project Manager.

C. Submit Environmental Health and Safety Plan within 30 days after issuance of Notice to Proceed.

1. The Health and Safety Plan shall be prepared by a Corrective Action Project Manager licensed in Texas, who has completed 40 hours of health and safety training, and required annual refresher training, or a Certified Industrial Hygienist.

2. Include methods and procedures for assuring work, which will be conducted under conditions expected in the field, is safe.

D. As work proceeds, submit field screening, monitoring and analytical laboratory test results on a weekly basis for soil and on a daily basis for groundwater. Summarize test results in tables together with applicable regulatory criteria.

E. Submit copies of correspondence, reports, permits and other documents provided to, or received from, regulatory agencies.

1.6 PERSONNEL REQUIREMENTS

A. Provide trained personnel who have completed minimum health and safety programs specified by the Occupational Safety and Health Administration in 29 CFR 1910.120. Before beginning work at the site, each employee that will work in PPCA is required to have completed 40 hours health and safety training and the required annual refresher training.

PART 2 P R O D U C T S

2.1 MATERIALS

A. Do not use polyvinyl chloride or other plastic material, unless approved by Project Manager.

B. Water Line Pipe Material.

1. Furnish ductile-iron pipe or steel pipe material within station-to-station locations identified as PPCA on Drawings.

2. Provide restrained joints for ductile-iron pipe or welded joints for steel pipe.

3. Provide pipe material conforming to Section 02501 – Ductile Iron Pipe and Fittings or Section 02502 - Steel Pipe and Fittings.

C. Sanitary Sewer Pipe Material.

1. Furnish ductile iron pipe, fiberglass reinforced pipe, or equivalent protective materials approved by Project Manager.

2. Provide restrained joints.

3. Provide pipe material conforming to Section 02501 – Ductile Iron Pipe and Fittings or Section 02504 - Fiberglass Reinforced Pipe. Use pipe with a minimum pressure rating of 150 psi.

D. Use Viton (FKM) type gaskets, or approved equal, for water lines and appurtenances requiring gaskets. Use Nitrile Rubber type gaskets, or approved equal, for sanitary and storm sewer pipes, precast concrete manhole joints and appurtenances requiring gaskets

PART 3 EXECUTION

3.1 POTENTIALLY PETROLEUM CONTAMINATED AREAS

A. Conduct operations in PPCA in accordance with the accepted Environmental Work Plan and the Environmental Health and Safety Plan and to minimize the spread of contamination. In other areas which are either detected or suspected to be potentially petroleum contaminated areas, immediately notify Project Manager and proceed with work in accordance with this Section, unless otherwise directed by Project Manager.

B. Immediately notify Project Manager and TCEQ's Region 12 Field Office whenever Category I or II Soil or potentially contaminated groundwater are encountered.

1. Provide location, depth, type (soil or groundwater), source (if known), and evidence of suspected contamination.

2. Determine if Category I Soil or potentially contaminated groundwater is present by visual or physical evidence of contamination. Visual or physical evidence includes:

   a. Petroleum or chemical odor.

   b. Indication of levels of contamination by air monitoring devices employed as part of the Environmental Health and Safety Plan.

   c. Soil or groundwater discoloration.

   d. Material oozing/dripping into excavation.

e. Liquid or oily sheen floating on groundwater.

f. Buried containers or refuse.

g. Field screening 'head-space' results in excess of a 25 ppm reading on a photoionization detector (PID) or flame ionization detector (FID).

C. Install piping and gasket materials and appurtenances in conformance with appropriate section, except as modified in this Section.

D. Construct trench dams within a utility trench at each boundary of PPCA and laterals to minimize potential for contaminant transport within pipe bedding material. A trench dam shall consist of at least 24 inches of cement stabilized sand with 10 percent bentonite clay added, extending from 6 inches below bottom of trench to within 12 inches of limits of topsoil or pavement.

3.2 ENVIRONMENTAL MONITORING

A. An environmental consultant shall monitor conditions in PPCA, as specified in the Environmental Health and Safety Plan. Maintain safe working conditions in accordance with OSHA requirements (29 CFR 1926).

3.3 SCREENING PPCA SOILS

A. An environmental consultant shall perform field screening of soil removed from excavation or tunneling in PPCA.

B. Screening Procedures.

1. Place samples in a sealed plastic bag and place in a warm location for 15 minutes prior to screening.

2. Properly calibrate the PID/FID using a calibration gas. For PID use 100 ppm isobutylene and for FID use 100 ppm methane.

3. Open bag just enough to insert instrument probe and take maximum headspace reading.

4. Screen at least twice per hour while removing soils in open cut areas or shafts.

5. During tunneling, screen once for each pipe length in pipe jacked tunnels or each advance of tunnel shield in primary lined tunnels. Screen at least once per shift when excavating.

3.4 SAMPLING AND TESTING

A. Frequency.

1. Sample soil in PPCA at a rate of not less than one composite sample for every 20 cubic yards of excavation or volume corresponding to every 50 linear feet of installed underground utility, whichever is more frequent.

2. Sample water from PPCA to be discharged to a sanitary sewer one week prior to initiation of discharge, and at a rate of one grab sample once per day during discharge to sanitary sewer.

B. Analyze soil samples for parameters listed in Section 02120 – Off-Site Transportation and Disposal, Table 02120-1, Soil Criteria - Petroleum Only, and in accordance with SW-846. Handle as a Category II Soil if analytical results indicate any one, or more, parameters exceed allowable Maximum Concentration listed in Table 02120-1. If benzene concentration from composite sample is greater than 5 milligrams per kilogram (mg/kg) or lead concentration is greater than 30 mg/kg, perform Toxicity Characteristic Leaching Procedure (TCLP) analysis of appropriate compound for that sample to determine if a more stringent disposal classification is warranted. If contaminants other than petroleum are suspected, immediately notify Project Manager who will determine the list of parameters to be analyzed. If such are encountered, compensation will be made under the Allowance for PPCA Handling. Use a 4-part representative composite sample for analysis of parameters, except when inconsistent with SW-846.

C. Analyze groundwater samples for discharge to sanitary sewers. Analyze samples for BTEX by EPA Method 602, 8020, or 8021; TPH by EPA Method 418.1 or Method TX 1005; and Lower Explosive Limit (LEL) in accordance with EPA Method 1010.

D. Conduct analyses by proposed analytical testing laboratory listed in Environmental Work Plan.

3.5 AIR MONITORING REQUIREMENTS

A. Ensure health and safety of workers at the construction site. Maintain air quality within the construction zone to conform to exposure limits specified in Code of Federal Regulations (CFR) Title 29, Section 1910.120 enforceable by OSHA.

B. Provide adequate shoring and sufficient escape ladders in accordance with applicable trench safety regulatory requirements.

C. In the trench, continuously operate a combustible gas indicator (CGI) with LEL/O_2 meter to monitor vapor and oxygen levels. Properly calibrate CGI and provide an alarm that sounds if greater than or equal to 20 percent Lower Explosive Limit (LEL), less than or equal to 19.5 percent oxygen, or greater than or equal to 25 percent oxygen is reached. Record monitoring data from CGI every 15 minutes to ensure safe work conditions.

D. Take appropriate measures during construction to keep LEL levels below 20 percent in the trench. If vapor concentrations exceed 20 percent of LEL stop construction work, turn off equipment, and have workers immediately vacate the PPCA in an upwind direction.

E. Take readings with PID/FID 50 feet downwind of area during excavation or work in contaminated excavation areas and until one hour after cessation of such work. Take readings within breathing zone at approximately 4 feet above ground level. Record readings, date, time, initials of person taking reading, PID/FID serial number and last calibration date of PID/FID in bound field book.

END OF SECTION

Attachment to Section 02105

PETROLEUM CONTAMINATION

Following, for informational purposes only, is the text of the 4/12/94 Interoffice Memo from Chris Chandler of the Texas Commission on Environmental Quality (TCEQ), RPR Section, PST Division, regarding Revised Procedures for Classifying and Assigning Waste Codes for Underground and Aboveground Petroleum Storage Tank Wastes:

This document is a revision of the waste classification memo dated July 18, 1991 which revised the original March 11, 1991 document. The main difference between the first two documents was the elimination of the distinction between industrial and nonindustrial petroleum substance wastes. This latest version has been revised to reflect changes in the rules and in the agency itself. Significant changes are denoted by underlines. Please discard the previous document.

An appropriate response to any leaking petroleum storage tank incident must always include the proper handling and disposal of all generated wastes. In the majority of cases these wastes include contaminated soils and/or wastewater. Before a disposal destination can be determined for a particular waste, the waste must be classified based on the concentrations of contaminants. The procedures for classification of petroleum contaminated wastes are detailed in the attached Guidance Document for the proper Management of Wastes Associated With Underground and Aboveground Petroleum Storage Tanks. The waste first must be analyzed by a laboratory and then, based upon the results of the analysis, a classification can be assigned to the waste with its corresponding waste code number. The waste code is a predesignated number based upon both the waste's classification and the type of contaminants.

Many disposal facilities are now requiring the generator of any petroleum substance waste to obtain a waste classification from TCEQ that assigns a waste code number to that particular waste before the facility will accept it (even though this is not a regulatory requirement for nonhazardous PST wastes). In order to receive this waste code, the generator first must submit laboratory reports and other information providing the results of analysis for the waste. This information should be attached to a completed copy of TCEQ Form No. 0197. Only after receipt of this documentation should the waste code assignment be made. Waste code numbers should never be issued based upon analytical results unsupported by laboratory documentation.

Laboratory reports should include a description of the analytical procedures utilized, the condition in which the sample was received, and the signature of the laboratory personnel. Also, reports must be accompanied by a description of the sample collection and handling procedures. If the procedures described are not in accordance with EPA-approved and/or TCEQ-accepted procedures, the results should be rejected as invalid.

Soil samples should be collected at the rate of one sample for every fifty cubic yards of material, and each sample should be a composite which is representative of the fifty

cubic yard unit. Water samples from inside storage vessels should be collected from the top of the water column in order to identify the highest contaminant level. Water should be sampled at the rate of one sample per 3000 gallons of water, or a minimum of one sample per container if there is more than one container.

When a waste is categorized as Class II PST or Special Waste-PST, the generator must document the volume, means of transportation, and ultimate destination for the waste. Once all of the proper information has been received by the PST of FO Division in writing, the waste classification and code number can be verbally issued to the generator. The number should be written on the submitted Form No. 0197 in the space marked TCEQ Use Only, and a copy of the form mailed or faxed to the Responsible Party (not the contractor or consultant). Also include the date, the person issuing the code number and the Regional Office number on the form. A copy of the completed form and all submitted information should be sent to the Central Office (or regional office as appropriate).

Regional Field Inspectors as well as PST Division Coordinators should issue waste classifications and code numbers for only Class II PST and Special Wastes-PST on cases they are responsible for coordinating.

Additionally, for all waste classification requests which are not associated with LPST sites (such as for disposal of water used to clean tanks or for disposal of soil/backfill material not associated with a confirmed release), the I&HW Division or the appropriate Regional Office should oversee the waste classification. All hazardous and industrial Class I waste must be manifested in accordance with the Industrial Solid Waste Rules, Chapter 335, Texas Administrative Code. Generators of any hazardous wastes or industrial Class I waste should be referred to the Waste Evaluation Section of the TCEQ Industrial and Hazardous Waste Division at (512) 239-6832.

Following are the waste classification and code numbers for typical nonhazardous wastes generated at leaking underground and aboveground petroleum storage tank sites involving the release of petroleum substances only (i.e., gasoline, diesel, kerosene, jet fuel, etc.).

CONTAMINATED SOILS

Contaminant Level	**Classification**	**Waste Code Number**
If greater than 150 ppm BTEX **OR** 600 ppm TPH	Special Waste PST	PSTW4891
If less than 150 ppm BTEX **AND** 600 ppm TPH	Class II PST Waste	PSTW4892

Note Soils saturated ('drippy') with gasoline are likely to be ignitable. Contaminated soils analyzed as ignitable are classified as hazardous waste and therefore can only be transported by a registered hazardous waste hauler and only disposed of at a permitted facility authorized to receive hazardous wastes.

CONTAMINATED WATER

Contaminant Level	Classification	Waste Code Number
Any concentration of dissolved contamination with no phase-separated product	Class II PST Waste	PSTW1021

As routinely requested in TCEQ's letters, documentation of the handling and disposition of all wastes generated in a LPST response action must be provided to TCEQ. It is essential that we track PST wastes through signed receipts and, when required, manifests to prevent their illegal dumping.

Should you have any questions or comments, please contact me at 512/239-2245 or the Waste Evaluation Section at 512/239-6832.

(Signed) Chris Chandler

END OF ATTACHMENT

Section 02120

OFF-SITE TRANSPORTATION AND DISPOSAL

PART 1 GENERAL

1.1 SECTION INCLUDES

A. Off-site disposal of non-hazardous and hazardous solid, liquid and resinous waste.

1.2 MEASUREMENT AND PAYMENT

A. Unit Prices

1. Payment for transportation and disposal of Class II Soil at approved facility is on a cubic yard basis.

2. Payment for transportation and disposal of Class I Soil at approved facility is on a cubic yard basis.

3. No separate payment will be made for soil reused as backfill material.

4. Payment for transportation and disposal of contaminated groundwater at approved facility is on a per gallon basis.

5. No separate payment for groundwater discharged into a sanitary sewer.

6. Refer to Section 01270 - Measurement and Payment for unit price procedures.

B. Stipulated Price (Lump Sum). If the Contract is a Stipulated Price Contract, payment for work in this Section is included in the total Stipulated Price.

1.3 REFERENCES

A. CFR, Title 29, Section 1910.120.- Occupational Safety and Health Administration, Department of Labor.

B. Texas Administrative Code (TAC), Title 30, Chapter 335.- Industrial Solid Waste and Municipal Hazardous Waste.

C. TAC, Title 30, Chapter 334.- Underground and Aboveground Storage Tanks.

D. TAC, Title 30, Chapter 106.533.- Exemptions from Permitting, Subchapter X, Waste Processes and Remediation.

E. U.S. Environmental Protection Agency (EPA), (SW-846) Test Methods for Evaluating Solid Waste, Office of Solid Waste and Emergency Response, Washington, D.C. (P1388-239223, November 1986).

PART 2 P R O D U C T S (Not Used)

PART 3 E X E C U T I O N

3.1 HANDLING CATEGORY I AND II SOILS

A. Do not place Category II Soil back into excavation. Properly dispose of Category II Soil at the facility listed in Environmental Work Plan. Category I Soil consistent with classification as Class II PST Waste as defined by Texas Commission on Environmental Quality (TCEQ) in their interoffice memo dated 4/12/94, and not Category II Soil (as demonstrated through laboratory testing) can be reused as backfill material, provided;

1. Soil is reused in the same area from which it originated at depths greater than 30 inches below top of pavement, finished grade or ditch flowline, whichever is lower.

2. Soil has suitable engineering properties for backfill material as specified in Section 02320 - Utility Backfill Material.

3. Does not have indications of impact by contaminants other than petroleum.

B. Do not spread Category I or II Soil on ground surface.

C. Place Category I or II Soil in covered roll-off box with a minimum 20-mil plastic liner or in a stockpile at temporary storage area, pending receipt of analytical results and receipt of authorization from TCEQ and the disposal site for final disposal; or, in trucks for transport directly to the disposal facility.

1. Do not commingle Category I or II Soil from different locations or with different sources.

2. Temporary storage area to meet following criteria:

a. Within 2 miles of project site, to allow access by City personnel, unless otherwise approved by Project Manager.

b. Outside the 100-year floodplain.

c. Outside of, and not adjacent to, an area known or suspected to be a wetland.

d. Acceptable to Project Manager.

3. Secure using temporary fencing or other means of controlling access.

4. Place stockpiled soils on an impervious membrane. Surround with a berm to prevent migration of soils or moisture either into or out of the stockpile, other than evaporation.

5. Protect and cover the stockpile with minimum 20-mil plastic or other approved waterproof membrane covering. Replace damaged covers.

6. Do not place soil over monitoring wells or piezometers, utility line manholes, or any other potential route for water to migrate to subsurface.

7. Handle runoff from the temporary storage area in accordance with paragraph 3.02, Handling Water.

8. Do not stockpile soil for greater than 30 days.

9. Remove remaining material, including excavated soil from construction site, from temporary storage area prior to completion of Work.

D. Remove, handle, transport, stockpile, and dispose of Category II Soil under direction of Corrective Action Project Manager. Dispose waste classified (i.e., meets characteristics or other definitions of) a hazardous waste consistent with Resource Conservation and Recovery Act (RCRA) and 30 TAC Chapter 335.

E. Transport Category I or II Soil in accordance with Department of Transportation (DOT) and TCEQ rules and regulations.

F. Dispose Category I Soil, not reused as backfill, under direction of Corrective Action Project Manager, at a properly licensed facility with prior approval of Project Manager.

G. Obtain signed manifests from the receiving facility and provide originals to Project Manager.

H. Decontaminate large equipment to prevent cross-contamination with clean material. Steam clean or pressure wash dump trucks, bulldozers, backhoes, and other large equipment prior to use in uncontaminated areas after being used in PPCA.

3.2 HANDLING WATER

A. Prior to discharging petroleum contaminated groundwater, obtain an Industrial Wastewater Discharge Permit (no cost) from the City for disposal directly to a sanitary sewer which discharges to a City-owned wastewater treatment plant.

B. Procedures.

1. Provide equipment sized to handle flows anticipated by dewatering operations.

2. Include commercially available oil/water separator unit as part of the treatment system for dewatering operation discharging to sanitary sewer.

3. Do not exceed limits listed in Table 02120-2, Potentially Contaminated Groundwater Discharge Limits for groundwater discharged to the sanitary sewer. Provide additional treatment systems as needed prior to discharge to sanitary sewers where groundwater contamination levels exceed those noted in Table 02120-2. Approval by Project Manager shall be obtained for proposed treatment system prior to initiation of treatment and discharge.

4. Comply with all applicable requirements of 30 TAC, Chapter 106.533, including submitting a PI-7 form to the TCEQ for a standard exemption of oil/water separator unit, and any additional treatment systems. Submit copy of PI-7 form to Project Manager.

5. Do not discharge treated water into sanitary sewer if water level is within one foot of the top of sanitary sewer manhole or would cause an overflow situation.

6. Recover free product collected in treatment equipment. Recycle for beneficial reuse or dispose of recovered contaminants in a manner acceptable to Project Manager and TCEQ.

7. Transport potentially contaminated groundwater and free product in accordance with DOT and TCEQ rules and regulations for flammable products. Use DOT-licensed carrier for transport.

8. Obtain signed manifests for potentially contaminated groundwater and free product from the receiving facility and provide originals to Project Manager.

9. Furnish laboratory reports to Project Manager within one week of sample date.

C. Install and operate groundwater control systems, as described in Section 01578 - Control of Groundwater. Design and operate groundwater control systems so water from PPCA is handled in a system separated and isolated from groundwater control systems outside PPCA.

D. Handle, test, treat, and discharge potentially contaminated groundwater to the sanitary sewer in accordance with the City of Houston, Industrial Wastewater Discharge Permit requirements, or have water evacuated and hauled for off-site treatment and disposal at a TCEQ-permitted facility. Perform discharge under direction of Corrective Action Project Manager.

3.3 AIR MONITORING REQUIREMENTS

A. Ensure health and safety of workers at the construction site. Maintain air quality within the construction zone to conform to exposure limits specified in Code of Federal Regulations (CFR) Title 29, Section 1910.120 enforceable by OSHA.

B. Provide adequate shoring and sufficient escape ladders in accordance with applicable trench safety regulatory requirements.

C. In the trench, continuously operate a combustible gas indicator (CGI) with LEL/O_2 meter to monitor vapor and oxygen levels. Properly calibrate CGI and provide an alarm that sounds if greater than or equal to 20 percent Lower Explosive Limit (LEL), less than or equal to 19.5 percent oxygen, or greater than or equal to 25 percent oxygen is reached. Record monitoring data from CGI every 15 minutes to ensure safe work conditions.

D. Take appropriate measures during construction to keep LEL levels below 20 percent in the trench. If vapor concentrations exceed 20 percent of LEL stop construction work, turn off equipment, and have workers immediately vacate the PPCA in an upwind direction.

E. Take readings with PID/FID 50 feet downwind of area during excavation or work in contaminated excavation areas and until one hour after cessation of such work. Take readings within breathing zone at approximately 4 feet above ground level. Record readings, date, time, initials of person taking

reading, PID/FID serial number and last calibration date of PID/FID in bound field book.

3.4 DISPOSAL OF MATERIAL

A. Non-categorized Material. Dispose of excess or unsuitable excavated materials, not Category I or II Soil, off-site in accordance with Section 01576 - Waste Material Disposal.

B. Category I or II Soil. Dispose of excess or unsuitable excavated materials off-site at a state registered Treatment, Storage, or Disposal (TSD) facility. Obtain signed manifests from the receiving facility and provide originals to Project Manager.

TABLE 02120-1
SOIL CRITERIA - PETROLEUM ONLY

Contaminant	Maximum[a] Concentration (mg/kg)	Method
TPH	1500	EPA 418.1/TX 1005
Total BTEX	150	EPA 8020/8021
Total Lead	30	EPA 6000/6010/7000

Notes: [a] If any parameters exceed the maximum concentrations, then the soil shall be considered Category II Soil and a Special Waste-PST as defined by the TCEQ in their interoffice memo dated 4/12/94.

Definitions: BTEX - benzene, toluene, ethyl benzene, and total xylenes
TPH - total petroleum hydrocarbons
mg/kg - milligrams per kilogram
mg/l - milligrams per liter

TABLE 02120-2
POTENTIALLY CONTAMINATED GROUNDWATER DISCHARGE LIMITS

Parameter	Discharge to Sanitary Sewer	
	Limit	Method
TPH (mg/l)	30.0	EPA 418.1/TX 1005
Total BTEX (mg/l)	1.0	EPA 602/8020/8021
Lower Explosive Limit (%)	10	EPA 1010

Notes: See definitions above.

END OF SECTION

Section 02221S

REMOVING EXISTING PAVEMENTS, STRUCTURES, WOOD, AND DEMOLITION DEBRIS

The following supplements modify Specification Section 02221 – Removing Existing Pavements, Structures, Wood, and Demolition Debris. Where a portion of the Specification or Detail is modified or deleted by this Supplementary Specification, the unaltered portions of the Specification shall remain in effect.

1.03 REGULATORY REQUIREMENTS: Add the following Paragraph C:

C. For removal of asbestos containing materials, or material that could potentially contain asbestos, comply with applicable provisions of OSHA 29 CFR 1926.1101 – Asbestos, OSHA 29 CFR 1926.32 – General Safety and Health Provisions, and EPA 40 CFR 61 Subpart M – National Emission Standard for Asbestos.

3.01 PREPARATION: Add the following Paragraph C:

C. For removal of asbestos containing materials, or materials that could potentially contain asbestos, comply with the following:

1. Crew members must be trained in accordance with OSHA 29 CFR 1926.1101 – Asbestos.
2. Conduct negative exposure assessment to demonstrate asbestos exposure below permissible exposure limit (PEL) in accordance with OSHA 29 CFR 1926.1101 – Asbestos and EPA 40 CFR 763 – Asbestos.
3. If negative exposure assessment not conducted, or if results are above PEL, provide respiratory protection in accordance with Paragraph 3.02 of this Section.

3.02 PROTECTION: Add the following Paragraph B:

B. When required, provide respiratory protection in accordance with OSHA 29 CFR 1910.134 – Respiratory Protection, and National Institute of Occupational Safety and Health (NIOSH).

3.03 REMOVALS: Add the following Paragraph G:

G. Labeling of Asbestos Cement (AC) Pipe:

1. Label leak-tight container with warning statement of hazardous asbestos content in accordance with OSHA 29 CFR 1926.1101 and as noted below.
2. Label waste material with following warning:

DANGER
CONTAINS ASBESTOS FIBERS
MAY CAUSE CANCER
CAUSES DAMAGE TO LUNGS
DO NOT BREATHE DUST
AVOID CREATING DUST

3. Neatly print labels in letters of sufficient size and contrast so label is easily visible and legible.

3.05 DISPOSAL: Add the following Paragraph C:

C. For asbestos-containing materials:

1. Comply with 40 CFR Part 61 and 30 TAC Sections 330.137(b) for Industrial Class 1 waste.
2. Inspect load to ensure correct packaging and labeling.
3. Line vehicles with two layers of 6-mil polyethylene sheeting.
4. Remove asbestos-containing waste from site daily.

END OF SUPPLEMENT

Approved by:

Mark L. Loethen, P.E., CFM, PTOE
City Engineer
Department of Public Works & Engineering

11/17/2012
Date

Section 02425(Large Diameter)

TUNNEL EXCAVATION AND PRIMARY LINER FOR WATER MAINS

PART 1 GENERAL

1.01 SECTION INCLUDES

A. Tunnel construction operation with primary lined tunnel installed during tunnel drive followed by placement of water line inside tunnel after completion of tunnel construction. This Specification is intended to be primarily functional in nature and to define in general terms work to be accomplished. Contractor granted full discretion to select method of tunnel construction, subject to review by City Engineer.

1.02 MEASUREMENT AND PAYMENT

A. No separate payment will be made for other work performed under this Specification such as excavation, liner, grouting, or instrumentation. Include cost of such other work in contract unit prices for items listed in bid form for Section 02517 - Water Main in Tunnels.

B. Where such effort is necessary, cost for ground water control during course of tunnel work included in unit prices for water main in tunnel.

C. Ground water control required during course of Project to lower water table for other utility installation, to remove standing water, surface drainage seepage, or to protect ongoing work against rising waters or floods considered incidental to work being performed.

1.03 REFERENCE STANDARDS

A. The publications listed below form part of this specification to extent referenced. publications are referred to in text by abbreviations only.

1. AREMA Manual for Railway Engineering (Applicable sections).

2. American Association of State Highway and Transportation Officials (AASHTO).

3. American Society for Testing and Materials (ASTM).

   a. ASTM A36 - Standard Specifications for Carbon Structural Steel.

   b. ASTM A82 - Standard Specifications for Steel Wire, Plain, for Concrete Reinforcement.

   c. ASTM A185 - Standard Specifications for Steel Welded Wire Fabric for Concrete Reinforcement.

d. ASTM A283 - Standard Specifications for Low and Intermediate Tensile Strength Carbon Steel Plates.

e. ASTM A307 - Standard Specifications for Carbon Steel Bolts and Studs, 60,000 PSI Tensile Strength.

f. ASTM A328 - Standard Specifications for Steel Sheet Piling.

g. ASTM A496 - Standard Specifications for Steel Wire, Deformed, for Concrete Reinforcement.

h. ASTM A615 - Standard Specifications for Deformed and Plain Billet-Steel Bars for Concrete Reinforcement.

i. ASTM C33 - Standard Specification for Concrete Aggregates.

j. ASTM C150 - Standard Specifications for Portland Cement.

4. American Water Works Association (AWWA)

a. AWWA C200 - Steel Water Pipe 6-inches and Larger.

5. Occupational Safety and Health Administration (OSHA): Particular attention is called to Subpart S of OSHA Standards (29 CFR 1926/1920), published as U.S. Department of Labor Publication 2207, Revised Oct. 1, 1979. Second revision dated August 1, 1989. See Federal Register dated June 2, 1989 for revised standard and commentary.

1.04 DEFINITION

A. Tunneling Work Plan defined as written description together with sketches, drawings, schedules, and other documents defining Contractor's planned methods and procedures to construct referenced item. Contractor's Construction Drawings defined as drawings by which Contractor proposes to furnish, construct, install, and operate referenced item. Submission of Tunneling Work Plans, including construction drawings, required for providing City Engineer sufficient details to verify that Contractor's planned work and work in progress is in accordance with intent of design and specification requirements.

B. Primary Liner defined as Contractor's initial construction liner and tunnel support installed by Contractor for ground stability and safety during construction preparatory to installation of water line. Contractor chooses method of construction in accordance with this Specification. Inclusion of various methods in specification or reviews by City Engineer of Contractor's submittals shall not be construed by Contractor as endorsement by City Engineer that all such methods are constructible or will work for specific subsurface soils encountered.

C. Carrier Pipe is referred to as water line or permanent (secondary) liner. Such water line/permanent liner defined and installed in accordance with Section 02517 - Water Main in Tunnels or Section 02511 - Water Mains.

1.05 SUBMITTALS

A. Review: Conform to requirements of Section 01330 - Submittals Procedures. City Engineer will review submitted plans, details and data for compliance with requirements of Specification. Such review shall not be construed to relieve Contractor of responsibilities under Contract. Contractor shall not commence work on items requiring Contractor's work plan, construction drawings or other submittals until submittals have been reviewed and accepted by City Engineer. All structural designs and other engineered components signed and sealed by Professional Engineer registered in the State of Texas.

B. Tunneling: Submit for review Tunneling Work Plan with complete construction drawings, complete written description identifying details of proposed method of construction and sequence of operations to be performed during construction, as required by method of tunnel excavation and liner installation. Sufficiently detail construction drawings and descriptions detailed to demonstrate to City Engineer whether proposed materials and procedures will meet requirements of Specification.

1. Depending on Contractor's method of construction, submit Contractor's work plan and construction drawings on following items:

a. If use of mechanized excavating equipment (such as TBM or shielded excavators) is proposed, submit arrangement drawings and technical specifications of machine and trailing equipment (included modifications), experience record with this type of machine of both Contractor and proposed operator and copy of manufacturer's operation manual for machine.

b. The Contractor may elect to use tunnel shield that is separate from mechanized excavation equipment or for use with hand excavation. When use of tunnel shield is proposed, submit arrangement drawings, design criteria, dimensional data and method of excavation and operation of shield, including acceptable method for supporting, controlling and closing face of heading.

c. Complete details of equipment, methods and procedures to be used for ground support, including but not limited to primary liner installation, timing of installation in relation to excavation plan, bulkheads and equipment.

d. Grouting techniques meeting requirements this Section and Section 02431 - Tunneling Grout.

e. Procedures for measuring excavation quantities versus forward progress during tunneling operation (for earth pressure balance TBM only).

f. Method of controlling line and grade of excavation.

g. Details of muck removal, including equipment type, number and disposal location.

h. Description of ventilation system, lighting system, and electrical system.

i. Proposed contingency plans for critical phases and areas of tunneling.

2. Submit for review design criteria established by Contractor's Engineer for primary liner, including design calculations and installation details, and certification by qualified Engineer Registered in the State of Texas that structural design of primary tunnel meets criteria and specified requirements for range of field conditions.

3. Include in work plan special activities at critical utility crossings, or for work potentially effecting other facilities and existing installations, where special precautions must be taken during construction.

4. Submit for review layout and design of proposed access shafts and shafts for permanent installations in accordance with Section 02400 - Tunnel Shafts.

5. Ground water control system per requirements in this Section and in accordance with Section 01578 - Control of Ground Water and Surface Water, as required by construction method.

6. All structural designs and other engineered items signed and sealed by qualified Professional Engineer Registered in the State of Texas unless otherwise specified.

C. Quality Control Methods: At least 30 days prior to start of tunneling, submit description of quality control methods he proposes to use in this operation to City Engineer. Include in submittal:

1. Supervision: Supervisory control to ensure that work is performed in accordance with Drawings and Specifications and Contractor's work plan and construction drawings.

2. Line and Grade: Procedures for surveying, controlling and checking line and grade, including field forms for establishing and checking line, and grade.

3. Tunneling Observation and Monitoring: Procedures for preparing and submitting daily logs of tunneling operations, including field forms, to meet requirement of Paragraphs 3.06, Tunneling Data and Paragraph 3.07, Control of Tunnel Line and Grade.

4. Monitoring Instrumentation: Conform to requirements of Paragraph 3.09A, Monitoring Instrumentation.

a. Name of instrument installation subcontractors.

b. Layout of instrumentation points.

c. Procedures, forms and schedules for periodic submittals of readings.

5. Settlement Survey Plan, to meet requirements of Paragraph 3.09C, Settlement Surveying. This plan may be submitted as part of Instrumentation Monitoring Plan.

6. Building Condition/Assessment Plans: Conform to requirements of Paragraph 3.09B, Buildings and Structures Assessment.

D. Geotechnical and Environmental Investigation: Include results of geotechnical and environmental investigations performed by Contractor as relevant to tunneling in Work Plan.

E. Safety: Submit procedures to meet all applicable OSHA requirements including the following as minimum: Submit these procedures for record purpose only and they will not be subject to approval by City Engineer.

1. Protection against soil instability and ground water inflow.

2. Safety for shaft access and exit including ladders, stairs, walkways, and hoists.

3. Protection against mechanical and hydraulic equipment operations, and for lifting and hoisting equipment and material.

4. Ventilation, lighting, and communication systems.

5. Monitoring for hazardous gases.

6. Protection against flooding.

7. Means for emergency evacuation.

8. Protection of shaft including traffic barriers, accidental or unauthorized entry, and falling objects.

9. Emergency protection equipment and self-rescue equipment.

10. Safety supervising responsibilities.

1.06 DESIGN CRITERIA

A. Design primary liner for appropriate loading conditions, including but not limited to: overburden and lateral earth pressures, handling and installation stresses, loads imposed by tunnel shield or tunnel boring machine thrust jacks, subsurface soil and water loads, grouting,

and all other conditions of service. Contractor responsible for design of primary liner to carry thrust of jacking or other construction forces or loads anticipated.

B. Use Cooper E-80 locomotive loading distributions in accordance with AREA specifications for culverts for criteria at railroad crossings. Account for additive loadings for multiple tracks in design. Provide liner type for railroad crossings as specified or as otherwise required by railroad authority. Acceptable monitoring devices, such as closed circuit television, which permit continuous monitoring of conditions at face by qualified observers, from outside tunnel, may be used.

C. Use HS-20 vehicle loading distributions for truck loading criteria in accordance with AASHTO.

D. Compatibility of Methods:

1. Use compatible methods of excavation, liner, and ground stabilization and ground water control.

2. Design primary lining, when used to provide thrust for propulsion of shield, to withstand this thrust without damage or distortion. Configure propulsion jacks on shield so that thrust is uniformly distributed and will not damage or distort primary liner.

3. Use compatible tunneling method with possible restrictions on work, such as influence on existing installations or potential ground water contamination.

1.07 JOB CONDITIONS

A. Safety Requirements:

1. Perform work in manner to maximize safety and avoid exposure of men and equipment to hazardous and potentially hazardous conditions, in accordance with applicable safety standards and Contractor's safety procedures.

2. Whenever there is emergency or stoppage of work which is likely to endanger tunnel excavation or adjacent structures, operate full work force for 24 hours day, including weekends and holidays, without intermission until potentially hazardous conditions no longer exist or jeopardize stability and safety of work or existing installations.

3. Perform tunnel construction in manner that will minimize movement of ground in front and surrounding tunnel. Prevent significant subsidence of surface and protect structures and utilities above, and in vicinity of, tunnel from damage.

4. Support ground continuously in manner to prevent loss of ground and keep perimeters and faces of tunnel and bottoms of shafts stable. Use filter-fabric and other means as necessary behind primary liner to prevent soil migration into tunnel.

B. Surveillance of Headings: When Contractor is not able to close face of machine because of maintenance requirements, maintain qualified personnel on duty to observe conditions that might threaten stability of heading whenever tunnel excavation is suspended or shut down. Equip personnel with approved contingency plan to take appropriate action to prevent or limit damage should conditions which threaten stability of heading occur.

C. Air Quality:

1. Conduct tunneling operations by methods and with equipment which will positively control dust, fumes, vapors, gases or other atmospheric impurities in accordance with OSHA, Federal, State and City requirements.

2. Provide approved mining instrumentation for testing quality of tunnel atmosphere and obtain samples, under working conditions, at prescribed intervals in accordance with above referenced requirements. Submit results of air quality tests to City Engineer.

D. Ground Conditions: Perform sufficient exploration by geotechnical and environmental borings in advance of construction to define necessary parameters for design of primary tunnel liner, planning and designing ground water control system, and for selection of tunneling method and equipment to successfully complete each tunnel reach. Present results of Contractor's geotechnical and environmental investigations in related work plans.

PART 2 PRODUCTS

2.01 GENERAL

A. Use of various construction methods for tunnel excavation and ground support, such as by tunnel boring machine (TBM), hand tunneling or shield will be allowed, provided it can be demonstrated to City Engineer that proposed method will complete Project in accordance with Specifications, this Section, applicable safety codes, and Project schedules.

1. Contractor's Engineer responsible for design of primary tunnel liner system.

2. Contractor responsible for final constructed product, materials and tools used, and for furnishing labor and qualified superintendents necessary for selected method of construction.

3. Demonstrate that chosen method will prevent flow of water or soil into tunnel and provide stability of face under anticipated conditions.

B. Use tunnel liner or casing of size so that minimum clearance between bottom of carrier pipe and inside of liner is minimum 4 inches, and minimum clearance between top of pipe and inside of liner or casing is in accordance with following:

Carrier Pipe Net I.D.	Minimum Clearance to Top
≥ 48"	9"
42"	7"
36"	5"
≤ 30"	3"

This clearance also applies to distance between carrier pipe and electrical conducting pipe support system.

C. Furnish all items, such as TBM or shield with excavation equipment, spoil disposal systems, muck trains, hoist, grouting, signal systems, ventilation, safety equipment, and survey controls necessary to excavate and advance tunnel and construct primary tunnel liner by selected method.

2.02 LINER AND SUPPORTS

A. The primary tunnel liner may consist of steel ribs and lagging, steel liner plates, precast concrete segments, steel casing pipe, or combinations of these. Lagging may be timber or steel. Box tunnels with timber supports or steel sets with timber lagging may be constructed when ground conditions are suitable. Utilize additional support elements including shotcrete, additional steel sets, breasting, spilling, forepoling, crown bars, soil anchors, or fabrics, as required to provide safe, stable excavation.

B. Use steel liner plates, steel casing or steel lagging with steel ring beams as primary liner for tunneling under Texas Department of Transportation rights-of-way. Use steel casing as primary liner for tunneling under railroad rights-of-way. Timber lagging or timber falsework permitted in tunnels at other locations as shown on Drawings.

C. Use steel casing as primary liner for tunneling in fault zone crossings.

2.03 MATERIALS

A. Where use of following materials is required, conform to requirements of following minimum standards:

Material	Reference Standards
Cement	ASTM C150
Structural Concrete	See Section 03300
Reinforcing Steel Wire	ASTM A82 or A496
Reinforcing Steel Wire Fabric	ASTM A185 or A497
Reinforcing Steel Bars	ASTM A615, Grade 60
Sand and Aggregate	ASTM C33
Structural Steel	ASTM A36

Steel Piles, Sheets	ASTM A328
Rings and Ribs	ASTM A36
Steel Plates	ASTM A36 and A283
Lumber and Timber	Hardwood, sound or better, as defined by Commercial Standard C560
Steel Casing Pipe	AWWA C200

2.04 STEEL LINER PLATES

A. Except as otherwise specified, furnish materials according to applicable requirements of AREMA Manual for Railway Engineering.

B. Bolts and nuts: Conform to ASTM A307, Grade A. Use bolts no less than 1/2 inch in diameter for plate gauge 7 or thinner and no less than 5/8 inch in diameter for greater plate thicknesses.

C. Punch plates for bolting on both longitudinal and circumferential seams and fabricate to permit complete erection from inside tunnel. Use plates of uniform fabrication and use interchangeable plates for those intended for one size tunnel .

D. Use new material for construction of liner plates. City Engineer, at his option, may allow used plates provided that thickness of used plates after removal of rust is, at minimum, equal to thickness of new plates suitable for use on this Project; shape and dimensions meet acceptance tolerance for new plates; and used plates are free from other defects. City Engineer will determine acceptability of used plates.

E. Provide steel liner plates manufactured by Contech Construction Products (2-flange), Commercial Pantex Sika, Inc. (4-flange), or approved equal, and certified by manufacturer of compliance with specifications. Provide tensile strength, yield strength and minimum elongation of liner plates. Also, provide design calculations for either 2-or 4-flange liner plates, as appropriate for Contractor's method of construction. All steel liner plate designs shall meet following minimum factors of safety:

Seam Strength = 3
Buckling = 2
Maximum Deflection = 2% (of normal tunnel diameter)

F. Maintain minimum thickness of metal for these steel plates as shown on drawings, allowing for standard mill tolerances.

G. Equip steel liner plates with approximately 2-inch-diameter grout holes furnished with plugs. Locate holes near plate centers, such that when plates are installed there will be one line of holes along crown and along each side of tunnel, not more than 18 inches above invert. Locate holes in each line at no more than every other plate and stagger.

H. Protective coating not required for steel liner plates, unless otherwise specified or shown on Drawings.

I. Install gaskets between liner plates when required to control seepage, or as specified or shown in Drawings.

J. Steel ribs used with liner plates: Conform to requirements of Paragraph 2.05, Steel Beams and Lagging.

2.05 STEEL CASING PIPE

A. Casing pipe: Provide new uncoated welded steel pipe, manufactured in accordance with AWWA C200.

B. Design stress in pipe wall shall be 50 percent of minimum yield point of steel or 18,000 psi, whichever is less when subjected to loading conditions.

C. Design deflection to be used in determining wall thickness shall not exceed 3 percent of nominal casing pipe size.

D. Bedding constant to be used in determining wall thickness shall be 0.10. Lag factors shall be 1.0 for all live loads.

E. Minimum thickness of steel casing shall be as shown on drawing. When casing is installed without benefit of protective coating, and said casing is not cathodically protected, increase wall thickness shown on drawings to nearest standard size, which is minimum of 0.0633 inches greater than thickness shown except for diameters under 12-3/4 inches.

F. Casing pipe design shall also include stresses due to jacking forces when pipe is to be installed by jacking method.

G. Equip casing pipe with approximately 2-inch diameter grout holes furnished with plugs. Place holes in pattern so that each succeeding hole from top dead center is 60 degrees right, then 60 degrees left, then top dead center. Locate holes in each line no more than 9 feet apart.

H. Conform casing pipe used in fault zones to welding and weld testing requirements specified in Section 02502 - Steel Pipe and Fittings.

I. Casing pipe used in fault zones must be plugged at each end with clay bricks around O.D. of pipe minimum of one foot thickness measured into casing to prevent infiltration of soil into annular space.

2.06 STEEL BEAMS AND LAGGING

A. Steel ribs and auxiliary structural members shall be free of defects which may impair or reduce their structural integrity. Ribs shall be accurately curved to proper radius of tunnel section (or

shaft section) and rib segments shall fit closely for bolted connections at segmental and transverse joints. Provide steel appurtenances required for installation of ribs such as tie road, bolts, splice plates, dutchmen and drift pins, with ribs.

B. Minimum factors of safety:

Buckling = 2
Stiffness = 3

2.07 FILTER FABRIC

A. See Section 02621 - Geotextile for requirements of material and minimum installation requirements. Install fabric, and backer rods, as required to prevent loss of fine-soil sediments into tunnel.

2.08 TIMBER

A. Use new timber for primary liner ground support without defects, of true dimensions and of quality grade and wood type defined by Contractor's Engineer.

PART 3 EXECUTION

3.01 PREPARATION

A. Contractor shall be responsible for his means and methods of tunneling construction and shall ensure safety of work, Contractor's employees, public, and adjacent property, whether public or private.

B. Execute work of excavating, lining, grouting, and construction of tunnel so that ground settlement or loss will be minimized. Completed primary tunnel lining shall have full bearing against earth with no voids or pockets left in work. Fill peripheral space between support elements and excavated surface no less frequently than after each shore or close by expanding support elements against ground as shield advances.

C. Maintain clean working conditions inside tunnel and remove muck, debris, material spills, unusable supports, and other material not required for tunneling.

D. Be aware that various existing soil borings, piezometers, or instrument wells may coincide with proposed tunnel alignment. These may or may not have been backfilled with grout and therefore caution should be used in tunneling through these existing borings. Take mitigating measures to counter effect these boreholes, piezometers, or instrument wells may have on tunneling operations.

E. Perform tunneling under railroad embankments, highways, or streets to prevent interference with operation of railroad, highways, or streets.

F. Do not perform any surface activities pertaining to water line construction within a tunnel area unless otherwise approved by City Engineer.

3.02 GROUND WATER CONTROL AND GROUND STABILIZATION

A. Provide necessary ground water control measures to perform work and to provide safe working conditions. Prevent excessive inflow of water into excavation during construction of tunnel and installation of carrier pipe and grouting of annular space. Ground water control method shall provide means to prevent piping of fines into shafts or tunnel and other adverse effects due to ground water inflow. Additional requirements are included in Section 01578 - Control of Ground Water and Surface Water. Other methods of construction, including tunnel work under compressed air, may be considered when Contractor is able to demonstrate that it will prevent flow of materials or water into tunnel excavation and allows construction of work to meet requirements of drawings and specifications. Additional requirements are included in Section 01578 - Control of Ground Water and Surface Water.

B. Anticipate that portions of tunnel excavation may be below ground water table and in cohesionless soils, even when not indicated on soil borings, and in conditions which may require ground water control system for tunneling operations. Install filter fabrics, backer-rods and other means as necessary to prevent piping of fines into tunnel. Remove water that may be encountered during course of work by pumping, well pointing, deep well pumping, or other means determined by Contractor as necessary to achieve stable conditions and applied in manner as described in Section 01578 - Control of Ground Water and Surface Water. Standing water not permitted at face, in tunnel or shafts.

C. The ground water control method used shall not cause damage to adjacent structures or property due to lowering of water table and subsequent ground settlement. In event damage does occur, correct damage and settle claims arising from damage.

D. If Contractor chooses pumping installations to control ground water level or installs pervious liner through water bearing layers, install and maintain instrumentation system to monitor water level and to detect movement in adjacent structures and property. Monitor water level by recording initial water level before dewatering is started and thereafter on weekly basis. Remove water monthly from piezometers to demonstrate that they are operable. Submit weekly reports of water levels to City Engineer. Provide access to piezometers for City Engineer to perform independent measurements.

E. Maintain dewatering system for tunnels in continuous operation until minimum of 48 hours after carrier pipe has been installed and annular space is fully grouted, or until watertight liner designed for hydrostatic pressures is installed.

F. If eductors, well points or deep wells are used, space them adequately to provide necessary dewatering. Use sand packing, and other means to prevent pumping of fine sands or silts from subsurface and to minimize ground subsidence. Check continuously to ensure that subsurface soil is not being removed by ground water control operation or subsurface drainage

into shafts or through pervious liner. Before operations begin, maintain availability of pumping equipment and other machinery on site to assure that operation of dewatering system can be maintained.

G. When groundwater control is necessary, do not begin tunneling operations until monitoring data shows that it is safe to do so. When dewatering is sole means of ground water control, draw piezometric level at least down below elevation of invert of tunnel, or to lower elevation as required for excavation face and tunnel stability.

3.03 EQUIPMENT

A. Tunneling method or equipment which Contractor can demonstrate based on past experience will produce specified results for soils encountered will be considered. However, use tunneling method, whether hand or machine, with full-face closure capabilities.

B. Diesel, electrical, hydraulic, or air-powered equipment will be acceptable, subject to applicable Federal and State regulations. Diesel engines equipped with scrubbers are acceptable only when tunneling in free air with adequate ventilation. Provide compressed air and electricity for Contractor's operations from source outside tunnel.

C. Tunnel Boring Machine: When tunnel boring machine is used, employ equipment that will be capable of handling various anticipated ground conditions. In addition, TBM shall:

1. Be capable of minimizing loss of ground ahead of and around machine and providing satisfactory support of excavated face. Use TBM with, when necessary for ground control, earth-pressure balance or slurry-shield capabilities.

2. Conform to shape of tunnel with uniform perimeter that is free of projections that could produce over-excavation or voids. TBM shield shall be continuous around its full perimeter; open-bottom shield is not acceptable.

3. Have tail section long enough to enable setting of initial supports within machine, while still providing at least 12-inches of overlap beyond last installed support elements when thrusting jacks are extended to fullest extent possible.

4. Have propulsion jacks capable of moving machine in forward direction while maintaining construction tolerances with respect to line and grade, without damage to previously-installed tunnel supports. Design propulsion system so that in event of failure of any element of system, there is no movement backward and there is no overstressing or distortion of tunnel supports.

5. Incorporate seal in TBM tail shield to prevent leakage of grout between shield and liner into tunnel space, when grout is required immediately behind shield.

6. Have motors and operating controls protected against water inflow.

7. Provide bi-directional drive on cutter head wheel, or fins or grippers to control roll due to rotation.

8. Provide means for maintaining tunnel face under wet and adverse soil conditions. Use closure doors on cutter wheel or other means, such as earth-pressure balance or slurry shield, acceptable to City Engineer.

D. Tunnel Shield: tunnel shield is used (with or without attached mechanized excavating equipment),employ shield that will be capable of handling various anticipated ground conditions. In addition, shield shall:

1. Conform to shape of tunnel with uniform perimeter that is free of projections that could produce over excavation or voids. Appropriately sized overcutting bead or taper along length of shield may be provided to facilitate steering. Shield shall be continuous around its full perimeter; open bottom shield is not acceptable. Although it is recognized that capability to over excavate beyond perimeter of shield may be necessary under certain conditions, make provisions to prevent accidental over excavation.

2. Have hood, poling or breasting plates, shelves and breast jacks, breast tables, and combinations of these and other bracing as necessary to fully support face of tunnel excavation without loss of ground.

3. Have tail section long enough to enable setting of initial supports within shield while still providing at least 12-inches of overlap beyond last-installed support elements when shield has been pushed forward to fullest extent possible.

4. Have propulsion system for moving shield in forward direction, while maintaining construction tolerances with respect to line and grade, without damage to previously-installed tunnel support. Design propulsion system so that in event of failure of any element of system, there is no movement backward and there is no overstressing or distortion of tunnel supports.

5. Have motors and operating controls protected against water inflow.

6. Incorporate seal in tail of shield to prevent leakage of grout between shield and liner into tunnel space, when grout is required immediately behind shield.

E. Air Quality: Provide equipment to adequately ventilate entire tunnel operation during construction.

1. Provide portable testing equipment for carbon monoxide gas, hydrogen sulfide gas, oxygen deficiency, and explosive gases. Monitoring for other constituents may be required while tunneling in potentially contaminated areas as defined in Contractor's safety plan.

2. Provide audible automatic gas alarm on TBM to detect explosive gases Locate alarm near tunnel face.

3. Equip motors and controls with automatic shutoff methane monitoring system.

F. Lighting: Provide adequate lighting with lights at 50 feet, maximum spacing in tunnel. Fixtures shall be in watertight enclosures with suitable guards. Provide separate circuits for lighting and for electrical equipment.

G. Electrical: Equip electrical systems utilized on TBM with appropriate ground fault system. Electrical systems are to be insulated, not permitting bare-wire exposures.

H. Access: Provide safe access through tunnel to TBM.

1. Provide walkway in tunnels greater than 10 feet in diameter which is separate from tracks used by spoil removal equipment.

2. Equip locomotives or cars used for transport of personnel with necessary safety devices.

I. Necessary equipment for tunnel excavation includes telephones, signal systems, fire extinguishers, safety equipment, and other equipment required by Contractor's method of construction, work plan and safety plan. Maintain equipment in good repair, and readily available at place of work.

3.04 SHAFTS

A. Construction of Shafts: Conform work for all shafts, with or without permanent structures in them, to requirements of Section 02400 - Tunnel Shafts. Contractor responsible for selecting shaft locations in agreement with his planned method of tunneling and for sizing shafts.

3.05 TUNNEL EXCAVATION AND PRIMARY LINER INSTALLATION

A. Tunnel Excavation:

1. Methods of tunnel excavation at Contractor's option, subject to review of City Engineer.

2. Conduct tunneling operations in accordance with applicable safety rules and regulations, and Contractor's safety plan. Use methods which include due regard for safety of workmen, adjacent structures, utilities, and public.

3. Limit tunnel excavation to within easements and rights-of-way indicated on Drawings, and to lines and grades designated on Drawings. Perform excavation of sufficient size to allow installation of water line to lines and grades indicated on Drawings.

4. Locate equipment powered by combustible fuels at suitable distances from shafts to prevent possibility of explosion and fire in shafts or tunnel.

5. During open-face excavation:

   a. Excavate face commencing at crown and proceed down to invert. Excavate both sides of heading simultaneously. Keep hood buried in soil ahead where soils include sands and silts.

   b. Keep face breasted or otherwise supported; employ other means as necessary to maintain face stability and prevent falls, excessive ravelling, or erosion. Maintain standby face supports for immediate use when needed.

   c. During shut-down periods, support face of excavation by positive means; do not rely solely on hydraulic pressure for support. When face is untouched for more than 24 hours, and when required by City Engineer, fully breast face and shove shield tight against it.

6. During closed-face excavation:

   a. Carefully control and monitor volume of spoil removed. For earth-pressure balance TBM, balance spoil removed with advance rate and excavation rate.

   b. When cutting face is withdrawn, keep excavated face stabilized as required.

7. Advancing Shield: During forward movement of shield, provide sufficient support at excavation face to prevent movement of materials except materials as are physically displaced by elements of shield itself.

B. Size of Tunnel: Determine adequate tunnel size and section to match construction methods described in work plan. Build tunnels of sufficient size to permit efficient excavation operations, to provide sufficient working space for placing primary tunnel liner, and to allow for installation of water line as shown on Drawings or indicated in Specifications. Dimensions shown on Drawings represent minimum dimensions acceptable to City Engineer and do not necessarily represent size or section suitable for construction methods or operational procedures as may be proposed or conducted by Contractor.

C. Primary Liner:

1. Provide primary liner for tunnel which is capable of supporting ground, and hydrostatic forces until permanent water pipe has been installed and grouted in place, and to resist construction loads.

2. Use methods that ensure full bearing of soil against primary liner without significant settlement or movement of surrounding soil. To fill void behind primary liner, either expandable liner (e.g., ring beams and timber lagging) or nonexpandable liner (e.g., bolted steel liner plates) may be used provided grout is placed behind nonexpandable

liner. Box tunnel where ground is excavated to true shape may be ungrouted. Grout excavation not to true shape as result of careless excavation or loss of ground.

3. The primary liner's seepage inflow for each 100-foot length of tunnel shall not exceed 3 gallons per minute, including inflow through face or shield. Localized inflow shall not exceed 0.5 gallons per minute. Provide drainage facilities to remove inflow of water from tunnels and shafts. Provide means to prevent inflow of soil fines associated with water inflow by use of filter fabrics or other approved methods.

4. Expandable liner shall be continuous and shall be expanded to limits of excavation promptly after it is out of shield.

5. During excavation of tunnel, advance TBM or shield only far enough to permit construction of one primary liner ring beam set, or rings of bolted steel liner plates that can be assembled entirely within tail shield of TBM.

6. Install filter fabric around exterior of primary liner when using non-watertight liner and when tunneling through sandy or silty ground conditions. Install backer rods at ribs as required to control migration of fines. Close windows in lagging.

7. Provide hog rods, struts or similar members when required to maintain roundness. After grouting liner shall be no more than 3 percent out of round as measured by difference between maximum and minimum measured diameter divided by average diameter.

D. Hand Jacking of Casing:

1. Provide heavy-duty jacks of capacity suitable for forcing casing pipe through ground. Construct operating jacks so that even pressure is applied to all jacks used. Provide suitable jacking head, (timber, etc.), and suitable bracing between jacks and jacking head. Provide suitable jacking frame and/or back stop. Set casing pipe to be jacked on guides, (timber, etc.), properly braced together, to support section of pipe and direct it to proper line and grade. Place whole jacking assembly so as to line up with direction and grade of casing pipe.

2. Excavate ground material just ahead of casing pipe by use of air-powered tools, excavating machine or other acceptable means, and remove through casing pipe. Then force casing pipe through ground with jacks, into space thus provided. Dispose excavated material as specified.

3. Trim excavation in manner so that at least one third of circumference of excavation conforms to contour and grade of casing pipe. Provide clearance of not more than 2 inches for upper half of casing pipe with clearance tapering off to zero at point where excavation conforms to contour of casing pipe. cutting edge of steel plate installed around head end of casing pipe extending short distance beyond end of casing pipe with

inside angles or lugs to keep cutting edge from slipping back onto casing pipe may be used.

4. In addition to requirements set for in this specification, Contractor shall:

   a. Excavate face commencing at crown and proceed down to invert. Excavate heading so that both sides of heading are excavated simultaneously.

   b. At all times maintain standby face supports to allow for immediate use when needed.

   c. At end of each shift and whenever excavation is suspended or shut down, install breast boards, or other approved methods, across full face of heading.

5. Distance that excavation extends beyond end of casing pipe shall not exceed three feet. Decrease this distance as directed by Engineer, or due to character of material being excavated.

6. The casing pipe, insofar as practical, jack from low or downstream end. Lateral or vertical variation in final position of casing pipe from line and grade as established by Engineer will be permitted only to extent of 1 inch in 10 feet, provided that variation is regular and only in one direction and that final grade of flow line is in direction indicated on plans. Remedy overcutting by pressure grouting entire length of installation. Use of grout mix immediately behind shield tail shall have efficient tail seal to prevent flow of grout into shield.

7. Depending on character of soil encountered during jacking operation, carry on operation without interruption, insofar as practical, to prevent casing pipe from becoming firmly set in ground.

8. Remove and replace casing pipe damaged in jacking operations by Contractor at no additional cost to Owner.

9. Backfill pits or trenches which have been excavated to aid jacking operations as soon as casing pipe is complete in place, equipment and appurtenances have been removed and structure, which is to be built in excavated zone, is in place. In no case shall pits remain open without appropriate safety barricades, concrete traffic barriers (CTB's), railing or plates.

10. When jacking casing pipe, water jetting of casing pipe bedding or backfill is not allowed. In unconsolidated soil formations, use gel-forming colloidal drilling fluid consisting of at least 10 percent of high grade fully hydrated bentonite to seal voids outside walls and furnish lubrication for installation of casing pipe.

E. Grouting:

1. Furnish and operate suitable equipment for grouting operations to effectively and completely fill voids outside of primary tunnel liner as quickly as possible.

2. Additional requirements pertaining to grout mix design and tunnel grouting are provided in Section 02431 - Tunneling Grout.

3. Provide in tunneling work plan description of primary liner grouting operations, including:

   a. Arrangement of grouting equipment including mixer, pumps, piping and hoses, valves, pressure gauges and injection fixtures.

   b. Location, spacing and size of grout ports and vents.

   c. Grouting sequence for initial backfill of voids between liner and ground, and for second stage back grouting.

   d. Grout injection pressures and estimated volumes.

   e. Procedure to check for remaining voids.

   f. Sampling procedures and locations for quality control testing.

   g. Grout production and quality shall be in accordance with Contractor's mix design and grout production plan as required by Section 02431 - Tunneling Grout.

4. Use care in grouting operations to prevent damage to adjacent utilities or other properties. Ensure that pressure used in grouting is not great enough to distort or imperil work.

5. Fill voids behind nonexpandable primary liner with sand-cement grout promptly after liner is out of shield. Grout pressure shall not exceed value that may cause damage or distortion to installed liner plate rings. Grout from bottom up and plug each grout hole promptly after grout has been placed. Provide seals on tail of TBM which will prevent grout from moving into shield.

6. Liner requiring grout shall be back grouted (second stage grouting) once each shift, or more often when required to ensure that all voids are filled.

7. Place grout behind tunnel liner at end of each day or at every 10 feet of tunnel installed, whichever is less, unless in opinion of Engineer, ground conditions are such as to require each ring to be grouted immediately after erection. Upon completion of each grouting operation, sound primary liner and immediately correct voids discovered by necessary means as approved by Engineer. After all voids are successfully filled, grout

holes will be packed, when necessary, with dry mortar mix and threaded taps securely placed in holes.

8. Completely and immediately fill voids outside limits of tunnel excavation created by caving or collapse of earth cover over excavation, or by other cause, with sand cement grout. Perform second grouting to fill soft spots or voids which may be detected, no later than 24 hours after initial grouting of primary liner.

9. Perform quality control sampling and testing of grout.

   a. Grout production shall be in accordance with Section 02431 - Tunneling Grout.

   b. Measure density of grout throughout placement procedure as directed by City Engineer. Measure grout density at discharge point and discharge grout until density is within 0.3 pounds per gallon of input density.

   c. Take samples of well-mixed grout for 28-day compressive strength tests at beginning, middle and end of each grouting operation.

3.06 TUNNELING DATA

A. Submit shift logs of construction events and observations within 24 hours of operation on at least following:

1. Location of face by station and progress of tunnel drive during shift.

2. Observation of lost ground and other signs of ground movement.

3. Location and elevation of significant soil strata boundaries and brief soil descriptions.

4. Ground water control operations, piezometric levels, ground water inflow location and rates.

5. Completed field forms for establishing and checking line and grade and achieved tolerance relative to design alignment.

6. Operation shut-down periods or other interruptions in work, and reason.

7. Any unusual condition or event.

B. Clearly mark primary liner every 20 feet along tunnel with distance in feet from centerline of preceding shaft.

3.07 CONTROL OF TUNNEL LINE AND GRADE

A. Construction Control:

1. The City Engineer will establish baseline and benchmarks indicated on Drawings. check these baseline and benchmarks at beginning of work and report errors or discrepancies to City Engineer.

2. Use baseline and benchmarks established by City Engineer to furnish and maintain reference lines and grades for construction. Use these lines and grades to establish location of tunnel, water line, and structures.

3. Establish and be fully responsible for accuracy of controls for construction of Project, including access shaft locations, structures, tunnel line, and grade. Utilize laser to insure line and grade are maintained during tunneling process.

4. Establish control points sufficiently removed from tunnel operation not to be affected by potential ground movement.

5. maintain daily surveying records of alignment and grade and submit three copies of records to City Engineer by end of day after work performed. Locate points at top, bottom and each side of springline.

6. check tunnel survey control against aboveground undisturbed reference at least once each week and once for each 250 feet of tunnel constructed, or more often as needed or directed by City Engineer.

B. Earth Movement: Contractor responsible for damages due to settlement from construction-induced activities or occurrences.

1. Take precautions to avoid damage or settlement to buildings, structures, roads, and utilities to work in proximity of tunnel. Minimum precautions to include use of construction methods and equipment to minimize loss of earth at tunnel face and settlement of soil around primary tunnel liner.

2. Refer to Paragraph 3.09, Monitoring for detecting earth movement.

3. In event movement of ground is detected, City Engineer may order work stopped and secured. Before proceeding, correct problems causing or resulting from movement.

4. Be aware that when settlement of ground surface should occur during construction of tunnel which will affect accuracy of temporary benchmarks established by City Engineer, detect and report movement. Locations of permanent City of Houston monumentation benchmarks are indicated on Drawings; Contractor may use these to verify temporary benchmark accuracy. Advise City Engineer of settlement affecting permanent monumentation benchmarks. Upon completion, submit field books pertaining to monitoring of permanent monumentation benchmarks to City Engineer.

C. Tunnel Line and Grade:

1. Survey crown, invert, and springline on each side of primary liner at 50-foot intervals, or minimum of once per shift, or more frequently when line and grade tolerances have been exceeded, to ensure alignment is within tolerances specified. Conduct survey immediately behind tunnel excavation to allow immediate correction of misalignment.

2. When excavation is off line and grade, make corrections to plan line and grade at rate of 3 inches per 100 feet.

3. Control excavation of tunnel and construction of primary liner to allow construction of carrier pipe within 6 inches on line and 4 inches on grade and to maintain circular shape of tunnel.

4. Alignment adjustments between primary tunnel liner and water main shall not encroach on minimum required clearance of 4 inches defined in Section 02517 - Water Main in Tunnels.

5. If unable to maintain specified tolerances, bear full responsibility and expense of correction (redesign, easement acquisition, etc.). when these tolerances are exceeded and redesign of structures is required, obtain services of qualified Professional Engineer registered in the State of Texas for redesign. Submit plans showing changes to City Engineer for review.

6. Backfill (grout) and reconstruct tunnel built outside tolerance or which is outside City's right-of-way to be within tolerance when so directed by City Engineer.

3.08 TUNNEL CONNECTIONS, TERMINATIONS, AND TEMPORARY BULKHEADS

A. Connect new tunnels to existing structures by removing existing bulkheads, when necessary, and sealing junction as shown on Drawings.

B. Seal terminations of tunnels, which are not connected to permanent structures, by temporary bulkhead.

C. Design temporary bulkheads where and when required and obtain City Engineer's acceptance of design prior to constructing it. Provide bulkheads capable of resisting lateral earth and hydrostatic pressures, waterproof, and capable of being removed without damaging water line or plastic liner.

3.09 MONITORING

A. Monitoring Instrumentation: This specification establishes minimum instrumentation requirements for tunneling. Additional instrumentation requirements for critical areas may be specified elsewhere in Specifications or on Drawings. Contractor may install more extensive system at Contractor's sole expense. Instrumentation specified shall be accessible at all times to City Engineer.

1. Submit for review, prior to construction, Monitoring Plan including instrument installation design, instrumentation points location and layout, manufacturer's catalog literature, installation report formats.

2. Install and maintain system of instrumentation to monitor tunneling operation and to detect movement in soil and adjacent structures. Instruments shall consist of no less than sufficient number of inclinometers and crack monitors at bridge and adjacent structures and sufficient piezometers. Use monuments sufficiently removed from construction to avoid errors in readings due to ground settlement.

3. Installation of instrumentation by Contractor shall not preclude City Engineer, through independent contractor or consultant, from installing instrumentation in, on, near, or adjacent to construction work. Provide access to work for independent installations.

4. Install soil instruments such as piezometers, inclinometers, extensometers, and crack monitors by qualified subcontractor specializing in geotechnical work.

5. Install extensometers to depth of 5 feet above crown of water line tunnel as shown on Drawings to measure vertical movements in soils during and subsequent to tunneling. Extensometer consists typically of three-prong anchor, 1/4-inch standard stainless steel inner pipe, and 1-inch standard Schedule 80 PVC outer pipe. Pipes are assembled in sections and fastened together with standard couplings to required anchor depths. Locate top of extensometer within flush-mounted hand hole cover capable of withstanding HS-20 truck loading. Geotechnical instrumentation installation subcontractor shall provide procedures for installation of extensometers as part of Monitoring Plan.

B. Building and Structures Assessment: Submit for review prior to construction, Building and Structures Assessment Plan. Provide preconstruction and post-construction assessment reports for buildings and structures located within distance equal to depth of tunnel but at least 50 feet in plan from proposed tunnel centerline and shafts. Include photographs or video of existing damage to structures in vicinity of water line alignment in assessment reports.

C. Settlement Surveying: This specification establishes minimum settlement survey requirements for structures and ground surface monitoring points.

1. Submit settlement surveying and monitoring plan for review prior to construction. Plan shall identify location of settlement monitoring points, reference benchmarks, survey schedules and procedures and reporting formats.

2. Locate survey points on all structures within distance equal to depth of tunnel but at least 50 feet in plan from tunnel centerline.

3. Record horizontal coordinates and elevations (with accuracy of 0.01 feet) for each survey point location. Reference survey points so that they may be accurately re-establishedwhen lost or destroyed.

4. Unless otherwise specified, record ground surface elevations on center line ahead of TBM and at 20 feet either side of center line at minimum of 100-foot intervals or at least three locations per tunnel drive. Starting 100 feet ahead of TBM and continuing until TBM is 100 feet beyond measurement point or until further movement is not detected, unless otherwise directed by City Engineer. Record cross-sectional points at 10-foot spacing for distance of 50 feet each side of center line or to ROW, whichever is less.

5. Locate survey points at crossings under installations as follows:

   Roads: Centerline and each shoulder.

   Railroad: Track subbase at centerline of each track.

   Utilities and Pipelines: Directly above and 10 feet before and after intersection.

1. For shaft settlement see Section 02400 - Tunnel Shafts.

D. Measure and maintain records of deformation of primary liner.

E. Reading Schedule and Reporting: Submit readings from various instruments and survey points weekly to City Engineer. Take daily Readings as required by City Engineer when construction is approaching or near critical structures (structures, bridge piers, pipelines, etc., partially or entirely located within distance equal to depth of tunnel but at least 50 feet in plan from tunnel centerline). Take initial readings of surface points before excavation or construction is started.

Immediately report to City Engineer movement, cracking, or settlement which is detected and take immediate remedial action. Contractor shall be fully responsible for damage to adjacent structures.

At end of construction after water line is installed, and dewatering is discontinued, make final survey of control points established for instrumentation and observation. Submit final readings to City Engineer. Make visual inspection of structures adjacent to water line and report to City Engineer condition of structures, damage incurred during construction, and corrective action taken.

DISPOSAL OF EXCESS MATERIAL

Remove spoil from job site and dispose in accordance with Section 01504 - Temporary Facilities and Controls.

END OF SECTION

Section 02511S

WATER LINES

The following supplements modify Section 02511 - Water Lines Standard Specification. Where a portion of the Specification is modified or deleted by this Supplementary Specification, the unaltered portions of the Specification shall remain in effect.

1.02 MEASUREMENT AND PAYMENT: replace Paragraph 1.02 A. 1 with the following:

1. Payment for water lines installed by open- cut or trenchless construction or aerial crossing, with or without restrained joints, with or without casing, within limits of pipe offset section or within limits of Potentially Petroleum Contaminated Area (PPCA) or within limits of Fault Hazard Zone (FHZ) is on a linear foot basis for each size of pipe installed. Payment will include welded and restrained joints, for large diameter water lines. Separate pay items are used for each type of installation:

    a. Mains: Mains Measure along axis of pipe and include fittings and valves.

    b. Branch Pipe: Measure from axis of water line to end of branch.

Insert the following paragraph:

2.05 FLEXIBLE EXPANSION JOINTS:

A. Install Flexible Expansion Joints at locations indicated on drawings, within limits of Fault Hazard Zone, in accordance with the manufacturer's recommendations.

3.01 PREPARATION: Delete Paragraph I and replace with the following:

I. If asbestos-cement (A.C.) pipe is encountered, follow safety practices outlined in OSHA 29 CFR 1926.1101 – Asbestos. Refer to Section 02221 – Removing Existing Pavements, Structures, Wood, and Demolition Debris for removing and disposing of A.C. pipe.

END OF SUPPLEMENT

Approved by:

James T. Lincoln, P.E. Date 10/21/13
City Engineer
Department of Public Works & Engineering

Section 02513S

WET CONNECTIONS

The following supplements modify Specification Section 02513 – Wet Connections. Where a portion of the Specification or Detail is modified or deleted by this Supplementary Specification, the unaltered portions of the Specification shall remain in effect.

1.03 REFERENCES: Add the following Paragraph B:

B. OSHA 29 CFR 1926.1101 – Asbestos.

Add the following new Paragraph:

3.03 CONNECTION TO ASBESTOS-CEMENT (AC) PIPE

A. Notify Project Manager when AC pipe is encountered.

B. Refer to Section 02221 – Removing Existing Pavements and Structures for crew training, safety precautions, and AC pipe removal requirements.

C. Protocol:

1. Mechanically excavate to no more than 6 in. of AC Pipe. Carefully uncover the remainder of pipe by hand or with shovel.
2. Keep pipe adequately wet before and during work.
3. Place 2 layers of 6 mil polyethylene sheeting under the asbestos pipe to prevent soil contamination.
4. Use hand tools to remove collars. Replace minimum 6 ft. section of pipe. Use of power tools is prohibited.
5. Do not crush AC pipe in place. Remove waste AC pipe.

END OF SUPPLEMENT

Approved by:

Mark L. Loethen, P.E., CFM, PTOE
City Engineer
Department of Public Works & Engineering

11/17/2012
Date

Section 02525S

TAPPING SLEEVES AND VALVES

The following supplements modify Specification Section 02525 – Tapping Sleeves and Valves. Where a portion of the Specification or Detail is modified or deleted by this Supplementary Specification, the unaltered portions of the Specification shall remain in effect.

1.03 REFERENCES: Add the following Paragraph I:

I. OSHA 29 CFR 1926.1101 – Asbestos.

Add the following new Paragraph:

3.03 ADDITIONAL REQUIREMENTS FOR TAPPING ASBESTOS-CEMENT (AC) PIPE

A. Notify Project Manager when AC pipe is encountered.

B. Refer to Section 02221 – Removing Existing Pavements and Structures for crew training, safety precautions, and AC pipe removal requirements.

C. Protocol:

1. Mechanically excavate to no more than 6 in. of AC Pipe. Carefully uncover the remainder of pipe by hand or with shovel.
2. Keep pipe adequately wet before and during work.
3. Locate tap a minimum of 2 ft. away from existing AC collar.
4. Use of power tools is prohibited.
5. Remove waste AC pipe coupon.

END OF SUPPLEMENT

Approved by:

Mark L. Loethen, P.E., CFM, PTOE
City Engineer
Department of Public Works & Engineering

11/17/2012
Date

Section 2752S

The following supplement modifies Section 02752 Standard Specification. Where a portion of the Specification is modified or deleted by this Supplementary Specification, the unaltered portions of the Specification shall remain in effect.

1.01 SECTION INCLUDES.

Add Part C as follows.
C. Full depth saw cutting of concrete pavement as required by other agency.

1.02 MEASUREMENT AND PAYMENT

Add item 6.
6. Full depth Saw cutting for concrete pavement will be paid on linear foot base, if required by other agency for joining with existing roadway.

Renumber item 6 as 7

END OF SUPPLEMENT

Approved:

John H Kuo, P.E.
Assistant Director
Engineering and Construction Division

12/29/09
Date

Section 2752S

The following supplement modifies Section 02752 Standard Specification. Where a portion of the Specification is modified or deleted by this Supplementary Specification, the unaltered portions of the Specification shall remain in effect.

1.01 SECTION INCLUDES.

Add Part C as follows.
C. Full depth saw cutting of concrete pavement as required by other agency.

1.02 MEASUREMENT AND PAYMENT

Add item 6.
6. Full depth Saw cutting for concrete pavement will be paid on linear foot base, if required by other agency for joining with existing roadway.

Renumber item 6 as 7

END OF SUPPLEMENT

Approved:

John H Kuo, P.E.
Assistant Director
Engineering and Construction Division

12/29/09
Date

Section 13281
Asbestos Abatement Specifications

GENERAL REQUIREMENTS

The Project name is Bridge across Hoods Bayou on Greens Road. The site Plan for the bridge is shown in this Project Manual for Contractor's convenience. The scope of work for this project includes the removal and disposal of characteristically hazardous materials from the site prior to any scheduled construction and demolition at the site. Contact the ECMS, Inc. Environmental Health and Safety Director at 713-842-9896 for additional information and safety instructions for transportation of all hazardous, materials from the site.

A. This Section specifies administrative and procedural requirements for submittals required for performance of the Work, including:
   1. Site Specific Health and Safety Plan (H&SP).
   2. Certificates of Health of Safety Training.
   3. Hazardous Materials Handling Plan, Waste Profiling and Manifesting Procedures.
   4. Certificates of Insurance for General and Professional Liability, Workman's Compensation, Pollution Insurance with the Owner and Owner's Project Manager listed as Certificate Holder with Waiver of Subrogation.
   5. Analytical Laboratory Certification.
   6. Analytical Laboratory Reports.

B. Administrative Submittals: Refer to other Sections and other Contract Documents for requirements for administrative submittals. Such submittals include, but are not limited to:
   1. Permits.
   2. Applications for Payment.
   3. Performance and Payment Bonds.
   4. Insurance Certificates.
   5. List of Subcontractors.

1.1 SUBMITTAL PROCEDURES

A. Coordination: Transmit each submittal sufficiently in advance of performance of related activities to avoid delay.

1.2 CONTRACTOR'S CONSTRUCTION SCHEDULE

A. Bar-Chart Schedule: Prepare a fully developed, horizontal bar-chart type Contractor's construction schedule.

1.3 WORK INCLUDED

A. Perform all planning, administration, execution, and coordination necessary to properly and safely perform the work identified in this Specification.

B. Coordinate all work activities with Owner and Owner's Representative to minimize disruption of Owner's operations and adjacent Property Owners' operations.

C. General items include but are not necessarily limited to:
   1. Coordinate with Owner/Owner's Representative for use of available existing utilities (electricity, water and sewer). Arrange and pay for temporary utilities at the site as required or provide generator power. Installation of temporary electrical power panels at the site with Ground Fault Circuit Interrupters (GFC) are needed for Contractor/Abatement Contractor's and Environmental Consultants equipment. All electrical tie-ins are to be performed by licensed electricians.

2. Coordinate project schedule and phasing with Owner/Owner's Representative, and Environmental Consultant.
3. **Obtain necessary permits and submit any required notification. Pay for all required permit/notification fees, including Texas Department of State Health Services (DSHS) notification fees.**
4. Prepare work area(s) as specified elsewhere.
5. Perform incidental mechanical, electrical and plumbing work necessary for conducting the Work. Utilize tradesmen experienced and licensed in their respective trades.
6. Perform selective demolition scope of work as specified if needed.
7. Removal and disposal of all asbestos-containing materials as specified elsewhere.
8. Removal and disposal of various maintenance, housekeeping and other chemicals/chemical containers. Dispose of chemicals/chemical containers in accordance with applicable regulations.
9. Recovery, disposal and/or recycling of oils/fuels/hydraulic fluids that maybe encountered. Recycle or dispose of oils/fuels/hydraulic fluids in accordance with applicable regulations.
10. Cleanup of the work area(s) as specified.
11. Dispose of non-contaminated, removed objects as construction waste. Removal and disposal of fixed or moveable objects as necessary to facilitate required abatement

SCOPE OF WORK

DESCRIPTION

A. The project intent is to perform asbestos abatement activity in removing non friable asbestos expansion joints material from the base of the bridge. Disposal & Abatement activity is governed under NESHAP Category II guidelines. Following the abatement, the entire targeted area will be upgraded.

B. The asbestos abatement scope of work shall also include any hidden asbestos-containing materials that may be uncovered during the construction / demolition activities. This work will also include the necessary selective demolition required to access the identified asbestos-containing materials.

C. There is no lead abatement required for this site. All metal components shall be recycled.

D. All expansion joint material shall be considered asbestos-containing and shall be abated by mechanical techniques and separated from the general construction waste stream. These materials shall be removed and disposed of as a NESHAP Category II, non-friable material. There are approximately Sixty (60) or more linear feet to be abated from the base of the bridge.

E. All asbestos abatement work shall be conducted pursuant to the OSHA and NESHAP requirements.

F. The quantity of the material to be removed to allow for demolition activities is approximately 60 sq. ft. The material is in fair condition, with only minor damage to edges that are exposed. The damaged areas should be encapsulated to avoid additional damage prior to demolition.

Option 1: Total Abatement

Abatement approximately 60 sq. ft. of asbestos containing mastic material at bridge base by standard wet methods and proper disposal of materials. Estimated Cost: $3,000.00

Option 2: Non – Abatement Criteria

If contractors carefully remove asbestos-cement materials using tools that do not cause significant damage as defined by NESHAP, the materials are not considered RACM and can be disposed of with other construction debris. Asbestos associated with cement products are subject to the asbestos NESHAP guidelines and should be determined by the owner or operator on a case-by case basis based on the demolition techniques to be used.

In general, since cleanup activities such as loading waste debris onto trucks for disposal do not subject non-friable materials to sanding, grinding, cutting or abrading; such materials are not considered asbestos–containing waste materials and are not regulated by the asbestos NESHAP guidelines.

The general contractor should coordinate with the abatement contractor to schedule abatement activities.

2.1 WORK TASK NOT INCLUDED

A. Contractor/Abatement Contractor shall be responsible for air monitoring required for the safety of its employees. **Personal air monitoring for abatement workers and subcontractor's workers as required by regulatory agencies.**

B. Re-installation or replacement of any removed items scheduled for demolition or abatement.

2.2 EXISTING CONDITIONS

A. Existing conditions are reflected correctly to the best of Owner's and Environmental Consultant's knowledge. Should minor conditions be encountered which are not exactly as indicated, modification to work shall be made as required at no additional expense to Owner.

B. Randomly or arbitrarily selected areas were sampled, Environmental Consultant and Project Owner make no representation, warranty, or guaranty that the conditions indicated by the test reports either are representative of those conditions existing throughout the area, or that unforeseen developments may not occur, or that materials other than, or in proportions different from those indicated may not exist.

C. Contractor/Abatement Contractor is responsible for fire safety in the project work area(s).

D. Provide Type "A" fire extinguishers for temporary offices and similar spaces where there is minimal danger of electrical or grease-oil-flammable liquid fires. In other locations, provide type "ABC" dry chemical fire extinguishers, or a combination of several extinguishers per National Fire Protection Association (NFPA) recommendations and OSHA regulations. In accordance with DSHS regulations, a minimum of one fire extinguisher shall be placed within each abatement project containment for every 1,000 square feet of containment area.

E. Contractor/Abatement Contractor's employees shall not enter areas with cigarette lighters, matches, cigarettes, cigars, pipes or other flame emitting items. Contractor/Abatement Contractor's employees shall not smoke cigarettes, cigars, pipes or the like within the designated work areas.

F. Flammable materials shall not be stored in the work area.

2.3 CONTINGENCY PLAN

A. Prepare a contingency plan for emergencies including fire, fire alarms, accident, power failure, diminished pressure failure, or any other event that may require modification of abridgement of decontamination or work area isolation procedures. Include in plan specific procedures for decontamination or work area isolation. Incorporate facility's emergency procedures as required. Note that nothing in the Specifications and Drawings should impede safe exiting or providing of adequate medical attention in the event of an emergency.

B. Post at the entrance to the work area telephone numbers and locations of emergency services.

2.4 PROJECT SUPERINTENDENT

A. Maintain a "competent" full-time superintendent (as defined by the OSHA, EPA and DSHS) and necessary assistants who shall be in attendance at the building during the progress of the work. The superintendent shall be satisfactory to Owner/Owner's Representative and shall not be changed without prior approval by the Owner/Owner's Representative.

2.5 SEGREGATION OF WORK AREAS

A. Segregate the work area from the surrounding unoccupied areas and public.

1. Install temporary construction barriers acceptable to Owner/Owner's Representative to segregate abatement work areas.
2. Demarcate work areas with warning barrier tape and post warning signage as required for the applicable hazardous abatement work.

2.6 UTILITIES

A. Contractor/Abatement Contractor may temporarily connect to available, existing permanent utilities during execution of the Work. Make connections in locations designated by Owner/Owner's Representative. The cost for the use of available, existing permanent utilities will be paid by Owner. If permanent utilities or domestic hot water are not available, Contractor/Abatement Contractor is to provide and pay for temporary utilities and/or domestic hot water during the Project. Remove connections and all extensions of utilities at Project completion.

2.7 SALVAGEABLE MATERIALS

A. Consider all materials and items removed in the execution of the Work salvageable unless specifically noted otherwise in the Contract documents.

2.8 CLEANUP

A. Dismantle and dispose of all temporary construction barriers, plastic sheeting, etc. erected to isolate the work area at completion of Work.

B. Maintain public areas free from accumulation of trash, waste, rubbish or other abatement/demolition.

WORKERS PROTECTION

3.1 PERSONNEL PROTECTION

A. Prior to commencement of work, instruct all workers in the appropriate procedures for personnel protection and asbestos removal. Ensure that workers are knowledgeable in these procedures.

B. Acknowledge and agree to sole responsibility for enforcing worker protection requirements at least equal to those specified in this Section.

C. Provide workers with personally issued and marked respiratory equipment approved by NIOSH and MSHA for the type of work being performed.

D. Where respirators with disposable filters are used, provide sufficient filters for replacement as necessary.

E. Provide respiratory protection at all times, which is in compliance with Occupational Health and Safety Administration (OSHA) requirements. When not in violation of the above, the minimum acceptable respiratory protection used for this project shall be as follows, unless airborne fiber concentrations inside the face mask exceed 0.01 fibers per cubic centimeter (f/cc). In the event that airborne fiber concentrations inside the mask exceed 0.01 f/cc, respiratory protection required to achieve 0.01 f/cc shall be used.

1. Provide a minimum of half-face dual cartridge respirators for workers during pre- cleaning of work area (including HEPA-vacuuming of floors), installation of plastic sheeting, and waste handling and disposal activities outside the work area.

2. Provide a minimum of Powered Air Purifying Respirator (PAPR) equipment for "friable" removal work and half-face respirators for "glove-bag" and "non-friable" removal work for workers during all phases of the Work from the time of first disturbance of the asbestos- containing/contaminated material until acceptance of final air clearance tests by Environmental Consultant.

3. Provide additional "piggy-back" cartridges recommended by the product or solvent manufacturer whenever solvents (e.g. spray adhesives, etc.) are used.

F. Be solely responsible for providing necessary air sampling and analysis by an independent testing laboratory for compliance monitoring of own respiratory protection with Occupational Health and Safety Administration (OSHA) regulations. Pay for all costs associated with such testing. In addition, submit copies of personal air monitoring results to Environmental Consultant daily. If a prior negative exposure assessment (NEA) is used in lieu of employee air monitoring, provide documentation indicating that an NEA has been performed and include supporting documentation (e.g. the objective data used in the determination of the NEA).

G. Permit no visitors, except for governmental inspectors having jurisdiction, or as authorized by Owner/Owner's Representative or Environmental Consultant, in the work areas after commencement of asbestos disturbance or removal.

H. Provide workers with sufficient sets of protective disposable clothing, consisting of full-body coveralls, head covers, gloves, and foot covers, of sizes to properly fit individual workers.

I. Leave reusable equipment, apparel and protection devices (excluding respirators) in the contaminated equipment room until the end of the asbestos abatement work, at which time such items shall be disposed of as contaminated waste or decontaminated for reuse.

J. Provide suitable respirators (new and unused) and protective equipment for use by authorized visitors, Owner/Owner's Representative, Environmental Consultant and Environmental Consultant representatives. Furnish these in as many sets as required for full-time monitoring by Environmental Consultant. Provide and post at the entrance to the work area the asbestos removal work procedures to be followed by workers.

3.2 SIGN IN/OUT LOG

A. Maintain a Sign In/Out Log in the immediate vicinity of the Change Room of the personnel decontamination enclosure. Maintain log from the time the first activity is performed involving the application of plastic sheeting until acceptance of the final air test results by Environmental Consultant. Require all persons entering the work areas, including the Contractor/Abatement Contractor's workers, Environmental Consultant, Owner or agents/representatives of the Owner, and government officials to register each time upon entering and leaving work areas. Indicate name, social security number, time, company or agency represented and reason for entering work area.

3.3 PERSONNEL SUBMITTALS:

A. Listing of supervisory personnel (including foremen) and workers to be utilized on the Project. Listing shall be in alphabetical order and include each worker's social security number. Include copy of Texas Department of State Health Services License or Registration for each asbestos supervisor or worker to be used on the Project.

B. Training documentation that each and every employee to be utilized on the Project has had instruction on the hazards of asbestos exposure, protective dress, use of showers, entry to and exit from work areas and on all aspects of work procedures and protective measures regarding asbestos removal.

C. Certification that each and every worker to be utilized on the Project is actively involved in an employee medical surveillance program for asbestos exposure. Include copy of physician's written opinion for each person to be utilized on the Project.

D. Individually signed and notarized forms by each and every worker to be utilized on the Project, documenting that each is actively involved in a company employee respirator protection program and has had appropriate training in respiratory protection. (SF-1)

E. Individually signed and notarized Certificate of Worker's Release Form for each and every worker to be utilized on the Project. (SF-2)

F. Manufacturer's specifications for air cleaning equipment, vacuum equipment, air handling equipment, respirator equipment, etc., as well as any special tools or

G. Safety equipment to be utilized on this Project. Manufacturer's certification or independent test reports confirming that materials to be utilized on this Project meet or exceed all performance criteria required by the specifications. Include manufacturer's safety data sheets (MSDS) and product data sheets for all applicable materials (e.g. adhesives, mastic removers, encapsulants/sealant materials, cleaning solutions, etc.).

H. Any special equipment, techniques, etc. to be used on the Project.

3.4 INTERMITTENT SUBMITTALS

A. Texas Department of State Health Services License or Registration, training documentation, physician's written opinion, respirator training documentation, worker release forms, etc. of all new employees used on the Project

B. Any special equipment, techniques, etc., to be used on the Project.

Copies of employee air monitoring results relative to Occupational Health and Safety Administration (OSHA) respiratory protection level compliance. If a prior negative exposure assessment (NEA) is used in lieu of employee air monitoring, provide documentation indicating that an NEA has been performed and include supporting documentation (e.g. the objective data used in the determination of the NEA).

3.5 SCHEDULE OF ASBESTOS AIR SAMPLES

A. Before Start of Work:

1. Environmental Consultant Agency will collect, at a minimum, the following air samples to establish a base line before the start of work:

ASBESTOS BASE LINE SAMPLES				
Sample Location	Number of Samples	Analysis Method	Minimum Volume (Liters)	Rate LPM
Work Area or Work Floors	3 Minimum	PCM	1,283	9.5

2. Base Line: An action level expressed in fibers per cubic centimeter which, for PCM, is equal to the greater of the average of the samples collected on mixed cellulose ester filters in the work area prior to abatement activities or 0.01 fibers per cubic centimeter.

B. Daily During the Course of the Work:

1. Environmental Consultant Agency Project Manager will collect area samples in areas and at times during the work as deemed necessary, required by the Agency Consultant, or as specified in the Specifications. Daily samples will be analyzed using Phase Contrast Microscopy.

C. Final Air Clearance Samples:

1. Testing Laboratory will analyze the following air samples to determine if the Contractor/Abatement Contractor may remove critical barriers and demobilize:

ASBESTOS FINAL AIR CLEARANCE				
Sample Location	Number of Samples	Analysis Method	Minimum Volume (Liters)	Rate LPM
Inside Work Area	3 Minimum Per Work Area Greater Than Or Equal To 1000 SQFT	PCM	1283	9.5 to <16
Inside Work Area	2 Minimum Per Work Area Less Than 1000 SQFT and Greater than 100 SQFT	PCM	1283	9.5 to <16
Inside Work Area	2 Minimum Per Work Area Less Than Or Equal To 100 SQFT	PCM	1283	9.5 to <16

3.6 RESULTS

A. Environmental Consultant Agency will perform all daily analysis promptly and issue results expeditiously in order to minimize any possible delay in the progress of the Work.

B. Test results shall be available to Owner and Contractor/Abatement Contractor as follows:

1. PCM Asbestos Final Air Clearance results: As quickly as possible as but not later than 8 hours following tests.

2. Results of other tests deemed necessary by Environmental Consultant: as quickly as possible, but not earlier than \8 hours following completion of tests.

C. Asbestos air tests will be collected both inside and outside of work areas, as necessary. Contractor/Abatement Contractor is cautioned, however, that should interpretations be made, opinions be formed and conclusions be drawn as a result of examining the test results, these interpretations, opinions and conclusions will be those made, formed and drawn solely by Contractor/Abatement Contractor. Contractor/Abatement Contractor is responsible for performing air tests required for its evaluation of the safety of its employees.

3.7 CLEANUP AND CLEARANCE TESTING

A. Provide general cleanup of work area concurrent with the removal of all asbestos-containing materials. Do not permit accumulation of debris within workspace surroundings.

B. Cleanup Sequence

1. Remove all visible accumulations of asbestos-containing material and debris.
2. Wet clean and HEPA-vacuum work area.
3. Clean all equipment used in the work area and remove from work area.
4. Dispose of debris from removal operations and used cleaning materials. Consider the materials to be contaminated and dispose of accordingly.
5. Notify Environmental Consultant for observation of cleaning to determine completeness. Work area will be considered clean when free from residual debris resultant from abatement operations or other activities subordinate to these operations.

C. Final Air Clearance Testing (Gross Removal Work Areas)

1. Environmental Consultant will test for the final air clearance levels upon notice from Contractor/Abatement Contractor that work areas are considered by Environmental Consultant as visually decontaminated. Final air clearance testing shall be performed using aggressive air sampling techniques and Phase Contrast Microscopy (PCM) analysis. If the final air clearance samples indicate airborne fiber concentrations of less than or equal to ambient prevalent levels or 0.01 f/cc, whichever is greater, the work will be considered completed.
2. Re-clean and continue to clean at Contractor/Abatement Contractor's expense, areas which do not comply with the specified final clearance level. Contractor/Abatement Contractor to bear cost of all follow-up tests necessitated by the failure of the air tests to meet the specified clearance level.
3. Upon achieving final air clearance, dismantle Decontamination Enclosure Systems and thoroughly wet clean and HEPA-vacuum immediate areas.
4. Dispose of debris from removal operation, used cleaning materials, unsalvageable materials used for sturdy barriers, and any other remaining materials. Consider the materials to be contaminated, and dispose of accordingly.

D. Final Air Clearance Testing (Glove-Bag Removal Work Areas)

1. Environmental Consultant will collect air samples in the work area during the removal and cleaning operations. If these samples indicate airborne fiber concentrations of less than or equal to ambient prevalent levels or 0.01 f/cc, whichever is greater, the work will be considered completed.
2. If airborne fiber concentrations during removal and cleaning operations indicate airborne fiber concentrations greater than ambient prevalent levels or 0.01 f/cc, whichever is greater, Environmental Consultant will test for the final air clearance levels upon notice from Contractor/Abatement Contractor that work areas are considered by Environmental Consultant as visually decontaminated. If the final air clearance samples indicate airborne fiber concentrations of less than or equal to ambient prevalent levels or 0.01 f/cc, whichever is greater, the work will be considered completed.
3. Re-clean and continue to clean at Contractor/Abatement Contractor's expense, areas which do not comply with the specified final clearance level. Contractor/Abatement Contractor to bear cost of all follow-up tests necessitated by the failure of the air tests to meet the specified clearance level.

4. Upon achieving final air clearance, dismantle the work area barriers and signage.

3.8 DISPOSAL OF ASBESTOS-CONTAMINATED WASTE

A. Performed ACM waste bag decontamination procedures as follows:

1. As bags are moved out of the work area, wet-wipe bags to remove all contamination from them before they are moved into an uncontaminated area.
2. Place bagged waste into appropriately labeled second bag for transport to landfill.
3. Label asbestos-containing/contaminated waste in accordance with EPA 40 CFR 61.150, including waste generator and location information.
4. Transport bagged waste on-site inside an enclosed buggy. Enclose and secure top of buggy with a minimum of 6-mil opaque plastic sheeting.

B. Transportation to landfill shall be performed in accordance with all federal, state, and local laws and regulations.

1. Place bags in the lockable, fully enclosed, metal waste disposal container, which has been lined with a minimum of one layer of 6-mil plastic sheeting. Plastic sheeting for the transport shall be reinforced type.
2. Transport contaminated waste using a transporter licensed by the Texas Department of Health to transport asbestos waste.
3. Provide Texas Commission on Environmental Quality or Environmental Protection Agency waste manifests for transportation of all contaminated waste to landfill.

C. Remove sealed and labeled bags of contaminated material and wastes, and transport them for disposal to an approved landfill as follows:

1. Notify Environmental Consultant prior to removing each waste disposal container from the jobsite.
2. Notify Owner and Environmental Consultant not less than 48 hours prior to the proposed time of delivery of contaminated waste to the landfill. Owner and Environmental Consultant may elect to observe this operation.
3. Dispose of treated, packaged, labeled, asbestos-containing waste material in accordance with EPA 40 CFR 61.150.
4. Allow only sealed plastic bags or impermeable containers to be deposited in landfill.
5. Ensure that there are no visible emissions to the outside air from site where materials and waste are deposited.
6. Submit copies of receipts from authorized representative of landfill operator for each delivery of waste material to Environmental Consultant after each delivery and a complete set of copies of receipts for all deliveries.

3.9 FIELD QUALITY CONTROL

A. Environmental Consultant will conduct air monitoring prior to, and throughout, removal and cleaning operations.

B. Visual observations will be performed in general accordance with ASTM E 1368-90 ("Standard Practice for Visual Inspection of Asbestos Abatement Projects").

C. A final visual observation will be performed in the work areas by Environmental Consultant following notification by Contractor/Abatement Contractor that stated areas have been properly cleaned and are ready for final air testing. Areas will be observed for the presence of visible dust, dirt and debris.

D. Tests will be performed in the work area after final cleanup and prior to removal of critical barriers.

E. Perform additional cleaning at no additional expense to Owner, if in the opinion of Environmental Consultant, based upon the final visual observation, previous cleanup operations were determined to be inadequate.

3.10 MEDICAL EXAMINATIONS

A. Examination shall as a minimum meet OSHA requirements as set forth in 29 CFR 1926 for hazardous waste operations. In addition, provide an evaluation of the individual's ability to work in environments capable of producing heat stress in the worker.

3.11 SUBMITTALS

A. Before Start of Work: Submit the following to the Environmental Consultant for review. Do not start work until these submittals are approved by the Consultant.

B. State and Local License: Submit evidence that all workers have been trained, certified and accredited as required by state or local code or regulation.

C. Certificate Worker Acknowledgement: Submit an original signed copy of the Certificate of Worker's Acknowledgement found at the end of this section, for each worker who is to be at the job site or enter the Work Area.

D. Report from Medical Examination: Conducted within last 12 months as part of compliance with OSHA medical surveillance requirements for each worker who is to enter the Work Area. Submit, at a minimum, for each worker the following:

1. Name and Social Security Number
2. Physicians Written Opinion from examining physician including at a minimum the following:
    a. Whether worker has any detected medical conditions that would place the worker at an increased risk of material health impairment from exposure to hazardous waste and lead.
    b. Any recommended limitations on the worker or on the use of personal protective equipment such as respirators.
    c. Statement that the worker has been informed by the physician of the results of the medical examination and of any medical conditions that may result from hazardous waste exposure.
    d. Copy of information that was provided to physician in compliance with 29 CFR 1926.
3. Statement that worker is able to wear and use the type of respiratory protection (if required) for the project, and is able to work safely in an environment capable of producing heat stress in the worker.

E. Notarized Certifications: Submit certification signed by an officer of the abatement contracting firm and notarized that exposure measurements, medical surveillance, and worker training records are being kept in conformance with 29 CFR 1926.

F. Health and Safety Plan: Submit a Site Specific Health and Safety Plan (H&SP) prepared by a qualified health and safety professional. The H&SP shall sufficiently identify the site specific health and safety hazards related to the work, to include but not be limited to the following: Radiation safety, emergency contact information for medical, law enforcement, fire department, Hazmat Spill response, and directions to the nearest medical facility. The H&SP shall also identify emergency contact numbers for health and safety officers of the Contractor, the site health and safety officer, and other key personnel. The H&SP shall include heat stress, hypothermia, and environmental monitoring of hazardous materials workers, facility information, work tasks, chemical and physical hazards, and personal protective equipment in accordance with OSHA requirements.

4.1 PROTECTIVE CLOTHING

A. Provide applicable "Tyvek" disposable protective clothing consisting of full-body coveralls, head covers, and boots as required by the most stringent OSHA standards applicable to the work and as manufactured by DuPont or approved equal. Eye protection, hard hats, gloves, and safety shoes shall be worn. They shall be in accordance with ANSI Z89.1 (1969) and ANSI Z41.1 (1967).

B. Coveralls: Provide disposable full-body coveralls and disposable head covers, and require that they be worn by all workers in the Work Area. Provide a sufficient number for all required changes, for all workers in the Work Area.

C. Boots: Provide work boots with non-skid soles, and where required by OSHA, foot protection, for all workers. Provide boots at no cost to workers. Paint uppers of all boots red with waterproof enamel. Do not allow boots to be removed from the Work Area for any reason, after being contaminated with hazardous waste containing material. Dispose of boots as hazardous waste contaminated waste at the end of the work.

D. Hard Hats: Provide head protection (hard hats) as required by OSHA for all workers, and provide 4 spares for use by Owner and Project Manager. Label hats with same warning labels as used on disposal bags. Require hard hats to be worn at all times that work is in progress that may potentially cause head injury. Provide hard hats of type with plastic strap type suspension. Require hats to remain in the Work Area throughout the work. Thoroughly clean, decontaminate and bag hats before removing them from Work Area at the end of the work.

E. Goggles: Provide eye protection (goggles) as required by OSHA for all workers involved in scraping, spraying, or any other activity which may potentially cause eye injury. Thoroughly clean, decontaminate and bag goggles before removing them from Work Area at the end of the work.

F. Gloves: Provide work gloves to all workers and require that they be worn at all times in the Work Area Do not remove gloves from Work Area and dispose of as contaminated waste at the end of the work.

4.2 ADDITIONAL PROTECTIVE EQUIPMENT

If necessary-Radiation safety and breathing zone monitoring for personnel and work area monitoring.

GENERAL

Provide worker protection as required by the OSHA and/or EPA standards applicable to the work.

5.1 DECONTAMINATION PROCEDURES

A. Require all workers to adhere to the following personal decontamination procedures whenever they leave the Work Area:

1. Personal Protective Equipment (PPE): Require that all workers use the following decontamination procedure as a minimum requirement whenever leaving the Work Area:

   a. When exiting area, remove outer layer of disposable coveralls, disposable head covers, and disposable footwear covers or boots.

   b. Store PPE in applicable storage containers as required for offsite disposal.

B. Within the Work Area: Require that workers NOT eat, drink, smoke, chew tobacco or gum, or apply cosmetics in the Work Area. To eat, chew, drink or smoke, workers shall follow the procedure described above then dress in street clothes before entering the non-Work Areas of the building

PROJECT RECORD DOCUMENTS

RELATED DOCUMENTS

A. Drawings and general provisions of Contract, including General and Supplementary Conditions and other Specifications apply to work specified in this Section.

B. Refer to section "Environmental Project Documents" for additional requirements and information.

6.1 SUMMARY

A. This section describes the administrative and procedural requirements of the Contractor for preparation of Project Record Documents.

B. Store record documents in the field office apart from Contract Documents used for demolition. Do not permit Project Record Documents to be used for demolition purposes. Maintain record documents in good order, and in a clean, dry, legible condition. Make documents and samples available at all times for inspection by the Architect / Project Manager.

6.2 RECORD DRAWINGS

A. During the demolition period, maintain a set of black-line white-prints of Contract Drawings and Shop drawings for Project Record Document purposes. Mark with red non-erasable ink all deviations from the original drawings.

B. Upon Substantial Completion of the project, or throughout the demolition incorporate all changes into a digital PDF stamped "As-Demolished". ECMS, Inc. will make digital originals available to the Contractor and Contractor's print shop. Contractor shall produce five sets and submit these with the digital files to ECMS, Inc.

6.3 RECORD SPECIFICATIONS

A. During the demolition period, maintain one copy of the project specifications, including addenda and modifications issued, for Project Record Document purposes. Mark any changes or modifications to the Specifications.

B. **Upon Substantial Completion of the project, or throughout the demolition incorporate all changes into a digital PDF stamped "As-Demolished". ECMS, Inc. will make digital originals available to the Contractor and Contractor's print shop. Upon completion of mark-up contractor shall produce five sets to be submitted with the digital record specifications to the Architect / Project Manager for Owner's records.**

RECORDING

Post changes and modifications to the documents as they occur. Do not wait until the end of the project. The Owner / Project Manager may periodically review record documents to assure compliance with this requirement.

7.1 POST-JOB SUBMITTALS

A. Submittals required under this paragraph include:
   1. **Certificate of Completion Form (SF-3).**

P.E., P.G.

Tyrone P. Dorian

Asbestos Consultant DSHS License # 10-5313

Special Provision to Item 000
Schedule of Liquidated Damages

The dollar amount of daily contract administration Liquidated Damages per Working Day is $

Special Provision to Item 000
Nondiscrimination

1. DESCRIPTION

All recipients of federal financial assistance are required to comply with various nondiscrimination laws including Title VI of the Civil Rights Act of 1964, as amended, (Title VI). Title VI forbids discrimination against anyone in the United States on the grounds of race, color, or national origin by any agency receiving federal funds.

Owner, as a recipient of Federal financial assistance, and under Title VI and related statutes, ensures that no person shall on the grounds of race, religion (where the primary objective of the financial assistance is to provide employment per 42 U.S.C. § 2000d-3), color, national origin, sex, age or disability be excluded from participation in, be denied the benefits of, or otherwise be subjected to discrimination under any of Owner's programs or activities.

2. DEFINITION OF TERMS

Where the term "contractor" appears in the following six nondiscrimination clauses, the term "contractor" is understood to include all parties to contracts or agreements with the Owner.

3. NONDISCRIMINATION PROVISIONS

During the performance of this contract, the contractor agrees as follows:

3.1. **Compliance with Regulations**. The Contractor shall comply with the Regulations relative to nondiscrimination in Federally-assisted programs of the Department of Transportation (hereinafter, "DOT") Title 49, Code of Federal Regulations, Part 21, as they may be amended from time to time, (hereinafter referred to as the Regulations), which are herein incorporated by reference and made a part of this contract.

3.2. **Nondiscrimination**. The contractor, with regard to the work performed by it during the contract, shall not discriminate on the grounds of race, color, or national origin in the selection and retention of subcontractors, including procurements of materials and leases of equipment. The contractor shall not participate either directly or indirectly in the discrimination prohibited by section 21.5 of the Regulations, including employment practices when the contract covers a program set forth in Appendix B of the Regulations.

3.3. **Solicitations for Subcontracts, Including Procurements of Materials and Equipment:** In all solicitations either by competitive bidding or negotiation made by the contractor for work to be performed under a subcontract, including procurements of materials or leases of equipment, each potential subcontractor or supplier shall be notified by the contractor of the contractor's obligations under this contract and the Regulations relative to nondiscrimination on the grounds of race, color, or national origin.

3.4. **Information and Reports:** The contractor shall provide all information and reports required by the Regulations or directives issued pursuant thereto, and shall permit access to its books, records, accounts, other sources of information, and its facilities as may be determined by the Owner or the Texas Department of Transportation to be pertinent to ascertain compliance with such Regulations, orders and instructions. Where any information required of a contractor is in the exclusive possession of another who fails or refuses to furnish this information the contractor shall so certify to the Owner or the Texas Department of Transportation as appropriate, and shall set forth what efforts it has made to obtain the information.

3.5. **Sanctions for Noncompliance**. In the event of the contractor's noncompliance with the nondiscrimination provisions of this contract, the Owner shall impose such contract sanctions as it, the Owner may determine to be appropriate, including, but not limited to:

- withholding of payments to the contractor under the contract until the contractor complies, and/or
- cancellation, termination or suspension of the contract, in whole or in part.

3.6. **Incorporation of Provisions**. The contractor shall include the provisions of paragraphs (3.1) through (3.6) in every subcontract, including procurements of materials and leases of equipment, unless exempt by the Regulations, or directives issued pursuant thereto. The contractor shall take such action with respect to any subcontract or procurement as the Owner may direct as a means of enforcing such provisions including sanctions for non-compliance: provided, however that, in the event a contractor becomes involved in, or is threatened with, litigation with a subcontractor or supplier as a result of such direction, the contractor may request the Owner to enter into such litigation to protect the interests of the Owner, and, in addition, the contractor may request the United States to enter into such litigation to protect the interests of the United States.

Special Provision to Item 000
Certification of Nondiscrimination in Employment

1. GENERAL

By signing this proposal, the Bidder certifies that Bidder has participated in a previous contract or subcontract subject to the equal opportunity clause, as required by Executive Orders 10925, 11114, or 11246, or if Bidder has not participated in a previous contract of this type, or if Bidder has had previous contract or subcontracts and has not filed, Bidder will file with the Joint Reporting Committee, the Director of the Office of Federal Contract Compliance, a Federal Government contracting or administering agency, or the former President's Committee on Equal Employment Opportunity, all reports due under the applicable filing requirements.

Note—The above certification is required by the Equal Employment Opportunity Regulations of the Secretary of Labor (41 CFR 60-1.7(b)(1)), and must be submitted by Bidders and proposed subcontractors only in connection with contracts and subcontracts which are subject to the equal opportunity clause. Contracts and subcontracts which are exempt from the equal opportunity clause are set forth in 41 CFR 60-1.5. (Generally only contracts or subcontracts of $10,000 or under are exempt.)

Currently, Standard Form 100 (EEO-1) is the only report required by the Executive Orders or their implementing regulations.

Proposed prime contractors and subcontractors who have participated in a previous contract or subcontract subject to the Executive Orders and have not filed the required reports should note that 41 CFR 60-1.7(b)(1) prevents the award of contracts and subcontracts unless such contractor submits a report covering the delinquent period or such other period specified by the Federal Highway Administration or by the Director, Office of Federal Contract Compliance, U.S. Department of Labor.

Special Provision to Item 000

Notice of Requirement for Affirmative Action to Ensure Equal Employment Opportunity (Executive Order 11246)

1. GENERAL

In addition to the affirmative action requirements of the Special Provision titled "Standard Federal Equal Employment Opportunity Construction Contract Specifications" as set forth elsewhere in this proposal, the Bidder's attention is directed to the specific requirements for utilization of minorities and females as set forth below.

2. GOALS

2.1. Goals for minority and female participation are hereby established in accordance with 41 CFR 60-4.

2.2. The goals for minority and female participation expressed in percentage terms for the Contractor's aggregate work force in each trade on all construction work in the covered area are as follows:

Goals for minority participation in each trade, %	Goals for female participation in each trade, %
See Table 1	6.9

2.3. These goals are applicable to all the Contractor's construction work (whether or not it is Federal or federally assisted) performed in the covered area. If the Contractor performs construction work in a geographical area located outside of the covered area, it will apply the goals established for such geographical area where the work is actually performed. With regard to this second area, the Contractor also is subject to the goals for both its federally involved and non-federally involved construction. The Contractor's compliance with the Executive Order and the regulations in 41 CFR Part 60-4 will be based on its implementation of the Standard Federal Equal Employment Opportunity Construction Contract Specifications Special Provision and its efforts to meet the goals. The hours of minority and female employment and training must be substantially uniform throughout the length of the Contract, and in each trade, and the Contractor must make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority and female employees or trainees from Contractor to Contractor or from project to project for the sole purpose of meeting the Contractor's goals will be a violation of the Contract, the Executive Order and the regulations in 41 CFR Part 60-4. Compliance with the goals will be measured against the total work hours performed.

2.4. A Contractor or subcontractor will be considered in compliance with these provisions by participation in the Texas Highway-Heavy Branch, AGC, Statewide Training and Affirmative Action Plan. Provided that each Contractor or subcontractor participating in this plan must individually comply with the equal opportunity clause set forth in 41 CFR 60-1.4 and must make a good faith effort to achieve the goals set forth for each participating trade in the plan in which it has employees. The overall good performance of other Contractors and subcontractors toward a goal in an approved plan does not excuse any covered Contractor's or subcontractor's failure to make good faith efforts to achieve the goals contained in these provisions. Contractors or subcontractors participating in the plan must be able to demonstrate their participation and document their compliance with the provisions of this Plan.

3. SUBCONTRACTING

The Contractor must provide written notification to the Owner within 10 working days of award of any construction subcontract in excess of $10,000 at any tier for construction work under the Contract resulting from this solicitation pending concurrence of the Owner in the award. The notification will list the names,

address and telephone number of the subcontractor; employer identification number; estimated dollar amount of the subcontract; estimated starting and completion dates of the subcontract; and the geographical area in which the Contract is to be performed.

4. COVERED AREA

As used in this special provision, and in the Contract resulting from this solicitation, the geographical area covered by these goals for female participation is the State of Texas. The geographical area covered by these goals for other minorities are the counties in the State of Texas as indicated in Table 1.

5. REPORTS

The Contractor is hereby notified that he may be subject to the Office of Federal Contract Compliance Programs (OFCCP) reporting and record keeping requirements as provided for under Executive Order 11246 as amended. OFCCP will provide direct notice to the Contractor as to the specific reporting requirements that he will be expected to fulfill.

Table 1
Goals for Minority Participation

County	Participation, %	County	Participation, %
Anderson	22.5	Chambers	27.4
Andrews	18.9	Cherokee	22.5
Angelina	22.5	Childress	11.0
Aransas	44.2	Clay	12.4
Archer	11.0	Cochran	19.5
Armstrong	11.0	Coke	20.0
Atascosa	49.4	Coleman	10.9
Austin	27.4	Collin	18.2
Bailey	19.5	Collingsworth	11.0
Bandera	49.4	Colorado	27.4
Bastrop	24.2	Comal	47.8
Baylor	11.0	Comanche	10.9
Bee	44.2	Concho	20.0
Bell	16.4	Cooke	17.2
Bexar	47.8	Coryell	16.4
Blanco	24.2	Cottle	11.0
Borden	19.5	Crane	18.9
Bosque	18.6	Crockett	20.0
Bowie	19.7	Crosby	19.5
Brazoria	27.3	Culberson	49.0
Brazos	23.7	Dallam	11.0
Brewster	49.0	Dallas	18.2
Briscoe	11.0	Dawson	19.5
Brooks	44.2	Deaf Smith	11.0
Brown	10.9	Delta	17.2
Burleson	27.4	Denton	18.2
Burnet	24.2	DeWitt	27.4
Caldwell	24.2	Dickens	19.5
Calhoun	27.4	Dimmit	49.4
Callahan	11.6	Donley	11.0
Cameron	71.0	Duval	44.2
Camp	20.2	Eastland	10.9
Carson	11.0	Ector	15.1
Cass	20.2	Edwards	49.4
Castro	11.0	Ellis	18.2

County	Participation, %	County	Participation, %
El Paso	57.8	Kenedy	44.2
Erath	17.2	Kent	10.9
Falls	18.6	Kerr	49.4
Fannin	17.2	Kimble	20.0
Fayette	27.4	King	19.5
Fisher	10.9	Kinney	49.4
Floyd	19.5	Kleberg	44.2
Foard	11.0	Knox	10.9
Fort Bend	27.3	Lamar	20.2
Franklin	17.2	Lamb	19.5
Freestone	18.6	Lampasas	18.6
Frio	49.4	LaSalle	49.4
Gaines	19.5	Lavaca	27.4
Galveston	28.9	Lee	24.2
Garza	19.5	Leon	27.4
Gillespie	49.4	Liberty	27.3
Glasscock	18.9	Limestone	18.6
Goliad	27.4	Lipscomb	11.0
Gonzales	49.4	Live Oak	44.2
Gray	11.0	Llano	24.2
Grayson	9.4	Loving	18.9
Gregg	22.8	Lubbock	19.6
Grimes	27.4	Lynn	19.5
Guadalupe	47.8	Madison	27.4
Hale	19.5	Marion	22.5
Hall	11.0	Martin	18.9
Hamilton	18.6	Mason	20.0
Hansford	11.0	Matagorda	27.4
Hardeman	11.0	Maverick	49.4
Hardin	22.6	McCulloch	20.0
Harris	27.3	McLennan	20.7
Harrison	22.8	McMullen	49.4
Hartley	11.0	Medina	49.4
Haskell	10.9	Menard	20.0
Hays	24.1	Midland	19.1
Hemphill	11.0	Milam	18.6
Henderson	22.5	Mills	18.6
Hidalgo	72.8	Mitchell	10.9
Hill	18.6	Montague	17.2
Hockley	19.5	Montgomery	27.3
Hood	18.2	Moore	11.0
Hopkins	17.2	Morris	20.2
Houston	22.5	Motley	19.5
Howard	18.9	Nacogdoches	22.5
Hudspeth	49.0	Navarro	17.2
Hunt	17.2	Newton	22.6
Hutchinson	11.0	Nolan	10.9
Irion	20.0	Nueces	41.7
Jack	17.2	Ochiltree	11.0
Jackson	27.4	Oldham	11.0
Jasper	22.6	Orange	22.6
Jeff Davis	49.0	Palo Pinto	17.2
Jefferson	22.6	Panola	22.5
Jim Hogg	49.4	Parker	18.2
Jim Wells	44.2	Parmer	11.0
Johnson	18.2	Pecos	18.9
Jones	11.6	Polk	27.4
Karnes	49.4	Potter	9.3
Kaufman	18.2	Presidio	49.0
Kendall	49.4	Randall	9.3

County	Participation, %	County	Participation, %
Rains	17.2	Reagan	20.0
Real	49.4	Throckmorton	10.9
Red River	20.2	Titus	20.2
Reeves	18.9	Tom Green	19.2
Refugio	44.2	Travis	24.1
Roberts	11.0	Trinity	27.4
Robertson	27.4	Tyler	22.6
Rockwall	18.2	Upshur	22.5
Runnels	20.0	Upton	18.9
Rusk	22.5	Uvalde	49.4
Sabine	22.6	Val Verde	49.4
San Augustine	22.5	Van Zandt	17.2
San Jacinto	27.4	Victoria	27.4
San Patricio	41.7	Walker	27.4
San Saba	20.0	Waller	27.3
Schleicher	20.0	Ward	18.9
Scurry	10.9	Washington	27.4
Shackelford	10.9	Webb	87.3
Shelby	22.5	Wharton	27.4
Sherman	11.0	Wheeler	11.0
Smith	23.5	Wichita	12.4
Somervell	17.2	Wilbarger	11.0
Starr	72.9	Willacy	72.9
Stephens	10.9	Williamson	24.1
Sterling	20.0	Wilson	49.4
Stonewall	10.9	Winkler	18.9
Sutton	20.0	Wise	18.2
Swisher	11.0	Wood	22.5
Tarrant	18.2	Yoakum	19.5
Taylor	11.6	Young	11.0
Terrell	20.0	Zapata	49.4
Terry	19.5	Zavala	49.4

Special Provision to Item 000

Standard Federal Equal Employment Opportunity Construction Contract Specifications (Executive Order 11246)

1. GENERAL

1.1. As used in these specifications:

- "Covered area" means the geographical area described in the solicitation from which this Contract resulted;
- "Director" means Director, Office of Federal Contract Compliance Programs, United States Department of Labor, or any person to whom the Director delegates authority;
- "Employer identification number" means the Federal Social Security number used on the Employer's Quarterly Federal Tax Return, U.S. Treasury Department Form 941.
- "Minority" includes:
  - Black (all persons having origins in any of the Black African racial groups not of Hispanic origin);
  - Hispanic (all persons of Mexican, Puerto Rican, Cuban, Central or South American or other Spanish Culture or origin, regardless of race);
  - Asian and Pacific Islander (all persons having origins in any of the original peoples of the Far East, Southeast Asia, the Indian Subcontinent, or the Pacific Islands); and
  - American Indian or Alaskan Native (all persons having origins in any of the original peoples of North American and maintaining identifiable tribal affiliations through membership and participation or community identification).

1.2. Whenever the Contractor, or any Subcontractor at any tier, subcontracts a portion of the work involving any construction trade, it will physically include in each subcontract in excess of $10,000 the provisions of these specifications and the Notice which contains the applicable goals for minority and female participation and which is set forth in the solicitations from which this Contract resulted.

1.3. If the Contractor is participating (pursuant to 41 CFR 60-4.5) in a Hometown Plan approved by the U. S. Department of Labor in the covered area either individually or through an association, its affirmative action obligations on all work in the Plan area (including goals and timetables) will be in accordance with that plan for those trades which have unions participating in the Plan. Contractors must be able to demonstrate their participation in and compliance with the provisions of any such Hometown Plan. Each Contractor or Subcontractor participating in an approved Plan is individually required to comply with its obligations under the equal employment opportunity (EEO) clause, and to make a good faith effort to achieve each goal under the Plan in each trade in which it has employees. The overall good faith performance by other Contractors or Subcontractors toward a goal in an approved Plan does not excuse any covered Contractor's or Subcontractor's failure to take good faith efforts to achieve the Plan goals and timetables.

1.4. The Contractor will implement the specific affirmative action standards provided in Section 1.7.1. through Section 1.7.16. of these specifications. The goals set forth in the solicitation from which this Contract resulted are expressed as percentages of the total hours of employment and training of minority and female utilization the Contractor should reasonably be able to achieve in each construction trade in which it has employees in the covered area. Covered construction Contractors performing Contracts in geographical areas where they do not have a Federal or federally assisted construction Contract will apply the minority and female goals established for the geographical area where the Contract is being performed. Goals are published periodically in the Federal Register in notice form and such notices may be obtained from any Office of Federal Contract Compliance Programs office or any Federal procurement contracting officer. The

Contractor is expected to make substantially uniform progress toward its goals in each craft during the period specified.

1.5. Neither the provisions of any collective bargaining agreement, nor the failure by a union with whom the Contractor has a collective bargaining agreement, to refer either minorities or women will excuse the Contractor's obligations under these specifications, Executive Order 11246, or the regulations promulgated pursuant thereto.

1.6. In order for the nonworking training hours of apprentices and trainees to be counted in meeting the goals, such apprentices and trainees must be employed by the Contractor during the training period, and the Contractor must have made a commitment to employ the apprentices and trainees at the completion of their training, subject to the availability of employment opportunities. Trainees must be trained pursuant to training programs approved by the U. S. Department of Labor.

1.7. The Contractor will take specific affirmative actions to ensure equal employment opportunity. The evaluation of the Contractor's compliance with these specifications will be based upon its effort to achieve maximum results from its actions. The Contractor will document these efforts fully, and will implement affirmative action steps at least as extensive as the following:

1.7.1. Ensure and maintain a working environment free of harassment, intimidation, and coercion at all sites, and in all facilities at which the Contractor's employees are assigned to work. The Contractor, where possible, will assign two or more women to each construction project. The Contractor will specifically ensure that all foremen, superintendents, and other on-site supervisory personnel are aware of and carry out the Contractor's obligation to maintain such a working environment, with specific attention to minority or female individuals working at such sites or in such facilities.

1.7.2. Establish and maintain a current list of minority and female recruitment sources, provide written notification to minority and female recruitment sources and to community organizations when the Contractor or its unions have employment opportunities available, and maintain a record of the organizations' responses.

1.7.3. Maintain a current file of the names, addresses and telephone numbers of each minority and female off-the-street applicant and minority or female referral from a union, a recruitment source or community organization and of what action was taken with respect to each such individual. If such individual was sent to the union hiring hall for referral and was not referred back to the Contractor by the union or, if referred, not employed by the Contractor, this will be documented in the file with the reason therefor, along with whatever additional actions the Contractor may have taken.

1.7.4. Provide immediate written notification to the Director when the union or unions with which the Contractor has a collective bargaining agreement has not referred to the Contractor a minority person or woman sent by the Contractor, or when the Contractor has other information that the union referral Process has impeded the Contractor's efforts to meet its obligations.

1.7.5. Develop on-the-job training opportunities and/or participate in training programs for the area which expressly include minorities and women, including upgrading programs and apprenticeship and trainee programs relevant to the Contractor's employment needs, especially those programs funded or approved by the U.S. Department of Labor. The Contractor will provide notice of these programs to the sources compiled under 7b above.

1.7.6. Disseminate the Contractor's EEO policy by providing notice of the policy to unions and training programs and requesting their cooperation in assisting the Contractor in meeting its EEO obligations; by including it in any policy manual and Collective bargaining agreement; by publicizing it in the company newspaper, annual report, etc.; by specific review of the policy with all management personnel and with all minority and female employees at least once a year; and by posting the company EEO policy on bulletin boards accessible to all employees at each location where construction work is performed.

1.7.7. Review, at least annually, the company's EEO policy and affirmative action obligations under these specifications with all employees having any responsibility for hiring, assignment, layoff, termination or other

employment decisions including specific review of these items with on-site supervisory personnel such as Superintendents, General Foremen, etc., before the initiation of construction work at any job site. A written record must be made and maintained identifying the time and place of these meetings, persons attending, subject matter discussed, and disposition of the subject matter.

1.7.8. Disseminate the Contractor's EEO policy externally by including it in any advertising in the news media, specifically including minority and female news media, and providing written notification to and discussing the Contractor's EEO policy with other Contractors and Subcontractors with whom the Contractor does or anticipates doing business.

1.7.9. Direct its recruitment efforts, both oral and written, to minority, female and community organizations, to schools with minority and female students and to minority and female recruitment and training organizations serving the Contractor's recruitment area and employment needs. Not later than one month before the date for the acceptance of applications for apprenticeship or other training by any recruitment source, the Contractor will send written notification to organizations such as the above, describing the openings, screening procedures, and tests to be used in the selection process.

1.7.10. Encourage present minority and female employees to recruit other minority persons and women and, where reasonable, provide after school, summer and vacation employment to minority and female youth both on the site and in other areas of a Contractor's workforce.

1.7.11. Validate all tests and other selection requirements where there is an obligation to do so under 41 CFR Part 60-3.

1.7.12. Conduct, at least annually, an inventory and evaluation at least of all minority and female personnel for promotional opportunities and encourage these employees to seek or to prepare for, through appropriate training, etc., such opportunities.

1.7.13. Ensure that seniority practices, job classifications, work assignments and other personnel practices, do not have a discriminatory effect by continually monitoring all personnel and employment-related activities to ensure that the EEO policy and the Contractor's obligations under these specifications are being carried out.

1.7.14. Ensure that all facilities and company activities are non-segregated except that separate or single-user toilet and necessary changing facilities will be provided to assure privacy between the sexes.

1.7.15. Document and maintain a record of all solicitations of offers for subcontracts from minority and female construction contractors and suppliers, including circulation of solicitations to minority and female contractor associations and other business associations.

1.7.16. Conduct a review, at least annually, of all supervisors' adherence to and performance under the Contractor's EEO policies and affirmative action obligations.

1.8. Contractors are encouraged to participate in voluntary associations which assist in fulfilling one or more of their affirmative action obligations (Section 7.1. through Section 7.16.). The efforts of a contractor association, joint contractor-union, contractor-community, or other similar group of which the Contractor is a member and participant, may be asserted as fulfilling any one or more of its obligations under Section 7.1. through Section 7.16. of these Specifications provided that the Contractor actively participates in the group, makes every effort to assure that the group has a positive impact on the employment of minorities and women in the industry, ensures that the concrete benefits of the program are reflected in the Contractor's minority and female workforce participation, makes a good faith effort to meet its individual goals and timetables, and can provide access to documentation which demonstrates the effectiveness of actions taken on behalf of the Contractor. The obligation to comply, however, is the Contractor's and failure of such a group to fulfill an obligation will not be a defense for the Contractor's noncompliance.

1.9. A single goal for minorities and a separate single goal for women have been established. The Contractor, however, is required to provide equal employment opportunity and to take affirmative action for all minority groups, both male and female, and all women, both minority and non-minority. Consequently, the Contractor

may be in violation of the Executive Order if a particular group is employed in a substantially disparate manner (for example, even though the Contractor has achieved its goals for women generally, the Contractor may be in violation of the Executive Order if a specific minority group of women is underutilized).

1.10. The Contractor shall not use the goals and timetables or affirmative action standards to discriminate against any person because of race, color, religion, sex, or national origin.

1.11. The Contractor will not enter into any Subcontract with any person or firm debarred from Government Contracts pursuant to Executive Order 11246.

1.12. The Contractor will carry out such sanctions and penalties for violation of these specifications and of the Equal Opportunity Clause, including suspension, termination and cancellation of existing subcontracts as may be imposed or ordered pursuant to Executive Order 11246, as amended, and its implementing regulations, by the Office of Federal Contract Compliance Programs. Any Contractor who fails to carry out such sanctions and penalties will be in violation of these specifications and Executive Order 11246, as amended.

1.13. The Contractor, in fulfilling its obligations under these specifications, will implement specific affirmative action steps, at least as extensive as those standards prescribed in paragraph 7 of these specifications, so as to achieve maximum results from its efforts to ensure equal employment opportunity. If the Contractor fails to comply with the requirements of the Executive Order, the implementing regulations, or these specifications, the Director will proceed in accordance with 41 CFR 60-4.8.

1.14. The Contractor will designate a responsible official to monitor all employment-related activity to ensure that the company EEO policy is being carried out, to submit reports relating to the provisions hereof as may be required by the Government and to keep records. Records must at least include for each employee the name, address, telephone numbers, construction trade, union affiliation if any, employee identification number when assigned, social security number, race, sex, status (e.g., mechanic, apprentice, trainee, helper, or laborer), dates of changes in status, hours worked per week in the indicated trade, rate of pay, and locations at which the work was performed. Records must be maintained in an easily understandable and retrievable form; however, to the degree that existing records satisfy this requirement, Contractors shall not be required to maintain separate records.

1.15. Nothing herein provided will be construed as a limitation upon the application of other laws which establish different standards of compliance or upon the application of requirements for the hiring of local or other area residents (e.g., those under the Public Works Employment Act of 1977 and the Community Development Block Grant Program).

1.16. In addition to the reporting requirements set forth elsewhere in this Contract, the Contractor and the subcontractors holding subcontracts, not including material suppliers, of $10,000 or more, will submit for every month of July during which work is performed, employment data as contained under Form PR 1391 (Appendix C to 23 CFR, Part 230), and in accordance with the included instructions.

Special Provision to Item 000

Disadvantaged Business Enterprise in Federal Aid Contracts

1. DESCRIPTION

The purpose of this Special Provision is to carry out the U.S. Department of Transportation's (DOT) policy of ensuring nondiscrimination in the award and administration of DOT assisted Contracts and creating a level playing field on which firms owned and controlled by individuals who are determined to be socially and economically disadvantaged can compete fairly for DOT assisted Contracts. If the Disadvantaged Business Enterprise (DBE) goal is greater than zero, Article A, "Disadvantaged Business Enterprise in Federal Aid Contracts", of this Special Provision shall apply to this Contract. If there is no DBE goal, Article B, "Race-Neutral DBE Participation," of this Special Provision will apply to this Contract. The percentage goal for DBE participation in the work to be performed under this Contract will be shown on the proposal.

1.1. **Article A. Disadvantaged Business Enterprise in Federal Aid Contracts.**

1.1.1. **Policy**. It is the policy of the DOT and the Texas Department of Transportation (Department) that DBEs, as defined in 49 CFR Part 26, Subpart A and the Department's DBE Program, shall have the opportunity to participate in the performance of Contracts financed in whole or in part with Federal funds. The DBE requirements of 49 CFR Part 26, and the Department's DBE Program, apply to this Contract as follows:

1.1.1.1. The Contractor will solicit DBEs through reasonable and available means, as defined in 49 CFR Part 26, Appendix A and the Department's DBE Program, or show a good faith effort to meet the DBE goal for this Contract.

1.1.1.2. The Contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this Contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted Contracts. Failure by the Contractor to carry out these requirements is a material breach of this Contract, which may result in the termination of this Contract or such other remedy as the recipient deems appropriate.

1.1.1.3. The requirements of this Special Provision shall be physically included in any subcontract.

1.1.1.4. By signing the Contract proposal, the Bidder is certifying that the DBE goal as stated in the proposal will be met by obtaining commitments from eligible DBEs or that the Bidder will provide acceptable evidence of good faith effort to meet the commitment. The Owner will determine the adequacy of a Contractor's efforts to meet the Contract goal, within 10 business days, excluding national holidays, from receipt of the information outlined in this Special Provision under Section 1.1.3., "Contractor's Responsibilities." If the requirements of Section 1.A.3 are met, the conditional situation will be removed and the Contract will be forwarded to the Contractor for execution.

1.1.2. **Definitions.**

1.1.2.1. "Broker" is an intermediary or middleman that does not take possession of a commodity or act as a regular dealer selling to the public.

1.1.2.2. "Disadvantaged Business Enterprise" or "DBE" is defined in the standard specifications, Article 1, Definition of Terms.

1.1.2.3. "DBE Joint Venture" means an association of a DBE firm and 1 or more other firm(s) to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge, and in which the DBE is responsible for a distinct, clearly defined portion of the work of the

Contract and whose share in the capital contribution, control, management, risks, and profits of the joint venture are commensurate with its ownership interest.

1.1.2.4. "DOT" means the U.S. Department of Transportation, including the Office of the Secretary, the Federal Highway Administration (FHWA), the Federal Transit Administration (FTA), and the Federal Aviation Administration (FAA).

1.1.2.5. "Federal Aid Contract" is any Contract between the Owner and a Contractor which is paid for in whole or in part with DOT financial assistance.

1.1.2.6. "Good Faith Effort" means efforts to achieve a DBE goal or other requirement of this Special Provision which, by their scope, intensity, and appropriateness to the objective, can reasonably be expected to fulfill the program requirement.

1.1.2.7. "Manufacturer" is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the Contract and of the general character described by the specifications."

1.1.2.8. "Race-conscious" means a measure or program that is focused specifically on assisting only DBEs, including women-owned businesses.

1.1.2.9. "Race-neutral DBE Participation" means any participation by a DBE through customary competitive procurement procedures.

1.1.2.10. "Regular Dealer" is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the Contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business. To be a regular dealer, the firm must be an established, regular business that engages in, as its principal business and under its own name, the purchase and sale or lease of the products in question.

A regular dealer in such bulk items as steel, cement, gravel, stone, and petroleum products need not keep such products in stock if it owns and operates distribution equipment for the products. Any supplementing of regular dealers own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis. Brokers, packagers, manufacturers' representatives, or other persons who arrange or expedite transactions shall not be regarded as a regular dealer.

1.1.2.11. "Texas Unified Certification Program" or "TUCP" provides one-stop shopping to applicants for certification, such that applicants are required to apply only once for a DBE certification that will be honored by all recipients of federal funds in the state. The TUCP by Memorandum of Agreement established six member entities to serve as certifying agents for Texas in specified regions.

1.1.3. **Contractor's Responsibilities**. These requirements must be satisfied by the Contractor.

1.1.3.1. After conditional award of the Contract, the Contractor shall submit a completed Form SMS.4901 "DBE Commitment Agreement", From SMS 4901-T "DBE Trucking Commitment Agreement", or Form SMS.4901-MS "DBE Material & Supplier Commitment Agreement" for each DBE he/she intends to use to satisfy the DBE goal or a good faith effort to explain why the goal could not be reached. Provide these forms to the Owner so as to arrive not later than 5:00 p.m. on the 10th business day, excluding national holidays, after the conditional award of the Contract. When requested, additional time, not to exceed 7 business days, excluding national holidays, may be granted based on documentation submitted by the Contractor.

1.1.3.2. DBE prime Contractors may receive credit toward the DBE goal for work performed by his/her own forces and work subcontracted to DBEs. A DBE prime must make a good faith effort to meet the goals. In the event a DBE prime subcontracts to a non-DBE, that information must be reported on Form SMS.4902.

1.1.3.3. A Contractor who cannot meet the Contract goal, in whole or in part, shall make adequate good faith efforts to obtain DBE participation as so stated and defined in 49 CFR Part 26, Appendix A. The following is a list of the types of action that may be considered as good faith efforts. It is not intended to be a mandatory checklist, nor is it intended to be exclusive or exhaustive. Other factors or types of efforts may be relevant in appropriate cases.

- Soliciting through all reasonable and available means (e.g. attendance at prebid meetings, advertising, and/or written notices) the interest of all certified DBEs who have the capability to perform the work of the Contract. The solicitation must be done within sufficient time to allow the DBEs to respond to it. Appropriate steps must be taken to follow up initial solicitations to determine, with certainty, if the DBEs are interested.
- Selecting portions of the work to be performed by DBEs in order to increase the likelihood that the DBE goals will be achieved. This includes, where appropriate, breaking out Contract work items into economically feasible units to facilitate DBE participation, even when the Contractor might otherwise prefer to perform the work items with its own forces.
- Providing interested DBEs with adequate information about the plans, specifications, and requirements of the Contract in a timely manner to assist them in responding to a solicitation.
- Negotiating in good faith with interested DBEs to make a portion of the work available to DBE subcontractors and suppliers and select those portions of the work or material needs consistent with the available DBE subcontractors and suppliers, so as to facilitate DBE participation. Evidence of such negotiations includes the names, addresses, and telephone numbers of DBEs that were considered; a description of the information provided regarding the plans and specifications for the work selected for subcontracting; and evidence as to why additional agreements could not be reached for DBEs to perform the work.
- A Bidder using good business judgment would consider a number of factors in negotiating with subcontractors, including DBE subcontractors, and would take a firm price and capabilities as well as Contract goals into consideration. However, the fact that there may be some additional cost involved in finding and using DBEs is not in itself sufficient reason for a bidders failure to meet the Contract DBE goal as long as such cost are reasonable. Also, the ability or desire of the Contractor to perform the work of the Contract with its own organization does not relieve the Bidder of the responsibility to make good faith effort. Contractors are not, however, required to accept higher quotes from DBEs if the price difference is excessive or unreasonable.
- Not rejecting DBEs as being unqualified without sound reasons based on a thorough investigation of their capabilities. The Contractor's standing within its industry, membership in specific groups, organizations, or associations and political or social affiliations (for example union vs. non-union employee status) are not legitimate cause for the rejection or non-solicitation of bids and the Contractors efforts to meet the project goal.
- Making efforts to assist interested DBEs in obtaining bonding, lines of credit, or insurance as required by the recipient or Contractor.
- Making efforts to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services.
- Effectively using the services of available minority/women community organizations; minority/women Contractors' groups; local, state, and Federal minority/women business assistance offices; and other organizations as allowed on a case-by-case basis to provide assistance in the recruitment and placement of DBEs.
- If the Owner determines that the Contractor has failed to meet the good faith effort requirements, the Contractor will be given an opportunity for reconsideration by the Owner.

1.1.3.4. Should the bidder to whom the Contract is conditionally awarded refuse, neglect or fail to meet the DBE goal or comply with good faith effort requirements, the proposal guaranty filed with the bid shall become the property of the Owner, not as a penalty, but as liquidated damages to the Owner.

1.1.3.5. The preceding information shall be submitted directly to the Owner.

1.1.3.6. The Contractor shall not terminate for convenience a DBE subcontractor named in the commitment submitted under Section 1.A.3.a, of this Special Provision. Before terminating or removing a DBE subcontractor named in the commitment, the Contractor must have a written consent of the Owner.

1.1.3.7. The Contractor shall also make a good faith effort to replace a DBE subcontractor that is unable to perform successfully with another DBE, to the extent needed to meet the Contract goal. The Contractor shall submit a completed Form 4901 "DBE Commitment Agreement", From SMS 4901-T "DBE Trucking Commitment Agreement", or Form SMS.4901-MS "DBE Material & Supplier Commitment Agreement" for the substitute DBE firm(s). Any substitution of DBEs shall be subject to approval by the Owner. Before approving the substitution, the Owner will request a statement from the DBE concerning it being replaced.

1.1.3.8. The Contractor shall designate a DBE liaison officer who will administer the Contractor's DBE program and who will be responsible for maintenance of records of efforts and contacts made to subcontract with DBEs.

1.1.3.9. Contractors are encouraged to investigate the services offered by banks owned and controlled by disadvantaged individuals and to make use of these banks where feasible.

1.1.4. **Eligibility of DBEs.**

1.1.4.1. The member entities of the TUCP certify the eligibility of DBEs and DBE joint ventures to perform DBE subcontract work on DOT financially assisted Contracts.

1.1.4.2. The Department maintains the Texas Unified Certification Program DBE Directory containing the names of firms that have been certified to be eligible to participate as DBE's on DOT financially assisted Contracts. An update of the Directory can be found on the Internet at http://www.txdot.gov/apps-cg/tucp/default.htm.

1.1.4.3. Only DBE firms certified at the time commitments are submitted are eligible to be used in the information furnished by the Contractor as required under Section 1.A.3.a. and 3.g. above. For purposes of the DBE goal on this project, DBEs will only be allowed to perform work in the categories of work for which they are certified.

1.1.4.4. Only DBE firms certified at the time of execution of a Contract/subcontract/purchase order, are eligible for DBE goal participation.

1.1.5. **Determination of DBE Participation**. When a DBE participates in a Contract, only the values of the work actually performed by the DBE, as referenced below, shall be counted by the prime Contractor toward DBE goals:

1.1.5.1. The total amount paid to the DBE for work performed with his/her own forces is counted toward the DBE goal. When a DBE subcontracts part of the work of its Contract to another firm, the value of the subcontracted work may be counted toward DBE goals only if the subcontractor is itself a DBE. Work that a DBE subcontracts to a non-DBE firm does not count toward DBE goals.

1.1.5.2. A Contractor may count toward its DBE goal a portion of the total value of the Contract amount paid to a DBE joint venture equal to the distinct, clearly defined portion of the work of the Contract performed by the DBE.

1.1.5.2.1. A Contractor may count toward its DBE goal only expenditures to DBEs that perform a commercially useful function (CUF) in the work of a Contract or purchase order. A DBE is considered to perform a CUF when it is responsible for execution of the work of the Contract and is carrying out its responsibilities by actually performing, managing, and supervising the work involved. To perform a CUF, the DBE must also be responsible, with respect to materials and supplies used on the Contract, for negotiating price, determining quality and quantity, ordering the material, and installing (where applicable) and paying for the material itself.

In accordance with 49 CFR Part 26, Appendix A, guidance concerning Good Faith Efforts, Contractors may make efforts to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services. Contractors may not however, negotiate the price of materials or supplies used on the Contract by the DBE, nor may they determine quality and quantity, order the materials themselves, nor install the materials (where applicable), or pay for the material themselves. Contractors however, may share the quotations they receive from the material supplier with the DBE firm, so that the DBE firm may negotiate a reasonable price with the material supplier.

In all cases, prime or other non-DBE subcontractor assistance will not be credited toward the DBE goal.

1.1.5.2.2. A DBE does not perform a CUF if its role is limited to that of an extra participant in a transaction, Contract, or project through which funds are passed in order to obtain the appearance of DBE participation.

Consistent with industry practices and the DOT/Department's DBE program, a DBE subcontractor may enter into second-tier subcontracts, amounting up to 70% of their Contract. Work subcontracted to a non-DBE does not count towards DBE goals. If a DBE does not perform or exercise responsibility for at least 30% of the total cost of its Contract with its own work force, or the DBE subcontracts a greater portion of the work of a Contract than would be expected on the basis of normal industry practice for the type of work involved, it will be presumed that the DBE is not performing a CUF

1.1.5.2.3. A DBE trucking firm (including an owner operator who is certified as a DBE is considered to be performing a CUF when the DBE is responsible for the management and supervision of the entire trucking operation on a particular Contract and the DBE itself owns and operates at least 1 fully licensed, insured, and operational truck used on the Contract.

1.1.5.2.3.1. The Contractor receives credit for the total value of the transportation services the DBE provides on a Contract using trucks it owns, insures, and operates using drivers it employs.

1.1.5.2.3.2. The DBE may lease trucks from another DBE firm, including an owner operator who is certified as a DBE. The DBE who leases trucks from another DBE receives credit for the total value of the transportation services the lessee DBE provides on the Contract.

1.1.5.2.3.3. The DBE may also lease trucks from a non-DBE firm, including from an owner-operator. The DBE who leases trucks from a non-DBE is entitled to credit for the total value of transportation services provided by non-DBE lessees not to exceed the value of transportation services provided by the DBE-owned trucks on the Contract. Additional participation by non-DBE lessees receive credit only for the fee or commission it receives as result of the lease arrangement

1.1.5.2.3.4. A lease must indicate that the DBE has exclusive use of and control over the trucks giving the DBE absolute priority for use of the leased trucks. Leased trucks must display the name and identification number of the DBE.

1.1.5.2.4. When a DBE is presumed not to be performing a CUF the DBE may present evidence to rebut this presumption.

1.1.5.2.5. Project materials or supplies acquired from an affiliate of the prime Contractor can not directly or indirectly (2nd or lower tier subcontractor) be used for DBE goal credit.

1.1.5.3. A Contractor may count toward its DBE goals expenditures for materials and supplies obtained from a DBE manufacturer, provided that the DBE assumes the actual and contractual responsibility for the materials and supplies. Count expenditures with DBEs for materials or supplies toward DBE goals as provided in the following:

1.1.5.3.1. If the materials or supplies are obtained from a DBE manufacturer, count 100% of the cost of the materials or supplies toward DBE goals. (Definition of a DBE manufacturer found at 1A.c.(1) of this provision.)

For purposes of this Section (1.A.c.(1)), a manufacturer is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the Contract and of the general character described by the specifications.

1.1.5.3.2. If the materials or supplies are purchased from a DBE regular dealer, count 60% of the cost of the materials or supplies toward DBE goals.

For purposes of this Section (1.A.5.c.(2)), a regular dealer is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the Contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business:

1.1.5.3.2.1. To be a regular dealer, the firm must be an established, regular business that engages, as its principal business and under its own name, in the purchase and sale or lease of the products in question.

1.1.5.3.2.2. A person may be a regular dealer in such bulk items as petroleum products, steel, cement, gravel, stone or asphalt without owning, operating, or maintaining a place of business as provided in the first paragraph under Section 1.A.5.c.(2), if the person both owns and operates distribution equipment for the products. Any supplementing of regular dealers' own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis.

1.1.5.3.2.3. Packagers, brokers, manufacturers' representatives, or other persons who arrange or expedite transactions are not regular dealers within the meaning of Section 1.A.5.c.(2).

1.1.5.3.3. With respect to materials or supplies purchased from DBE which is neither a manufacturer nor a regular dealer, count the entire amount of fees or commissions charged for assistance in the procurement of the materials and supplies, or fees or transportation charges for the delivery of materials or supplies required on a job site, toward DBE goals, provided you determine the fees to be reasonable and not excessive as compared with fees customarily allowed for similar services.

Do not count any portion of the cost of the materials and supplies themselves toward DBE goals.

1.1.5.3.4. Count the entire amount of fees or commissions charged by a DBE firm for providing a bona fide service, such as professional, technical, consultant or managerial services, or for providing bonds or insurance specifically required for the performance of a DOT-assisted Contract, toward DBE goals, provided you determine the fee to be reasonable and not excessive as compared with fees customarily allowed for similar services.

1.1.5.4. If the Contractor chooses to assist a DBE firm, other than a manufacturing material supplier or regular dealer, and the DBE firm accepts the assistance, the Contractor may act solely as a guarantor by use of a two-party check for payment of materials to be used on the project by the DBE. The material supplier must invoice the DBE who will present the invoice to the Contractor. The Contractor may issue a joint check to the DBE and the material supplier and the DBE firm must issue the remittance to the material supplier. No funds shall go directly from the Contractor to the material supplier. The DBE firm may accept or reject this joint checking arrangement.

The Contractor must obtain approval from the Owner before implementing the use of joint check arrangements with the DBE. Submit to the Owner, Joint Check Approval Form 2178 for requesting approval. Provide copies of cancelled joint checks upon request. No DBE goal credit will be allowed for the cost of DBE materials that are paid by the Contractor directly to the material supplier.

1.1.5.5. No DBE goal credit will be allowed for supplies and equipment the DBE subcontractor leases from the Contractor or its affiliates.

1.1.5.6. No DBE goal credit will be allowed for the period of time determined by the Owner that the DBE was not performing a CUF. The denial period of time may occur before or after a determination has been made by the Owner. In case of the denial of credit for non-performance of a CUF of a DBE, the Contractor will be

required to provide a substitute DBE to meet the Contract goal or provide an adequate good faith effort when applicable.

1.1.6. **Records and Reports.**

1.1.6.1. The Contractor shall submit monthly reports, after work begins, on DBE payments to meet the DBE goal and for DBE or HUB race-neutral participation. Report payments made to non-DBE HUBs. The monthly report is to be sent to the Owner. These reports will be due within 15 days after the end of a calendar month. These reports will be required until all DBE subcontracting or material supply activity is completed. Form SMS.4903, "DBE Progress Report," is to be used for monthly reporting. Form. SMS.4904, "DBE Final Report," is to be used as a final summary of DBE payments submitted upon completion of the project.

The original final report must be submitted to the Owner. These forms may be obtained from the Owner or may be reproduced by the Contractor. The Owner may verify the amounts being reported as paid to DBEs by requesting copies of cancelled checks paid to DBEs on a random basis. Cancelled checks and invoices should reference the Owner's project number.

1.1.6.2. DBE subcontractors and/or material suppliers should be identified on the monthly report by Vendor Number, name, and the amount of actual payment made to each during the monthly period. Negative reports are required when no activity has occurred in a monthly period.

1.1.6.3. All such records must be retained for a period of 3 years following completion of the Contract work, and shall be available at reasonable times and places for inspection by authorized representatives of the Owner, the Department or the DOT. Provide copies of subcontracts or agreements and other documentation upon request.

1.1.6.4. Before receiving final payment, the Contractor shall submit Form SMS.4904, "DBE Final Report". If the DBE goal requirement is not met, documentation supporting Good Faith Efforts, as outlined in Section 1.A.3.c of this Special Provision, must be submitted with the "DBE Final Report."

1.1.6.5. Provide a certification of prompt payment in accordance with the Owner's prompt payment procedure to certify that all subcontractors and suppliers were paid from the previous months payments and retainage was released for those whose work is complete. Submit the completed form each month and the month following the month when final acceptance occurred at the end of the project.

1.1.7. **Compliance of Contractor**. To ensure that DBE requirements of this DOT assisted Contract are complied with, the Ownert will monitor the Contractor's efforts to involve DBEs during the performance of this Contract. This will be accomplished by a review of monthly reports submitted to the Owner by the Contractor indicating his progress in achieving the DBE Contract goal, and by compliance reviews conducted on the project site by the Owner.

The Contractor shall receive credit toward the DBE goal based on actual payments to the DBE subcontractor. The Contractor shall notify the Owner if he/she withholds or reduces payment to any DBE subcontractor. The Contractor shall submit an affidavit detailing the DBE subcontract payments before receiving final payment for the Contract.

Contractors' requests for substitutions of DBE subcontractors shall be accompanied by a detailed explanation which should substantiate the need for a substitution. The Contractor may not be allowed to count work on those items being substituted toward the DBE goal before approval of the substitution from the Owner.

The prime Contractor is prohibited from providing work crews and equipment to DBEs. DBE Goal credit for the DBE subcontractors leasing of equipment or purchasing of supplies from the prime Contractor or its affiliates is not allowed.

When a DBE subcontractor named in the commitment under Section 1.A.3.a. of this Special Provision, is terminated or fails to complete its work on the Contract for any reason, the prime Contractor is required to

make good faith efforts to find another DBE subcontractor to substitute for the original DBE. These good faith efforts shall be directed at finding another DBE to perform at least the same amount of work under the Contract as the DBE that was terminated, to the extent needed to meet the Contract goal.

A Contractor's failure to comply with the requirements of this Special Provision shall constitute a material breach of this Contract. In such a case, the Owner reserves the right to terminate the Contract; to deduct the amount of DBE goal not accomplished by DBEs from the money due or to become due the Contractor, or to secure a refund, not as a penalty but as liquidated damages to the Owner or such other remedy or remedies as the Owner deems appropriate.

Forward Form 2371, "DBE Trucking Credit Worksheet," completed by the DBE trucker every month DBE credit is used.

1.2. **Article B. Race-Neutral Disadvantaged Business Enterprise Participation**. It is the policy of the DOT that Disadvantaged Business Enterprises (DBE) as defined in 49 CFR Part 26 Subpart A, be given the opportunity to compete fairly for Contracts and subcontracts financed in whole or in part with Federal funds and that a maximum feasible portion of the Department's overall DBE goal be met using race-neutral means. Consequently, if there is no DBE goal, the DBE requirements of 49 CFR Part 26, apply to this Contract as follows:

The Contractor will offer DBEs as defined in 49 CFR Part 26, Subpart A, the opportunity to compete fairly for Contracts and subcontractors financed in whole or in part with Federal funds. Race-Neutral DBE and non-DBE HUB participation on projects with no DBE goal shall be reported on Form SMS.4903, "DBE or HUB Progress Report" and submitted to the Owner each month and at project completion. Payments to DBEs reported on Form SMS.4903 are subject to the requirements of Section 1.1.5., "Determination of DBE Participation."

The Contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this Contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted Contracts. Failure by the Contractor to carry out these requirements is a material breach of this Contract, which may result in the termination of this Contract or such other remedy as the recipient deems appropriate.

Special Provision to Item 7
Legal Relations and Responsibilities

Item 7, "Legal Relations and Responsibilities," of the Standard Specifications is amended with respect to the clauses cited below. No other clauses or requirements of this Item are waived or changed.

Section 2.6.5., "Training", is supplemented by the following:

Coordinate enrollment, pay associated fees, and successfully complete approved Training or Contractor Delivered Training. Training is valid for the period prescribed by the provider but no less than 3 yrs. from the date of completion. The Owner may require training at a frequency less than the period prescribed or 3 yrs. based on Owner's needs. Training and associated fees will not be measured or paid for directly but are considered subsidiary to pertinent Items.

2.6.5.1. **Approved Training.** Approved training is listed below:

2.6.5.1.1 **Contractor Responsible Person and Alternate.**

Provider	Course Title
American Traffic Safety Services Association	Traffic Control Supervisor
National Highway Institute	Maintenance of Traffic Control for Supervisors

2.6.5.1.2. **Flagger Instructor Training.**

Provider	Course Title
American Traffic Safety Services Association	Flagging Instructor Training Course
Texas Engineering Extension Services	Train-the-Trainer Flaggers
National Safety Council	Flagger (Instructor)
University of Texas at Arlington, Division for Enterprise Development	Certified Flagger Instructor

Flagger Training.

Provider	Course Title
Texas Engineering Extension Services	Flaggers in Work Zones
National Safety Council	Flagger (Novice)
University of Texas at Arlington, Continuing Education Department	Flaggers in Work Zones (TxDOT Training)
University of Texas at Arlington, Continuing Education Department	WZ Traffic Control/Qualified Flagger
Associated Builders and Contractors, Austin Chapter	Flagger Training
LDI Safety Training	Flagger Training
Tipton Compliance and Safety	Flagger Training

2.6.5.1.3. **Law Enforcement Personnel.**

Provider	Course Title
National Highway Institute	Safe and Effective Use of Law Enforcement Personnel in Work Zones

2.6.5.1.4. **Other Work Zone Personnel.**

Provider	Course Title
American Traffic Safety Services Association	Traffic Control Technician Training
Texas Engineering Extension Services	Work Zone Traffic Control
National Highway Institute	Maintenance of Traffic Control for Technicians
National Highway Institute	Maintenance Training Series: Basics of Work Zone Traffic Control

2.6.5.2. **Contractor Delivered Training.** Develop Contractor Delivered Training curriculum and submit the curriculum to the Owner for approval. Do not implement the training curriculum before receiving written approval from the Owner. The work performed and materials furnished to develop the curriculum and provide training will not be measured or paid for directly but will be considered subsidiary to pertinent Items.

A contractor's certified flagging instructor is permitted to train other flaggers.

Special Provision to Item 506
Temporary Erosion, Sedimentation, and Environmental Controls

Item 506, "Temporary Erosion, Sedimentation, and Environmental Controls," of the Standard Specifications is amended with respect to the clauses cited below. No other clauses or requirements of this Item are waived or changed.

Article 506.1., "Description." The second paragraph is voided and replaced by the following.

Contractor is considered primary operator to have day-to-day operational control as defined in TPDES GP TXR150000.

1.1. For projects with soil disturbance of less than 1 acre, no submittal to TCEQ will be required but Contractor will follow SWP3. For projects with soil disturbance of 1 acre to less than 5 acres a small site notice will be posted at the site. For projects with soil disturbance of 5 acres or more a notice of intent (NOI) is required and a large site notice posted at site. Postings will be in accordance with TPDES GP TXR150000. Postings not associated with project specific locations will be in same location as Department's postings.

1.2. Notice of Intent (NOI). Submit a NOI, if applicable, with the TCEQ under the TPDES GP TXR150000 at least 7 days prior to commencement of construction activities at the project site. Provide a signed copy to the Engineer and any other MS4 operators at the time of submittal. The Department will submit their NOI prior to contractor submission and will provide a copy for Contractor's use in completing the Contractor's NOI form.

1.3. Notice of Change (NOC). Upon concurrence of the Engineer, submit a NOC, if applicable, to the TCEQ within 14 days of discovery of a change or revision to the NOI as required by the TPDES GP TXR150000. Provide a signed copy of the NOC to the Engineer and any other MS4 operators at the time of submittal.

1.4. Notice of Termination (NOT). Upon concurrence of the Engineer, submit a NOT, if applicable, to the TCEQ within 30 days of the Engineer's approval that 70% native background vegetative cover is met or equivalent permanent stabilization have been employed in accordance with the TPDES GP TXR 150000. Provide a signed copy of the NOT to the Engineer and any other MS4 operators at the time of submittal.

Section 506.3.3., "Training," is supplemented by the following:

Training is provided by the Department at no cost to the Contractor and is valid for 3 yr. from the date of completion. The Engineer may require the following training at a frequency less than 3 yr. based on environmental needs:

- "Environmental Management System: Awareness Training for the Contractor" (English and Spanish) (Approximate running time 20 min.), and
- "Storm Water: Environmental Requirements During Construction" (English and Spanish) (Approximate running time 20 min.)

The CRPE, alternate CRPE designated for emergencies, Contractor's superintendent, Contractor, and subcontractor lead personnel involved in soil disturbing or SWP3 activities must enroll in and complete the training listed below and provide the certificate of completion to the Engineer before performing soil disturbing or SWP3 activities on the project. Coordinate enrollment as prescribed by the Department and pay associated fees for the following training:

- "Revegetation During Construction"
- "Construction General Permit Compliance," and

- "Construction State Gate Checklist (CSGC)."

Training and associated fee will not be measure or paid for directly but are subsidiary to this Item.

DISCLOSURE OF LOBBYING ACTIVITIES

Approved by OMB
0348-0046

Complete this form to disclose lobbying activities pursuant to 31 U.S.C. 1352
(See reverse for public burden disclosure.)

1. Type of Federal Action:	2. Status of Federal Action:	3. Report Type:
☐ a. contract b. grant c. cooperative agreement d. loan e. loan guarantee f. loan insurance	☐ a. bid/offer/application b. initial award c. post-award	☐ a. initial filing b. material change **For Material Change Only:** year _____ quarter _____ date of last report _____

4. Name and Address of Reporting Entity:	5. If Reporting Entity in No. 4 is a Subawardee, Enter Name and Address of Prime:
☐ Prime ☐ Subawardee Tier _____, *if known*: **Congressional District**, *if known*: 4c	**Congressional District**, *if known*:
6. Federal Department/Agency:	**7. Federal Program Name/Description:** CFDA Number, *if applicable*: _____
8. Federal Action Number, *if known*:	**9. Award Amount**, *if known*: $
10. a. Name and Address of Lobbying Registrant (*if individual, last name, first name, MI*):	**b. Individuals Performing Services** (*including address if different from No. 10a*) (*last name, first name, MI*):
11. Information requested through this form is authorized by title 31 U.S.C. section 1352. This disclosure of lobbying activities is a material representation of fact upon which reliance was placed by the tier above when this transaction was made or entered into. This disclosure is required pursuant to 31 U.S.C. 1352. This information will be available for public inspection. Any person who fails to file the required disclosure shall be subject to a civil penalty of not less than $10,000 and not more than $100,000 for each such failure.	Signature: _____ Print Name: _____ Title: _____ Telephone No.: _____ Date: _____
Federal Use Only:	Authorized for Local Reproduction Standard Form LLL (Rev. 7-97)

PRINT

INSTRUCTIONS FOR COMPLETION OF SF-LLL, DISCLOSURE OF LOBBYING ACTIVITIES

This disclosure form shall be completed by the reporting entity, whether subawardee or prime Federal recipient, at the initiation or receipt of a covered Federal action, or a material change to a previous filing, pursuant to title 31 U.S.C. section 1352. The filing of a form is required for each payment or agreement to make payment to any lobbying entity for influencing or attempting to influence an officer or employee of any agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with a covered Federal action. Complete all items that apply for both the initial filing and material change report. Refer to the implementing guidance published by the Office of Management and Budget for additional information.

1. Identify the type of covered Federal action for which lobbying activity is and/or has been secured to influence the outcome of a covered Federal action.

2. Identify the status of the covered Federal action.

3. Identify the appropriate classification of this report. If this is a followup report caused by a material change to the information previously reported, enter the year and quarter in which the change occurred. Enter the date of the last previously submitted report by this reporting entity for this covered Federal action.

4. Enter the full name, address, city, State and zip code of the reporting entity. Include Congressional District, if known. Check the appropriate classification of the reporting entity that designates if it is, or expects to be, a prime or subaward recipient. Identify the tier of the subawardee, e.g., the first subawardee of the prime is the 1st tier. Subawards include but are not limited to subcontracts, subgrants and contract awards under grants.

5. If the organization filing the report in item 4 checks "Subawardee," then enter the full name, address, city, State and zip code of the prime Federal recipient. Include Congressional District, if known.

6. Enter the name of the Federal agency making the award or loan commitment. Include at least one organizational level below agency name, if known. For example, Department of Transportation, United States Coast Guard.

7. Enter the Federal program name or description for the covered Federal action (item 1). If known, enter the full Catalog of Federal Domestic Assistance (CFDA) number for grants, cooperative agreements, loans, and loan commitments.

8. Enter the most appropriate Federal identifying number available for the Federal action identified in item 1 (e.g., Request for Proposal (RFP) number; Invitation for Bid (IFB) number; grant announcement number; the contract, grant, or loan award number; the application/proposal control number assigned by the Federal agency). Include prefixes, e.g., "RFP-DE-90-001."

9. For a covered Federal action where there has been an award or loan commitment by the Federal agency, enter the Federal amount of the award/loan commitment for the prime entity identified in item 4 or 5.

10. (a) Enter the full name, address, city, State and zip code of the lobbying registrant under the Lobbying Disclosure Act of 1995 engaged by the reporting entity identified in item 4 to influence the covered Federal action.

    (b) Enter the full names of the individual(s) performing services, and include full address if different from 10 (a). Enter Last Name, First Name, and Middle Initial (MI).

11. The certifying official shall sign and date the form, print his/her name, title, and telephone number.

According to the Paperwork Reduction Act, as amended, no persons are required to respond to a collection of information unless it displays a valid OMB Control Number. The valid OMB control number for this information collection is OMB No. 0348-0046. Public reporting burden for this collection of information is estimated to average 10 minutes per response, including time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding the burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden, to the Office of Management and Budget, Paperwork Reduction Project (0348-0046), Washington, DC 20503.

CHILD SUPPORT STATEMENT

Under Section 231.006, Family Code, the vendor or applicant certifies that the individual or business entity named in this contract, bid, or application is not ineligible to receive the specified grant, loan, or payment and acknowledges that this contract may be terminated and payment may be withheld if this certification is inaccurate.

REQUIRED CONTRACT PROVISIONS
FEDERAL-AID CONSTRUCTION CONTRACTS

I. General
II. Nondiscrimination
III. Nonsegregated Facilities
IV. Davis-Bacon and Related Act Provisions
V. Contract Work Hours and Safety Standards Act Provisions
VI. Subletting or Assigning the Contract
VII. Safety: Accident Prevention
VIII. False Statements Concerning Highway Projects
IX. Implementation of Clean Air Act and Federal Water Pollution Control Act
X. Compliance with Governmentwide Suspension and Debarment Requirements
XI. Certification Regarding Use of Contract Funds for Lobbying

ATTACHMENTS

A. Employment and Materials Preference for Appalachian Development Highway System or Appalachian Local Access Road Contracts (included in Appalachian contracts only)

I. GENERAL

1. Form FHWA-1273 must be physically incorporated in each construction contract funded under Title 23 (excluding emergency contracts solely intended for debris removal). The contractor (or subcontractor) must insert this form in each subcontract and further require its inclusion in all lower tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services).

The applicable requirements of Form FHWA-1273 are incorporated by reference for work done under any purchase order, rental agreement or agreement for other services. The prime contractor shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Form FHWA-1273 must be included in all Federal-aid design-build contracts, in all subcontracts and in lower tier subcontracts (excluding subcontracts for design services, purchase orders, rental agreements and other agreements for supplies or services). The design-builder shall be responsible for compliance by any subcontractor, lower-tier subcontractor or service provider.

Contracting agencies may reference Form FHWA-1273 in bid proposal or request for proposal documents, however, the Form FHWA-1273 must be physically incorporated (not referenced) in all contracts, subcontracts and lower-tier subcontracts (excluding purchase orders, rental agreements and other agreements for supplies or services related to a construction contract).

2. Subject to the applicability criteria noted in the following sections, these contract provisions shall apply to all work performed on the contract by the contractor's own organization and with the assistance of workers under the contractor's immediate superintendence and to all work performed on the contract by piecework, station work, or by subcontract.

3. A breach of any of the stipulations contained in these Required Contract Provisions may be sufficient grounds for withholding of progress payments, withholding of final payment, termination of the contract, suspension / debarment or any other action determined to be appropriate by the contracting agency and FHWA.

4. Selection of Labor: During the performance of this contract, the contractor shall not use convict labor for any purpose within the limits of a construction project on a Federal-aid highway unless it is labor performed by convicts who are on parole, supervised release, or probation. The term Federal-aid highway does not include roadways functionally classified as local roads or rural minor collectors.

II. NONDISCRIMINATION

The provisions of this section related to 23 CFR Part 230 are applicable to all Federal-aid construction contracts and to all related construction subcontracts of $10,000 or more. The provisions of 23 CFR Part 230 are not applicable to material supply, engineering, or architectural service contracts.

In addition, the contractor and all subcontractors must comply with the following policies: Executive Order 11246, 41 CFR 60, 29 CFR 1625-1627, Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The contractor and all subcontractors must comply with: the requirements of the Equal Opportunity Clause in 41 CFR 60-1.4(b) and, for all construction contracts exceeding $10,000, the Standard Federal Equal Employment Opportunity Construction Contract Specifications in 41 CFR 60-4.3.

Note: The U.S. Department of Labor has exclusive authority to determine compliance with Executive Order 11246 and the policies of the Secretary of Labor including 41 CFR 60, and 29 CFR 1625-1627. The contracting agency and the FHWA have the authority and the responsibility to ensure compliance with Title 23 USC Section 140, the Rehabilitation Act of 1973, as amended (29 USC 794), and Title VI of the Civil Rights Act of 1964, as amended, and related regulations including 49 CFR Parts 21, 26 and 27; and 23 CFR Parts 200, 230, and 633.

The following provision is adopted from 23 CFR 230, Appendix A, with appropriate revisions to conform to the U.S. Department of Labor (US DOL) and FHWA requirements.

1. Equal Employment Opportunity: Equal employment opportunity (EEO) requirements not to discriminate and to take affirmative action to assure equal opportunity as set forth under laws, executive orders, rules, regulations (28 CFR 35, 29 CFR 1630, 29 CFR 1625-1627, 41 CFR 60 and 49 CFR 27) and orders of the Secretary of Labor as modified by the provisions prescribed herein, and imposed pursuant to 23 U.S.C. 140 shall constitute the EEO and specific affirmative action standards for the contractor's project activities under

this contract. The provisions of the Americans with Disabilities Act of 1990 (42 U.S.C. 12101 et seq.) set forth under 28 CFR 35 and 29 CFR 1630 are incorporated by reference in this contract. In the execution of this contract, the contractor agrees to comply with the following minimum specific requirement activities of EEO:

a. The contractor will work with the contracting agency and the Federal Government to ensure that it has made every good faith effort to provide equal opportunity with respect to all of its terms and conditions of employment and in their review of activities under the contract.

b. The contractor will accept as its operating policy the following statement:

"It is the policy of this Company to assure that applicants are employed, and that employees are treated during employment, without regard to their race, religion, sex, color, national origin, age or disability. Such action shall include: employment, upgrading, demotion, or transfer; recruitment or recruitment advertising; layoff or termination; rates of pay or other forms of compensation; and selection for training, including apprenticeship, pre-apprenticeship, and/or on-the-job training."

2. EEO Officer: The contractor will designate and make known to the contracting officers an EEO Officer who will have the responsibility for and must be capable of effectively administering and promoting an active EEO program and who must be assigned adequate authority and responsibility to do so.

3. Dissemination of Policy: All members of the contractor's staff who are authorized to hire, supervise, promote, and discharge employees, or who recommend such action, or who are substantially involved in such action, will be made fully cognizant of, and will implement, the contractor's EEO policy and contractual responsibilities to provide EEO in each grade and classification of employment. To ensure that the above agreement will be met, the following actions will be taken as a minimum:

a. Periodic meetings of supervisory and personnel office employees will be conducted before the start of work and then not less often than once every six months, at which time the contractor's EEO policy and its implementation will be reviewed and explained. The meetings will be conducted by the EEO Officer.

b. All new supervisory or personnel office employees will be given a thorough indoctrination by the EEO Officer, covering all major aspects of the contractor's EEO obligations within thirty days following their reporting for duty with the contractor.

c. All personnel who are engaged in direct recruitment for the project will be instructed by the EEO Officer in the contractor's procedures for locating and hiring minorities and women.

d. Notices and posters setting forth the contractor's EEO policy will be placed in areas readily accessible to employees, applicants for employment and potential employees.

e. The contractor's EEO policy and the procedures to implement such policy will be brought to the attention of employees by means of meetings, employee handbooks, or other appropriate means.

4. Recruitment: When advertising for employees, the contractor will include in all advertisements for employees the notation: "An Equal Opportunity Employer." All such advertisements will be placed in publications having a large circulation among minorities and women in the area from which the project work force would normally be derived.

a. The contractor will, unless precluded by a valid bargaining agreement, conduct systematic and direct recruitment through public and private employee referral sources likely to yield qualified minorities and women. To meet this requirement, the contractor will identify sources of potential minority group employees, and establish with such identified sources procedures whereby minority and women applicants may be referred to the contractor for employment consideration.

b. In the event the contractor has a valid bargaining agreement providing for exclusive hiring hall referrals, the contractor is expected to observe the provisions of that agreement to the extent that the system meets the contractor's compliance with EEO contract provisions. Where implementation of such an agreement has the effect of discriminating against minorities or women, or obligates the contractor to do the same, such implementation violates Federal nondiscrimination provisions.

c. The contractor will encourage its present employees to refer minorities and women as applicants for employment. Information and procedures with regard to referring such applicants will be discussed with employees.

5. Personnel Actions: Wages, working conditions, and employee benefits shall be established and administered, and personnel actions of every type, including hiring, upgrading, promotion, transfer, demotion, layoff, and termination, shall be taken without regard to race, color, religion, sex, national origin, age or disability. The following procedures shall be followed:

a. The contractor will conduct periodic inspections of project sites to insure that working conditions and employee facilities do not indicate discriminatory treatment of project site personnel.

b. The contractor will periodically evaluate the spread of wages paid within each classification to determine any evidence of discriminatory wage practices.

c. The contractor will periodically review selected personnel actions in depth to determine whether there is evidence of discrimination. Where evidence is found, the contractor will promptly take corrective action. If the review indicates that the discrimination may extend beyond the actions reviewed, such corrective action shall include all affected persons.

d. The contractor will promptly investigate all complaints of alleged discrimination made to the contractor in connection with its obligations under this contract, will attempt to resolve such complaints, and will take appropriate corrective action within a reasonable time. If the investigation indicates that the discrimination may affect persons other than the complainant, such corrective action shall include such other persons. Upon completion of each investigation, the contractor will inform every complainant of all of their avenues of appeal.

6. Training and Promotion:

a. The contractor will assist in locating, qualifying, and increasing the skills of minorities and women who are

applicants for employment or current employees. Such efforts should be aimed at developing full journey level status employees in the type of trade or job classification involved.

b. Consistent with the contractor's work force requirements and as permissible under Federal and State regulations, the contractor shall make full use of training programs, i.e., apprenticeship, and on-the-job training programs for the geographical area of contract performance. In the event a special provision for training is provided under this contract, this subparagraph will be superseded as indicated in the special provision. The contracting agency may reserve training positions for persons who receive welfare assistance in accordance with 23 U.S.C. 140(a).

c. The contractor will advise employees and applicants for employment of available training programs and entrance requirements for each.

d. The contractor will periodically review the training and promotion potential of employees who are minorities and women and will encourage eligible employees to apply for such training and promotion.

7. Unions: If the contractor relies in whole or in part upon unions as a source of employees, the contractor will use good faith efforts to obtain the cooperation of such unions to increase opportunities for minorities and women. Actions by the contractor, either directly or through a contractor's association acting as agent, will include the procedures set forth below:

a. The contractor will use good faith efforts to develop, in cooperation with the unions, joint training programs aimed toward qualifying more minorities and women for membership in the unions and increasing the skills of minorities and women so that they may qualify for higher paying employment.

b. The contractor will use good faith efforts to incorporate an EEO clause into each union agreement to the end that such union will be contractually bound to refer applicants without regard to their race, color, religion, sex, national origin, age or disability.

c. The contractor is to obtain information as to the referral practices and policies of the labor union except that to the extent such information is within the exclusive possession of the labor union and such labor union refuses to furnish such information to the contractor, the contractor shall so certify to the contracting agency and shall set forth what efforts have been made to obtain such information.

d. In the event the union is unable to provide the contractor with a reasonable flow of referrals within the time limit set forth in the collective bargaining agreement, the contractor will, through independent recruitment efforts, fill the employment vacancies without regard to race, color, religion, sex, national origin, age or disability; making full efforts to obtain qualified and/or qualifiable minorities and women. The failure of a union to provide sufficient referrals (even though it is obligated to provide exclusive referrals under the terms of a collective bargaining agreement) does not relieve the contractor from the requirements of this paragraph. In the event the union referral practice prevents the contractor from meeting the obligations pursuant to Executive Order 11246, as amended, and these special provisions, such contractor shall immediately notify the contracting agency.

8. Reasonable Accommodation for Applicants / Employees with Disabilities: The contractor must be familiar with the requirements for and comply with the Americans with Disabilities Act and all rules and regulations established there under. Employers must provide reasonable accommodation in all employment activities unless to do so would cause an undue hardship.

9. Selection of Subcontractors, Procurement of Materials and Leasing of Equipment: The contractor shall not discriminate on the grounds of race, color, religion, sex, national origin, age or disability in the selection and retention of subcontractors, including procurement of materials and leases of equipment. The contractor shall take all necessary and reasonable steps to ensure nondiscrimination in the administration of this contract.

a. The contractor shall notify all potential subcontractors and suppliers and lessors of their EEO obligations under this contract.

b. The contractor will use good faith efforts to ensure subcontractor compliance with their EEO obligations.

10. Assurance Required by 49 CFR 26.13(b):

a. The requirements of 49 CFR Part 26 and the State DOT's U.S. DOT-approved DBE program are incorporated by reference.

b. The contractor or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the contracting agency deems appropriate.

11. Records and Reports: The contractor shall keep such records as necessary to document compliance with the EEO requirements. Such records shall be retained for a period of three years following the date of the final payment to the contractor for all contract work and shall be available at reasonable times and places for inspection by authorized representatives of the contracting agency and the FHWA.

a. The records kept by the contractor shall document the following:

(1) The number and work hours of minority and non-minority group members and women employed in each work classification on the project;

(2) The progress and efforts being made in cooperation with unions, when applicable, to increase employment opportunities for minorities and women; and

(3) The progress and efforts being made in locating, hiring, training, qualifying, and upgrading minorities and women;

b. The contractors and subcontractors will submit an annual report to the contracting agency each July for the duration of the project, indicating the number of minority, women, and non-minority group employees currently engaged in each work classification required by the contract work. This information is to be reported on Form FHWA-1391. The staffing data should represent the project work force on board in all or any part of the last payroll period preceding the end of July. If on-the-job training is being required by special provision, the contractor

will be required to collect and report training data. The employment data should reflect the work force on board during all or any part of the last payroll period preceding the end of July.

III. NONSEGREGATED FACILITIES

This provision is applicable to all Federal-aid construction contracts and to all related construction subcontracts of $10,000 or more.

The contractor must ensure that facilities provided for employees are provided in such a manner that segregation on the basis of race, color, religion, sex, or national origin cannot result. The contractor may neither require such segregated use by written or oral policies nor tolerate such use by employee custom. The contractor's obligation extends further to ensure that its employees are not assigned to perform their services at any location, under the contractor's control, where the facilities are segregated. The term "facilities" includes waiting rooms, work areas, restaurants and other eating areas, time clocks, restrooms, washrooms, locker rooms, and other storage or dressing areas, parking lots, drinking fountains, recreation or entertainment areas, transportation, and housing provided for employees. The contractor shall provide separate or single-user restrooms and necessary dressing or sleeping areas to assure privacy between sexes.

IV. DAVIS-BACON AND RELATED ACT PROVISIONS

This section is applicable to all Federal-aid construction projects exceeding $2,000 and to all related subcontracts and lower-tier subcontracts (regardless of subcontract size). The requirements apply to all projects located within the right-of-way of a roadway that is functionally classified as Federal-aid highway. This excludes roadways functionally classified as local roads or rural minor collectors, which are exempt. Contracting agencies may elect to apply these requirements to other projects.

The following provisions are from the U.S. Department of Labor regulations in 29 CFR 5.5 "Contract provisions and related matters" with minor revisions to conform to the FHWA-1273 format and FHWA program requirements.

1. Minimum wages

a. All laborers and mechanics employed or working upon the site of the work, will be paid unconditionally and not less often than once a week, and without subsequent deduction or rebate on any account (except such payroll deductions as are permitted by regulations issued by the Secretary of Labor under the Copeland Act (29 CFR part 3)), the full amount of wages and bona fide fringe benefits (or cash equivalents thereof) due at time of payment computed at rates not less than those contained in the wage determination of the Secretary of Labor which is attached hereto and made a part hereof, regardless of any contractual relationship which may be alleged to exist between the contractor and such laborers and mechanics.

Contributions made or costs reasonably anticipated for bona fide fringe benefits under section 1(b)(2) of the Davis-Bacon Act on behalf of laborers or mechanics are considered wages paid to such laborers or mechanics, subject to the provisions of paragraph 1.d. of this section; also, regular contributions made or costs incurred for more than a weekly period (but not less often than quarterly) under plans, funds, or programs which cover the particular weekly period, are deemed to be constructively made or incurred during such weekly period. Such laborers and mechanics shall be paid the appropriate wage rate and fringe benefits on the wage determination for the classification of work actually performed, without regard to skill, except as provided in 29 CFR 5.5(a)(4). Laborers or mechanics performing work in more than one classification may be compensated at the rate specified for each classification for the time actually worked therein: Provided, That the employer's payroll records accurately set forth the time spent in each classification in which work is performed. The wage determination (including any additional classification and wage rates conformed under paragraph 1.b. of this section) and the Davis-Bacon poster (WH–1321) shall be posted at all times by the contractor and its subcontractors at the site of the work in a prominent and accessible place where it can be easily seen by the workers.

b.(1) The contracting officer shall require that any class of laborers or mechanics, including helpers, which is not listed in the wage determination and which is to be employed under the contract shall be classified in conformance with the wage determination. The contracting officer shall approve an additional classification and wage rate and fringe benefits therefore only when the following criteria have been met:

(i) The work to be performed by the classification requested is not performed by a classification in the wage determination; and

(ii) The classification is utilized in the area by the construction industry; and

(iii) The proposed wage rate, including any bona fide fringe benefits, bears a reasonable relationship to the wage rates contained in the wage determination.

(2) If the contractor and the laborers and mechanics to be employed in the classification (if known), or their representatives, and the contracting officer agree on the classification and wage rate (including the amount designated for fringe benefits where appropriate), a report of the action taken shall be sent by the contracting officer to the Administrator of the Wage and Hour Division, Employment Standards Administration, U.S. Department of Labor, Washington, DC 20210. The Administrator, or an authorized representative, will approve, modify, or disapprove every additional classification action within 30 days of receipt and so advise the contracting officer or will notify the contracting officer within the 30-day period that additional time is necessary.

(3) In the event the contractor, the laborers or mechanics to be employed in the classification or their representatives, and the contracting officer do not agree on the proposed classification and wage rate (including the amount designated for fringe benefits, where appropriate), the contracting officer shall refer the questions, including the views of all interested parties and the recommendation of the contracting officer, to the Wage and Hour Administrator for determination. The Wage and Hour Administrator, or an authorized representative, will issue a determination within 30 days of receipt and so advise the contracting officer or

will notify the contracting officer within the 30-day period that additional time is necessary.

(4) The wage rate (including fringe benefits where appropriate) determined pursuant to paragraphs 1.b.(2) or 1.b.(3) of this section, shall be paid to all workers performing work in the classification under this contract from the first day on which work is performed in the classification.

c. Whenever the minimum wage rate prescribed in the contract for a class of laborers or mechanics includes a fringe benefit which is not expressed as an hourly rate, the contractor shall either pay the benefit as stated in the wage determination or shall pay another bona fide fringe benefit or an hourly cash equivalent thereof.

d. If the contractor does not make payments to a trustee or other third person, the contractor may consider as part of the wages of any laborer or mechanic the amount of any costs reasonably anticipated in providing bona fide fringe benefits under a plan or program, Provided, That the Secretary of Labor has found, upon the written request of the contractor, that the applicable standards of the Davis-Bacon Act have been met. The Secretary of Labor may require the contractor to set aside in a separate account assets for the meeting of obligations under the plan or program.

2. Withholding

The contracting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor, withhold or cause to be withheld from the contractor under this contract, or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to Davis-Bacon prevailing wage requirements, which is held by the same prime contractor, so much of the accrued payments or advances as may be considered necessary to pay laborers and mechanics, including apprentices, trainees, and helpers, employed by the contractor or any subcontractor the full amount of wages required by the contract. In the event of failure to pay any laborer or mechanic, including any apprentice, trainee, or helper, employed or working on the site of the work, all or part of the wages required by the contract, the contracting agency may, after written notice to the contractor, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds until such violations have ceased.

3. Payrolls and basic records

a. Payrolls and basic records relating thereto shall be maintained by the contractor during the course of the work and preserved for a period of three years thereafter for all laborers and mechanics working at the site of the work. Such records shall contain the name, address, and social security number of each such worker, his or her correct classification, hourly rates of wages paid (including rates of contributions or costs anticipated for bona fide fringe benefits or cash equivalents thereof of the types described in section 1(b)(2)(B) of the Davis-Bacon Act), daily and weekly number of hours worked, deductions made and actual wages paid. Whenever the Secretary of Labor has found under 29 CFR 5.5(a)(1)(iv) that the wages of any laborer or mechanic include the amount of any costs reasonably anticipated in providing benefits under a plan or program described in section 1(b)(2)(B) of the Davis-Bacon Act, the contractor shall maintain records which show that the commitment to provide such benefits is enforceable, that the plan or program is financially responsible, and that the plan or program has been communicated in writing to the laborers or mechanics affected, and records which show the costs anticipated or the actual cost incurred in providing such benefits. Contractors employing apprentices or trainees under approved programs shall maintain written evidence of the registration of apprenticeship programs and certification of trainee programs, the registration of the apprentices and trainees, and the ratios and wage rates prescribed in the applicable programs.

b.(1) The contractor shall submit weekly for each week in which any contract work is performed a copy of all payrolls to the contracting agency. The payrolls submitted shall set out accurately and completely all of the information required to be maintained under 29 CFR 5.5(a)(3)(i), except that full social security numbers and home addresses shall not be included on weekly transmittals. Instead the payrolls shall only need to include an individually identifying number for each employee (e.g. , the last four digits of the employee's social security number). The required weekly payroll information may be submitted in any form desired. Optional Form WH–347 is available for this purpose from the Wage and Hour Division Web site at http://www.dol.gov/esa/whd/forms/wh347instr.htm or its successor site. The prime contractor is responsible for the submission of copies of payrolls by all subcontractors. Contractors and subcontractors shall maintain the full social security number and current address of each covered worker, and shall provide them upon request to the contracting agency for transmission to the State DOT, the FHWA or the Wage and Hour Division of the Department of Labor for purposes of an investigation or audit of compliance with prevailing wage requirements. It is not a violation of this section for a prime contractor to require a subcontractor to provide addresses and social security numbers to the prime contractor for its own records, without weekly submission to the contracting agency..

(2) Each payroll submitted shall be accompanied by a "Statement of Compliance," signed by the contractor or subcontractor or his or her agent who pays or supervises the payment of the persons employed under the contract and shall certify the following:

(i) That the payroll for the payroll period contains the information required to be provided under §5.5 (a)(3)(ii) of Regulations, 29 CFR part 5, the appropriate information is being maintained under §5.5 (a)(3)(i) of Regulations, 29 CFR part 5, and that such information is correct and complete;

(ii) That each laborer or mechanic (including each helper, apprentice, and trainee) employed on the contract during the payroll period has been paid the full weekly wages earned, without rebate, either directly or indirectly, and that no deductions have been made either directly or indirectly from the full wages earned, other than permissible deductions as set forth in Regulations, 29 CFR part 3;

(iii) That each laborer or mechanic has been paid not less than the applicable wage rates and fringe benefits or cash equivalents for the classification of work performed, as specified in the applicable wage determination incorporated into the contract.

(3) The weekly submission of a properly executed certification set forth on the reverse side of Optional Form WH–347 shall satisfy the requirement for submission of the "Statement of Compliance" required by paragraph 3.b.(2) of this section.

(4) The falsification of any of the above certifications may subject the contractor or subcontractor to civil or criminal prosecution under section 1001 of title 18 and section 231 of title 31 of the United States Code.

c. The contractor or subcontractor shall make the records required under paragraph 3.a. of this section available for inspection, copying, or transcription by authorized representatives of the contracting agency, the State DOT, the FHWA, or the Department of Labor, and shall permit such representatives to interview employees during working hours on the job. If the contractor or subcontractor fails to submit the required records or to make them available, the FHWA may, after written notice to the contractor, the contracting agency or the State DOT, take such action as may be necessary to cause the suspension of any further payment, advance, or guarantee of funds. Furthermore, failure to submit the required records upon request or to make such records available may be grounds for debarment action pursuant to 29 CFR 5.12.

4. Apprentices and trainees

a. Apprentices (programs of the USDOL).

Apprentices will be permitted to work at less than the predetermined rate for the work they performed when they are employed pursuant to and individually registered in a bona fide apprenticeship program registered with the U.S. Department of Labor, Employment and Training Administration, Office of Apprenticeship Training, Employer and Labor Services, or with a State Apprenticeship Agency recognized by the Office, or if a person is employed in his or her first 90 days of probationary employment as an apprentice in such an apprenticeship program, who is not individually registered in the program, but who has been certified by the Office of Apprenticeship Training, Employer and Labor Services or a State Apprenticeship Agency (where appropriate) to be eligible for probationary employment as an apprentice.

The allowable ratio of apprentices to journeymen on the job site in any craft classification shall not be greater than the ratio permitted to the contractor as to the entire work force under the registered program. Any worker listed on a payroll at an apprentice wage rate, who is not registered or otherwise employed as stated above, shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any apprentice performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed. Where a contractor is performing construction on a project in a locality other than that in which its program is registered, the ratios and wage rates (expressed in percentages of the journeyman's hourly rate) specified in the contractor's or subcontractor's registered program shall be observed.

Every apprentice must be paid at not less than the rate specified in the registered program for the apprentice's level of progress, expressed as a percentage of the journeymen hourly rate specified in the applicable wage determination. Apprentices shall be paid fringe benefits in accordance with the provisions of the apprenticeship program. If the apprenticeship program does not specify fringe benefits, apprentices must be paid the full amount of fringe benefits listed on the wage determination for the applicable classification. If the Administrator determines that a different practice prevails for the applicable apprentice classification, fringes shall be paid in accordance with that determination.

In the event the Office of Apprenticeship Training, Employer and Labor Services, or a State Apprenticeship Agency recognized by the Office, withdraws approval of an apprenticeship program, the contractor will no longer be permitted to utilize apprentices at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

b. Trainees (programs of the USDOL).

Except as provided in 29 CFR 5.16, trainees will not be permitted to work at less than the predetermined rate for the work performed unless they are employed pursuant to and individually registered in a program which has received prior approval, evidenced by formal certification by the U.S. Department of Labor, Employment and Training Administration.

The ratio of trainees to journeymen on the job site shall not be greater than permitted under the plan approved by the Employment and Training Administration.

Every trainee must be paid at not less than the rate specified in the approved program for the trainee's level of progress, expressed as a percentage of the journeyman hourly rate specified in the applicable wage determination. Trainees shall be paid fringe benefits in accordance with the provisions of the trainee program. If the trainee program does not mention fringe benefits, trainees shall be paid the full amount of fringe benefits listed on the wage determination unless the Administrator of the Wage and Hour Division determines that there is an apprenticeship program associated with the corresponding journeyman wage rate on the wage determination which provides for less than full fringe benefits for apprentices. Any employee listed on the payroll at a trainee rate who is not registered and participating in a training plan approved by the Employment and Training Administration shall be paid not less than the applicable wage rate on the wage determination for the classification of work actually performed. In addition, any trainee performing work on the job site in excess of the ratio permitted under the registered program shall be paid not less than the applicable wage rate on the wage determination for the work actually performed.

In the event the Employment and Training Administration withdraws approval of a training program, the contractor will no longer be permitted to utilize trainees at less than the applicable predetermined rate for the work performed until an acceptable program is approved.

c. Equal employment opportunity. The utilization of apprentices, trainees and journeymen under this part shall be in conformity with the equal employment opportunity requirements of Executive Order 11246, as amended, and 29 CFR part 30.

d. Apprentices and Trainees (programs of the U.S. DOT).

Apprentices and trainees working under apprenticeship and skill training programs which have been certified by the Secretary of Transportation as promoting EEO in connection with Federal-aid highway construction programs are not subject to the requirements of paragraph 4 of this Section IV. The straight time hourly wage rates for apprentices and trainees under such programs will be established by the particular programs. The ratio of apprentices and trainees to journeymen shall not be greater than permitted by the terms of the particular program.

5. Compliance with Copeland Act requirements. The contractor shall comply with the requirements of 29 CFR part 3, which are incorporated by reference in this contract.

6. Subcontracts. The contractor or subcontractor shall insert Form FHWA-1273 in any subcontracts and also require the subcontractors to include Form FHWA-1273 in any lower tier subcontracts. The prime contractor shall be responsible for the compliance by any subcontractor or lower tier subcontractor with all the contract clauses in 29 CFR 5.5.

7. Contract termination: debarment. A breach of the contract clauses in 29 CFR 5.5 may be grounds for termination of the contract, and for debarment as a contractor and a subcontractor as provided in 29 CFR 5.12.

8. Compliance with Davis-Bacon and Related Act requirements. All rulings and interpretations of the Davis-Bacon and Related Acts contained in 29 CFR parts 1, 3, and 5 are herein incorporated by reference in this contract.

9. Disputes concerning labor standards. Disputes arising out of the labor standards provisions of this contract shall not be subject to the general disputes clause of this contract. Such disputes shall be resolved in accordance with the procedures of the Department of Labor set forth in 29 CFR parts 5, 6, and 7. Disputes within the meaning of this clause include disputes between the contractor (or any of its subcontractors) and the contracting agency, the U.S. Department of Labor, or the employees or their representatives.

10. Certification of eligibility.

a. By entering into this contract, the contractor certifies that neither it (nor he or she) nor any person or firm who has an interest in the contractor's firm is a person or firm ineligible to be awarded Government contracts by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).

b. No part of this contract shall be subcontracted to any person or firm ineligible for award of a Government contract by virtue of section 3(a) of the Davis-Bacon Act or 29 CFR 5.12(a)(1).

c. The penalty for making false statements is prescribed in the U.S. Criminal Code, 18 U.S.C. 1001.

V. CONTRACT WORK HOURS AND SAFETY STANDARDS ACT

The following clauses apply to any Federal-aid construction contract in an amount in excess of $100,000 and subject to the overtime provisions of the Contract Work Hours and Safety Standards Act. These clauses shall be inserted in addition to the clauses required by 29 CFR 5.5(a) or 29 CFR 4.6. As used in this paragraph, the terms laborers and mechanics include watchmen and guards.

1. Overtime requirements. No contractor or subcontractor contracting for any part of the contract work which may require or involve the employment of laborers or mechanics shall require or permit any such laborer or mechanic in any workweek in which he or she is employed on such work to work in excess of forty hours in such workweek unless such laborer or mechanic receives compensation at a rate not less than one and one-half times the basic rate of pay for all hours worked in excess of forty hours in such workweek.

2. Violation; liability for unpaid wages; liquidated damages. In the event of any violation of the clause set forth in paragraph (1.) of this section, the contractor and any subcontractor responsible therefor shall be liable for the unpaid wages. In addition, such contractor and subcontractor shall be liable to the United States (in the case of work done under contract for the District of Columbia or a territory, to such District or to such territory), for liquidated damages. Such liquidated damages shall be computed with respect to each individual laborer or mechanic, including watchmen and guards, employed in violation of the clause set forth in paragraph (1.) of this section, in the sum of $10 for each calendar day on which such individual was required or permitted to work in excess of the standard workweek of forty hours without payment of the overtime wages required by the clause set forth in paragraph (1.) of this section.

3. Withholding for unpaid wages and liquidated damages. The FHWA or the contacting agency shall upon its own action or upon written request of an authorized representative of the Department of Labor withhold or cause to be withheld, from any moneys payable on account of work performed by the contractor or subcontractor under any such contract or any other Federal contract with the same prime contractor, or any other federally-assisted contract subject to the Contract Work Hours and Safety Standards Act, which is held by the same prime contractor, such sums as may be determined to be necessary to satisfy any liabilities of such contractor or subcontractor for unpaid wages and liquidated damages as provided in the clause set forth in paragraph (2.) of this section.

4. Subcontracts. The contractor or subcontractor shall insert in any subcontracts the clauses set forth in paragraph (1.) through (4.) of this section and also a clause requiring the subcontractors to include these clauses in any lower tier subcontracts. The prime contractor shall be responsible for compliance by any subcontractor or lower tier subcontractor with the clauses set forth in paragraphs (1.) through (4.) of this section.

VI. SUBLETTING OR ASSIGNING THE CONTRACT

This provision is applicable to all Federal-aid construction contracts on the National Highway System.

1. The contractor shall perform with its own organization contract work amounting to not less than 30 percent (or a greater percentage if specified elsewhere in the contract) of the total original contract price, excluding any specialty items designated by the contracting agency. Specialty items may be performed by subcontract and the amount of any such specialty items performed may be deducted from the total original contract price before computing the amount of work required to be performed by the contractor's own organization (23 CFR 635.116).

a. The term "perform work with its own organization" refers to workers employed or leased by the prime contractor, and equipment owned or rented by the prime contractor, with or without operators. Such term does not include employees or equipment of a subcontractor or lower tier subcontractor, agents of the prime contractor, or any other assignees. The term may include payments for the costs of hiring leased employees from an employee leasing firm meeting all relevant Federal and State regulatory requirements. Leased employees may only be included in this term if the prime contractor meets all of the following conditions:

(1) the prime contractor maintains control over the supervision of the day-to-day activities of the leased employees;
(2) the prime contractor remains responsible for the quality of the work of the leased employees;
(3) the prime contractor retains all power to accept or exclude individual employees from work on the project; and
(4) the prime contractor remains ultimately responsible for the payment of predetermined minimum wages, the submission of payrolls, statements of compliance and all other Federal regulatory requirements.

b. "Specialty Items" shall be construed to be limited to work that requires highly specialized knowledge, abilities, or equipment not ordinarily available in the type of contracting organizations qualified and expected to bid or propose on the contract as a whole and in general are to be limited to minor components of the overall contract.

2. The contract amount upon which the requirements set forth in paragraph (1) of Section VI is computed includes the cost of material and manufactured products which are to be purchased or produced by the contractor under the contract provisions.

3. The contractor shall furnish (a) a competent superintendent or supervisor who is employed by the firm, has full authority to direct performance of the work in accordance with the contract requirements, and is in charge of all construction operations (regardless of who performs the work) and (b) such other of its own organizational resources (supervision, management, and engineering services) as the contracting officer determines is necessary to assure the performance of the contract.

4. No portion of the contract shall be sublet, assigned or otherwise disposed of except with the written consent of the contracting officer, or authorized representative, and such consent when given shall not be construed to relieve the contractor of any responsibility for the fulfillment of the contract. Written consent will be given only after the contracting agency has assured that each subcontract is evidenced in writing and that it contains all pertinent provisions and requirements of the prime contract.

5. The 30% self-performance requirement of paragraph (1) is not applicable to design-build contracts; however, contracting agencies may establish their own self-performance requirements.

VII. SAFETY: ACCIDENT PREVENTION

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

1. In the performance of this contract the contractor shall comply with all applicable Federal, State, and local laws governing safety, health, and sanitation (23 CFR 635). The contractor shall provide all safeguards, safety devices and protective equipment and take any other needed actions as it determines, or as the contracting officer may determine, to be reasonably necessary to protect the life and health of employees on the job and the safety of the public and to protect property in connection with the performance of the work covered by the contract.

2. It is a condition of this contract, and shall be made a condition of each subcontract, which the contractor enters into pursuant to this contract, that the contractor and any subcontractor shall not permit any employee, in performance of the contract, to work in surroundings or under conditions which are unsanitary, hazardous or dangerous to his/her health or safety, as determined under construction safety and health standards (29 CFR 1926) promulgated by the Secretary of Labor, in accordance with Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C. 3704).

3. Pursuant to 29 CFR 1926.3, it is a condition of this contract that the Secretary of Labor or authorized representative thereof, shall have right of entry to any site of contract performance to inspect or investigate the matter of compliance with the construction safety and health standards and to carry out the duties of the Secretary under Section 107 of the Contract Work Hours and Safety Standards Act (40 U.S.C.3704).

VIII. FALSE STATEMENTS CONCERNING HIGHWAY PROJECTS

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

In order to assure high quality and durable construction in conformity with approved plans and specifications and a high degree of reliability on statements and representations made by engineers, contractors, suppliers, and workers on Federal-aid highway projects, it is essential that all persons concerned with the project perform their functions as carefully, thoroughly, and honestly as possible. Willful falsification, distortion, or misrepresentation with respect to any facts related to the project is a violation of Federal law. To prevent any misunderstanding regarding the seriousness of these and similar acts, Form FHWA-1022 shall be posted on each Federal-aid highway project (23 CFR 635) in one or more places where it is readily available to all persons concerned with the project:

18 U.S.C. 1020 reads as follows:

"Whoever, being an officer, agent, or employee of the United States, or of any State or Territory, or whoever, whether a person, association, firm, or corporation, knowingly makes any false statement, false representation, or false report as to the character, quality, quantity, or cost of the material used or to be used, or the quantity or quality of the work performed or to be performed, or the cost thereof in connection with the submission of plans, maps, specifications, contracts, or costs of construction on any highway or related project submitted for approval to the Secretary of Transportation; or

Whoever knowingly makes any false statement, false representation, false report or false claim with respect to the character, quality, quantity, or cost of any work performed or to be performed, or materials furnished or to be furnished, in connection with the construction of any highway or related project approved by the Secretary of Transportation; or

Whoever knowingly makes any false statement or false representation as to material fact in any statement, certificate, or report submitted pursuant to provisions of the Federal-aid Roads Act approved July 1, 1916, (39 Stat. 355), as amended and supplemented;

Shall be fined under this title or imprisoned not more than 5 years or both."

IX. IMPLEMENTATION OF CLEAN AIR ACT AND FEDERAL WATER POLLUTION CONTROL ACT

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts.

By submission of this bid/proposal or the execution of this contract, or subcontract, as appropriate, the bidder, proposer, Federal-aid construction contractor, or subcontractor, as appropriate, will be deemed to have stipulated as follows:

1. That any person who is or will be utilized in the performance of this contract is not prohibited from receiving an award due to a violation of Section 508 of the Clean Water Act or Section 306 of the Clean Air Act.
2. That the contractor agrees to include or cause to be included the requirements of paragraph (1) of this Section X in every subcontract, and further agrees to take such action as the contracting agency may direct as a means of enforcing such requirements.

X. CERTIFICATION REGARDING DEBARMENT, SUSPENSION, INELIGIBILITY AND VOLUNTARY EXCLUSION

This provision is applicable to all Federal-aid construction contracts, design-build contracts, subcontracts, lower-tier subcontracts, purchase orders, lease agreements, consultant contracts or any other covered transaction requiring FHWA approval or that is estimated to cost $25,000 or more – as defined in 2 CFR Parts 180 and 1200.

1. Instructions for Certification – First Tier Participants:

a. By signing and submitting this proposal, the prospective first tier participant is providing the certification set out below.

b. The inability of a person to provide the certification set out below will not necessarily result in denial of participation in this covered transaction. The prospective first tier participant shall submit an explanation of why it cannot provide the certification set out below. The certification or explanation will be considered in connection with the department or agency's determination whether to enter into this transaction. However, failure of the prospective first tier participant to furnish a certification or an explanation shall disqualify such a person from participation in this transaction.

c. The certification in this clause is a material representation of fact upon which reliance was placed when the contracting agency determined to enter into this transaction. If it is later determined that the prospective participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the contracting agency may terminate this transaction for cause of default.

d. The prospective first tier participant shall provide immediate written notice to the contracting agency to whom this proposal is submitted if any time the prospective first tier participant learns that its certification was erroneous when submitted or has become erroneous by reason of changed circumstances.

e. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

f. The prospective first tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency entering into this transaction.

g. The prospective first tier participant further agrees by submitting this proposal that it will include the clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transactions," provided by the department or contracting agency, entering into this covered transaction, without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the $25,000 threshold.

h. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (https://www.epls.gov/), which is compiled by the General Services Administration.

i. Nothing contained in the foregoing shall be construed to require the establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of the prospective participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

j. Except for transactions authorized under paragraph (f) of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the department or agency may terminate this transaction for cause or default.

* * * * *

2. Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion – First Tier Participants:

a. The prospective first tier participant certifies to the best of its knowledge and belief, that it and its principals:

(1) Are not presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency;

(2) Have not within a three-year period preceding this proposal been convicted of or had a civil judgment rendered against them for commission of fraud or a criminal offense in connection with obtaining, attempting to obtain, or performing a public (Federal, State or local) transaction or contract under a public transaction; violation of Federal or State antitrust statutes or commission of embezzlement, theft, forgery, bribery, falsification or destruction of records, making false statements, or receiving stolen property;

(3) Are not presently indicted for or otherwise criminally or civilly charged by a governmental entity (Federal, State or local) with commission of any of the offenses enumerated in paragraph (a)(2) of this certification; and

(4) Have not within a three-year period preceding this application/proposal had one or more public transactions (Federal, State or local) terminated for cause or default.

b. Where the prospective participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

2. Instructions for Certification - Lower Tier Participants:

(Applicable to all subcontracts, purchase orders and other lower tier transactions requiring prior FHWA approval or estimated to cost $25,000 or more - 2 CFR Parts 180 and 1200)

a. By signing and submitting this proposal, the prospective lower tier is providing the certification set out below.

b. The certification in this clause is a material representation of fact upon which reliance was placed when this transaction was entered into. If it is later determined that the prospective lower tier participant knowingly rendered an erroneous certification, in addition to other remedies available to the Federal Government, the department, or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

c. The prospective lower tier participant shall provide immediate written notice to the person to which this proposal is submitted if at any time the prospective lower tier participant learns that its certification was erroneous by reason of changed circumstances.

d. The terms "covered transaction," "debarred," "suspended," "ineligible," "participant," "person," "principal," and "voluntarily excluded," as used in this clause, are defined in 2 CFR Parts 180 and 1200. You may contact the person to which this proposal is submitted for assistance in obtaining a copy of those regulations. "First Tier Covered Transactions" refers to any covered transaction between a grantee or subgrantee of Federal funds and a participant (such as the prime or general contract). "Lower Tier Covered Transactions" refers to any covered transaction under a First Tier Covered Transaction (such as subcontracts). "First Tier Participant" refers to the participant who has entered into a covered transaction with a grantee or subgrantee of Federal funds (such as the prime or general contractor). "Lower Tier Participant" refers any participant who has entered into a covered transaction with a First Tier Participant or other Lower Tier Participants (such as subcontractors and suppliers).

e. The prospective lower tier participant agrees by submitting this proposal that, should the proposed covered transaction be entered into, it shall not knowingly enter into any lower tier covered transaction with a person who is debarred, suspended, declared ineligible, or voluntarily excluded from participation in this covered transaction, unless authorized by the department or agency with which this transaction originated.

f. The prospective lower tier participant further agrees by submitting this proposal that it will include this clause titled "Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion-Lower Tier Covered Transaction," without modification, in all lower tier covered transactions and in all solicitations for lower tier covered transactions exceeding the $25,000 threshold.

g. A participant in a covered transaction may rely upon a certification of a prospective participant in a lower tier covered transaction that is not debarred, suspended, ineligible, or voluntarily excluded from the covered transaction, unless it knows that the certification is erroneous. A participant is responsible for ensuring that its principals are not suspended, debarred, or otherwise ineligible to participate in covered transactions. To verify the eligibility of its principals, as well as the eligibility of any lower tier prospective participants, each participant may, but is not required to, check the Excluded Parties List System website (https://www.epls.gov/), which is compiled by the General Services Administration.

h. Nothing contained in the foregoing shall be construed to require establishment of a system of records in order to render in good faith the certification required by this clause. The knowledge and information of participant is not required to exceed that which is normally possessed by a prudent person in the ordinary course of business dealings.

i. Except for transactions authorized under paragraph e of these instructions, if a participant in a covered transaction knowingly enters into a lower tier covered transaction with a person who is suspended, debarred, ineligible, or voluntarily excluded from participation in this transaction, in addition to other remedies available to the Federal Government, the

department or agency with which this transaction originated may pursue available remedies, including suspension and/or debarment.

* * * * *

Certification Regarding Debarment, Suspension, Ineligibility and Voluntary Exclusion--Lower Tier Participants:

1. The prospective lower tier participant certifies, by submission of this proposal, that neither it nor its principals is presently debarred, suspended, proposed for debarment, declared ineligible, or voluntarily excluded from participating in covered transactions by any Federal department or agency.

2. Where the prospective lower tier participant is unable to certify to any of the statements in this certification, such prospective participant shall attach an explanation to this proposal.

* * * * *

XI. CERTIFICATION REGARDING USE OF CONTRACT FUNDS FOR LOBBYING

This provision is applicable to all Federal-aid construction contracts and to all related subcontracts which exceed $100,000 (49 CFR 20).

1. The prospective participant certifies, by signing and submitting this bid or proposal, to the best of his or her knowledge and belief, that:

a. No Federal appropriated funds have been paid or will be paid, by or on behalf of the undersigned, to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with the awarding of any Federal contract, the making of any Federal grant, the making of any Federal loan, the entering into of any cooperative agreement, and the extension, continuation, renewal, amendment, or modification of any Federal contract, grant, loan, or cooperative agreement.

b. If any funds other than Federal appropriated funds have been paid or will be paid to any person for influencing or attempting to influence an officer or employee of any Federal agency, a Member of Congress, an officer or employee of Congress, or an employee of a Member of Congress in connection with this Federal contract, grant, loan, or cooperative agreement, the undersigned shall complete and submit Standard Form-LLL, "Disclosure Form to Report Lobbying," in accordance with its instructions.

2. This certification is a material representation of fact upon which reliance was placed when this transaction was made or entered into. Submission of this certification is a prerequisite for making or entering into this transaction imposed by 31 U.S.C. 1352. Any person who fails to file the required certification shall be subject to a civil penalty of not less than $10,000 and not more than $100,000 for each such failure.

3. The prospective participant also agrees by submitting its bid or proposal that the participant shall require that the language of this certification be included in all lower tier subcontracts, which exceed $100,000 and that all such recipients shall certify and disclose accordingly.

ATTACHMENT A - EMPLOYMENT AND MATERIALS PREFERENCE FOR APPALACHIAN DEVELOPMENT HIGHWAY SYSTEM OR APPALACHIAN LOCAL ACCESS ROAD CONTRACTS

This provision is applicable to all Federal-aid projects funded under the Appalachian Regional Development Act of 1965.

1. During the performance of this contract, the contractor undertaking to do work which is, or reasonably may be, done as on-site work, shall give preference to qualified persons who regularly reside in the labor area as designated by the DOL wherein the contract work is situated, or the subregion, or the Appalachian counties of the State wherein the contract work is situated, except:

a. To the extent that qualified persons regularly residing in the area are not available.

b. For the reasonable needs of the contractor to employ supervisory or specially experienced personnel necessary to assure an efficient execution of the contract work.

c. For the obligation of the contractor to offer employment to present or former employees as the result of a lawful collective bargaining contract, provided that the number of nonresident persons employed under this subparagraph (1c) shall not exceed 20 percent of the total number of employees employed by the contractor on the contract work, except as provided in subparagraph (4) below.

2. The contractor shall place a job order with the State Employment Service indicating (a) the classifications of the laborers, mechanics and other employees required to perform the contract work, (b) the number of employees required in each classification, (c) the date on which the participant estimates such employees will be required, and (d) any other pertinent information required by the State Employment Service to complete the job order form. The job order may be placed with the State Employment Service in writing or by telephone. If during the course of the contract work, the information submitted by the contractor in the original job order is substantially modified, the participant shall promptly notify the State Employment Service.

3. The contractor shall give full consideration to all qualified job applicants referred to him by the State Employment Service. The contractor is not required to grant employment to any job applicants who, in his opinion, are not qualified to perform the classification of work required.

4. If, within one week following the placing of a job order by the contractor with the State Employment Service, the State Employment Service is unable to refer any qualified job applicants to the contractor, or less than the number requested, the State Employment Service will forward a certificate to the contractor indicating the unavailability of applicants. Such certificate shall be made a part of the contractor's permanent project records. Upon receipt of this certificate, the contractor may employ persons who do not normally reside in the labor area to fill positions covered by the certificate, notwithstanding the provisions of subparagraph (1c) above.

5. The provisions of 23 CFR 633.207(e) allow the contracting agency to provide a contractual preference for the use of mineral resource materials native to the Appalachian region.

6. The contractor shall include the provisions of Sections 1 through 4 of this Attachment A in every subcontract for work which is, or reasonably may be, done as on-site work.

Small Business Enterprise (SBE) Program
Commitment Agreement Form

This commitment is subject to the award and receipt of a signed contract from the Texas Department of Transportation for the subject project.

Project #:	**County:**	**Contract-CSJ:**

Items of work to be performed* (attach a list of work items if more room is required):

Bid Item #	Item Description	Unit of Measure	Unit Price	Quantity	Total Per Item
			$		$
			$		$
			$		$
			$		$
			$		$
			$		$
			$		$
			$		$
			$		$
		Total Commitment Amount			$0.00

IMPORTANT! The signatures of the prime contractor and the SBE, and the total commitment amount must always be on the same page.

Prime Contractor:	Name/Title (please print):
Address:	Signature:
Phone: Fax:	
E-mail:	Date:
SBE:	Name/Title (please print):
Vendor No.:	
Address:	Signature:
Phone: Fax:	
E-mail:	Date:
Subcontractor, if the SBE will be a second tier sub. Subcontractor:	Name/Title (please print):
Address:	Signature:
Phone: Fax:	
E-mail:	Date:

The Texas Department of Transportation maintains the information collected through this form. With few exceptions, you are entitled on request, to be informed about the information that is collected about you. Under §552.021 and 552.023 of the Texas Government code, you also are entitled to receive and review the information. Under §559.004 of the Government Code, you are also entitled to have us correct information about you that is incorrect.

To ensure prompt and efficient handling of your project file we are requesting that all commitments be presented to the Business Opportunity Programs Office, using this basic format.

Texas Department of Transportation

Form 2229
(7/2007)

Significant Project Procedures

Control: 0912-71-739 **County:** Harris **Highway:** Greens Road

A Significant Project is any project which meets all of the following:

- **On an interstate or other controlled access facility**
- **Lies within a designated Transportation Management Area (urbanized area with a population of over 200,000 individuals)**
- **Has intermediate-term or long-term stationary lane closures as described in Part 6 of the TMUTCD**

Or which meets all of the following:

- **On any highway (IH, US, SH, FM, etc.) having an ADT of more than 20,000 (as per most current TxDOT traffic maps)**
- **Has long-term lane closures as described in Part 6 of the TMUTCD**

Projects meeting the definition of a Significant Project require a Transportation Management Plan (TMP) consisting of a temporary Traffic Control Plan (TCP) as well as Transportation Operations (TO) strategies and Public Information (PI) strategies. Check one.

☐ Project meets the criteria for a Significant Project (TMP includes TCP, TO and PI strategies)

☒ Project does not meet the criteria for a Significant Project (TMP includes TCP only)

☐ Project does not meet Significant Project criteria (TMP includes TCP and some TO or PI strategies)

☐ Project does not meet Significant Project criteria but District elects to treat it as a Significant Project due to other factors (TMP includes TCP, TO and PI strategies)

Traffic Control Plan strategies included in this plan set. Check all that apply.

☒ Construction phasing/staging
☒ Lane shifts or closures
☒ Two-way traffic on one side of divided highway
☐ Ramp closures/relocations
☐ Work hour restriction
☐ Off site detours/alternate routes
☐ Full road closures
☒ One-lane two-way operation
☐ Reversible lanes
☐ Night/weekend work
☒ Business access improvements/coordination
☐ Accelerated construction procedures
☐ Innovative construction techniques (precast or rapid cure materials)
☐ Other (please specify):

CSJ: 0912-71-739
County: Harris
Highway: Greens Road

Transportation Operations strategies included in this plan set. Check all that apply.

- ☐ Signal timing/coordination improvements
- ☒ Street/intersection improvements
- ☐ Turn/parking restrictions
- ☐ Truck lanes
- ☐ Ramp closures
- ☐ Coordination w/adjacent construction
- ☒ Temporary or movable traffic barriers
- ☐ Crash cushions
- ☐ Intrusion alarms
- ☐ Review by District Safety Review Team
- ☐ Safety Awards Incentives
- ☐ Transportation Management Center
- ☐ Towing/service patrol
- ☐ Police presence/enforcement
- ☐ Speed trailers or fixed radar units
- ☐ Temporary signals (fixed or portable)
- ☐ Bus turnouts
- ☐ Truck/heavy vehicle restrictions
- ☐ Reversible lanes
- ☐ Railroad crossing controls
- ☒ Construction Speed Zone
- ☐ Shadow vehicles with truck mounted attenuators
- ☐ Temporary rumble strips
- ☒ Warning lights
- ☐ ITS for traffic monitoring/management
- ☐ Surveillance for incidents (video, loop detectors)
- ☐ Incident/emergency response plan
- ☐ Local detour routes
- ☒ Traffic Fines Double
- ☐ Other (please specify):

Public Information strategies included in this plan set. Check all that apply.

- ☐ Coordinate with District PI officer
- ☐ Press releases/media alerts
- ☐ Public Information Centers
- ☐ Planned lane closure Web site
- ☒ Coordination w/schools, businesses
- ☐ Work zone education/safety campaigns
- ☐ Traffic radio
- ☐ Highway Advisory Radio (HAR)
- ☐ Transportation Management Center (TMC)
- ☐ Other (please specify):
- ☒ Brochures/mailers
- ☐ Paid advertisements
- ☐ Telephone hotline
- ☒ Public meetings/hearings
- ☒ Coordination w/emergency services
- ☐ Rideshare promotions
- ☐ Changeable/dynamic message signs
- ☐ Contracted PI services
- ☒ Temporary motorist information signs

SPECIAL PROVISION

000---003

Notice to All Bidders

To report bid rigging activities call:

1-800-424-9071

The U.S. Department of Transportation (DOT) operates the above toll-free "hotline" Monday through Friday, 8:00 a.m. to 5:00 p.m., eastern time. Anyone with knowledge of possible bid rigging, bidder collusion, or other fraudulent activities should use the "hotline" to report such activities.

The "hotline" is part of the DOT's continuing effort to identify and investigate highway construction contract fraud and abuse and is operated under the direction of the DOT Inspector General. All information will be treated confidentially and caller anonymity will be respected.

SPECIAL PROVISION

000---004

Notice of Requirement for Affirmative Action to Ensure Equal Employment Opportunity (Executive Order 11246)

1. **General.** In addition to the affirmative action requirements of the Special Provision titled "Standard Federal Equal Employment Opportunity Construction Contract Specifications" as set forth elsewhere in this proposal, the Bidder's attention is directed to the specific requirements for utilization of minorities and females as set forth below.

2. **Goals.**

   a. Goals for minority and female participation are hereby established in accordance with 41 CFR 60-4.

   b. The goals for minority and female participation expressed in percentage terms for the Contractor's aggregate work force in each trade on all construction work in the covered area, are as follows:

Goals for minority participation in each trade (percent)	Goals for female participation in each trade (percent)
See Table 1	6.9

   c. These goals are applicable to all the Contractor's construction work (whether or not it is Federal or federally assisted) performed in the covered area. If the Contractor performs construction work in a geographical area located outside of the covered area, it shall apply the goals established for such geographical area where the work is actually performed. With regard to this second area, the Contractor also is subject to the goals for both its federally involved and non-federally involved construction. The Contractor's compliance with the Executive Order and the regulations in 41 CFR Part 60-4 shall be based on its implementation of the Standard Federal Equal Employment Opportunity Construction Contract Specifications Special Provision and its efforts to meet the goals. The hours of minority and female employment and training must be substantially uniform throughout the length of the contract, and in each trade, and the Contractor shall make a good faith effort to employ minorities and women evenly on each of its projects. The transfer of minority and female employees or trainees from Contractor to Contractor or from project to project for the sole purpose of meeting the Contractor's goals shall be a violation of the contract, the Executive Order and the regulations in 41 CFR Part 60-4. Compliance with the goals will be measured against the total work hours performed.

d. A contractor or subcontractor will be considered in compliance with these provisions by participation in the Texas Highway-Heavy Branch, AGC, Statewide Training and Affirmative Action Plan. Provided that each contractor or subcontractor participating in this plan must individually comply with the equal opportunity clause set forth in 41 CFR 60-1.4 and must make a good faith effort to achieve the goals set forth for each participating trade in the plan in which it has employees. The overall good performance of other contractors and subcontractors toward a goal in an approved plan does not excuse any covered contractor's or subcontractor's failure to make good faith efforts to achieve the goals contained in these provisions. Contractors or subcontractors participating in the plan must be able to demonstrate their participation and document their compliance with the provisions of this Plan.

3. **Subcontracting.** The Contractor shall provide written notification to the Department within 10 working days of award of any construction subcontract in excess of $10,000 at any tier for construction work under the contract resulting from this solicitation pending concurrence of the Department in the award. The notification shall list the names, address and telephone number of the subcontractor; employer identification number; estimated dollar amount of the subcontract; estimated starting and completion dates of the subcontract; and the geographical area in which the contract is to be performed.

4. **Covered Area.** As used in this special provision, and in the contract resulting from this solicitation, the geographical area covered by these goals for female participation is the State of Texas. The geographical area covered by these goals for other minorities are the counties in the State of Texas as indicated in Table 1.

5. **Reports.** The Contractor is hereby notified that he may be subject to the Office of Federal Contract Compliance Programs (OFCCP) reporting and record keeping requirements as provided for under Executive Order 11246 as amended. OFCCP will provide direct notice to the Contractor as to the specific reporting requirements that he will be expected to fulfill.

Table 1

County	Goals for Minority Participation	County	Goals for Minority Participation
Anderson	22.5	Concho	20.0
Andrews	18.9	Cooke	17.2
Angelina	22.5	Coryell	16.4
Aransas	44.2	Cottle	11.0
Archer	11.0	Crane	18.9
Armstrong	11.0	Crockett	20.0
Atascosa	49.4	Crosby	19.5
Austin	27.4	Culberson	49.0
Bailey	19.5	Dallam	11.0
Bandera	49.4	Dallas	18.2
Bastrop	24.2	Dawson	19.5
Baylor	11.0	Deaf Smith	11.0
Bee	44.2	Delta	17.2
Bell	16.4	Denton	18.2
Bexar	47.8	DeWitt	27.4
Blanco	24.2	Dickens	19.5
Borden	19.5	Dimmit	49.4
Bosque	18.6	Donley	11.0
Bowie	19.7	Duval	44.2
Brazoria	27.3	Eastland	10.9
Brazos	23.7	Ector	15.1
Brewster	49.0	Edwards	49.4
Briscoe	11.0	Ellis	18.2
Brooks	44.2	El Paso	57.8
Brown	10.9	Erath	17.2
Burleson	27.4	Falls	18.6
Burnet	24.2	Fannin	17.2
Caldwell	24.2	Fayette	27.4
Calhoun	27.4	Fisher	10.9
Callahan	11.6	Floyd	19.5
Cameron	71.0	Foard	11.0
Camp	20.2	Fort Bend	27.3
Carson	11.0	Franklin	17.2
Cass	20.2	Freestone	18.6
Castro	11.0	Frio	49.4
Chambers	27.4	Gaines	19.5
Cherokee	22.5	Galveston	28.9
Childress	11.0	Garza	19.5
Clay	12.4	Gillespie	49.4
Cochran	19.5	Glasscock	18.9
Coke	20.0	Goliad	27.4
Coleman	10.9	Gonzales	49.4
Collin	18.2	Gray	11.0
Collingsworth	11.0	Grayson	9.4
Colorado	27.4	Gregg	22.8
Comal	47.8	Grimes	27.4
Comanche	10.9	Guadalupe	47.8

County	Goals for Minority Participation	County	Goals for Minority Participation
Hale	19.5	Lavaca	27.4
Hall	11.0	Lee	24.2
Hamilton	18.6	Leon	27.4
Hansford	11.0	Liberty	27.3
Hardeman	11.0	Limestone	18.6
Hardin	22.6	Lipscomb	11.0
Harris	27.3	Live Oak	44.2
Harrison	22.8	Llano	24.2
Hartley	11.0	Loving	18.9
Haskell	10.9	Lubbock	19.6
Hays	24.1	Lynn	19.5
Hemphill	11.0	Madison	27.4
Henderson	22.5	Marion	22.5
Hidalgo	72.8	Martin	18.9
Hill	18.6	Mason	20.0
Hockley	19.5	Matagorda	27.4
Hood	18.2	Maverick	49.4
Hopkins	17.2	McCulloch	20.0
Houston	22.5	McLennan	20.7
Howard	18.9	McMullen	49.4
Hudspeth	49.0	Medina	49.4
Hunt	17.2	Menard	20.0
Hutchinson	11.0	Midland	19.1
Irion	20.0	Milam	18.6
Jack	17.2	Mills	18.6
Jackson	27.4	Mitchell	10.9
Jasper	22.6	Montague	17.2
Jeff Davis	49.0	Montgomery	27.3
Jefferson	22.6	Moore	11.0
Jim Hogg	49.4	Morris	20.2
Jim Wells	44.2	Motley	19.5
Johnson	18.2	Nacogdoches	22.5
Jones	11.6	Navarro	17.2
Karnes	49.4	Newton	22.6
Kaufman	18.2	Nolan	10.9
Kendall	49.4	Nueces	41.7
Kenedy	44.2	Ochiltree	11.0
Kent	10.9	Oldham	11.0
Kerr	49.4	Orange	22.6
Kimble	20.0	Palo Pinto	17.2
King	19.5	Panola	22.5
Kinney	49.4	Parker	18.2
Kleberg	44.2	Parmer	11.0
Knox	10.9	Pecos	18.9
Lamar	20.2	Polk	27.4
Lamb	19.5	Potter	9.3
Lampasas	18.6	Presidio	49.0
LaSalle	49.4	Rains	17.2

County	Goals for Minority Participation	County	Goals for Minority Participation
Randall	9.3	Webb	87.3
Reagan	20.0	Wharton	27.4
Real	49.4	Wheeler	11.0
Red River	20.2	Wichita	12.4
Reeves	18.9	Wilbarger	11.0
Refugio	44.2	Willacy	72.9
Roberts	11.0	Williamson	24.1
Robertson	27.4	Wilson	49.4
Rockwall	18.2	Winkler	18.9
Runnels	20.0	Wise	18.2
Rusk	22.5	Wood	22.5
Sabine	22.6	Yoakum	19.5
San Augustine	22.5	Young	11.0
San Jacinto	27.4	Zapata	49.4
San Patricio	41.7	Zavala	49.4
San Saba	20.0		
Schleicher	20.0		
Scurry	10.9		
Shackelford	10.9		
Shelby	22.5		
Sherman	11.0		
Smith	23.5		
Somervell	17.2		
Starr	72.9		
Stephens	10.9		
Sterling	20.0		
Stonewall	10.9		
Sutton	20.0		
Swisher	11.0		
Tarrant	18.2		
Taylor	11.6		
Terrell	20.0		
Terry	19.5		
Throckmorton	10.9		
Titus	20.2		
Tom Green	19.2		
Travis	24.1		
Trinity	27.4		
Tyler	22.6		
Upshur	22.5		
Upton	18.9		
Uvalde	49.4		
Val Verde	49.4		
Van Zandt	17.2		
Victoria	27.4		
Walker	27.4		
Waller	27.3		
Ward	18.9		
Washington	27.4		

SPECIAL PROVISION

000---006

Standard Federal Equal Employment Opportunity Construction Contract Specifications (Executive Order 11246)

1. As used in these specifications:

a. "Covered area" means the geographical area described in the solicitation from which this contract resulted;

b. "Director" means Director, Office of Federal Contract Compliance Programs, United States Department of Labor, or any person to whom the Director delegates authority;

c. "Employer identification number" means the Federal Social Security number used on the Employer's Quarterly Federal Tax Return, U.S. Treasury Department Form 941.

d. "Minority" includes:

(i) Black (all persons having origins in any of the Black African racial groups not of Hispanic origin);

(ii) Hispanic (all persons of Mexican, Puerto Rican, Cuban, Central or South American or other Spanish Culture or origin, regardless of race);

(iii) Asian and Pacific Islander (all persons having origins in any of the original peoples of the Far East, Southeast Asia, the Indian Subcontinent, or the Pacific Islands); and

(iv) American Indian or Alaskan Native (all persons having origins in any of the original peoples of North American and maintaining identifiable tribal affiliations through membership and participation or community identification).

2. Whenever the Contractor, or any Subcontractor at any tier, subcontracts a portion of the work involving any construction trade, it shall physically include in each subcontract in excess of $10,000 the provisions of these specifications and the Notice which contains the applicable goals for minority and female participation and which is set forth in the solicitations from which this contract resulted.

3. If the Contractor is participating (pursuant to 41 CFR 60-4.5) in a Hometown Plan approved by the U. S. Department of Labor in the covered area either individually or through an association, its affirmative action obligations on all work in the Plan area (including goals and timetables) shall be in accordance with that plan for those trades which have unions participating in the Plan. Contractors must be able to demonstrate their participation in and compliance with the provisions of any such Hometown Plan. Each Contractor or Subcontractor participating in an approved Plan is individually required to comply with its

obligations under the EEO clause, and to make a good faith effort to achieve each goal under the Plan in each trade in which it has employees. The overall good faith performance by other Contractors or Subcontractors toward a goal in an approved Plan does not excuse any covered Contractor's or Subcontractor's failure to take good faith efforts to achieve the Plan goals and timetables.

4. The Contractor shall implement the specific affirmative action standards provided in paragraphs 7a through p of these specifications. The goals set forth in the solicitation from which this contract resulted are expressed as percentages of the total hours of employment and training of minority and female utilization the Contractor should reasonably be able to achieve in each construction trade in which it has employees in the covered area. Covered construction contractors performing contracts in geographical areas where they do not have a Federal or federally assisted construction contract shall apply the minority and female goals established for the geographical area where the contract is being performed. Goals are published periodically in the Federal Register in notice form and such notices may be obtained from any Office of Federal Contract Compliance Programs office or any Federal procurement contracting officer. The Contractor is expected to make substantially uniform progress toward its goals in each craft during the period specified.

5. Neither the provisions of any collective bargaining agreement, nor the failure by a union with whom the Contractor has a collective bargaining agreement, to refer either minorities or women shall excuse the Contractor's obligations under these specifications, Executive Order 11246, or the regulations promulgated pursuant thereto.

6. In order for the nonworking training hours of apprentices and trainees to be counted in meeting the goals, such apprentices and trainees must be employed by the Contractor during the training period, and the Contractor must have made a commitment to employ the apprentices and trainees at the completion of their training, subject to the availability of employment opportunities. Trainees must be trained pursuant to training programs approved by the U. S. Department of Labor.

7. The Contractor shall take specific affirmative actions to ensure equal employment opportunity. The evaluation of the Contractor's compliance with these specifications shall be based upon its effort to achieve maximum results from its actions. The Contractor shall document these efforts fully, and shall implement affirmative action steps at least as extensive as the following:

   a. Ensure and maintain a working environment free of harassment, intimidation, and coercion at all sites, and in all facilities at which the Contractor's employees are assigned to work. The Contractor, where possible, will assign two or more women to each construction project. The Contractor shall specifically ensure that all foremen, superintendents, and other on-site supervisory personnel are aware of and carry out the Contractor's obligation to maintain such a working environment, with specific attention to minority or female individuals working at such sites or in such facilities.

   b. Establish and maintain a current list of minority and female recruitment sources, provide written notification to minority and female recruitment sources and to community organizations when the Contractor or its unions have employment opportunities available, and maintain a record of the organizations' responses.

c. Maintain a current file of the names, addresses and telephone numbers of each minority and female off-the-street applicant and minority or female referral from a union, a recruitment source or community organization and of what action was taken with respect to each such individual. If such individual was sent to the union hiring hall for referral and was not referred back to the Contractor by the union or, if referred, not employed by the Contractor, this shall be documented in the file with the reason therefor, along with whatever additional actions the Contractor may have taken.

d. Provide immediate written notification to the Director when the union or unions with which the Contractor has a collective bargaining agreement has not referred to the Contractor a minority person or woman sent by the Contractor, or when the Contractor has other information that the union referral Process has impeded the Contractor's efforts to meet its obligations.

e. Develop on-the-job training opportunities and/or participate in training programs for the area which expressly include minorities and women, including upgrading programs and apprenticeship and trainee programs relevant to the Contractor's employment needs, especially those programs funded or approved by the Department of Labor. The Contractor shall provide notice of these programs to the sources compiled under 7b above.

f. Disseminate the Contractor's EEO policy by providing notice of the policy to unions and training programs and requesting their cooperation in assisting the Contractor in meeting its EEO obligations; by including it in any policy manual and Collective bargaining agreement; by publicizing it in the company newspaper, annual report, etc.; by specific review of the policy with all management personnel and with all minority and female employees at least once a year; and by posting the company EEO policy on bulletin boards accessible to all employees at each location where construction work is performed.

g. Review, at least annually, the company's EEO policy and affirmative action obligations under these specifications with all employees having any responsibility for hiring, assignment, layoff, termination or other employment decisions including specific review of these items with onsite supervisory personnel such as Superintendents, General Foremen, etc., prior to the initiation of construction work at any job site. A written record shall be made and maintained identifying the time and place of these meetings, persons attending, subject matter discussed, and disposition of the subject matter.

h. Disseminate the Contractor's EEO policy externally by including it in any advertising in the news media, specifically including minority and female news media, and providing written notification to and discussing the Contractor's EEO policy with other Contractors and Subcontractors with whom the Contractor does or anticipates doing business.

i. Direct its recruitment efforts, both oral and written, to minority, female and community organizations, to schools with minority and female students and to minority and female recruitment and training organizations serving the Contractor's recruitment area and employment needs. Not later than one month prior to the date for the acceptance of

applications for apprenticeship or other training by any recruitment source, the Contractor shall send written notification to organizations such as the above, describing the openings, screening procedures, and tests to be used in the selection process.

j. Encourage present minority and female employees to recruit other minority persons and women and, where reasonable, provide after school, summer and vacation employment to minority and female youth both on the site and in other areas of a Contractor's workforce.

k. Validate all tests and other selection requirements where there is an obligation to do so under 41 CFR Part 60-3.

l. Conduct, at least annually, an inventory and evaluation at least of all minority and female personnel for promotional opportunities and encourage these employees to seek or to prepare for, through appropriate training, etc., such opportunities.

m. Ensure that seniority practices, job classifications, work assignments and other personnel practices, do not have a discriminatory effect by continually monitoring all personnel and employment related activities to ensure that the EEO policy and the Contractor's obligations under these specifications are being carried out.

n. Ensure that all facilities and company activities are non-segregated except that separate or single-user toilet and necessary changing facilities shall be provided to assure privacy between the sexes.

o. Document and maintain a record of all solicitations of offers for subcontracts from minority and female construction contractors and suppliers, including circulation of solicitations to minority and female contractor associations and other business associations.

p. Conduct a review, at least annually, of all supervisors' adherence to and performance under the Contractor's EEO policies and affirmative action obligations.

8. Contractors are encouraged to participate in voluntary associations which assist in fulfilling one or more of their affirmative action obligations (7a through p). The efforts of a contractor association, joint contractor-union, contractor-community, or other similar group of which the contractor is a member and participant, may be asserted as fulfilling any one or more of its obligations under 7a through p of these Specifications provided that the contractor actively participates in the group, makes every effort to assure that the group has a positive impact on the employment of minorities and women in the industry, ensures that the concrete benefits of the program are reflected in the Contractor's minority and female workforce participation, makes a good faith effort to meet its individual goals and timetables, and can provide access to documentation which demonstrates the effectiveness of actions taken on behalf of the Contractor. The obligation to comply, however, is the Contractor's and failure of such a group to fulfill an obligation shall not be a defense for the Contractor's noncompliance.

9. A single goal for minorities and a separate single goal for women have been established. The Contractor, however, is required to provide equal employment opportunity and to take affirmative action for all minority groups, both male and female, and all women, both

minority and non-minority. Consequently, the Contractor may be in violation of the Executive Order if a particular group is employed in a substantially disparate manner (for example, even though the Contractor has achieved its goals for women generally, the Contractor may be in violation of the Executive Order if a specific minority group of women is underutilized).

10. Nondiscrimination programs require that Federal-aid recipients, subrecipients, and contractors prevent discrimination and ensure nondiscrimination in all of their programs and activities, whether those programs and activities are federally funded or not. The factors prohibited from serving as a basis for action or inaction which discriminates include race, color, national origin, sex, age, and handicap/disability. The efforts to prevent discrimination must address, but not be limited to a program's impacts, access, benefits, participation, treatment, services, contracting opportunities, training opportunities, investigations of complaints, allocations of funds, prioritization of projects, and the functions of right-of-way, research, planning, and design.

11. The Contractor shall not enter into any Subcontract with any person or firm debarred from Government contracts pursuant to Executive Order 11246.

12. The Contractor shall carry out such sanctions and penalties for violation of these specifications and of the Equal Opportunity Clause, including suspension, termination and cancellation of existing subcontracts as may be imposed or ordered pursuant to Executive Order 11246, as amended, and its implementing regulations, by the Office of Federal Contract Compliance Programs. Any contractor who fails to carry out such sanctions and penalties shall be in violation of these specifications and Executive Order 11246, as amended.

13. The Contractor, in fulfilling its obligations under these specifications, shall implement specific affirmative action steps, at least as extensive as those standards prescribed in paragraph 7 of these specifications, so as to achieve maximum results from its efforts to ensure equal employment opportunity. If the Contractor fails to comply with the requirements of the Executive Order, the implementing regulations, or these specifications, the Director shall proceed in accordance with 41 CFR 60-4.8.

14. The Contractor shall designate a responsible official to monitor all employment related activity to ensure that the company EEO policy is being carried out, to submit reports relating to the provisions hereof as may be required by the Government and to keep records. Records shall at least include for each employee the name, address, telephone numbers, construction trade, union affiliation if any, employee identification number when assigned, social security number, race, sex, status (e.g., mechanic, apprentice, trainee, helper, or laborer), dates of changes in status, hours worked per week in the indicated trade, rate of pay, and locations at which the work was performed. Records shall be maintained in an easily understandable and retrievable form; however, to the degree that existing records satisfy this requirement, contractors shall not be required to maintain separate records.

15. Nothing herein provided shall be construed as a limitation upon the application of other laws which establish different standards of compliance or upon the application of requirements for the hiring of local or other area residents (e.g., those under the Public Works Employment Act of 1977 and the Community Development Block Grant Program).

16. In addition to the reporting requirements set forth elsewhere in this contract, the Contractor and the subcontractors holding subcontracts, not including material suppliers, of $10,000 or more, shall submit for every month of July during which work is per-formed, employment data as contained under Form PR 1391 (Appendix C to 23 CFR, Part 230), and in accordance with the instructions included thereon.

SPECIAL PROVISION

000---009

Certification of Nondiscrimination in Employment

By signing this proposal, the bidder certifies that he has participated in a previous contract or subcontract subject to the equal opportunity clause, as required by Executive Orders 10925, 11114, or 11246, or if he has not participated in a previous contract of this type, or if he has had previous contract or subcontracts and has not filed, he will file with the Joint Reporting Committee, the Director of the Office of Federal Contract Compliance, a Federal Government contracting or administering agency, or the former President's Committee on Equal Employment Opportunity, all reports due under the applicable filing requirements.

Note: The above certification is required by the Equal Employment Opportunity Regulations of the Secretary of Labor (41 CFR 60-1.7(b)(1)), and must be submitted by bidders and proposed subcontractors only in connection with contracts and subcontracts which are subject to the equal opportunity clause. Contracts and subcontracts which are exempt from the equal opportunity clause are set forth in 41 CFR 60-1.5. (Generally only contracts or subcontracts of $10,000 or under are exempt.)

Currently, Standard Form 100 (EEO-1) is the only report required by the Executive Orders or their implementing regulations.

Proposed prime contractors and subcontractors who have participated in a previous contract or subcontract subject to the Executive Orders and have not filed the required reports should note that 41 CFR 60-1.7(b)(1) prevents the award of contracts and subcontracts unless such contractor submits a report covering the delinquent period or such other period specified by the Federal Highway Administration or by the Director, Office of Federal Contract Compliance, U. S. Department of Labor.

SPECIAL PROVISION

000--1483

Notice of Changes to U.S. Department of Labor Required Payroll Information

Do not include employee addresses and social security numbers on the payroll submissions to the department. In lieu of the social security number, include an individually identifying number for each employee (Example: last four digits of the individual's social security number).

Maintain the full social security number and current address of each covered employee in files for 3 years after project completion and make the information available upon the Department's request.

Form FHWA 1273 and optional form WH-347 will be revised in the future to reflect these changes.

SPECIAL PROVISION
000--1676
On-the-Job Training Program

1. **Description.** The primary objective of this Special Provision is the training and advancement of minorities, women and economically disadvantaged persons toward journeyworker status. Accordingly, make every effort to enroll minority, women and economically disadvantaged persons to the extent that such persons are available within a reasonable area of recruitment. This training commitment is not intended, and shall not be used to discriminate against any applicant for training, whether or not he/she is a member of a minority group.

2. **Trainee Assignment.** Training assignments are determined based on the past contract volume of federal-aid work performed with the Department. Contractors meeting the selection criteria will be notified of their training assignment at the beginning of the reporting year by the Department's Office of Civil Rights.

3. **Program Requirements.** Fulfill all of the requirements of the On-the-Job Training Program including the maintenance of records and submittal of periodic reports documenting program performance. Trainees shall be paid at least 60% of the appropriate minimum journeyworker's rate specified in the contract for the first half of the training period, 75% for the third quarter and 90% for the last quarter, respectively. Contractors may be reimbursed $0.80 per training hour at no additional cost to the Department.

4. **Compliance.** The Contractor will have fulfilled the contractual responsibilities by having provided acceptable training to the number of trainees specified in their goal assignment. Noncompliance may be cause for corrective and appropriate measures pursuant to Article 8.6., "Abandonment of Work or Default of Contract," which may be used to comply with the sanctions for noncompliance pursuant to 23 CFR Part 230.

SPECIAL PROVISION

000--1966

Disadvantaged Business Enterprise in Federal Aid Contracts

1. **Description.** The purpose of this Special Provision is to carry out the U. S. Department of Transportation's (DOT) policy of ensuring nondiscrimination in the award and administration of DOT assisted contracts and creating a level playing field on which firms owned and controlled by individuals who are determined to be socially and economically disadvantaged can compete fairly for DOT assisted contracts. If the Disadvantaged Business Enterprise (DBE) goal is greater than zero, Article A, "Disadvantaged Business Enterprise in Federal Aid Contracts", of this Special Provision shall apply to this contract. If there is no DBE goal, Article B, "Race-Neutral DBE Participation", of this Special Provision shall apply to this contract. The percentage goal for DBE participation in the work to be performed under this contract will be shown on the proposal.

A. Article A. Disadvantaged Business Enterprise in Federal Aid Contracts.

1. **Policy**. It is the policy of the DOT and the Texas Department of Transportation (henceforth the "Department") that DBEs, as defined in 49 CFR Part 26, Subpart A and the Department's DBE Program, shall have the opportunity to participate in the performance of contracts financed in whole or in part with Federal funds. The DBE requirements of 49 CFR Part 26, and the Department's DBE Program, apply to this contract as follows:

   a. The Contractor will solicit DBEs through reasonable and available means, as defined in 49 CFR Part 26, Appendix A and the Department's DBE Program, or show a good faith effort to meet the DBE goal for this contract.

   b. The Contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate.

   c. The requirements of this Special Provision shall be physically included in any subcontract.

   d. By signing the contract proposal, the Bidder is certifying that the DBE goal as stated in the proposal will be met by obtaining commitments from eligible DBEs or that the Bidder will provide acceptable evidence of good faith effort to meet the commitment. The Department will determine the adequacy of a Contractor's efforts to meet the contract goal, within 10 business days,

excluding national holidays, from receipt of the information outlined in this Special Provision under Section 1.A.3, "Contractor's Responsibilities." If the requirements of Section 1.A.3 are met, the conditional situation will be removed and the contract will be forwarded to the Contractor for execution.

2. **Definitions.**

a. "Broker" is an intermediary or middleman that does not take possession of a commodity or act as a regular dealer selling to the public.

b. "Disadvantaged Business Enterprise" or "DBE" is defined in the standard specifications, Article 1, Definition of Terms.

c. "DBE Joint Venture" means an association of a DBE firm and 1 or more other firm(s) to carry out a single business enterprise for profit for which purpose they combine their property, capital, efforts, skills and knowledge, and in which the DBE is responsible for a distinct, clearly defined portion of the work of the contract and whose share in the capital contribution, control, management, risks, and profits of the joint venture are commensurate with its ownership interest.

d. "DOT" means the U.S. Department of Transportation, including the Office of the Secretary, the Federal Highway Administration (FHWA), the Federal Transit Administration (FTA), and the Federal Aviation Administration (FAA).

e. "Federal Aid Contract" is any contract between the Texas Department of Transportation and a Contractor which is paid for in whole or in part with DOT financial assistance.

f. "Good Faith Effort" means efforts to achieve a DBE goal or other requirement of this Special Provision which, by their scope, intensity, and appropriateness to the objective, can reasonably be expected to fulfill the program requirement.

g. "Manufacturer" is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the contract and of the general character described by the specifications."

h. "Race-conscious" means a measure or program that is focused specifically on assisting only DBEs, including women-owned businesses.

i. "Race-neutral DBE Participation" means any participation by a DBE through customary competitive procurement procedures.

j. "Regular Dealer" is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business. To be a regular dealer, the firm must be an established, regular business that engages in, as its principal business and under its own name, the purchase and sale or lease of the products in question.

A regular dealer in such bulk items as steel, cement, gravel, stone, and petroleum products need not keep such products in stock if it owns and operates distribution equipment for the products. Any supplementing of regular dealers own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis. Brokers, packagers, manufacturers' representatives, or other persons who arrange or expedite transactions shall not be regarded as a regular dealer.

k. "Texas Unified Certification Program" or "TUCP" provides one-stop shopping to applicants for certification, such that applicants are required to apply only once for a DBE certification that will be honored by all recipients of federal funds in the state. The TUCP by Memorandum of Agreement established six member entities to serve as certifying agents for Texas in specified regions.

3. **Contractor's Responsibilities**. These requirements must be satisfied by the Contractor.

a. After conditional award of the contract, the Contractor shall submit a completed Form SMS.4901 "DBE Commitment Agreement", From SMS 4901-T "DBE Trucking Commitment Agreement", or Form SMS.4901-MS "DBE Material & Supplier Commitment Agreement" for each DBE he/she intends to use to satisfy the DBE goal or a good faith effort to explain why the goal could not be reached, so as to arrive in the Department's Office of Civil Rights (OCR) in Austin, Texas not later than 5:00 p.m. on the 10th business day, excluding national holidays, after the conditional award of the contract. When requested, additional time, not to exceed 7 business days, excluding national holidays, may be granted based on documentation submitted by the Contractor.

b. DBE prime Contractors may receive credit toward the DBE goal for work performed by his/her own forces and work subcontracted to DBEs. A DBE prime must make a good faith effort to meet the goals. In the event a DBE prime subcontracts to a non-DBE, that information must be reported on Form SMS.4902.

c. A Contractor who cannot meet the contract goal, in whole or in part, shall make adequate good faith efforts to obtain DBE participation as so stated and defined in 49 CFR Part 26, Appendix A. The following is a list of the types of action that may be considered as good faith efforts. It is not intended to be a mandatory checklist, nor is it intended to be exclusive or exhaustive. Other factors or types of efforts may be relevant in appropriate cases.

- Soliciting through all reasonable and available means (e.g. attendance at prebid meetings, advertising, and/or written notices) the interest of all certified DBEs who have the capability to perform the work of the contract. The solicitation must be done within sufficient time to allow the DBEs to respond to it. Appropriate steps must be taken to follow up initial solicitations to determine, with certainty, if the DBEs are interested.

- Selecting portions of the work to be performed by DBEs in order to increase the likelihood that the DBE goals will be achieved. This includes, where appropriate, breaking out contract work items into economically feasible units to facilitate DBE participation, even when the Contractor might otherwise prefer to perform the work items with its own forces.
- Providing interested DBEs with adequate information about the plans, specifications, and requirements of the contract in a timely manner to assist them in responding to a solicitation.
- Negotiating in good faith with interested DBEs to make a portion of the work available to DBE subcontractors and suppliers and select those portions of the work or material needs consistent with the available DBE subcontractors and suppliers, so as to facilitate DBE participation. Evidence of such negotiations includes the names, addresses, and telephone numbers of DBEs that were considered; a description of the information provided regarding the plans and specifications for the work selected for subcontracting; and evidence as to why additional agreements could not be reached for DBEs to perform the work.
- A Bidder using good business judgment would consider a number of factors in negotiating with subcontractors, including DBE subcontractors, and would take a firm price and capabilities as well as contract goals into consideration. However, the fact that there may be some additional cost involved in finding and using DBEs is not in itself sufficient reason for a bidders failure to meet the Contract DBE goal as long as such cost are reasonable. Also, the ability or desire of the Contractor to perform the work of the Contract with its own organization does not relieve the Bidder of the responsibility to make good faith effort. Contractors are not, however, required to accept higher quotes from DBEs if the price difference is excessive or unreasonable.
- Not rejecting DBEs as being unqualified without sound reasons based on a thorough investigation of their capabilities. The Contractor's standing within its industry, membership in specific groups, organizations, or associations and political or social affiliations (for example union vs. non-union employee status) are not legitimate cause for the rejection or non-solicitation of bids and the Contractors efforts to meet the project goal.
- Making efforts to assist interested DBEs in obtaining bonding, lines of credit, or insurance as required by the recipient or Contractor.
- Making efforts to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services.
- Effectively using the services of available minority/women community organizations; minority/women Contractors' groups; local, state, and Federal minority/women business assistance offices; and other organizations as allowed on a case-by-case basis to provide assistance in the recruitment and placement of DBEs.

- If the Program Manager of the OCR determines that the Contractor has failed to meet the good faith effort requirements, the Contractor will be given an opportunity for reconsideration by the Director of the OCR.

d. Should the bidder to whom the contract is conditionally awarded refuse, neglect or fail to meet the DBE goal or comply with good faith effort requirements, the proposal guaranty filed with the bid shall become the property of the state, not as a penalty, but as liquidated damages to the Department.

e. The preceding information shall be submitted directly to the Office of Civil Rights, Texas Department of Transportation, 125 E. 11th Street, Austin, Texas 78701-2483.

f. The Contractor shall not terminate for convenience a DBE subcontractor named in the commitment submitted under Section 1.A.3.a, of this Special Provision. Prior to terminating or removing a DBE subcontractor named in the commitment, the Contractor must have a written consent of the Department.

g. The Contractor shall also make a good faith effort to replace a DBE subcontractor that is unable to perform successfully with another DBE, to the extent needed to meet the contract goal. The Contractor shall submit a completed Form 4901 "DBE Commitment Agreement", From SMS 4901-T "DBE Trucking Commitment Agreement", or Form SMS.4901-MS "DBE Material & Supplier Commitment Agreement" for the substitute DBE firm(s). Any substitution of DBEs shall be subject to approval by the Department. Prior to approving the substitution, the Department will request a statement from the DBE concerning it being replaced.

h. The Contractor shall designate a DBE liaison officer who will administer the Contractor's DBE program and who will be responsible for maintenance of records of efforts and contacts made to subcontract with DBEs.

i. Contractors are encouraged to investigate the services offered by banks owned and controlled by disadvantaged individuals and to make use of these banks where feasible.

4. Eligibility of DBEs.

a. The member entities of the TUCP certify the eligibility of DBEs and DBE joint ventures to perform DBE subcontract work on DOT financially assisted contracts.

b. The Department maintains the Texas Unified Certification Program DBE Directory containing the names of firms that have been certified to be eligible to participate as DBE's on DOT financially assisted contracts. This Directory is available from the Department's OCR. An update of the Directory can be found on the Internet at http://www.dot.state.tx.us/business/tucp/default.htm.

c. Only DBE firms certified at the time commitments are submitted are eligible to be used in the information furnished by the Contractor as required under Section 1.A.3.a. and 3.g. above. For purposes of the DBE goal on this project, DBEs will only be allowed to perform work in the categories of work for which they are certified.

d. Only DBE firms certified at the time of execution of a contract/subcontract/purchase order, are eligible for DBE goal participation.

5. **Determination of DBE Participation**. When a DBE participates in a contract, only the values of the work actually performed by the DBE, as referenced below, shall be counted by the prime contractor toward DBE goals:

a. The total amount paid to the DBE for work performed with his/her own forces is counted toward the DBE goal. When a DBE subcontracts part of the work of its contract to another firm, the value of the subcontracted work may be counted toward DBE goals only if the subcontractor is itself a DBE. Work that a DBE subcontracts to a non-DBE firm does not count toward DBE goals.

b. A Contractor may count toward its DBE goal a portion of the total value of the contract amount paid to a DBE joint venture equal to the distinct, clearly defined portion of the work of the contract performed by the DBE.

(1) A Contractor may count toward its DBE goal only expenditures to DBEs that perform a commercially useful function (CUF) in the work of a contract or purchase order. A DBE is considered to perform a CUF when it is responsible for execution of the work of the contract and is carrying out its responsibilities by actually performing, managing, and supervising the work involved. To perform a CUF, the DBE must also be responsible, with respect to materials and supplies used on the contract, for negotiating price, determining quality and quantity, ordering the material, and installing (where applicable) and paying for the material itself.

In accordance with 49 CFR Part 26, Appendix A, guidance concerning Good Faith Efforts, contractors may make efforts to assist interested DBEs in obtaining necessary equipment, supplies, materials, or related assistance or services. Contractors may not however, negotiate the price of materials or supplies used on the contract by the DBE, nor may they determine quality and quantity, order the materials themselves, nor install the materials (where applicable), or pay for the material themselves. Contractors however, may share the quotations they receive from the material supplier with the DBE firm, so that the DBE firm may negotiate a reasonable price with the material supplier.

In all cases, prime or other non-DBE subcontractor assistance will not be credited toward the DBE goal.

(2) A DBE does not perform a CUF if its role is limited to that of an extra participant in a transaction, contract, or project through which funds are passed in order to obtain the appearance of DBE participation.

Consistent with industry practices and the DOT/Department's DBE program, a DBE subcontractor may enter into second-tier subcontracts, amounting up to 70% of their contract. Work subcontracted to a non-DBE does not count towards DBE goals. If a DBE does not perform or exercise responsibility for at least 30% of the total cost of its contract with its own work force, or the DBE subcontracts a greater portion of the work of a contract than would be expected on the basis of normal industry practice for the type of work involved, it will be presumed that the DBE is not performing a CUF

(3) A DBE trucking firm (including an owner operator who is certified as a DBE is considered to be performing a CUF when the DBE is responsible for the management and supervision of the entire trucking operation on a particular contract and the DBE itself owns and operates at least 1 fully licensed, insured, and operational truck used on the contract.

(a) The Contractor receives credit for the total value of the transportation services the DBE provides on a contract using trucks it owns, insures, and operates using drivers it employs.

(b) The DBE may lease trucks from another DBE firm, including an owner operator who is certified as a DBE. The DBE who leases trucks from another DBE receives credit for the total value of the transportation services the lessee DBE provides on the Contract.

(c) The DBE may also lease trucks from a non-DBE firm, including from an owner-operator. The DBE who leases trucks from a non-DBE is entitled to credit for the total value of transportation services provided by non-DBE lessees not to exceed the value of transportation services provided by the DBE-owned trucks on the contract. Additional participation by non-DBE lessees receive credit only for the fee or commission it receives as result of the lease arrangement

(d) A lease must indicate that the DBE has exclusive use of and control over the trucks giving the DBE absolute priority for use of the leased trucks. Leased trucks must display the name and identification number of the DBE.

(4) When a DBE is presumed not to be performing a CUF the DBE may present evidence to rebut this presumption.

(5) Project materials or supplies acquired from an affiliate of the prime contractor can not directly or indirectly (2nd or lower tier subcontractor) be used for DBE goal credit.

c. A Contractor may count toward its DBE goals expenditures for materials and supplies obtained from a DBE manufacturer, provided that the DBE assumes the actual and contractual responsibility for the materials and supplies. Count expenditures with DBEs for materials or supplies toward DBE goals as provided in the following:

(1) If the materials or supplies are obtained from a DBE manufacturer, count 100% of the cost of the materials or supplies toward DBE goals. (Definition of a DBE manufacturer found at 1A.c.(1) of this provision.)

For purposes of this Section (1.A.c.(1)), a manufacturer is a firm that operates or maintains a factory or establishment that produces, on the premises, the materials, supplies, articles, or equipment required under the contract and of the general character described by the specifications.

(2) If the materials or supplies are purchased from a DBE regular dealer, count 60% of the cost of the materials or supplies toward DBE goals.

For purposes of this Section (1.A.5.c.(2)), a regular dealer is a firm that owns, operates, or maintains a store, warehouse, or other establishment in which the materials, supplies, articles or equipment of the general character described by the specifications and required under the contract are bought, kept in stock, and regularly sold or leased to the public in the usual course of business:

(A) To be a regular dealer, the firm must be an established, regular business that engages, as its principal business and under its own name, in the purchase and sale or lease of the products in question.

(B) A person may be a regular dealer in such bulk items as petroleum products, steel, cement, gravel, stone or asphalt without owning, operating, or maintaining a place of business as provided in the first paragraph under Section 1.A.5.c.(2), if the person both owns and operates distribution equipment for the products. Any supplementing of regular dealers' own distribution equipment shall be by a long-term lease agreement and not on an ad hoc or contract-by-contract basis.

(C) Packagers, brokers, manufacturers' representatives, or other persons who arrange or expedite transactions are not regular dealers within the meaning of Section 1.A.5.c.(2).

(3) With respect to materials or supplies purchased from DBE which is neither a manufacturer nor a regular dealer, count the entire amount of fees or commissions charged for assistance in the procurement of the materials and supplies, or fees or transportation charges for the delivery of materials or supplies required on a job site, toward DBE goals, provided you determine the fees to be reasonable and not excessive as compared with fees customarily allowed for similar services.

Do not count any portion of the cost of the materials and supplies themselves toward DBE goals.

(4) Count the entire amount of fees or commissions charged by a DBE firm for providing a bona fide service, such as professional, technical, consultant or managerial services, or for providing bonds or insurance specifically required for the performance of a DOT-assisted contract, toward DBE goals, provided you determine the fee to be reasonable and not excessive as compared with fees customarily allowed for similar services.

d. If the Contractor chooses to assist a DBE firm, other than a manufacturing material supplier or regular dealer, and the DBE firm accepts the assistance, the Contractor may act solely as a guarantor by use of a two-party check for payment of materials to be used on the project by the DBE. The material supplier must invoice the DBE who will present the invoice to the Contractor. The Contractor may issue a joint check to the DBE and the material supplier and the DBE firm must issue the remittance to the material supplier. No funds shall go directly from the Contractor to the material supplier. The DBE firm may accept or reject this joint checking arrangement.

The Contractor must obtain approval from the Department prior to implementing the use of joint check arrangements with the DBE. Submit to the Department, Joint Check Approval Form 2178 for requesting approval. Provide copies of cancelled joint checks upon request. No DBE goal credit will be allowed for the cost of DBE materials that are paid by the Contractor directly to the material supplier.

e. No DBE goal credit will be allowed for supplies and equipment the DBE subcontractor leases from the contractor or its affiliates.

f. No DBE goal credit will be allowed for the period of time determined by the Department that the DBE was not performing a CUF. The denial period of time may occur before or after a determination has been made by the department. In case of the denial of credit for non-performance of a CUF of a DBE, the Contractor will be required to provide a substitute DBE to meet the contract goal or provide an adequate good faith effort when applicable.

6. Records and Reports.

a. The Contractor shall submit monthly reports, after work begins, on DBE payments to meet the DBE goal and for DBE or HUB race-neutral participation. Report payments made to non-DBE HUBs. The monthly report is to be sent to the Area Engineer. These reports will be due within 15 days after the end of a calendar month. These reports will be required until all DBE subcontracting or material supply activity is completed. Form SMS.4903, "DBE Progress Report," is to be used for monthly reporting. Form. SMS.4904, "DBE Final Report," is to be used as a final summary of DBE payments submitted upon completion of the project.

The original final report must be submitted to the OCR and a copy must be submitted to the Area Engineer. These forms may be obtained from the Department or may be reproduced by the Contractor. The Department may verify the amounts being reported as paid to DBEs by requesting copies of cancelled checks paid to DBEs on a random basis. Cancelled checks and invoices should reference the Department's project number.

b. DBE subcontractors and/or material suppliers should be identified on the monthly report by Vendor Number, name, and the amount of actual payment made to each during the monthly period. Negative reports are required when no activity has occurred in a monthly period.

c. All such records must be retained for a period of 3 years following completion of the contract work, and shall be available at reasonable times and places for inspection by authorized representatives of the Department or the DOT. Provide copies of subcontracts or agreements and other documentation upon request.

d. Prior to receiving final payment, the Contractor shall submit Form SMS.4904, "DBE Final Report". If the DBE goal requirement is not met, documentation supporting Good Faith Efforts, as outlined in Section 1.A.3.c of this Special Provision, must be submitted with the "DBE Final Report."

e. Provide a certification of prompt payment in accordance with the Department's prompt payment procedure to certify that all subcontractors and suppliers were paid from the previous months payments and retainage was released for those whose work is complete. Submit the completed form each month and the month following the month when final acceptance occurred at the end of the project.

7. **Compliance of Contractor**. To ensure that DBE requirements of this DOT assisted contract are complied with, the Department will monitor the Contractor's efforts to involve DBEs during the performance of this contract. This will be accomplished by a review of monthly reports submitted to the Area Engineer by the Contractor indicating his progress in achieving the DBE contract goal, and by compliance reviews conducted on the project site by the Department.

The Contractor shall receive credit toward the DBE goal based on actual payments to the DBE subcontractor. The Contractor shall notify the Area Engineer if he/she withholds or reduces payment to any DBE subcontractor. The Contractor shall submit an affidavit detailing the DBE subcontract payments prior to receiving final payment for the contract.

Contractors' requests for substitutions of DBE subcontractors shall be accompanied by a detailed explanation which should substantiate the need for a substitution. The Contractor may not be allowed to count work on those items being substituted toward the DBE goal prior to approval of the substitution from the Department.

The prime Contractor is prohibited from providing work crews and equipment to DBEs. DBE Goal credit for the DBE subcontractors leasing of equipment or purchasing of supplies from the prime contractor or its affiliates is not allowed.

When a DBE subcontractor named in the commitment under Section 1.A.3.a. of this Special Provision, is terminated or fails to complete its work on the contract for any reason, the prime contractor is required to make good faith efforts to find another DBE subcontractor to substitute for the original DBE. These good faith efforts shall be directed at finding another DBE to perform at least the same amount of work under the contract as the DBE that was terminated, to the extent needed to meet the contract goal.

A Contractor's failure to comply with the requirements of this Special Provision shall constitute a material breach of this contract. In such a case, the Department reserves the right to terminate the contract; to deduct the amount of DBE goal not accomplished by DBEs from the money due or to become due the Contractor, or to secure a refund, not as a penalty but as liquidated damages to the Department or such other remedy or remedies as the Department deems appropriate.

Forward Form 2371, "DBE Trucking Credit Worksheet," completed by the DBE trucker every month DBE credit is used.

B. **Article B. Race-Neutral Disadvantaged Business Enterprise Participation**. It is the policy of the DOT that Disadvantaged Business Enterprises (DBE) as defined in 49 CFR Part 26 Subpart A, be given the opportunity to compete fairly for contracts and subcontracts financed in whole or in part with Federal funds and that a maximum feasible portion of the Department's overall DBE goal be met using race-neutral means. Consequently, if there is no DBE goal, the DBE requirements of 49 CFR Part 26, apply to this contract as follows:

The Contractor will offer DBEs as defined in 49 CFR Part 26, Subpart A, the opportunity to compete fairly for contracts and subcontractors financed in whole or in part with Federal funds. Race-Neutral DBE and non-DBE HUB participation on projects with no DBE goal shall be reported on Form SMS.4903, "DBE or HUB Progress Report" and submitted to the Area Engineer each month and at project completion. Payments to DBEs reported on Form SMS.4903 are subject to the requirements of Section 1.A.5, "Determination of DBE Participation."

The Contractor, subrecipient or subcontractor shall not discriminate on the basis of race, color, national origin, or sex in the performance of this contract. The Contractor shall carry out applicable requirements of 49 CFR Part 26 in the award and administration of DOT-assisted contracts. Failure by the contractor to carry out these requirements is a material breach of this contract, which may result in the termination of this contract or such other remedy as the recipient deems appropriate.

CHECKMATE™ SLIP-IN INLINE CHECK VALVES
Specification TT-CM-SL

PART 1: GENERAL

1.01 SUBMITTALS

A. Submit product literature that includes information on the performance and operation of the valve, materials of construction, dimensions and weights, elastomer characteristics, headloss, flow data and pressure ratings.

B. Upon request, provide shop drawings that clearly identify the valve materials of construction and dimensions.

1.02 QUALITY ASSURANCE

A. Supplier shall have at least twelve (12) years experience in the design and manufacture of "CheckMate™" style elastomeric check valves.

B. Manufacturer shall have designed, fabricated and have at least five (5) current installation of a "CheckMate™" style elastomeric check valves in the 72" (1800mm) size. Manufacturer must provide documentation, including project name, location, and references.

C. Manufacturer shall have conducted independent hydraulic testing to determine headloss, jet velocity and vertical opening height characteristics on a minimum of three (3) sizes of CheckMate™ valves ranging from 6" (150mm) through 24" (600mm). The testing must have been conducted for free discharge (pressurized and open channel flow discharging to atmosphere) and submerged conditions.

PART 2: PRODUCTS

2.01 "CHECKMATE™" ELASTOMERIC CHECK VALVES

A. Check Valves are to be all rubber and the flow operated check type with slip-in cuff connection. The entire CheckMate™ Valve shall be ply reinforced throughout the body, saddle and bill, which is cured and vulcanized into a one-piece unibody construction. A separate valve body or pipe used as the housing is not acceptable. The valve shall be manufactured with no metal, mechanical hinges or fasteners, which would be used to secure any component of the valve to a valve housing. The port area of the saddle shall contour into a circumferential sealing area concentric with the pipe which shall allow passage of flow in one direction while preventing reverse flow. The entire valve shall fit within the pipe inside diameter. The saddle area of the valve must be flat, not conical, and integral with the rubber body above centerline in order to not produce any areas or voids that can collect or trap debris. The valve must be easily installed in pipes with poor end condition without the need to modify or utilize the headwall or structure to seal and anchor the valve. Once installed, the CheckMate™ Valve shall not protrude beyond the face of the structure or end of the pipe.

B. The outside diameter of the upstream and downstream sections of the valve must be circumferentially in contact with the inside diameter of the pipe.

C. Slip-in style CheckMate™ Valves will be furnished with a set of stainless steel expansion clamps. The clamps, which will secure the valve in place, shall be installed in the upstream or downstream cuff of the valve, depending on installation orientation, and shall expand outwards by means of a turnbuckle. Each band shall be pre-drilled allowing for the valve to be pinned and secured into position in accordance with the manufacturer's installation instructions.

D. Manufacturer must have flow test data from an accredited hydraulics laboratory to confirm pressure drop and hydraulic data.

E. Company name, plant location, valve size patent number, and serial number shall be bonded to the check valve.

2.02 FUNCTION

A. When line pressure exceeds the backpressure, the line pressure forces the bill and saddle of the valve open, allowing flow to pass. When the backpressure exceeds the line pressure, or in the absence of any upstream or downstream pressure, the bill and saddle of the valve is forced closed, preventing backflow.

2.03 MANUFACTURER

A. All valves shall be Series CM-SL slip-in CheckMate™ Valves as manufactured by Tideflex Technologies®, A Division of Red Valve Company, Carnegie, PA 15106. All valves shall be manufactured in the U.S.A.

PART 3: EXECUTION

3.01 INSTALLATION

A. Valve shall be installed in accordance with manufacturer's written Installation and Operation Manual and approved submittals.

3.02 MANUFACTURER'S CUSTOMER SERVICE

A. Manufacturer's authorized representative shall be available for customer service during installation and start-up, and to train personnel in the operation, maintenance and troubleshooting of the valve.

B. If specified, the manufacturer shall also make customer service available directly from the factory in addition to authorized representatives for assistance during installation and start-up, and to train personnel in the operation, maintenance and troubleshooting of the valve.

APPENDICES

CSJ: 0912-71-739

Highway: CS

Project: C 912-71-739

County: Harris

Limits: Greens Road from Aldine Westfield Road to John F. Kennedy Boulevard

UTILITY CERTIFICATION

This is to certify that all utilities will be adjusted in accordance with the appropriate directives covering the adjustment of utilities, except those utilities listed below which will be adjusted in accordance with appropriate directives.

Location	Description	Utility Owner	Expected Completion Date
Sta. 14+70 to Sta. 91+73	Poles, Buried Cables and Electrical Boxes	AT&T Texas	All pending Right-Of-Way (ROW) anticipating acquisition by October 11th, 2016. Based on AT&T schedule, 8 months needed to relocate (End of June 2017)
Sta. 23+29 to Sta. 91+03	Power Poles and Underground Cables	CenterPoint Energy/Electric	All pending ROW Acquisition anticipating by October 11h, 2016. 4 months needed to relocate (February 2017)
Sta. 16+00 to Sta. 93+25	2-inch to 10-inch Gas Lines	CenterPoint Energy/Gas	All pending ROW Acquisition anticipating by October 11h, 2016. 3 months needed to relocate (January 2017)
Sta. 20+82 to Sta. 89+10	Aerial Cables	Comcast	After CenterPoint Power Pole relocation 4 weeks estimated (March 2017)
North of Greens Road	Fiber Optic Cable attached to Centerpoint Pole line	Verizon Business/MCI	4 weeks estimated, after CenterPoint Power Pole relocation (March 2017)
On the South side of Greens Rd from Aldine Westfield Rd to Greenview Dr. on the North side of Greens Rd from Greenview Dr to JFK Blvd	Buried Fiber Optic Cables	CenturyLink/ Embarq	Conflict and relocation to be determined when ROW is staked

Morales intersection	Underground fiber cable and power pole	Phonoscope	4 weeks estimated, after CenterPoint Power Pole relocation (March 2017)
Sta. 26+25 to Sta. 49+80 and Sta. 89+06 to Sta. 94+11	Underground and Aerial Cables	Level 3 Communications	4 weeks estimated, after CenterPoint Power Pole relocation (March 2017)

RIGHT OF WAY CERTIFICATION

This is to certify that some of the right-of-way has been acquired in accordance with the current FHWA directives concerning the acquisition of the real property, and the remaining right-of-way will be acquired in accordance with FHWA directives. The following is a list of all the parcels acquired or to be acquired.

	Parcel #	Acquired Date	Parcel status	Area Ac
1	AY14-120	6/30/2015	TRANSFER OF JURISDICTION	0.0344
2	AY14-121	8/14/2015	TRANSFER OF JURISDICTION	0.1417
3	AY14-122	9/25/2015	CLOSED - PURCHASE	0.0599
4	AY14-123	4/22/2016	CLOSED - PURCHASE	0.0026
5	AY14-124	4/22/2016	CLOSED - PURCHASE	0.0026
6	AY14-125		IN CONDEMNATION	0.0591
7	AY14-126		IN CONDEMNATION	0.0595
8	AY14-127	10/22/2015	CLOSED - PURCHASE	0.0607
9	AY14-128	8/10/2015	CLOSED - PURCHASE	0.0447
10	AY14-129	6/30/2015	CLOSED - PURCHASE	0.1427
12	AY14-131	1/13/2016	CLOSED - PURCHASE	0.0026
13	AY14-132	6/30/2015	TRANSFER OF JURISDICTION	0.0026
14	AY14-133		IN CLOSING-CHECK RECEIVED	0.0666
15	AY16-092		TIITLE/APPRAISAL PENDING	
16	AY14-135	6/30/2015	CLOSED - PURCHASE	0.0372
17	AY14-136		IN CONDEMNATION	0.3431
18	AY14-137	2/24/2016	CLOSED - PURCHASE	0.0434
19	AY14-138		IN CONDEMNATION	0.1701
20	AY14-139	9/16/2015	CLOSED - PURCHASE	0.1676
21	AY14-140	3/10/2016	CLOSED - PURCHASE	0.0412
22	AY14-141	9/30/2015	CLOSED - PURCHASE	0.0843
23	AY14-142	4/30/2015	TRANSFER OF JURISDICTION	0.1162
24	AY14-143		IN CLOSINGCHECK RECEIVED	0.1084

25	AY14-144	12/09/2015	CLOSED - PURCHASE	0.2298
26	AY14-145	10/22/2015	CLOSED - PURCHASE	0.052
27	AY14-146		IN CONDEMNATION	0.1176
28	AY14-147		IN CONDEMNATION	0.0698
29	AY14-148	02/12/2016	CLOSED - PURCHASE	0.093
30	AY14-150	06/24/2016	TRANSFER OF JURISDICTION	0.2296
31	AY16-020		OFFER PENDING	0.0599
32	LY15-006	01/04/2016	TRANSFER OF JURISDICTION	4.744

RELOCATION ASSISTANCE PROGRAM CERTIFICATION

This is to certify that this project did not cause any displacements, and the steps relative to relocation advisory assistance and payments under the current FHWA directive(s) covering the administration of the Highway Relocation Assistance Program were not required.

RAILROAD WORK

This is to certify that this project did not require any railroad work.

RIGHT-OF-WAY ENCROACHMENTS

This is to certify that no right-of-way encroachments existed within the limits of this project or all removal of encroachments has been completed.

This certification is issued with the understanding that State and/or Federal funds will not participate in any cost or time suspensions caused by delays in acquiring the right-of-way or adjusting utilities.

_____

John Kuo, P.E.

Assistant Director

Public Works and Engineering

Department

_____

Date

HVJ ASSOCIATES

Houston
Austin
Dallas
San Antonio

6120 S. Dairy Ashford Rd.
Houston, TX 77072-1010
281.933.7388 Ph
281.933.7293 Fax
www.hvj.com

November 4, 2015

Mr. Ryan Quinn, PE
AECOM
5444 Westheimer Rd, Suite 200
Houston, Texas 77056

Re: Trench Safety Letter
Greens Road from Aldine Westfield to JFK
Owner: City of Houston and Texas Department of Transportation
HVJ Project No. HG0519680

Dear Mr. Quinn:

The purpose of this letter is to provide trench safety recommendations for construction of proposed underground utilities, culvert, bridge foundation, detention pond, and pavement associated with the Greens Road improvements from Aldine Westfield to JFK in Houston, Texas.

Trench Excavation Considerations. Excavations should satisfy two requirements. First, the soils above final grade must be removed without disturbing the soil below, which will support constructed facilities. Second, the sides of the excavation must be stable to prevent damage to adjacent streets and facilities as a result of either vertical or lateral movements of the soil. In addition, a satisfactory excavation procedure must include an adequate construction dewatering system to lower and maintain the water level at least a few feet below the lowest excavation grade.

Excavation Stability. Excavations shall be shored, laid back to a stable slope or some other equivalent means may be used to provide safety for workers and adjacent structures. Assessment of the need for excavation sloping, use of trench boxes, or other measures required to provide a stable excavation, and the use of appropriate construction practices and/or equipment is the contractor's responsibility. The following comments are intended to represent common solutions to stability problems encountered in similar soil conditions in the Houston area, and may not be construed as excavation system design recommendations. The excavation operations shall be performed in accordance with 29 CFR Part 1926 subpart P, as amended, including rules published in the Federal Register, Vol. 54, No. 209, dated October 31, 1989, as a minimum. In addition, the provisions of legislation enacted by the Texas legislature and conformance to TxDOT Standard Specifications for Construction of Highways, Streets, and Bridges, Item 402 and 403 should be satisfied. Table 1 shows the classification of soils for excavations according to OSHA standards.

Table 1 OSHA Soil Type

Boring No.	OSHA Soil Type			
	Depth of Trench (ft.)			
	0 – 5	5 – 10	10-15	15 – 20
B-1	B	B	B	B
B-2	B	B	B	B
B-3	B	B	B	B
B-4	B	B	C	C
B-5	B	B	B	B
B-6	B	B	B	B
B-7	B	C	C	C
B-8	B	B	B	B
B-9	B	B	B	B
B-10	B	B	B	B
B-11	B	B	B	C
B-12	B	B	B	C
B-13	B	B	B	C
B-14	C	C	C	C
BR-1	B	B	B	B
BR-2	B	B	B	B

We recommend that a professional engineer should design temporary support for trenches deeper than 20 feet, and that the OSHA tables are not used below this depth.

Please call us if you have any questions or need more information.

Sincerely,

HVJ ASSOCIATES, INC.
Texas Firm Registration No. F-000646

SVedantam

Sharmi Vedantam, P.E.
Project Manager

SV/SS

Texas Department of Transportation

The wage rates listed are those predetermined by the Secretary of Labor and State Statue to be the minimum wages paid. To determine the applicable wage rate zone, a list entitled "TEXAS COUNTIES IDENTIFIED BY WAGE RATE ZONES" is provided in the contract. Any wage rate that is not listed must be submitted to the Engineer for approval. IMPORTANT NOTICE FOR STATE PROJECTS; only the controlling wage rate zone applies to the contract. Effective 1-8-2016

CLASS. #	CLASSIFICATION DESCRIPTION	ZONE TX07 1/8/16	ZONE TX08 1/8/16	ZONE TX11 1/8/16	ZONE TX12 1/8/16	ZONE TX14 1/8/16	ZONE TX16 1/8/16	ZONE TX18 1/8/16	ZONE TX34 1/8/16	ZONE TX35 1/8/16	ZONE TX37 1/8/16	ZONE TX38 1/8/16	ZONE TX40 1/8/16	ZONE TX41 1/8/16	ZONE TX54 1/8/16	ZONE TX56 1/8/16	ZONE TX63 1/8/16
1428	Agricultural Tractor Operator						$12.69					$12.35			$11.75		
1300	Asphalt Distributor Operator	$14.87	$13.48	$13.88	$15.72	$15.58	$15.55	$15.72	$13.28	$15.32	$15.62	$14.36	$14.25	$14.03	$13.75	$14.06	$14.40
1303	Asphalt Paving Machine Operator	$13.40	$12.25	$12.35	$13.87	$14.05	$14.36	$14.20	$13.26	$13.99	$14.68	$12.92	$13.44	$12.53	$14.00	$14.32	$12.99
1106	Asphalt Raker	$12.28	$10.61	$12.02	$14.21	$11.65	$12.12	$11.64	$11.44	$12.69	$12.05	$11.34	$11.67	$11.40	$12.59	$12.36	$11.78
1112	Batching Plant Operator, Asphalt																
1115	Batching Plant Operator, Concrete																
1214	Blaster																
1615	Boom Truck Operator						$18.36										
1444	Boring Machine Operator																
1305	Broom or Sweeper Operator	$11.21	$10.33	$10.15	$11.99		$11.04	$11.62		$11.74	$11.41	$10.30		$10.23	$10.60	$12.68	$11.05
1144	Communications Cable Installer																
1124	Concrete Finisher, Paving and Structures	$13.55	$12.46	$13.16	$12.85	$12.64	$12.56	$12.77	$12.44	$14.12	$13.04	$13.38	$12.64	$12.80	$12.79	$12.98	$13.32
1318	Concrete Pavement Finishing Machine Operator				$16.05		$15.48			$16.05		$19.31				$13.07	
1315	Concrete Paving, Curing, Float, Texturing Machine Operator											$16.34				$11.71	
1333	Concrete Saw Operator				$14.67					$14.48	$17.33					$13.99	
1399	Concrete/Gunite Pump Operator																
1344	Crane Operator, Hydraulic 80 tons or less				$18.22		$18.36			$18.12	$18.04	$20.21			$18.63	$13.86	
1345	Crane Operator, Hydraulic Over 80 Tons																
1342	Crane Operator, Lattice Boom 80 Tons or Less	$16.82	$14.39	$13.85	$17.27		$15.87			$17.27		$14.67			$16.42	$14.97	$13.87
1343	Crane Operator, Lattice Boom Over 80 Tons				$20.52		$19.38			$20.52		$17.49			$25.13	$15.80	
1306	Crawler Tractor Operator	$13.96	$16.63	$13.62	$14.26		$15.67			$14.07	$13.15	$13.38			$14.60	$13.68	$13.50
1351	Crusher or Screen Plant Operator																
1446	Directional Drilling Locator						$11.67										
1445	Directional Drilling Operator				$20.32		$17.24										
1139	Electricia	$20.96		$19.87	$19.80		$26.35		$20.27	$19.80		$20.92				$27.11	$19.87
1347	Excavator Operator, 50,000 pounds or less	$13.46	$12.56	$13.67	$17.19		$12.88	$14.38	$13.49	$17.19		$13.88			$14.09	$12.71	$14.42
1348	Excavator Operator, Over 50,000 pounds		$15.23	$13.52	$17.04		$17.71			$16.99	$18.80	$16.22				$14.53	$13.52
1150	Flagger	$10.15	$10.15	$10.15	$10.28	$10.15	$10.15	$10.15		$10.15	$10.15	$10.15	$10.15	$10.15	$10.15	$10.33	$10.15
1151	Form Builder/Setter, Structures	$13.52	$12.30	$13.38	$12.91	$12.71	$12.87	$12.38	$12.26	$13.84	$12.98	$13.07	$13.61	$12.82	$14.73	$12.23	$12.25
1160	Form Setter, Paving & Curb	$12.36	$12.16	$13.93	$11.83	$10.71	$12.94			$13.16	$12.54	$11.33	$10.69		$13.33	$12.34	$13.93
1360	Foundation Drill Operator, Crawler Mounted				$17.99					$17.99						$17.43	
1363	Foundation Drill Operator, Truck Mounted		$16.86	$22.05	$21.51		$16.93			$21.07	$20.20	$20.76		$17.54	$21.39	$15.89	$22.05
1369	Front End Loader Operator, 3 CY or Less	$12.28	$13.49	$13.40	$13.85		$13.04	$13.15	$13.29	$13.69	$12.64	$12.89			$13.51	$13.32	$12.17
1372	Front End Loader Operator, Over 3 CY	$12.77	$13.69	$12.33	$14.96		$13.21	$12.86	$13.57	$14.72	$13.75	$12.32			$13.19	$13.17	$13.02
1329	Joint Sealer																
1172	Laborer, Common	$10.30	$10.15	$10.15	$10.51	$10.71	$10.50	$10.24	$10.58	$10.72	$10.45	$10.30	$10.25	$10.15	$10.54	$11.02	$10.15
1175	Laborer, Utility	$11.80	$11.53	$12.70	$12.17	$11.81	$12.27	$12.11	$11.33	$12.32	$11.80	$11.53	$11.23	$11.50	$11.95	$11.73	$12.37
1346	Loader/Backhoe Operator	$14.18	$12.77	$12.97	$15.68		$14.12			$15.18	$13.58	$12.87		$13.21	$14.13	$14.29	$12.90

CLASS. #	CLASSIFICATION DESCRIPTION	ZONE TX07 1/8/16	ZONE TX08 1/8/16	ZONE TX11 1/8/16	ZONE TX12 1/8/16	ZONE TX14 1/8/16	ZONE TX16 1/8/16	ZONE TX18 1/8/16	ZONE TX34 1/8/16	ZONE TX35 1/8/16	ZONE TX37 1/8/16	ZONE TX38 1/8/16	ZONE TX40 1/8/16	ZONE TX41 1/8/16	ZONE TX54 1/8/16	ZONE TX56 1/8/16	ZONE TX63 1/8/16
1187	Mechanic	$20.14	$15.47	$17.47	$17.74	$17.00	$17.10			$17.68	$18.94	$18.58	$17.00	$16.61	$18.46	$16.96	$17.47
1380	Milling Machine Operator	$15.54	$14.64	$12.22	$14.29		$14.18			$14.32	$14.35	$12.86			$14.75	$13.53	$12.80
1390	Motor Grader Operator, Fine Grade	$17.49	$16.52	$16.88	$17.12	$18.37	$18.51	$16.69	$16.13	$17.19	$18.35	$17.07	$17.74	$17.47	$17.08	$15.69	$20.01
1393	Motor Grader Operator, Rough	$16.15	$14.62	$15.83	$16.20	$17.07	$14.63	$18.50		$16.02	$16.44	$15.12	$16.85	$14.47	$17.39	$14.23	$15.53
1413	Off Road Hauler			$10.15	$12.26		$11.88			$12.25		$12.23			$13.00	$14.60	
1196	Painter, Structures					$21.29	$18.34						$21.29			$18.62	
1396	Pavement Marking Machine Operator	$16.42		$13.10	$13.55		$19.17	$12.01		$13.63	$14.60	$13.17		$16.65	$10.54	$11.18	$13.10
1443	Percussion or Rotary Drill Operator																
1202	Piledriver															$14.95	
1205	Pipelayer		$11.87	$14.64	$13.17	$11.17	$12.79		$11.37	$13.24	$12.66	$13.24	$11.17	$11.67		$12.12	$14.64
1384	Reclaimer/Pulverizer Operator	$12.85			$11.90		$12.88			$11.01		$10.46					
1500	Reinforcing Steel Worker	$13.50	$14.07	$17.53	$16.17		$14.00			$16.18	$12.74	$15.83		$17.10		$15.15	$17.72
1402	Roller Operator, Asphalt	$10.95		$11.96	$13.29		$12.78	$11.61		$13.08	$12.36	$11.68			$11.71	$11.95	$11.50
1405	Roller Operator, Other	$10.36		$10.44	$11.82		$10.50	$11.64		$11.51	$10.59	$10.30		$12.04	$12.85	$11.57	$10.66
1411	Scraper Operator	$10.61	$11.07	$10.85	$12.88		$12.27		$11.12	$12.96	$11.88	$12.43		$11.22	$13.95	$13.47	$10.89
1417	Self-Propelled Hammer Operator																
1194	Servicer	$13.98	$12.34	$14.11	$14.74		$14.51	$15.56	$13.44	$14.58	$14.31	$13.83		$12.43	$13.72	$13.97	$14.11
1513	Sign Erector																
1708	Slurry Seal or Micro-Surfacing Machine Operator																
1341	Small Slipform Machine Operator									$15.96							
1515	Spreader Box Operator	$12.60		$13.12	$14.71		$14.04			$14.73	$13.84	$13.68		$13.45	$11.83	$13.58	$14.05
1705	Structural Steel Welder															$12.85	
1509	Structural Steel Worker						$19.29									$14.39	
1339	Subgrade Trimmer																
1143	Telecommunication Technician																
1145	Traffic Signal/Light Pole Worker						$16.00										
1440	Trenching Machine Operator, Heavy						$18.48										
1437	Trenching Machine Operator, Light																
1609	Truck Driver Lowboy-Float	$14.46	$13.63	$13.41	$15.00	$15.93	$15.66			$16.24	$16.39	$14.30	$16.62	$15.63	$14.28	$16.03	$13.41
1612	Truck Driver Transit-Mix				$14.14					$14.14							
1600	Truck Driver, Single Axle	$12.74	$10.82	$10.75	$13.04	$11.61	$11.79	$13.53	$13.16	$12.31	$13.40	$10.30	$11.61		$11.97	$11.46	$10.75
1606	Truck Driver, Single or Tandem Axle Dump Truck	$11.33	$14.53	$11.95	$12.95		$11.68		$14.06	$12.62	$11.45	$12.28		$13.08	$11.68	$11.48	$11.10
1607	Truck Driver, Tandem Axle Tractor with Semi Trailer	$12.49	$12.12	$12.50	$13.42		$12.81	$13.16		$12.86	$16.22	$12.50			$13.80	$12.27	$12.50
1441	Tunneling Machine Operator, Heavy																
1442	Tunneling Machine Operator, Light																
1706	Welder		$14.02		$14.86		$15.97		$13.74	$14.84					$13.78		
1520	Work Zone Barricade Servicer	$10.30	$12.88	$11.46	$11.70	$11.57	$11.85	$10.77		$11.68	$12.20	$11.22	$11.51	$12.96	$10.54	$11.67	$11.76

Notes:

Any worker employed on this project shall be paid at the rate of one and one half (1-1/2) times the regular rate for every hour worked in excess of forty (40) hours per week.

The titles and descriptions for the classifications listed here are further detailed in the AGC of Texas' *Standard Job Classifications and Descriptions for Highway, Heavy, Utilities, and Industrial Construction in Texas* . AGC will make it available on its Web site for any contractor.

TEXAS COUNTIES IDENTIFIED BY
WAGE RATE ZONES: 7, 8, 11, 12, 14, 16, 18, 34, 35, 37, 38, 40, 41, 54, 56, 63

County Name	Zone	County Name	Zone	County Name	Zone	County Name	Zone
Anderson	38	Donley	54	Karnes	37	Reagan	54
Andrews	54	Duval	41	Kaufman	35	Real	54
Angelina	38	Eastland	54	Kendall	16	Red River	38
Aransas	40	Ector	7	Kenedy	41	Reeves	18
Archer	35	Edwards	18	Kent	54	Refugio	37
Armstrong	7	El Paso	34	Kerr	37	Roberts	54
Atascosa	16	Ellis	35	Kimble	54	Robertson	16
Austin	56	Erath	38	King	54	Rockwall	35
Bailey	54	Falls	38	Kinney	18	Runnels	54
Bandera	16	Fannin	38	Kleberg	37	Rusk	11
Bastrop	16	Fayette	37	Knox	54	Sabine	38
Baylor	54	Fisher	54	Lamar	38	San Augustine	38
Bee	37	Floyd	54	Lamb	54	San Jacinto	56
Bell	16	Foard	54	Lampasas	16	San Patricio	40
Bexar	16	Fort Bend	56	LaSalle	41	San Saba	54
Blanco	37	Franklin	38	Lavaca	37	Schleicher	54
Borden	54	Freestone	38	Lee	37	Scurry	54
Bosque	38	Frio	37	Leon	38	Shackelford	54
Bowie	11	Gaines	54	Liberty	56	Shelby	38
Brazoria	56	Galveston	56	Limestone	38	Sherman	54
Brazos	16	Garza	54	Lipscomb	54	Smith	11
Brewster	18	Gillespie	37	Live Oak	37	Somervell	38
Briscoe	54	Glasscock	54	Llano	37	Starr	41
Brooks	41	Goliad	40	Loving	54	Stephens	54
Brown	54	Gonzales	37	Lubbock	7	Sterling	54
Burleson	16	Gray	54	Lynn	54	Stonewall	54
Burnet	37	Grayson	35	Madison	38	Sutton	18
Caldwell	16	Gregg	11	Marion	38	Swisher	54
Calhoun	40	Grimes	38	Martin	54	Tarrant	35
Callahan	35	Guadalupe	16	Mason	37	Taylor	7
Cameron	8	Hale	54	Matagorda	37	Terrell	18
Camp	38	Hall	54	Maverick	41	Terry	54
Carson	7	Hamilton	38	McCulloch	54	Throckmorton	54
Cass	38	Hansford	54	McLennan	16	Titus	38
Castro	54	Hardeman	54	McMullen	41	Tom Green	7
Chambers	56	Hardin	56	Medina	16	Travis	16
Cherokee	38	Harris	56	Menard	54	Trinity	38
Childress	54	Harrison	63	Midland	7	Tyler	38
Clay	35	Hartley	54	Milam	38	Upshur	11
Cochran	54	Haskell	54	Mills	54	Upton	54
Coke	54	Hays	16	Mitchell	54	Uvalde	41
Coleman	54	Hemphill	54	Montague	54	Val Verde	18
Collin	35	Henderson	38	Montgomery	56	Van Zandt	38
Collingsworth	54	Hidalgo	8	Moore	54	Victoria	14
Colorado	37	Hill	38	Morris	38	Walker	38
Comal	16	Hockley	54	Motley	54	Waller	56
Comanche	54	Hood	38	Nacogdoches	38	Ward	54
Concho	54	Hopkins	38	Navarro	38	Washington	38
Cooke	54	Houston	38	Newton	38	Webb	8
Coryell	16	Howard	54	Nolan	54	Wharton	37
Cottle	54	Hudspeth	18	Nueces	40	Wheeler	54
Crane	54	Hunt	35	Ochiltree	54	Wichita	12
Crockett	18	Hutchinson	54	Oldham	54	Wilbarger	54
Crosby	7	Irion	7	Orange	56	Willacy	41
Culberson	18	Jack	38	Palo Pinto	38	Williamson	16
Dallam	54	Jackson	37	Panola	38	Wilson	16
Dallas	35	Jasper	38	Parker	35	Winkler	54
Dawson	54	Jeff Davis	18	Parmer	54	Wise	35
Deaf Smith	54	Jefferson	56	Pecos	18	Wood	38
Delta	35	Jim Hogg	41	Polk	38	Yoakum	54
Denton	35	Jim Wells	37	Potter	7	Young	54
DeWitt	37	Johnson	35	Presidio	18	Zapata	41
Dickens	54	Jones	35	Rains	38	Zavala	41
Dimmit	41			Randall	7		

Revised 1-8-16

CITY OF HOUSTON

DEPARTMENT OF PUBLIC WORKS AND ENGINEERING
ENGINEERING AND CONSTRUCTION DIVISION

STORM WATER POLLUTION PREVENTION PLAN

GREENS ROAD
PAVING AND DRAINAGE AND PAVING IMPROVEMENTS
WBS NO.: N-000686-0002-4

STATE OF TEXAS
KEITH R. DAVIS
82625
LICENSED
PROFESSIONAL ENGINEER
8-31-15
KIT Professionals, Inc.
TBPE Firm Registration No. F-4991

August 2015

Prepared by:

KIT Professionals, Inc.
Engineers • Planners • Construction Managers
2000 W. Sam Houston Parkway S., Suite 1400, Houston, Texas 77042
Tel: 713-783-8700 • Fax: 713-783-8747 • www.kitprofs.com
Texas Board of P.E. Registration No.: F-4991

STROM WATER POLLUTION PREVENTION PLAN

TEXAS POLLUTION DISCHARGE ELIMINATION SYSTEM (TPDES)
GENERAL PERMIT FOR STORM WATER DISCHARGES FROM CONSTRUCTION SITES

NOTICE TO CONTRACTORS

Attached is the preliminary Storm Water Pollution Prevention Plan for this project. You should familiarize yourself with this plan. This document is provided to assist you in preparing your bid.

The bid sheet contains several items which cover the work required by this plan. Compliance will affect your project sequencing and the amount of work ongoing at any one time.

The successful bidder may submit alternatives to the Pollution Prevention Plan to reflect means, methods, and sequencing of work for this project. During construction, as required, the plan will be modified to reflect the site-specific nature of this project.

You should review the required Contractor/Subcontractor Certification located at the bottom of the Notice of Intent for this permit. The successful Bidder shall become the co-permittee under the TPDES General Permit. You should also review the required Inspector Certification for this Permit, as the successful Bidder become responsible for implementation, modification, and compliance with the terms and conditions of the plan under the TPDES General Permit.

NOTE: ONLY THE SUCCESSFUL BIDDER SHALL FILL OUT THE ATTACHED STORM WATER POLLUTION PREVENTION PLAN PRIOR TO THE COMMENCEMENT OF THE WORK.

Table of Contents

NOTICE TO CONTRACTORS ii

Table of Contents ii

List of Tables iv

List of Appendices iv

1.0 SITE DESCRIPTION 1
1.1 Description of Existing Conditions 1
1.2 Description of Construction Activity 1
1.3 Sequence of Major Activity 1
1.4 Estimated Total Site Area and Total Disturbed Area 1
1.5 Runoff Coefficient 1
1.6 Soils 2
1.7 Site and General Location Map 2
1.8 Name of Receiving Waters and Extent of Wetlands 2
1.9 Other Industrial Activities 2
1.10 Construction General Permit Requirements 2
1.11 Endangered or Threatened Species or Critical Habitats 2
1.12 National Register of Historic Places 2

2.0 CONTROLS 3
2.1 Erosion and Sediment Controls 3
2.1.1 Stabilization Practices 3
2.1.2 Structural Practices 3
2.1.3 Sequence of Erosion and Sediment Control Activities 3
2.2 Storm Water Management 4
2.3 Other Controls 4
2.3.1 Waste Disposal 4
2.3.2 Offsite Vehicle Tracking 4
2.3.3 Demonstration of Compliance with State and Local Regulations 4
2.3.4 Description of construction and waste materials to be stored onsite 4
2.3.5 Description of pollutant sources for support activities, and controls for them 5
2.3.6 Description of any necessary measures to protect listed endangered or threatened species or critical habitat, including any required terms or conditions as a result of threatened or endangered species/critical habitat review and coordination 5
2.4 Approved State or Local Plans 5

3.0 MAINTENANCE 6

4.0 INSPECTION 7
4.1 Scope of Inspection for SWPPP 7
4.2 Revisions to Plan 7
4.3 Inspection Reports 7

5.0 NON-STORM WATER DISCHARGES 8
5.1 Inventory for Pollution Prevention Plan 8
5.1.1 Authorized non-storm water discharges anticipated during the project: 8
5.1.2 Water pumped from trenches during dewatering operations will be discharged to a system with control measures in place prior to the receiving stream (i.e. swale ditch with reinforced fabric barrier). 8
5.2 Spill Prevention 8
5.2.1 Good Housekeeping 9
5.2.2 Hazardous Products 9
5.2.3 Product Specific Practices 9
5.2.4 Spill Prevention Practices 9

6.0 CONSTRUCTION SPECIFICATIONS 10

7.0 CERTIFICATIONS 10
7.1 Sample certification forms required in the general permit. 10
7.2 NOI Forms 10
7.3 NOT Forms 10

8.0 INSPECTIONS FORMS 10

List of Tables

TABLE 1. PRODUCT SPECIFIC PRACTICES 11
TABLE 2. SPILL PREVENTION PRACTICES 12

List of Appendices

A. Construction General Permit, EPA Region 6, March 5, 2003
B. Certification Forms
C. Notice of Intent (NOI) Forms
D. Notice of Termination (NOT) Forms
E. Inspection and Maintenance Forms
F. Storm Water Pollution Prevention Plans

STORM WATER POLLUTION PREVENTION PLAN

1.0 Site Description

1.1 Description of Existing Conditions

The project area is located in northeast Houston in the vicinity of Sam Houston Tollway (N) east of US 59. The project is bounded by Aldine-Westfield Road to the west, Intercontinental Airport to the north, JFK Boulevard to the east, and the Sam Houston Tollway North to the south.

1.2 Description of Construction Activity

Work of the contract is for the construction of water lines, storm sewer inlets, leads and trunk sewers, reconstruction of existing roadways with concrete pavement, sidewalks, driveways as shown on the construction drawings. In addition, an emergency traffic signal, a detention pond will be constructed south of Greens Road, and the replacement of a culvert crossing at Old Hoods Bayou (P240-00-00), a bridge replacement at Hoods Bayou (P140-00-00) and the culvert will be replaced from P240-00-00 to P140-00-00. The work also includes site and pavement restoration, tree protection, storm water pollution prevention, and traffic control.

1.3 Sequence of Major Activity

Construction work can be divided into several major phases, which include: 1) open-cut installation of storm sewer; 2) open-cut construction of water lines and service connections, and 4) street replacement, driveways, and sidewalks. The Construction sequencing will be at the discretion of the Contractor.

1.4 Estimated Total Site Area and Total Disturbed Area

Assuming that the entire Rights-of-Way will be disturbed, total estimated disturbed area is approximately 24.6 acres.

1.5 Runoff Coefficient

The project area in this area has an approximated weighted "C" value of 0.65. The project area within open areas has an approximated weighted "C" value of 0.35.

1.6 Soils

The soils within this project are predominantly cohesive in nature. See Geotechnical Investigation Report prepared for this project for the soil information.

1.7 Site and General Location Map

The Vicinity and Site Maps are included in the Construction Drawings.

1.8 Name of Receiving Waters and Extent of Wetlands

The overland sheet flow within the project area is ultimately conveyed to the Houston Ship Channel via a network of underground storm sewer systems along the project streets and Greens Bayou.

There are no documented wetlands within the project area. Any impacts to waters of United States, including wetlands, along the project alignment will be permitted through Section 404 of the Clean Water Act prior to commencement of construction.

1.9 Other Industrial Activities

There are no discharges associated with industrial activity other than construction.

1.10 Construction General Permit Requirements

A copy of March 5, 2003 Region 6 Construction General Permit is attached.

1.11 Endangered or Threatened Species or Critical Habitats

There are no known Endangered or Threatened Species or Critical Habitats that will be impacted by construction activities at this site.

1.12 National Register of Historic Places

The storm water discharges and related activities will not affect properties listed or eligible for listing on the National Register of Historic Places.

2.0 Controls

2.1 Erosion and Sediment Controls

Major erosion and sediment controls are as shown on the project drawings.

2.1.1 Stabilization Practices

- As construction of sections of proposed improvements are completed and are not scheduled to be disturbed for 21 days, stabilization shall be completed as soon as practicable, but always within 14 days. Stabilization shall include hydro-mulching all disturbed areas.
- Stabilized construction entrances and exits will be constructed in accordance with specifications prior to commencement of construction work.
- The contractor will be required to minimize off-site vehicle tracking of sediments. If this occurs, the contractor shall remove and dispose of sediments tracked off-site.

2.1.2 Structural Practices

- Trench excavation materials not immediately hauled off will be backfilled into the trenches in a continuous operation. Excavated material required for backfilling will be placed next to the trenches, but no closer than half the depth of the trench, for safety reasons.
- Reinforced fabric barriers will be used for sediment control along the road side ditches as well as drainage ditches/bayous that receive runoff from the proposed construction site.
- Filter fabric fence will be placed adjacent to construction areas where runoff from disturbed areas flows away from the site rather than into controlled road side ditches or storm sewers.
- All storm sewer inlets receiving sediment laden runoff shall have a Stage 1 or Stage 2 inlet protection barrier as applicable. Remove inlet protection barriers once the disturbed areas are stabilized.
- Road side ditches will be cleaned and graded to maintain existing flow patterns during stabilization operations.
- Where ground is flat and runoff is expected to be minimal, an existing vegetated filter strip will be left undisturbed.
- All wash water will be directed to a sediment pit prior to release into a drainage ditch or storm sewer.

2.1.3 Sequence of Erosion and Sediment Control Activities

- Prior to commencement of construction work, stabilized construction entrances and exits will be installed. Required reinforced fabric barriers and filter fabric fences will be installed.

- During construction, erosion and sediment control devices will be regularly maintained and replaced as necessary.
- When construction activities in an area have been completed, disturbed areas will be hydro-mulched within 14 days.

2.2 Storm Water Management

Due to the fact that the proposed site will match existing conditions, permanent storm water treatment will not be used. Storm water will flow in its existing pattern.

2.3 Other Controls

2.3.1 Waste Disposal

Waste Materials
All trash and construction debris from the site will be disposed of offsite. The trash and debris will be hauled to an approved landfill. No construction waste material will be buried onsite.

Hazardous Waste
Conduct operations in Potentially Petroleum Contaminated Area (PPCA) in accordance with the accepted Environmental Work Plan and the Environmental Health and Safety Plan to minimize the spread of contamination. All work in PPCA shall be in accordance with Specifications 02105 and 02120.

Sanitary Waste
All sanitary waste will be regularly collected from portable units.

2.3.2 Offsite Vehicle Tracking

The contractor will be held responsible for reducing vehicle tracking of sediments. Stabilized construction access will be provided to help reduce vehicle tracking of sediments. Additionally, street cleaning will be done on all paved street surfaces in the project site on an on-going basis and to the extent necessary to keep adjacent streets clean of loose construction debris and soils.

2.3.3 Demonstration of Compliance with State and Local Regulations

The proposed project will be in compliance with applicable state and local waste disposal and sanitary sewer regulations.

2.3.4 Description of construction and waste materials to be stored onsite

Refer to Section 5.0.

2.3.5 Description of pollutant sources for support activities, and controls for them

This project will not involve support activities that will create pollutant sources.

2.3.6 Description of any necessary measures to protect listed endangered or threatened species or critical habitat, including any required terms or conditions as a result of threatened or endangered species/critical habitat review and coordination.

Endangered or threatened species or critical habitats have not been found within the project area.

2.4 Approved State or Local Plans

There are no approved states or local site plan requirements for storm water management or erosion and sediment control.

3.0 Maintenance

Refer to Section 2.1 for a discussion of erosion and sediment controls to be used on this project. The project drawings illustrate the location of each of the proposed stabilization and structural practices.

The following maintenance measures will be followed to ensure that the erosion and sediment controls listed in Section 2.1 are performing properly.

- Maintenance and repairs will be conducted within 24 hours of inspection report (see Section 4.0).
- Sediment will be removed from the barriers when it becomes about 1/3 the height of the device.
- Sediments will be removed from receiving waters as necessary.
- All temporary controls will be removed after the disturbed areas have been stabilized.

4.0 Inspection

4.1 Scope of Inspection for SWPPP

Contractor will designate a qualified person or persons to perform the following inspections:

- Disturbed areas and areas used for storage of materials that are exposed to precipitation will be inspected for evidence of, or the potential for, pollutants entering the drainage system.
- Erosion and sediment control measures identified in the plans will be observed to ensure that they are operating correctly.
- Where discharge locations or points are accessible, they will be inspected to ascertain whether erosion control measures are effective in preventing significant impacts to receiving waters.
- Locations where vehicles enter or exit the site will be inspected for evidence of offsite sediment tracking.
- Filter fabric and reinforced fabric barriers will be inspected, as required, for the depth of sedimentation, tears in fabric, failure of wire attachment to posts, and fence post movement.

The inspection will be conducted by the responsible person at least once every 14 calendar days and within 24 hours after a storm with precipitation of 0.5 inch or greater. The Contractor shall be responsible for installing a rain tube, or other suitable device, to measure rainfall at the site at his own expense.

After a portion of the site is finally stabilized, inspection will be conducted at least once every month.

4.2 Revisions to Plan

Based on the results of the inspection, the site description (Section 1) and control measures (Section 2) of this Pollution Prevention Plan (PPP) will be revised as appropriate, but in no case later than 7 calendar days following the inspection.

4.3 Inspection Reports

A report summarizing the scope of the inspection, name(s) and qualifications of personnel making the inspection, the date(s) of the inspection, major observations related to the implementation of the storm water pollution prevention plan, and actions taken in accordance with Item 4.2 above will be made and retained as part of the storm water pollution prevention plan for at least three years from the date that the site is finally stabilized. The report will be signed by the inspector in accordance with Part VI.6 of the General Permit.

After each inspection, the inspector will complete the applicable inspection form and provide a copy of each form to the Project Manager.

Copies of the forms to be used for the inspection and Maintenance Report are included in Appendix E of this Pollution Prevention Plan (PPP).

5.0 Non-Storm Water Discharges

5.1 Inventory for Pollution Prevention Plan

The following substances listed below are expected to be present onsite during construction:

Aggregate		
Concrete	Fuels	Paints
Detergents	Lubricants	Cleaning Solvents
Fertilizers	Wood	Steel Products

5.1.1 Authorized non-storm water discharges anticipated during the project:

- Water for vehicle washing or dust control.
- Irrigation drainage from watering vegetation.
- Pavement washwater (not from toxic or hazardous material spill areas).
- Potable water sources including water line flushings.

These effluents are to be controlled as required to minimize creation of sediment discharges to offsite drainage structures.

5.1.2 Water pumped from trenches during dewatering operations will be discharged to a system with control measures in place prior to the receiving stream (i.e. swale ditch with reinforced fabric barrier).

5.2 Spill Prevention

The following are the material management practices that will be used to reduce the risk of spills or other accidental exposure of the materials and substances described above to storm water runoff.

5.2.1 Good Housekeeping

The following good housekeeping practices will be followed onsite during the construction project.

- An effort will be made to store only enough product required to do the job.
- All materials stored onsite will be stored in a neat, orderly manner in their appropriate containers and, if possible, under a roof or other enclosure.
- Products will be kept in their original containers with the original manufacturer's label.
- Substances will not be mixed with one another unless recommended by the manufacturer.
- Wherever possible, all of a product will be used up before disposing of the container.
- Manufacturers' recommendations for proper use and disposal will be followed.
- The site superintendent will inspect daily to ensure proper use and disposal of material onsite.

5.2.2 Hazardous Products

These practices will be used to reduce the risks associated with hazardous materials, if hazardous materials are used.

- Products will be kept in original containers unless they are not resealable.
- Original labels and material safety data will be retained.
- If surplus product must be disposed of, manufacturers' or local and State recommended methods for proper disposal will be followed.

5.2.3 Product Specific Practices

The product specific practices to be followed are listed in Table 1 attached.

5.2.4 Spill Prevention Practices

The spill prevention practices to be followed are listed in Table 1 attached.

6.0 Construction Specifications

Special specifications are included in the Project Manual.

The following specifications and drawings are used to comply with the SWPPP requirements and are included in the Contract Documents:

Item No.	Description
01410	TPDES Requirements
01570	Storm Water Pollution Control
01576	Waste Material Disposal
01578	Control of Groundwater
02921	Hydromulch Seeding
02922	Sodding

Sheet No.	Drawing Name
358	Storm Water Pollution Prevention Plan General Notes (Sheet 1 of 6)
359	Storm Water Pollution Prevention Plan (Sheet 2 of 6)
360	Storm Water Pollution Prevention Plan (Sheet 3 of 6)
361	Storm Water Pollution Prevention Plan (Sheet 4 of 6)
362	Storm Water Pollution Prevention Plan (Sheet 5 of 6)
363	Storm Water Pollution Prevention Plan Details (Sheet 6 of 6)

7.0 Certifications

7.1 Sample certification forms required in the general permit.

Refer to Appendix B.

7.2 NOI Forms

Refer to Appendix C.

7.3 NOT Forms

Refer to Appendix D.

8.0 Inspections Forms

Refer to Appendix E.

TABLE 1. PRODUCT SPECIFIC PRACTICES

The following product specific practices will be followed on-site:	
Petroleum Products	All on-site vehicles will be monitored for leaks and receive regular preventative maintenance to reduce the chance of leakage. Petroleum products will be stored in tightly sealed containers which are clearly labeled. Any asphalt substances used on-site will be applied according to manufacturer's recommendations.
Fertilizers	Fertilizers used will be applied only in the minimum amounts recommended by the manufacturer. Once applied, fertilizer will be worked in the soil to limit exposure to storm water. Storage will be in a covered shed. The contents of any partially used bags of fertilizer will be transferred to a sealable plastic bag to avoid spills.
Paints	All containers will be tightly sealed and stored when not required for use. Excess paint will not be discharged to the storm sewer system but will be properly disposed of according to manufacturer's instructions.
Concrete Trucks	Concrete trucks will be allowed to wash out or discharge surplus concrete or drum wash water only at the designated site.

TABLE 2. SPILL PREVENTION PRACTICES

In addition to the good housekeeping and material management practices discussed in the previous sections of this plan, the following practices will be followed for spill prevention and cleanup:

- Manufacturer's recommended methods for spill cleanup will be clearly posted and site personnel will be made aware of the procedures and the location of the information and cleanup supplies.

- Materials and equipment necessary for spill cleanup will be kept in the material storage area on-site. Equipment and materials will include but not be limited to brooms, dust pans, mops, rags, gloves, goggles, kitty litter, sand, sawdust, and plastic and metal trash containers specifically for this purpose.

- All spills will be cleaned up immediately after discovery.

- The spill area will be kept well ventilated and personnel will wear appropriate protective clothing to prevent injury from contact with a hazardous substance.

- Spills of toxic or hazardous material will be reported to the appropriate state or local government agency, regardless of the site.

- The Spill Prevention Plan will be adjusted to include measures to prevent this type of spill from reoccurring and how to clean up the spill if there is another one. A description of the spill, what caused it, and the clean measures will also be included.

- The site superintendent responsible for the day-to-day site operations, will be the spill prevention and clean up coordinator. He will designate at least three other site personnel who will receive spill prevention and clean up training. These individuals will each become responsible for a particular phase of prevention and clean up. The names of responsible spill personnel will be posted in the material storage area and in the office trailer on-site.

APPENDIX A

CONSTRUCTION GENERAL PERMIT, EPA REGION 6, MARCH 5, 2003

LARGE CONSTRUCTION SITE NOTICE

FOR THE
Texas Commission on Environmental Quality (TCEQ)
Storm Water Program

TPDES GENERAL PERMIT TXR150000

"PRIMARY OPERATOR" NOTICE

This notice applies to construction sites operating under Part II.E.3. of the TPDES General Permit Number TXR150000 for discharges of storm water runoff from construction sites equal to or greater than five acres, including the larger common plan of development. The information on this notice is required in Part III.D.2. of the general permit. This notice shall be posted along with a copy of the signed Notice of Intent (NOI), as applicable. Additional information regarding the TCEQ storm water permit program may be found on the internet at:

http://www.tceq.state.tx.us/nav/permits/sw_permits.html

Site-Specific TPDES Authorization Number:	
Operator Name:	
Contact Name and Phone Number:	
Project Description: *Physical address or description of the site's location, and estimated start date and projected end date, or date that disturbed soils will be stabilized.*	
Location of Storm Water Pollution Prevention Plan:	

APPENDIX B

CERTIFICATION FORMS

(NOTE: COMPLETE PRIOR TO CONSTRUCTION)

OWNER (CITY OF HOUSTON) CERTIFICATION

Project Name and Location:

Project Name: GREENS ROAD PAVING AND DRAINAGE AND PAVING IMPROVEMENTS
WBS No.: N-000686-0002-4

Location: Hardy Toll Road to the north, US-59 North to the east, Sam Houston Tollway North to the south, and Aldine-Westfield Road to the west.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of that person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signed: _____
City of Houston Official

Date: _____

(NOTE: COMPLETE PRIOR TO CONSTRUCTION)

OPERATOR (GENERAL CONTRACTOR) CERTIFICATION

Project Name and Location:

Project Name:	GREENS ROAD PAVING AND DRAINAGE AND PAVING IMPROVEMENTS WBS No.: N-000686-0002-4
Location:	Hardy Toll Road to the north, US-59 North to the east, Sam Houston Tollway North to the south, and Aldine-Westfield Road to the west.

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of that person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

General Contractor:

_____
Company

_____
Name

_____
Title

_____
Signature

_____
Date

Responsible For:

_____

(NOTE: COMPLETE PRIOR TO CONSTRUCTION)

SUBCONTRACTOR CERTIFICATION

Project Name and Location:

Project Name: GREENS ROAD PAVING AND DRAINAGE AND PAVING IMPROVEMENTS
WBS No.: N-000686-0002-4

Location: Hardy Toll Road to the north, US-59 North to the east, Sam Houston Tollway North to the south, and Aldine-Westfield Road to the west.

I certify under penalty of law that I understand the terms and conditions of the General National Pollutant Discharge Elimination System (NPDES) Permit that authorizes the storm water discharges associated with the industrial activity from the construction site identified as part of this certification.

Subcontractor:

_____
Company

_____
Name

_____
Title

_____
Signature

_____
Date

Responsible For:

_____

Subcontractor:

_____
Company

_____
Name

_____
Title

_____
Signature

_____
Date

Responsible For:

_____

(NOTE: COMPLETE PRIOR TO CONSTRUCTION)

CONTRACTOR'S SWPPP INSPECTOR CERTIFICATION

Project Name and Location:

Project Name: GREENS ROAD PAVING AND DRAINAGE AND PAVING IMPROVEMENTS
WBS No.: N-000686-0002-4

Location: Hardy Toll Road to the north, US-59 North to the east, Sam Houston Tollway North to the south, and Aldine-Westfield Road to the west.

I certify under penalty of law that this document and all attachments were prepared under my direction of supervision in accordance with a system designed to assure that qualified personnel property gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

General Contractor's SWPPP Inspector:

_____
Company

_____
Name

_____
Title

_____
Signature

_____
Date

(This certification shall be signed by the General Contractor's SWPPP inspector and attached to each Inspection and Maintenance Report.)

PREPARER'S CERTIFICATION FOR THE

STORM WATER POLLUTION PREVENTION PLAN

Project Name and Location:

Project Name: GREENS ROAD PAVING AND DRAINAGE AND PAVING IMPROVEMENTS
WBS No.: N-000686-0002-4

Location: Hardy Toll Road to the north, US-59 North to the east, Sam Houston Tollway North to the south, and Aldine-Westfield Road to the west

I certify under penalty of law that this document and all attachments were prepared under my direction of supervision in accordance with a system designed to assure that qualified personnel property gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Storm Water Pollution Prevention Plan prepared by:

KIT Professionals, Inc.
Company

Keith R. Davis, P.E.
Name

Project Manager
Title

Keith R Davis
Signature

Date

Date Prepared: August, 2015

Latest Revision: _____

APPENDIX C

NOTICE OF INTENT (NOI) FORMS

TCEQ Office Use Only
Permit No.:
RN:
CN:
Region:

RESET FORM

TCEQ

Notice of Intent (NOI) for Stormwater Discharges Associated with Construction Activity under TPDES General Permit (TXR150000)

IMPORTANT:

- Use the INSTRUCTIONS to fill out each question in this form.
- Use the CHECKLIST to make certain all you filled out all required information. Incomplete applications **WILL** delay approval or result in automatic denial.
- Once processed your permit can be viewed at: http://www2.tceq.texas.gov/wq_dpa/index.cfm

ePERMITS: Sign up now for online NOI: https://www3.tceq.texas.gov/steers/index.cfm
Pay a $225 reduced application fee by using ePermits.

APPLICATION FEE:

- You must pay the **$325** Application Fee to TCEQ for the paper application to be complete.
- Payment and NOI must be mailed to separate addresses.
- Did you know you can pay on line?
  - Go to https://www3.tceq.texas.gov/epay/index.cfm
  - Select Fee Type: GENERAL PERMIT CONSTRUCTION STORM WATER DISCHARGE NOI APPLICATION
- **Provide your payment information below, for verification of payment:**

☐ Mailed Check/Money Order No.: _____
Name Printed on Check: _____
☐ EPAY Voucher No.: _____
Is the Payment Voucher copy attached? ☐ Yes

RENEWAL: Is this NOI a Renewal of an existing General Permit Authorization? (Note: A permit cannot be renewed after June 3, 2013.)

☐ Yes The Permit number is: TXR15_____
(If a permit number is not provided, a new number will be assigned.)
☐ No

1) OPERATOR (Applicant)

a) If the applicant is currently a customer with TCEQ, what is the Customer Number (CN) issued to this entity? You may search for your CN at: http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=cust.CustSearch

CN_____

b) What is the Legal Name of the entity (applicant) applying for this permit?

_____

(The legal name must be spelled exactly as filed with the Texas Secretary of State, County, or in the legal document forming the entity.)

c) What is the name and title of the person signing the application? The person must be an executive official meeting signatory requirements in TAC 305.44(a).
Prefix (Mr. Ms. Miss): _____
First/Last Name: _____ Suffix: _____
Title: _____ Credential: _____

d) What is the Operator Contact's (Responsible Authority) contact information and mailing address as recognized by the US Postal Service (USPS)? You may verify the address at: http://zip4.usps.com/zip4/welcome.jsp
Phone #: _____ ext: _____ Fax #: _____
E-mail: _____
Mailing Address: _____
Internal Routing (Mail Code, Etc.): _____
City: _____ State: _____ ZIP Code: _____
If outside USA: Territory: _____ Country Code: _____ Postal Code: _____

e) Indicate the type of Customer (The instructions will help determine your customer type):

- ☐ Individual
- ☐ Joint Venture
- ☐ Trust
- ☐ State Government
- ☐ Other Government
- ☐ Limited Partnership
- ☐ General Partnership
- ☐ Estate
- ☐ County Government
- ☐ Sole Proprietorship-DBA
- ☐ Corporation
- ☐ Federal Government
- ☐ City Government

f) Independent Operator? ☐ Yes ☐ No
(If governmental entity, subsidiary, or part of a larger corporation, check "No".)

g) Number of Employees:
☐ 0-20; ☐ 21-100; ☐ 101-250; ☐ 251-500; or ☐ 501 or higher

h) Customer Business Tax and Filing Numbers:
(REQUIRED for Corporations and Limited Partnerships. Not Required for Individuals, Government, or Sole Proprietors)
State Franchise Tax ID Number: _____
Federal Tax ID: _____
Texas Secretary of State Charter (filing) Number: _____
DUNS Number (if known): _____

2) APPLICATION CONTACT

If TCEQ needs additional information regarding this application, who should be contacted?

Is the application contact the same as the applicant identified above?

☐ Yes, go to Section 3). ☐ No, complete section below.

Prefix (Mr. Ms. Miss): _____
First/Last Name: _____ Suffix: _____
Title: _____ Credential: _____

Organization Name:_____
Phone No.:_____ ext:_____ Fax Number:_____
E-mail:_____
Mailing Address:_____
Internal Routing (Mail Code, Etc.):_____
City:_____State:_____ZIP Code:_____
Mailing Information if outside USA:
Territory:_____Country Code:_____Postal Code:_____

3) REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

If the site of your business is part of a larger business site or if other businesses were located at this site before yours, a Regulated Entity Number (RN) may already be assigned for the larger site. Use the RN assigned for the larger site. Search TCEQ's Central Registry to see if the larger site may already be registered as a regulated site at: http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=regent.RNSearch.

If the site is found, provide the assigned Regulated Entity Reference Number and provide the information for the site to be authorized through this application below. The site information for this authorization may vary from the larger site information.

a) TCEQ issued RE Reference Number (RN): RN_____

b) Name of project or site (the name known by the community where located):
_____

c) In your own words, briefly describe the primary business of the Regulated Entity: (Do not repeat the SIC and NAICS code):
_____

d) County (or counties if > 1) _____

e) Latitude:_____ Longitude: _____

f) Does the site have a physical address?
☐ Yes, complete Section A for a physical address.
☐ No, complete Section B for site location information.

Section A: Enter the physical address for the site.
Verify the address with USPS. If the address is not recognized as a delivery address, provide the address as identified for overnight mail delivery, 911 emergency or other online map tools to confirm an address.

Physical Address of Project or Site:
Street Number: _____ Street Name: _____
City: _____State: Texas ZIP Code: _____

Section B: Enter the site location information.
If no physical address (Street Number & Street Name), provide a written location access description to the site. (Ex.: located 2 miles west from intersection of Hwy 290 & IH35 accessible on Hwy 290 South)

City where the site is located or, if not in a city, what is the nearest city:

State: Texas ZIP Code where the site is located: _____

4) GENERAL CHARACTERISTICS

a) Is the project/site located on Indian Country Lands?

☐ Yes - If the answer is Yes, you must obtain authorization through EPA, Region 6.

☐ No

b) Is your construction activity associated with a facility that, when completed, would be associated with the exploration, development, or production of oil or gas or geothermal resources?

☐ Yes - If the answer is Yes, you may be under jurisdiction of the Railroad Commission of Texas and may need to obtain authorization through EPA, Region 6.

☐ No

c) What is the Primary Standard Industrial Classification (SIC) Code that best describes the construction activity being conducted at the site?
Primary SIC Code: _____

d) If applicable, what is the Secondary SIC Code(s): _____

e) What is the total number of acres disturbed? _____

f) Is the project site part of a larger common plan of development or sale?

☐ Yes - If the answer is Yes, the total number of acres disturbed can be less than 5 acres.

☐ No - If the answer is No, the total number of acres disturbed must be 5 or more. If the total number of acres disturbed is less than 5 then the project site does not qualify for coverage through this Notice of Intent. Coverage will be denied. See the requirements in the general permit for small construction sites.

g) What is the name of the first water body(s) to receive the stormwater runoff or potential runoff from the site?

_____

h) What is the segment number(s) of the classified water body(s) that the discharge will eventually reach?

_____

i) Is the discharge into an MS4?

☐ Yes - If the answer is Yes, provide the name of the MS4 operator below.

☐ No

If Yes, provide the name of the MS4 operator:

_____

Note: The general permit requires you to send a copy of the NOI to the MS4 operator.

j) Are any of the surface water bodies receiving discharges from the construction site on the latest EPA-approved CWA 303(d) List of impaired waters?

☐ Yes - If the answer is Yes, provide the name(s) of the impaired water body(s) below.

☐ No

If Yes, provide the name(s) of the impaired water body(s):

_____

k) Is the discharge or potential discharge within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer as defined in 30 TAC Chapter 213?

☐ Yes - If the answer is Yes, complete certification below by checking "Yes."

☐ No

I certify that a copy of the TCEQ approved Plan required by the Edwards Aquifer Rule (30 TAC Chapter 213) is either included or referenced in the Stormwater Pollution Prevention Plan.

☐ Yes

5) CERTIFICATION

Check Yes to the certifications below. Failure to indicate Yes to ***ALL*** items may result in denial of coverage under the general permit.

a) I certify that I have obtained a copy and understand the terms and conditions of the Construction General Permit (TXR150000). ☐ Yes

b) I certify that the full legal name of the entity applying for this permit has been provided and is legally authorized to do business in Texas. ☐ Yes

c) I understand that a Notice of Termination (NOT) must be submitted when this authorization is no longer needed. ☐ Yes

d) I certify that a Stormwater Pollution Prevention Plan has been developed, will be implemented prior to construction and to the best of my knowledge and belief is compliant with any applicable local sediment and erosion control plans, as required in the general permit TXR150000. Note: For multiple operators who prepare a shared SWP3, the confirmation of an operator may be limited to its obligations under the SWP3 provided all obligations are confirmed by at least one operator. ☐ Yes

Operator Certification:

I,_____ _____

Typed or printed name Title

certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under 30 Texas Administrative Code 305.44 to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature: _____ Date:_____

(Use blue ink)

NOTICE OF INTENT CHECKLIST (TXR150000)

- Did you complete everything? Use this checklist to be sure!
- Are you ready to mail your form to TCEQ? Go to the General Information Section of the Instructions for mailing addresses.

This checklist is for use by the operator to ensure a complete application. Missing information may result in denial of coverage under the general permit. (See NOI process description in the Instructions)

Application Fee:

If paying by Check:

- ☐ Check was mailed **separately** to the TCEQs Cashier's Office. (See Instructions for Cashier's address and Application address.)
- ☐ Check number and name on check is provided in this application.

If using ePay:

- ☐ The voucher number is provided in this application or a copy of the voucher is attached.

PERMIT NUMBER:

- ☐ Permit number provided – if this application is for renewal of an existing authorization.

OPERATOR INFORMATION - Confirm each item is complete:

- ☐ Customer Number (CN) issued by TCEQ Central Registry
- ☐ Legal name as filed to do business in Texas (Call TX SOS 512/463-5555)
- ☐ Name and title of responsible authority signing the application
- ☐ Mailing address is complete & verifiable with USPS. www.usps.com
- ☐ Phone numbers/e-mail address
- ☐ Type of operator (entity type)
- ☐ Independent operator
- ☐ Number of employees
- ☐ For corporations or limited partnerships – Tax ID and SOS filing numbers
- ☐ Application contact and address is complete & verifiable with USPS. http://www.usps.com

REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE - Confirm each item is complete:

- ☐ Regulated Entity Reference Number (RN) (if site is already regulated by TCEQ)
- ☐ Site/project name/regulated entity
- ☐ Latitude and longitude http://www.tceq.texas.gov/gis/sqmaview.html
- ☐ County
- ☐ Site/project physical address. Do not use a rural route or post office box.
- ☐ Business description

GENERAL CHARACTERISTICS - Confirm each item is complete:

- ☐ Indian Country Lands –the facility is not on Indian Country Lands
- ☐ Construction activity related to facility associated to oil, gas, or geothermal resources
- ☐ Standard Industrial Classification (SIC) Code www.osha.gov/oshstats/sicser.html
- ☐ Acres disturbed is provided and qualifies for coverage through a NOI
- ☐ Common plan of development or sale
- ☐ Receiving water body(s)
- ☐ Segment number(s)
- ☐ Impaired water body(s)
- ☐ MS4 operator
- ☐ Edwards Aquifer rule

CERTIFICATION

- ☐ Certification statements have been checked indicating "Yes"
- ☐ Signature meets 30 Texas Administrative Code (TAC) 305.44 and is original.

Notice of Intent (NOI) for Stormwater Discharges Associated with Construction Activity under TPDES General Permit (TXR150000)

General Information and Instructions

GENERAL INFORMATION

Where to Send the Notice of Intent (NOI):

BY REGULAR U.S. MAIL
Texas Commission on
Environmental Quality
Stormwater Processing Center
(MC228)
P.O. Box 13087
Austin, Texas 78711-3087

BY OVERNIGHT/EXPRESS MAIL
Texas Commission on
Environmental Quality
Stormwater Processing Center
(MC228)
12100 Park 35 Circle
Austin, TX 78753

TCEQ Contact List:

Application – status and form questions:	*512/239-3700, swpermit@tceq.texas.gov*
Technical questions:	*512/239-4671, swgp@tceq.texas.gov*
Environmental Law Division:	*512/239-0600*
Records Management - obtain copies of forms:	*512/239-0900*
Reports from databases (as available):	*512/239-DATA (3282)*
Cashier's office:	*512/239-0357 or 512/239-0187*

Notice of Intent Process:

When your NOI is received by the program, the form will be processed as follows:

1) **Administrative Review:** Each item on the form will be reviewed for a complete response. In addition, the operator's legal name must be verified with Texas Secretary of State as valid and active (if applicable). The address(s) on the form must be verified with the US Postal service as receiving regular mail delivery. Never give an overnight/express mailing address.

2) **Notice of Deficiency:** If an item is incomplete or not verifiable as indicated above, a notice of deficiency (NOD) will be mailed to the operator. The operator will have 30 days to respond to the NOD. The response will be reviewed for completeness.

3) **Acknowledgment of Coverage:** An Acknowledgment Certificate will be mailed to the operator. This certificate acknowledges coverage under the general permit.
   -or-
   Denial of Coverage: If the operator fails to respond to the NOD or the response is inadequate, coverage under the general permit may be denied. If coverage is denied, the operator will be notified.

General Permit (Your Permit)

For NOIs submitted **electronically** through ePermits, provisional coverage under the general permit begins immediately following confirmation of receipt of the NOI form by the TCEQ.

For **paper** NOIs, provisional coverage under the general permit begins **7 days after a completed NOI is postmarked for delivery** to the TCEQ.

You should have a copy of your general permit when submitting your application. You may view and print your permit for which you are seeking coverage, on the TCEQ web site http://www.tceq.texas.gov. Search using key word TXR150000.

General Permit Forms

The Notice of Intent (NOI), Notice of Termination (NOT), and Notice of Change (NOC) (including instructions) are available in Adobe Acrobat PDF format on the TCEQ web site http://www.tceq.texas.gov.

Change in Operator

An authorization under the general permit is not transferable. If the operator of the regulated entity changes, the present permittee must submit a Notice of Termination and the new operator must submit a Notice of Intent. The NOT and NOI must be submitted no later than 10 days prior to the change in Operator status.

TCEQ Central Registry Core Data Form

The Core Data Form has been incorporated into this form. Do not send a Core Data Form to TCEQ. After final acknowledgment of coverage under the general permit, the program will assign a Customer Number and Regulated Entity Number.

You can find the information on the Central Registry web site at http://www12.tceq.texas.gov/crpub/index.cfm. You can search by the Regulated Entity (RN), Customer Number (CN) or Name (Permittee), or by your permit number under the search field labeled "Additional ID". Capitalize all letters in the permit number.

The Customer (Permittee) is responsible for providing consistent information to the TCEQ, and for updating all CN and RN data for all authorizations as changes occur. For General Permits, a Notice of Change form must be submitted to the program area.

Fees associated with a General Permit

Payment of the fee may be made by check or money order, payable to TCEQ, or through EPAY (electronic payment through the web).

Application Fee: This fee is required to be paid at the time the NOI is submitted. Failure to submit payment at the time the application is filed will cause delays in acknowledgment or denial of coverage under the general permit.

Mailed Payments:

Payment must be mailed under separate cover at one of the addresses below using the attached Application Fee submittal form. (DO NOT SEND A COPY OF THE NOI WITH THE APPLICATION FEE SUBMITTAL FORM)

BY REGULAR U.S. MAIL
Texas Commission on Environmental Quality
Financial Administration Division
Cashier's Office, MC-214
P.O. Box 13088
Austin, TX 78711-3088

BY OVERNIGHT/EXPRESS MAIL
Texas Commission on Environmental Quality
Financial Administration Division
Cashier's Office, MC-214
12100 Park 35 Circle
Austin, TX 78753

ePAY Electronic Payment: http://www.tceq.texas.gov/epay

When making the payment you must select Water Quality, and then select the fee category "General Permit Construction Storm Water Discharge NOI Application". You must include a copy of the payment voucher with your NOI. Your NOI will not be considered complete without the payment voucher.

INSTRUCTIONS FOR FILLING OUT THE NOI FORM

Renewal of General Permit. Dischargers holding active authorizations under the expired General Permit are required to submit a NOI to continue coverage. The existing permit number is required. If the permit number is not provided or has been terminated, expired, or denied a new permit number will be issued.

1. Operator (Applicant)

a) Enter assigned Customer Number (CN)
TCEQ's Central Registry will assign each customer a number that begins with CN, followed by nine digits. **This is not a permit number, registration number, or license number.**
If this customer has not been assigned a CN, leave the space for the CN blank.
If this customer has already been assigned this number, enter the permittee's CN.

b) Legal Name
Provide the current legal name of the permittee, as authorized to do business in Texas. The name must be provided exactly as filed with the Texas Secretary of State (SOS), or on other legal documents forming the entity, that is filed in the county where doing business. You may contact the SOS at 512/463-5555, for more information related to filing in Texas. If filed in the county where doing business, provide a copy of the legal documents showing the legal name.

c) Person Signing Application
Provide information about person signing section 5) Certification.

d) Operator Contact's (Responsible Authority) Contact Information and Mailing Address
Provide a complete mailing address for receiving mail from the TCEQ. The address must be verifiable with the US Postal Service at http://www.usps.com for regular mail delivery (not overnight express mail). If you find that the address is not verifiable using the USPS web search, please indicate the address is used by the USPS for regular mail delivery.

The area code and phone number should provide contact to the operator. Leave Extension blank if not applicable.

The fax number and e-mail address are optional and should correspond to the operator.

e) Type of Customer (Entity Type)
Check only one box that identifies the type of entity. Use the descriptions below to identify the appropriate entity type. Note that the selected entity type also indicates the name that must be provided as an applicant for a permit, registration or authorization.

Sole Proprietorship – DBA

A sole proprietorship is a customer that is owned by only one person and has not been incorporated. This business may:

- be under the person's name
- have its own name (doing business as or d.b.a.)
- have any number of employees

If the customer is a Sole Proprietorship or DBA, the 'legal name' of the individual business 'owner' must be provided. The DBA name is not recognized as the 'legal name' of the entity. The DBA name may be used for the site name (regulated entity).

Individual

An individual is a customer who has not established a business, but conducts an activity that needs to be regulated by the TCEQ.

Partnership

- A customer that is established as a partnership as defined by the Texas Secretary of State Office (TX SOS). A Limited Partnership or Limited Liability Partnership (Partnership) is required to file with the Texas Secretary of State. A General Partnership or Joint Venture is not required to register with the state.
- **Partnership (Limited Partnership or Limited Liability Partnership):** A limited partnership is defined in the Act as a partnership formed by two or more persons under the provisions of Section 3 of the Uniform Limited Partnership Act (Art. 6132a, Revised Civil Statutes of Texas) and having as members one or more general partners and one or more limited partners. The limited partners as such are not bound by the obligations of the partnership. Limited partners may not take part in the day-to-day operations of the business. A Limited Partnership must file with the Texas Secretary of State. A registered limited liability partnership is a general or limited partnership that is registered with the Texas Secretary of State. The partnership's name must contain the words "Registered Limited Liability Partnership" or the abbreviation "L.L.P." as the last words or letters of its name.
- **General Partnership:** A general partner may or may not invest, participates in running the partnership and is liable for all acts and debts of the partnership and any member of it. A General Partnership does not have limited partners. For a General Partnership, there is no registration with the state or even written agreement necessary for a general partnership to be formed. The legal definition of a partnership is generally stated as "an association of two or more persons to carry on as co-owners a business for profit" (Revised Uniform Partnership Act § 101 [1994]).
- **Joint Venture:** A joint venture is but another name for a special partnership. It might be distinguished from a general partnership in that the latter is formed for the transaction of a general business, while a joint venture is usually limited to a single transaction. That is, a joint venture is a special combination of persons in the nature of a partnership engaged in the joint prosecution of a particular transaction for mutual benefit or profit.

Corporation

A customer meets all of these conditions:

- is a legally incorporated entity under the laws of any state or country
- is recognized as a corporation by the Texas Secretary of State

- has proper operating authority to operate in Texas.
- The corporation's 'legal name' as filed with the Texas Secretary of State must be provided as applicant. An 'assumed' name of a corporation is not recognized as the 'legal name' of the entity.

Government

Federal, state, county, or city government (as appropriate)
The customer is either an agency of one of these levels of government or the governmental body itself. The government agency's 'legal name' must be provided as the applicant. A department name or other description of the organization should not be included as a part of the 'legal name' as applicant.

Trust or Estate

A trust and an estate are fiduciary relationships governing the trustee/executor with respect to the trust/estate property.

Other Government

A utility district, water district, tribal government, college district, council of governments, or river authority. Write in the specific type of government.

f) Independent Entity

Check No if this customer is a subsidiary, part of a larger company, or is a governmental entity. Otherwise, check Yes.

g) Number of Employees

Check one box to show the number of employees for this customer's entire company, at all locations. This is not necessarily the number of employees at the site named in the application.

h) Customer Business Tax and Filing Numbers

These are required for Corporations and Limited Partnerships. These are not required for Individuals, Government, and Sole Proprietors.

State Franchise Tax ID Number

Corporations and limited liability companies that operate in Texas are issued a franchise tax identification number. If this customer is a corporation or limited liability company, enter this number here.

Federal Tax ID

All businesses, except for some small sole proprietors, individuals, or general partnerships should have a federal taxpayer identification number (TIN). Enter this number here. Use no prefixes, dashes, or hyphens. Sole proprietors, individuals, or general partnerships do not need to provide a federal tax ID.

TX SOS Charter (filing) Number

Corporations and Limited Partnerships required to register with the Texas Secretary of State are issued a charter or filing number. You may obtain further information by calling SOS at 512/463-5555.

DUNS Number

Most businesses have a DUNS (Data Universal Numbering System) number issued by Dun and Bradstreet Corp. If this customer has one, enter it here.

2. APPLICATION CONTACT

Provide the name, title and communication information of the person that TCEQ can contact for additional information regarding this application.

3. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

a) Regulated Entity Reference Number (RN)

A number issued by TCEQ's Central Registry to sites (a location where a regulated activity occurs) regulated by TCEQ. This is not a permit number, registration number, or license number. If this regulated entity has not been assigned an RN, leave this space blank.

If the site of your business is part of a larger business site, a Regulated Entity Number (RN) may already be assigned for the larger site. Use the RN assigned for the larger site. Search TCEQ's Central Registry to see if the larger site may already be registered as a regulated site at: http://www12.tceq.texas.gov/crpub/index.cfm?fuseaction=regent.RNSearch

If the site is found, provide the assigned Regulated Entity Reference Number (RN) and provide the information for the site to be authorized through this application. The site information for this authorization may vary from the larger site information.

An example is a chemical plant where a unit is owned or operated by a separate corporation that is accessible by the same physical address of your unit or facility. Other examples include industrial parks identified by one common address but different corporations have control of defined areas within the site. In both cases, an RN would be assigned for the physical address location and the permitted sites would be identified separately under the same RN.

b) Site/Project Name/Regulated Entity

Provide the name of the site as known by the public in the area where the site is located. The name you provide on this application will be used in the TCEQ Central Registry as the Regulated Entity name.

c) Description of Activity Regulated

In your own words, briefly describe the primary business that you are doing that requires this authorization. Do not repeat the SIC Code description.

d) County

Identify the county or counties in which the regulated entity is located.

e) Latitude and Longitude

Enter the latitude and longitude of the site in degrees, minutes, and seconds or decimal form. For help obtaining the latitude and longitude, go to: http://www.tceq.texas.gov/gis/sqmaview.html or http://nationalmap.gov/ustopo

f) Site/Project (RE) Physical Address/Location Information

Enter the complete address for the site in Section A if the address can be validated through the US Postal Service. If the physical address is not recognized as a USPS delivery address, you may need to validate the address with your local police (911 service) or through an online map site used to locate a site. Please confirm this to be a complete and valid address. Do not use a rural route or post office box for a site location.

If a site does not have an address that includes a street (or house) number and street name, enter NO ADDRESS for the street name in Section A. In Section B provide a complete written location description. For example: "The site is located 2 miles west from intersection of Hwy 290 & IH35, located on the southwest corner of the Hwy 290 South bound lane." Provide the city (or nearest city) and zip code of the facility location.

4. GENERAL CHARACTERISTICS

a) Indian Country Lands

If your site is located on Indian Country Lands, the TCEQ does not have authority to process your application. You must obtain authorization through EPA, Region 6, Dallas. Do not submit this form to TCEQ.

b) Construction activity associated with facility associated with exploration, development, or production of oil, gas, or geothermal resources

If your activity is associated with oil and gas exploration, development, or production, you may be under jurisdiction of the Railroad Commission of Texas and may need to obtain authorization from EPA Region 6. For more information, see:
http://info.sos.state.tx.us/pls/pub/readtac$ext.TacPage?sl=R&app=9&p_dir=&p_rloc=&p_tloc=&p_ploc=&pg=1&p_tac=&ti=16&pt=1&ch=3&rl=30

Construction activities associated with a facility related to oil, gas or geothermal resources may include the construction of a well site; treatment or storage facility; underground hydrocarbon or natural gas storage facility; reclamation plant; gas processing facility; compressor station; terminal facility where crude oil is stored prior to refining and at which refined products are stored solely for use at the facility; a carbon dioxide geologic storage facility; and a gathering, transmission, or distribution pipeline that will transport crude oil or natural gas, including natural gas liquids, prior to refining of such oil or the use of the natural gas in any manufacturing process or as a residential or industrial fuel.

Where required by federal law, discharges of stormwater associated with construction activities under the Railroad Commission's jurisdiction must be authorized by the EPA and the Railroad Commission of Texas, as applicable. Activities under Railroad Commission of Texas jurisdiction include construction of a facility that, when completed, would be associated with the exploration, development, or production of oil or gas or geothermal resources, such as a well site; treatment or storage facility; underground hydrocarbon or natural gas storage facility; reclamation plant; gas processing facility; compressor station; terminal facility where crude oil is stored prior to refining and at which refined products are stored solely for use at the facility; a carbon dioxide geologic storage facility under the jurisdiction of the Railroad Commission of Texas; and a gathering, transmission, or distribution pipeline that will transport crude oil or natural gas, including natural gas liquids, prior to refining of such oil or the use of the natural gas in any manufacturing process or as a residential or industrial fuel. The Railroad Commission of Texas also has jurisdiction over stormwater from land disturbance associated with a site survey that is conducted prior to construction of a facility that would be regulated by the Railroad Commission of Texas. Under 33 U.S.C. §1342(l)(2) and §1362(24), EPA cannot require a permit for discharges of stormwater from "field activities or operations associated with {oil and gas} exploration, production, processing, or treatment operations, or transmission facilities, including activities necessary to prepare a site for drilling and for the movement and placement of drilling equipment, whether or not such field activities or operations may be considered to be construction activities" unless the discharge is contaminated by contact with any overburden, raw material, intermediate product, finished product, byproduct, or waste product located on the site of the facility. Under §3.8 of this title (relating to Water Protection), the Railroad

Commission of Texas prohibits operators from causing or allowing pollution of surface or subsurface water. Operators are encouraged to implement and maintain best management practices (BMPs) to minimize discharges of pollutants, including sediment, in stormwater during construction activities to help ensure protection of surface water quality during storm events.

c) Primary Standard Industrial Classification (SIC) Code
Provide the SIC Code that best describes the construction activity being conducted at this site.

Common SIC Codes related to construction activities include:

- 1521 - Construction of Single Family Homes
- 1522 - Construction of Residential Bldgs. Other than Single Family Homes
- 1541 - Construction of Industrial Bldgs. and Warehouses
- 1542 - Construction of Non-residential Bldgs, other than Industrial Bldgs. and Warehouses
- 1611 - Highway and Street Construction, except Highway Construction
- 1622 - Bridge, Tunnel, and Elevated Highway Construction
- 1623 - Water, Sewer, Pipeline and Communications, and Power Line Construction

For help with SIC Codes, go to:
http://www.osha.gov/pls/imis/sicsearch.html

d) Secondary SIC Code
Secondary SIC Code(s) may be provided. Leave blank if not applicable. For help with SIC Codes, go to:
http://www.osha.gov/pls/imis/sicsearch.html

e) Total Number of Acres Disturbed
Provide the approximate number of acres that the construction site will disturb. Construction activities that disturb less than one acre, unless they are part of a larger common plan that disturbs more than one acre, do not require permit coverage. Construction activities that disturb between one and five acres, unless they are part of a common plan that disturbs more than five acres, do not require submission of an NOI. Therefore, the estimated area of land disturbed should not be less than five, unless the project is part of a larger common plan that disturbs five or more acres. Disturbed means any clearing, grading, excavating, or other similar activities.

If you have any questions about this item, please contact the stormwater technical staff by phone at (512)239-4671 or by email at swgp@tceq.texas.gov.

f) Common Plan of Development
Construction activities that disturb less than five acres do not require submission of an NOI unless they are part of a common plan of development or for sale where the area disturbed is five or more acres. Therefore, the estimated area of land disturbed should not be less than five, unless the project is part of a larger common plan that disturbs five or more acres. Disturbed means any clearing, grading, excavating, or other similar activities.

For more information on "What is a common plan of development?" go to:
www.tceq.texas.gov/permitting/stormwater/common_plan_of_development_steps.html

For further information, go to the TCEQ stormwater construction webpage at:
www.tceq.texas.gov/goto/construction and search for "Additional Guidance and Quick Links". If

you have any further questions about this item, please call the stormwater technical staff at (512)239-4671.

g) Identify the water body(s) receiving stormwater runoff
The stormwater may be discharged directly to a receiving stream or through a MS4 from your site. It eventually reaches a receiving water body such as a local stream or lake, possibly via a drainage ditch. You must provide the name of the water body that receives the discharge from the site (a local stream or lake).

If your site has more than one outfall you need to include the name of the first water body for each outfall, if they are different.

h) Identify the segment number(s) of the classified water body(s)
Identify the classified segment number(s) receiving a discharge directly or indirectly. Go to the following link to find the segment number of the classified water body where stormwater will flow from the site: www.tceq.texas.gov/waterquality/monitoring/viewer.html

You may also find the segment number in TCEQ publication GI-316:
www.tceq.texas.gov/publications/gi/gi-316

If the discharge is into an unclassified receiving water and then crosses state lines prior to entering a classified segment, select the appropriate watershed:

- 0100 (Canadian River Basin)
- 0200 (Red River Basin)
- 0300 (Sulfur River Basin)
- 0400 (Cypress Creek Basin)
- 0500 (Sabine River Basin)

Call the Water Quality Assessments section at (512)239-4671 for further assistance.

i) Discharge into MS4 – Identify the MS4 Operator
The discharge may initially be into a municipal separate storm sewer system (MS4). If the stormwater discharge is into an MS4, provide the name of the entity that operates the MS4 where the stormwater discharges. An MS4 operator is often a city, town, county, or utility district, but possibly can be another form of government. Please note that the Construction General Permit requires the Operator to supply the MS4 with a copy of the NOI submitted to TCEQ. For assistance, you may call the technical staff at (512)239-4671.

j) Surface Water bodies on list of impaired waters – Identify the impaired water body(s)
Indicate Yes or No if any surface water bodies receiving discharges from the construction site are on the latest EPA-approved CWA 303(d) List of impaired waters. Provide the name(s) of surface water bodies receiving discharges or potential discharges from the construction site that are on the latest EPA-approved CWA 303(d) List of impaired waters. The EPA-approved CWA 303(d) List of impaired waters in Texas can be found at:
www.tceq.texas.gov/waterquality/assessment/305_303.html

NOTE: Do not use any "draft" documents.

k) Discharges to the Edwards Aquifer Recharge Zone and Certification

See maps on the TCEQ website to determine if the site is located within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer at: www.tceq.texas.gov/field/eapp/viewer.html

If the discharge or potential discharge is within the Recharge Zone, Contributing Zone, or Contributing Zone within the Transition Zone of the Edwards Aquifer, a site specific authorization approved by the Executive Director under the Edwards Aquifer Protection Program (30 TAC Chapter 213) is required before construction can begin. The certification must be answered "Yes" for coverage under the Construction General Permit. The TCEQ approved plan must be readily available for TCEQ staff to review at the time that the NOI is submitted.

The general permit requires the approved Contributing Zone Plan or Water Pollution Abatement Plan to be included or referenced as a part of the Stormwater Pollution Prevention Plan.

For questions regarding the Edwards Aquifer Protection Program, contact the appropriate TCEQ Regional Office. For projects in Hays, Travis and Williamson Counties: Austin Regional Office, 12100 Park 35 Circle, Austin, TX 78753, 512-339-2929. For Projects in Bexar, Comal, Kinney, Medina and Uvalde Counties: TCEQ San Antonio Regional Office, 14250 Judson Rd., San Antonio, TX 78233-4480, 210-490-3096.

5. CERTIFICATIONS

Failure to indicate **Yes** to ALL of the certification items may result in denial of coverage under the general permit.

a) Certification of Understanding the Terms and Conditions of Construction General Permit (TXR150000)

Provisional coverage under the Construction General Permit (TXR150000) begins 7 days after the completed paper NOI is postmarked for delivery to the TCEQ. (Electronic applications submitted through ePermits have immediate provisional coverage). You must obtain a copy and read the Construction General Permit before submitting your application. You may view and print the Construction General Permit for which you are seeking coverage at the TCEQ web site: www.tceq.texas.gov/goto/construction

b) Certification of Legal Name

The full legal name of the applicant as authorized to do business in Texas is required. The name must be provided exactly as filed with the Texas Secretary of State (SOS), or on other legal documents forming the entity, that is filed in the county where doing business. You may contact the SOS at (512)463 5555, for more information related to filing in Texas.

c) Understanding of Notice of Termination

A permittee shall terminate coverage under this Construction General Permit through the submittal of a NOT when the operator of the facility changes, final stabilization has been reached, the discharge becomes authorized under an individual permit, or the construction activity never began at this site.

d) Certification of Stormwater Pollution Prevention Plan

The SWP3 identifies the areas and activities that could produce contaminated runoff at your site and then tells how you will ensure that this contamination is mitigated. For example, in describing your mitigation measures, your site's plan might identify the devices that collect and

filter stormwater, tell how those devices are to be maintained, and tell how frequently that maintenance is to be carried out. You must develop this plan in accordance with the TCEQ general permit requirements. This plan must be developed and implemented before you complete this NOI. The SWP3 must be available for a TCEQ investigator to review on request.

Operator Certification:

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code (TAC) §305.44.

IF YOU ARE A CORPORATION:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(1) (see below). According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

IF YOU ARE A MUNICIPALITY OR OTHER GOVERNMENT ENTITY:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(3) (see below). According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statute(s) under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to §305.44(a)(3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer may be requested by the TCEQ.

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the Texas Commission on Environmental Quality's Environmental Law Division at (512)239-0600.

30 Texas Administrative Code
§305.44. Signatories to Applications

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding $25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

Texas Commission on Environmental Quality
General Permit Payment Submittal Form

Use this form to submit your Application Fee only if you are mailing your payment.

- Complete items 1 through 5 below:
- Staple your check in the space provided at the bottom of this document.
- Do not mail this form with your NOI form.
- Do not mail this form to the same address as your NOI.

Mail this form and your check to:

BY REGULAR U.S. MAIL

Texas Commission on Environmental Quality
Financial Administration Division
Cashier's Office, MC-214
P.O. Box 13088
Austin, TX 78711-3088

BY OVERNIGHT/EXPRESS MAIL

Texas Commission on Environmental Quality
Financial Administration Division
Cashier's Office, MC-214
12100 Park 35 Circle
Austin, TX 78753

Fee Code: GPA	General Permit: TXR150000

1. Check / Money Order No: _____
2. Amount of Check/Money Order: _____
3. Date of Check or Money Order: _____
4. Name on Check or Money Order: _____
5. NOI INFORMATION

   If the check is for more than one NOI, list each Project/Site (RE) Name and Physical Address exactly as provided on the NOI. DO NOT SUBMIT A COPY OF THE NOI WITH THIS FORM AS IT COULD CAUSE DUPLICATE PERMIT ENTRIES.

   See Attached List of Sites (If more space is needed, you may attach a list.)

   Project/Site (RE) Name: _____

   Project/Site (RE) Physical Address:

   _____

Staple Check in This Space

APPENDIX D

NOTICE OF TERMINATION (NOT) FORMS

Notice of Termination (NOT) for Authorizations under TPDES General Permit TXR150000

TCEQ Office Use Only
Permit No.:
RN:
CN:

Reset Form

Sign up now for on line NOT at https://www6.tceq.texas.gov/steers/
Get your NOT Confirmation letter immediately after submitting the on line NOT form.

What is the permit number to be terminated?
Processing will be delayed without the permit number. TXR15_____

A. OPERATOR (applicant)

1. What is the Customer Number (CN) issued to this entity? **CN**
2. What is the full Legal Name of the current permittee?

This must be the current permittee of the permit to be terminated.

3. What is the applicant's mailing address as recognized by the **US Postal Service**?

Address:	Suite No./Bldg. No./Mail Code:	
City:	State:	ZIP Code:
Country Mailing Information (if outside USA).	Country Code:	Postal Code:

4. Phone No.: ( )	Extension:
5. Fax No.: ( )	E-mail Address:

B. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

1. What is the TCEQ Issued RE Reference Number (RN)? **RN**
2. Name of Project or Site as currently permitted):

(Example: phase and name of subdivision or name of project that's unique to the site)

3. Physical Address of Project or Site as currently permitted: (enter in spaces below)

Street Number:	Street Name:	
City:	ZIP Code:	County (Counties if >1):

4. If no physical address (Street Number & Street Name), provide the written location access description to the site:

C. REASON FOR TERMINATION

Check the reason for termination:

- ☐ Final stabilization has been achieved on all portions of the site that are the responsibility of the Operator and all silt fences and other temporary erosion controls have either been removed, or scheduled for removal as defined in the SWP3.
- ☐ Another permitted Operator has assumed control over all areas of the site that have not been finally stabilized, and temporary erosion controls that have been defined in the SWP3 have been transferred to the new Operator.
- ☐ The activity is now authorized under an alternate TPDES permit.
- ☐ The activity never began at this site that is regulated under the general permit.

D. CERTIFICATION

I, _____ _____
Typed or printed name Title

certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

I further certify that I am authorized under **30 Texas Administrative Code §305.44** to sign and submit this document, and can provide documentation in proof of such authorization upon request.

Signature:_____ Date:_____
(Use blue ink)

Notice of Termination (NOT) for Authorizations under TPDES General Permit TXR150000 General Information and Instructions

GENERAL INFORMATION

Where to Send the Notice of Intent (NOI):

BY REGULAR U.S. MAIL
Texas Commission on Environmental Quality
Stormwater Processing Center (MC228)
P.O. Box 13087
Austin, TX 78711-3087

BY OVERNIGHT/EXPRESS MAIL
Texas Commission on Environmental Quality
Stormwater Processing Center (MC228)
12100 Park 35 Circle
Austin, TX 78753

TCEQ Contact list:

Application Processing Questions relating to the status and form requirements:	512/239-3700 or swpermit@tceq.texas.gov
Technical Questions relating to the general permit:	512/239-4671
Environmental Law Division:	512/239-0600
Records Management for obtaining copies of forms submitted to TCEQ:	512/239-0900
Information Services for obtaining reports from program data bases (as available):	512/239-DATA (3282)
Financial Administration's Cashier's office:	512/239-0357 or 512/239-0187

Notice of Termination Process:

A Notice of Termination is **effective on the date postmarked for delivery to TCEQ**.
When your NOT is received by the program, the form will be processed as follows:

1. **Administrative Review:** The form will be reviewed to confirm the following:
   - the permit number is provided
   - the permit is active and has been approved
   - the entity terminating the permit is the current permittee
   - the site information matches the original permit record
   - the form has the required original signature with title and date

2. **Notice of Deficiency:** If an item is incomplete or not verifiable as indicated above, a phone call will be made to the applicant to clear the deficiency. A letter will not be sent to the permittee if unable to process the form.

3. **Confirmation of Termination:** A Notice of Termination Confirmation letter will be mailed to the operator.

General Permit (Your Permit)
Coverage under the general permit begins **48 hours after a completed NOI is postmarked for delivery to** the TCEQ. You should have a copy of your general permit when submitting your application. You may view and print your permit for which you are seeking coverage, on the TCEQ web site www.tceq.texas.gov

General Permit Forms
The Notice of Intent (NOI), Notice of Termination (NOT), and Notice of Change (NOC) with instructions are available in Adobe Acrobat PDF format on the TCEQ web site www.tceq.texas.gov.

Change in Operator
An authorization under the general permit is not transferable. If the operator or owner of the regulated entity changes, the present permittee must submit a Notice of Termination and the new operator must submit a Notice of Intent. The NOT and NOI must be submitted not later than 10 days prior to the change in Operator status.

TCEQ Central Registry Core Data Form
The Core Data Form has been incorporated into this form. **Do not send a core data form to TCEQ.**

After final acknowledgment of coverage under the general permit, the program will assign a Customer Number (CN) and Regulated Entity Number (RN). For Construction Permits, a new RN will be assigned for each Notice of Intent filed with TCEQ, since construction project sites can overlap with other Customers. The RN assigned to your construction project will not be assigned to any other TCEQ authorization.

You can find the information on the Central Registry web site at www12.tceq.texas.gov/crpub/. You can search by the Regulated Entity (RN), Customer Number (CN) or Name (Permittee), or by your permit number under the search field labeled "Additional ID". Capitalize all letters in the permit number.

The Customer (Permittee) is responsible for providing consistent information to the TCEQ, and for updating all CN and RN data for all authorzations as changes occur. For General Permits, a Notice of Change form must be submitted to the program area.

Annual Water Quality Fee: This fee is assessed to operators with an active authorization under the general permit on September 1 of each year. The operator will receive an invoice for payment of the annual fee in November of each year. The payment will be due 30 days from the invoice date. A 5% penalty will be assessed if the payment is received by TCEQ after the due date. Annual fee assessments cannot be waived as long as the authorization under the general permit is active on September 1.

It's important for the operator to submit a **Notice of Termination** (NOT) when coverage under the general permit is no longer required. A NOT is effective on the postmarked date of mailing the form to TCEQ. It is recommended that the NOT be mailed using a method that documents the date mailed and received by TCEQ.

• Mailed Payments:
You must return your payment with the billing coupon provided with the billing statement.

• ePAY Electronic Payment:
Go to www6.tceq.texas.gov/epay/
You must enter your account number provided at the top portion of your billing statement. Payment methods include Mastercard, Visa, and electronic check payment (ACH). A transaction over $500 can only be made by ACH.

INSTRUCTIONS FOR FILLING OUT THE NOT FORM

A. OPERATOR (current permittee.)

1. TCEQ Issued Customer Number (CN)

2. Legal Name of Operator
The operator must be the same entity as previously submitted on the original Notice of Intent for the permit number provided.

3. Operator Mailing Address
Provide a complete mailing address for receiving mail from the TCEQ. Update the address if different than previously submitted in the Notice of Intent or Notice of Change.

4. Phone Number, Fax Number, and E-mail Address
Provide updated contact information.

B. REGULATED ENTITY (RE) INFORMATION ON PROJECT OR SITE

1. Regulated Entity Reference Number (RN)

2. Site/Project Name/Regulated Entity
Provide the name of the site as previously submitted in the Notice of Intent for the permit number provided.

3. Site/Project (RE) Physical Address
Provide the physical address or location access description as previously submitted for the permit number provided.

C. REASON FOR TERMINATION

Indicate the reason for terminating the permit by checking one of the options. If the reason is not listed then provide an attachment that explains the reason for termination.

Please read your general permit carefully to determine when to terminate your permit. Permits will not be reactivated after submitting a termination form. The termination is effective on the date postmarked for delivery to TCEQ.

D. CERTIFICATIONS

The certification must bear an original signature of a person meeting the signatory requirements specified under 30 Texas Administrative Code (TAC) §305.44.

IF YOU ARE A CORPORATION:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(1) (see below). According to this code provision, any corporate representative may sign an NOI or similar form so long as the authority to sign such a document has been delegated to that person in accordance with corporate procedures. By signing the NOI or similar form, you are certifying that such authority has been delegated to you. The TCEQ may request documentation evidencing such authority.

IF YOU ARE A MUNICIPALITY OR OTHER GOVERNMENT ENTITY:

The regulation that controls who may sign an NOI or similar form is 30 Texas Administrative Code §305.44(a)(3) (see below). According to this code provision, only a ranking elected official or principal executive officer may sign an NOI or similar form. Persons such as the City Mayor or County Commissioner will be considered ranking elected officials. In order to identify the principal executive officer of your government entity, it may be beneficial to consult your city charter, county or city ordinances, or the Texas statute(s) under which your government entity was formed. An NOI or similar document that is signed by a government official who is not a ranking elected official or principal executive officer does not conform to

§305.44(a)(3). The signatory requirement may not be delegated to a government representative other than those identified in the regulation. By signing the NOI or similar form, you are certifying that you are either a ranking elected official or principal executive officer as required by the administrative code. Documentation demonstrating your position as a ranking elected official or principal executive officer may be requested by the TCEQ.

If you have any questions or need additional information concerning the signatory requirements discussed above, please contact the Texas Commission on Environmental Quality's Environmental Law Division at 512/239-0600.

30 Texas Administrative Code
§305.44. Signatories to Applications.

(a) All applications shall be signed as follows.

(1) For a corporation, the application shall be signed by a responsible corporate officer. For purposes of this paragraph, a responsible corporate officer means a president, secretary, treasurer, or vice-president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation; or the manager of one or more manufacturing, production, or operating facilities employing more than 250 persons or having gross annual sales or expenditures exceeding $25 million (in second-quarter 1980 dollars), if authority to sign documents has been assigned or delegated to the manager in accordance with corporate procedures. Corporate procedures governing authority to sign permit or post-closure order applications may provide for assignment or delegation to applicable corporate positions rather than to specific individuals.

(2) For a partnership or sole proprietorship, the application shall be signed by a general partner or the proprietor, respectively.

(3) For a municipality, state, federal, or other public agency, the application shall be signed by either a principal executive officer or a ranking elected official. For purposes of this paragraph, a principal executive officer of a federal agency includes the chief executive officer of the agency, or a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., regional administrator of the EPA).

APPENDIX E

INSPECTION AND MAINTENANCE FORMS

STORM WATER POLLUTION PREVENTION PLAN

INSPECTION AND MAINTENANCE REPORT

STRUCTURAL CONTROLS

STABILIZED CONSTRUCTION ACCESSES (EXITS):

LOCATION	IN PLACE? / CONDITION:	TOP-DRESSING NEEDED?	SEDIMENT ON ADJACENT ROAD?

MAINTENANCE REQUIRED FOR STABILIZED CONSTRUCTION ACCESSES (EXITS):

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

CERTIFICATION

TO BE PERFORMED BY: _____ **ON OR BEFORE:** _____

CORRECTED BY: _____ **DATE:** _____

STORM WATER POLLUTION PREVENTION PLAN

INSPECTION AND MAINTENANCE REPORT

STRUCTURAL CONTROLS

INLET PROTECTION BARRIERS:

LOCATION	IN PLACE? / CONDITION:	DEPTH OF SEDIMENT	CONDITION OF INLET

MAINTENANCE REQUIRED FOR INLET PROTECTION BARRIERS:

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

CERTIFICATION

TO BE PERFORMED BY: _____ **ON OR BEFORE:** _____

CORRECTED BY: _____ **DATE:** _____

STORM WATER POLLUTION PREVENTION PLAN

INSPECTION AND MAINTENANCE REPORT

STRUCTURAL CONTROLS

REINFORCED FILTER FABRIC BARRIER:

LOCATION	BOTTOM OF FABRIC STILL BURIED?	FABRIC TORN OR SAGGING?	POSTS TIPPING OVER?	HOW DEEP IS THE SEDIMENT?

MAINTENANCE REQUIRED FOR REINFORCED FILTER FABRIC BARRIER:

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

CERTIFICATION

TO BE PERFORMED BY: _____ **ON OR BEFORE:** _____

CORRECTED BY: _____ **DATE:** _____

STORM WATER POLLUTION PREVENTION PLAN

INSPECTION AND MAINTENANCE REPORT

INSPECTOR: _____ DATE: _____

DAYS SINCE LAST RAINFALL: _____AMOUNT OF LAST RAINFALL: _____INCHES

STABILIZATION MEASURES

AREA	DATE SINCE LAST DISTURBED	DATE OF NEXT DISTURBANCE	STABILIZED?	STABILIZED WITH	CONDITION

STABILIZATION REQUIRED:

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

_____

CERTIFICATION

TO BE PERFORMED BY: _____ **ON OR BEFORE:** _____

CORRECTED BY: _____ **DATE:** _____

APPENDIX F

SWPPP PLANS

GENERAL NOTES

HYPER-CHLORINATED WATER NOTES:

1. HYPER-CHLORINATED WATER SHALL NOT BE DISCHARGED TO THE STORM SEWER DRAINAGE SYSTEM UNLESS THE CHLORINE CONCENTRATION IS REDUCED TO 4 PPM OR LESS BY CHEMICALLY TREATING THE DECHLORINATE OR BY ONSITE RETENTION UNTIL NATURAL RETENTION OCCURS.
2. DISCHARGE OF HIGH FLOW RATE AND VELOCITIES SHALL BE DIRECTED TO VELOCITY DISSIPATION DEVICES.
3. CHLORINE CAN BURN VEGETATION SO IT SHOULD NOT BE USED TO WATER VEGETATION THAT IS BEING USED FOR STABILIZATION. VEGETATED FILTERS OR BUFFERS, OR OTHER VEGETATION TO BE PRESERVED.
4. HYPER-CHLORINATED WATER MAY BE DISCHARGED TO AN ONSITE RETENTION AREA UNTIL NATURAL ATTENUATION OCCURS. THE AREA MAY BE A DRY RETENTION STORMWATER RETENTION BASIN, OR A PORTION OF A SITE MAY BE GRADED TO FORM A TEMPORARY PIT OR BERMED AREA.
5. NATURAL ATTENUATION OF THE CHLORINE MAY BE AIDED BY AERATION. AIR CAN BE ADDED TO THE WATER BY DIRECTING THE DISCHARGE OVER A ROUGH SURFACE BEFORE IT ENTERS THE TEMPORARY RETENTION AREA OR AN AERATION DEVICE CAN BE PLACED IN THE RETENTION AREA.
6. ONSITE DISCHARGE MAY BE REQUIRED SEVERAL HOURS TO A FEW DAYS BEFORE THE WATER IS SAFE TO DISCHARGE. THE RATE AT WHICH CHLORINE WILL ATTENUATE IS AFFECTED BY SOIL CONDITIONS AND WEATHER CONDITIONS. ATTENUATION WILL OCCUR QUICKEST DURING WARM, SUNNY AND DRY PERIODS.

SPILL AND LEAK RESPONSE NOTES:

1. RECORDS OF RELEASES THAT EXCEED THE REPORTABLE QUANTITY (RQ) OIL AND HAZARDOUS SUBSTANCES SHOULD BE MAINTAINED IN ACCORDANCE WITH THE FEDERAL AND STATE REGULATIONS.
2. EMERGENCY CONTACT INFORMATION AND SPILL RESPONSE PROCEDURES SHALL BE POSTED IN A READILY AVAILABLE AREA FOR ACCESS BY ALL EMPLOYEES AND SUBCONTRACTORS.
3. SPILL CONTAINMENT KIT SHOULD BE MAINTAINED FOR PETROLEUM PRODUCTS AND OTHER CHEMICALS THAT ARE REGULARLY ONSITE. MATERIALS IN KITS SHOULD BE BASED ON CONTAINMENT GUIDELINES IN THE MATERIALS SAFETY AND DATA SHEETS (MSDSS) FOR THE SUBSTANCE MOST FREQUENTLY ONSITE.
4. SPILL KITS ARE INTENDED FOR RESPONSE TO SMALL SPILLS, TYPICALLY LESS THAN 5 GALLONS, OR SUBSTANCES THAT ARE NOT EXTREMELY HAZARDOUS.
5. SIGNIFICANT SPILLS OR OTHER RELEASES WARRANT IMMEDIATE RESPONSE BY TRAINED PROFESSIONALS.
6. SUSPECTED JOB SITE CONTAMINATION SHOULD BE IMMEDIATELY REPORTED TO REGULATORY AUTHORITIES AND PROTECTIVE ACTIONS TAKEN.
7. THE CONTRACTOR SHOULD BE REQUIRED TO DESIGNATE A SITE SUPERINTENDENT, FOREMAN, SAFETY OFFICER, OR OTHER SENIOR PERSON WHO IS ONSITE DAILY TO BE THE SPILL AND LEAK RESPONSE COORDINATOR (SLRC) AND MUST HAVE KNOWLEDGE OF AND BE TRAINED IN CORRECT SPILL AND LEAK RESPONSE PROCEDURES.

SANITARY WASTE NOTES:

1. THE CONTRACTOR SHALL PROVIDE AN APPROPRIATE NUMBER OF PORTABLE TOILETS BASED ON THE NUMBER OF EMPLOYEES USING THE TOILETS AND THE HOURS THEY WILL WORK.
2. SANITARY FACILITIES SHALL BE PLACED A MINIMUM OF 50 FEET AWAY FROM STORM DRAIN INLETS, CONVEYANCE, CHANNELS OR SURFACE WATERS. IF UNABLE TO MEET THE 50 FEET REQUIREMENT DUE TO SITE CONFIGURATION, PORTABLE TOILETS SHALL BE A MINIMUM OF 20 FEET AWAY FROM STORM DRAIN INLETS, CONVEYANCE CHANNELS OR SURFACE WATER AND SECONDARY CONTAINMENT SHALL BE PROVIDED IN CASE OF SPILLS.
3. THE LOCATION OF THE PORTABLE TOILET SHALL BE ACCESSIBLE TO MAINTENANCE TRUCKS WITHOUT DAMAGING EROSION AND SEDIMENT CONTROLS OR CAUSING EROSIONS OR TRACKING PROBLEMS.
4. SANITARY FACILITIES SHALL BE FULLY ENCLOSED AND DESIGNED IN A MANNER THAT MINIMIZES THE EXPOSURE OF SANITARY WASTE TO PRECIPITATION AND STORMWATER RUNOFF.
5. WHEN HIGH WINDS ARE EXPECTED, PORTABLE TOILET SHALL BE ANCHORED OR OTHERWISE SECURED TO PREVENT THEM FROM BEING BLOWN OVER.
6. THE COMPANY THAT SUPPLIES AND MAINTAINS THE PORTABLE TOILETS SHALL BE NOTIFIED IMMEDIATELY IF A TOILET IS TIPPED OVER OR DAMAGED IN A WAY THAT RESULTS IN A DISCHARGE. DISCHARGED SOLID MATTER SHALL BE VACUUMED INTO A SEPTIC TRUCK BY THE COMPANY THAT MAINTAINS THE TOILETS.
7. THE OPERATOR OF THE MUNICIPAL SEPARATE STORM SEWER SYSTEM (MS4) SHALL BE NOTIFIED IF A DISCHARGE FROM THE PORTABLE TOILETS ENTERS THE MS4 OR A NATURAL CHANNEL.
8. SANITARY FACILITIES SHALL NOT BE PERMITTED ON PUBLIC SIDEWALKS, STREETS OR INLETS.

SUBGRADE STABILIZATION NOTES:

1. MINIMIZE THE DISCHARGE OF THE CHEMICAL STABILIZERS BY THE CONTRACTOR LIMITING THE AMOUNT OF STABILIZING AGENT ONSITE TO THAT WHICH CAN BE THOROUGHLY MIXED AND COMPACTED BY THE END OF EACH WORKDAY.
2. STABILIZERS SHALL BE APPLIED AT RATES THAT RESULT IN NO RUN OFF.
3. STABILIZATION SHALL NOT OCCUR IMMEDIATELY BEFORE AND DURING RAINFALL EVENTS.
4. NO TRAFFIC OTHER THAN WATER TRUCKS, AND MIXING EQUIPMENT SHALL BE ALLOWED TO PASS OVER THE AREA BEING STABILIZED UNTIL AFTER COMPLETION OF MIXING THE CHEMICALS.
5. AREA ADJACENT AND DOWNSTREAM OF STABILIZED AREA SHALL BE ROUGHENED TO INTERCEPT CHEMICAL RUNOFF AND REDUCE RUNOFF VELOCITY.
6. GEOTEXTILE FABRICS SUCH AS THOSE USED FOR SILT FENCE SHOULD NOT BE USED TO TREAT CHEMICAL RUNOFF, BECAUSE THE CHEMICALS ARE DISSOLVED IN THE WATER AND WON'T BE AFFECTED BY A BARRIER AND THE SUSPENDED SOLIDS ARE SIGNIFICANTLY SMALLER THAN THE APPARENT OPENING SIZE OF THE FABRIC.
7. IF SOIL STABILIZERS ARE STORED ONSITE, THEY SHALL BE CONSIDERED HAZARDOUS MATERIAL AND SHALL BE MANAGED ACCORDING TO THE CRITERIA OF CHEMICAL MANAGEMENT TO CAPTURE ANY ACCIDENTAL LIME OR ANY CHEMICAL OVERFLOW.
8. THE CONTRACTOR SHALL INSTALL BMP'S TO ALL INLETS AND OPENINGS CONNECTED TO THE STORM SEWER SYSTEMS TO PREVENT LIME FROM ENTERING THE MS4 SYSTEM.

DEBRIS AND TRASH NOTES:

1. ALL WASTE SOURCES AND STORAGE AREAS SHALL BE LOCATED A MINIMUM OF 50 FEET AWAY FROM INLETS, SWALES, DRAINAGE WAYS, CHANNELS, AND OTHER WATERS, IF THE SITE CONFIGURATION PROVIDE SUFFICIENT SPACE TO DO SO. IN NO CASE SHALL MATERIAL AND WASTE SOURCES BE CLOSURE THAN 20 FROM INLETS, SWALES, DRAINAGE WAYS, CHANNELS, AND OTHER WATERS.
2. CONSTRUCTION WASTE AND TRASH SHALL BE STORED IN A MANNER THAT MINIMIZES IT'S EXPOSURE TO PRECIPITATION AND STORM WATER RUN OFF.
3. WHENEVER POSSIBLE MINIMIZE PRODUCTION OF DEBRIS AND TRASH.
4. INSTRUCT CONSTRUCTION WORKERS IN PROPER DEBRIS AND TRASH STORAGE AND HANDLING PROCEDURES.
5. SEGREGATE POTENTIAL HAZARDOUS WASTE FROM NON-HAZARDOUS CONSTRUCTION SITE DEBRIS.
6. PROHIBIT LITTERING BY WORKERS AND VISITORS.
7. POLICE SITE DAILY FOR LITTER AND DEBRIS.
8. ENFORCE SOLID WASTE HANDLING AND STORAGE PROCEDURES.
9. IF FEASIBLE, RECYCLE CONSTRUCTION AND DEMOLITION DEBRIS SUCH AS WOOD, METAL, AND CONCRETE.
10. TRASH AND DEBRIS SHALL BE REMOVED FROM THE SITE AT REGULAR INTERVALS THAT ARE SCHEDULED TO EMPTY CONTAINERS WHEN THEY ARE 90 PERCENT FULL OR MORE FREQUENTLY.
11. GENERAL CONSTRUCTION DEBRIS MAY BE HAULED TO A LICENSED CONSTRUCTION DEBRIS LANDFILL.
12. USE WASTE AND RECYCLING HAULERS/ FACILITIES APPROVED BY THE LOCAL MUNICIPALITY.
13. CHIPPING OF TREES AND AND BRUSH FOR USE SUCH AS MULCH IS PREFERRED ALTERNATIVE TO OFFSITE DISPOSAL.
14. NO WASTE, TRASH, OR DEBRIS SHALL BE BURIED, BURNED OR OTHERWISE DISPOSED OF ONSITE.
15. CLEARLY MARK ON ALL DEBRIS AND TRASH CONTAINERS WHICH MATERIALS ARE ACCEPTABLE. FOREMAN AND/OR CONSTRUCTION SUPERVISOR SHALL MONITOR ONSITE SOLID WASTE STORAGE AND DISPOSAL PROCEDURE DAILY.

AECOM
AECOM TECHNICAL SERVICES, INC.– F-3580

©2015 Texas Department of Transportation

KIT Professionals, Inc.
Challenging Challenges...
Engineers ● Planners ● Construction Managers
2000 W. Sam Houston Pkwy S. Suite 1400
Houston, Texas 77042
Phone: (713)783-8700 Fax: (713)783-8747
TBPE Firm Registration No. F-4991

SURVEYED BY:
GEOSOLUTIONS, LLC.
FB No. P-5658

STATE OF TEXAS
KEITH R. DAVIS
82625
LICENSED PROFESSIONAL ENGINEER
2-1-16
KIT Professionals, Inc.
TBPE Firm Registration No. F-4991

CITY OF HOUSTON
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

GREENS ROAD

STORM WATER POLLUTION PREVENTION GENERAL NOTES

SHEET 1 OF 7

WBS NUMBER	
N-000686-0002-4	
DRAWING SCALE	
1"=50	
CITY OF HOUSTON PM	
SUDARSHAN GOUNI	
SHEET No. 369 of 403	

Feb 01 2016 11:23AM tote
M:\KIT_Projects\K06_PW_114\PROD\3.2.5_SWPPP\SWPPP.dwg
Includes Xref(s): _BORDER.dwg; Bridge.dwg; P-Paving.dwg; Topo_mod1-14-15.dwg; Alignment.dwg; SOD PANELS.dwg; _PSTM.dwg

NOTES:

1. ESTIMATED 25 LF TYPE 2 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE INDICATED.
2. ESTIMATED 40 LF TYPE 3 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE.
3. STABILIZATION DEVICES AS LOCATED ON THE SITE PLAN ARE FOR CLARITY PURPOSE ONLY. NO WORK SHALL BE PERFORMED BEYOND THE LIMITS OF THE EXISTING RIGHT OF WAY.
4. PLACE TEMPORARY SEEDING IN DISTURBED AREAS AFTER EVERY PHASE.

LEGEND:

- DIRECTION OF FLOW
- FF — FILTER FABRIC FENCE
- RFB — REINFORCE FILTER FABRIC BARRIER
- RFD 2 — TYPE 2 ROCK FILTER DAM
- RFD 3 — TYPE 3 ROCK FILTER DAM
- CONSTRUCTION EXIT TY I
- PX-SX — TCP PHASE – STEP
- IST — STAGE I, INLET SEDIMENT TRAP
- IPB — STAGE II, INLET PROTECTION BARRIER

AREA INLETS:
SCF PROTECTION
BARRIER ESTIMATED: 50 LF

OUTFALL INTERCEPTORS:
SCF PROTECTION
BARRIER ESTMATED: 50LF

STAGGERED TWO ROWS OF SOD PANELS, SEE SWPPP DETAIL (SOD)

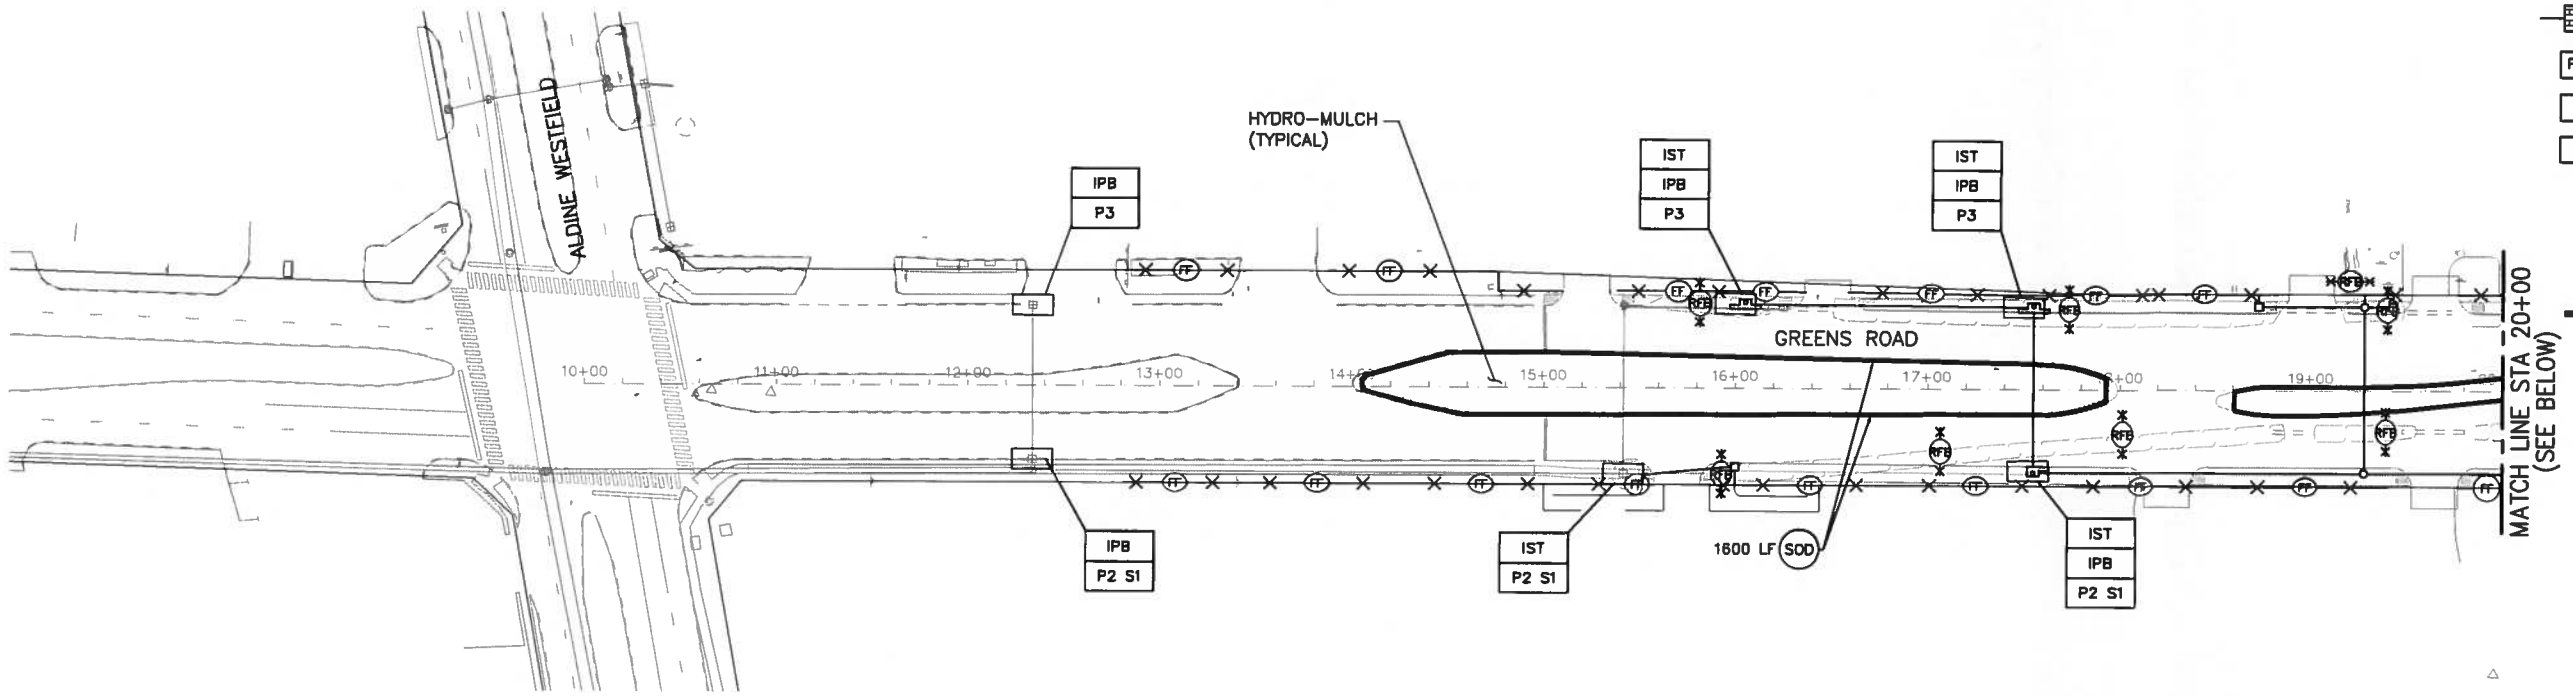

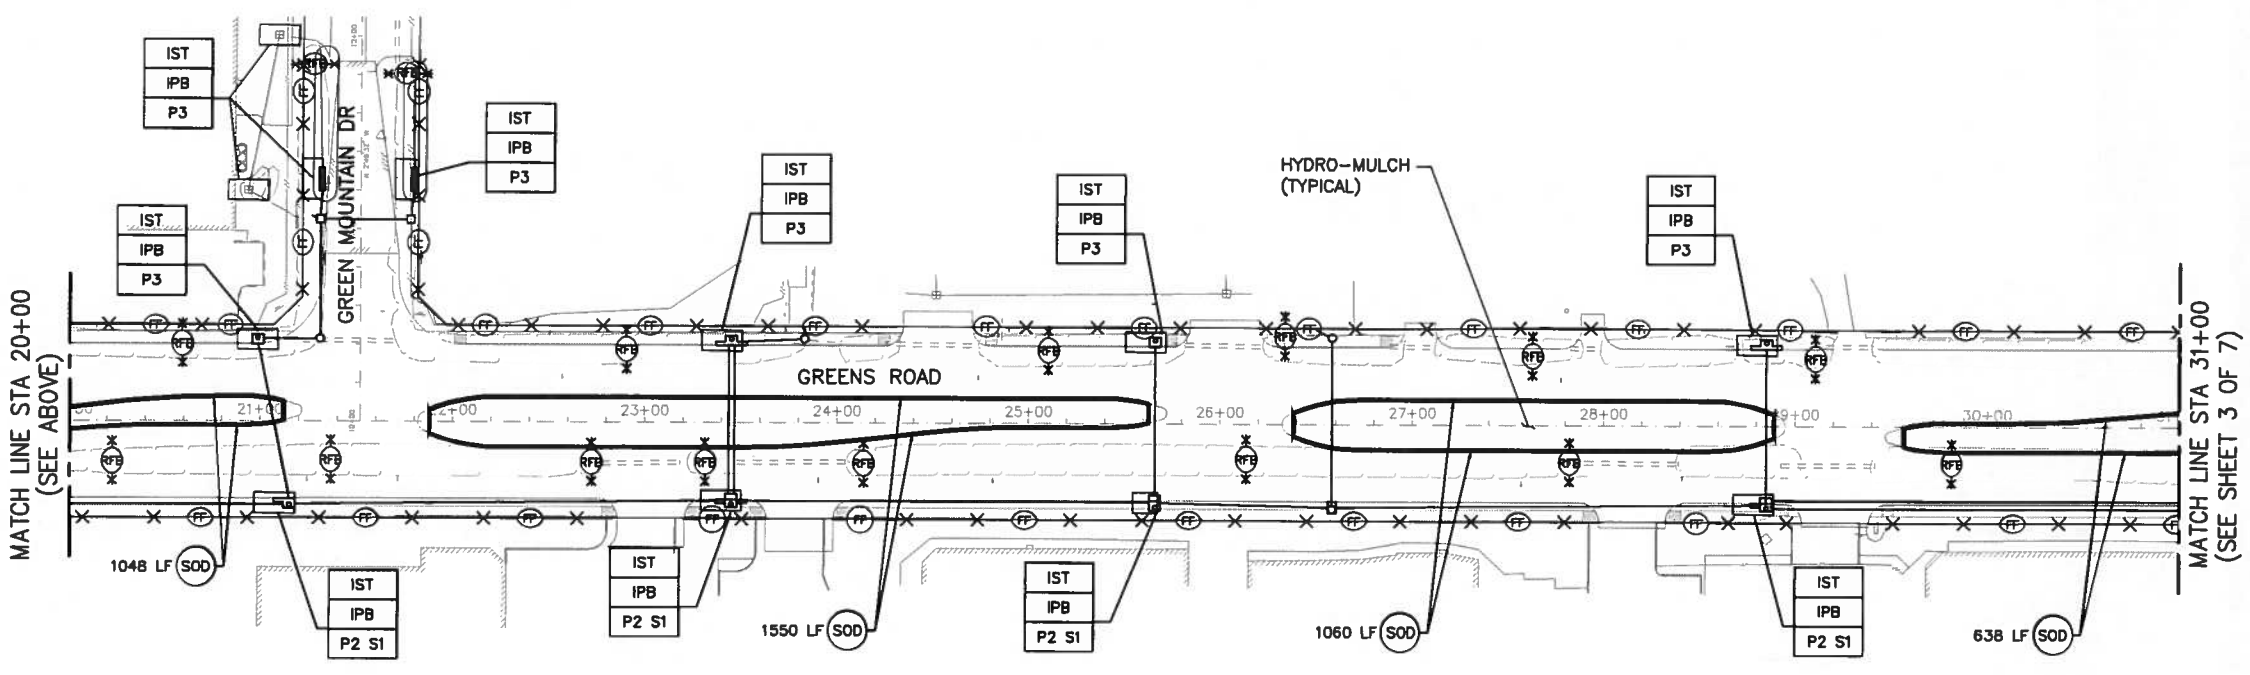

0 25' 50' 100'

AECOM
AECOM TECHNICAL SERVICES, INC.– F-3580

©2015 Texas Department of Transportation

KIT Professionals, Inc.
Challenging Challenges...
Engineers ● Planners ● Construction Managers
2000 W. Sam Houston Pkwy S., Suite 1400
Houston, Texas 77042
Phone: (713)783-8700, Fax: (713)783-5747
TBPE Firm Registration No. F-4991

SURVEYED BY:
GEOSOLUTIONS, LLC.
FB No. P-5658

STATE OF TEXAS
KEITH R. DAVIS
82625
LICENSED PROFESSIONAL ENGINEER
2-1-16
KIT Professionals, Inc
TBPE Firm Registration No. F-4991

CITY OF HOUSTON
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

GREENS ROAD

STORM WATER POLLUTION PREVENTION PLAN

BEGIN TO STA. 31+00
SHEET 2 OF 7

WBS NUMBER	
N-000686-0002-4	
DRAWING SCALE	
1"=50	
CITY OF HOUSTON PM	
SUDARSHAN GOUNI	
SHEET No. 370 of 403	

Feb 01 2016 11:23AM tote
M:\KIT_Projects\K06_PW_114\PROD\3.2.5_SWPPP\SWPPP.dwg
Includes Xref(s): _BORDER.dwg; Bridge.dwg; P-Paving.dwg; Topo_mod1-14-15.dwg; Alignment.dwg; SOD PANELS.dwg; _PSTM.dwg

NOTES:

1. ESTIMATED 25 LF TYPE 2 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE INDICATED.
2. ESTIMATED 40 LF TYPE 3 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE.
3. STABILIZATION DEVICES AS LOCATED ON THE SITE PLAN ARE FOR CLARITY PURPOSE ONLY. NO WORK SHALL BE PERFORMED BEYOND THE LIMITS OF THE EXISTING RIGHT OF WAY.
4. PLACE TEMPORARY SEEDING IN DISTURBED AREAS AFTER EVERY PHASE.

LEGEND:

- DIRECTION OF FLOW
- FF — FILTER FABRIC FENCE
- RFB — REINFORCE FILTER FABRIC BARRIER
- RFD 2 — TYPE 2 ROCK FILTER DAM
- RFD 3 — TYPE 3 ROCK FILTER DAM
- CONSTRUCTION EXIT TY I
- PX-SX — TCP PHASE – STEP
- IST — STAGE I, INLET SEDIMENT TRAP
- IPB — STAGE II, INLET PROTECTION BARRIER

AREA INLETS:
SCF PROTECTION
BARRIER ESTIMATED: 50 LF

OUTFALL INTERCEPTORS:
SCF PROTECTION
BARRIER ESTMATED: 50LF

- SOD — STAGGERED TWO ROWS OF SOD PANELS, SEE SWPPP DETAIL

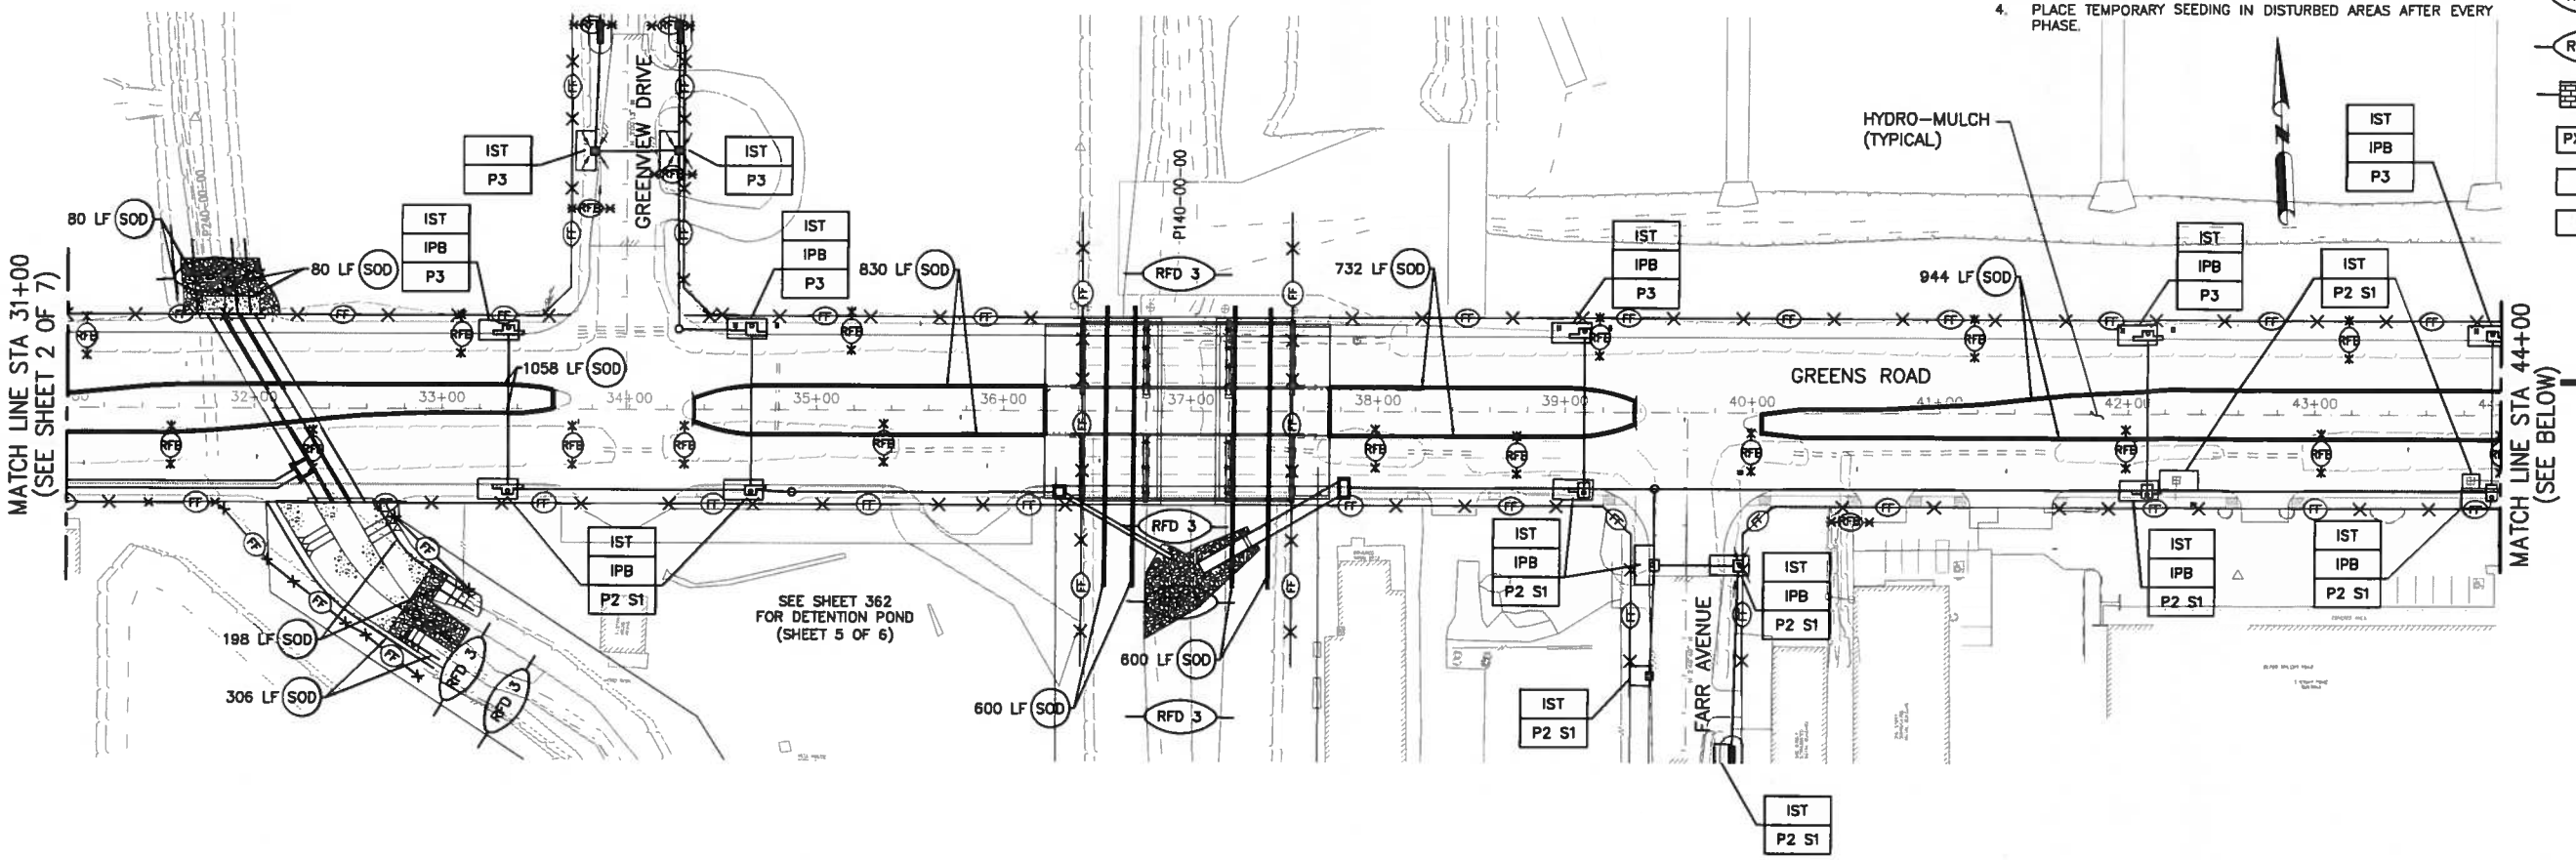

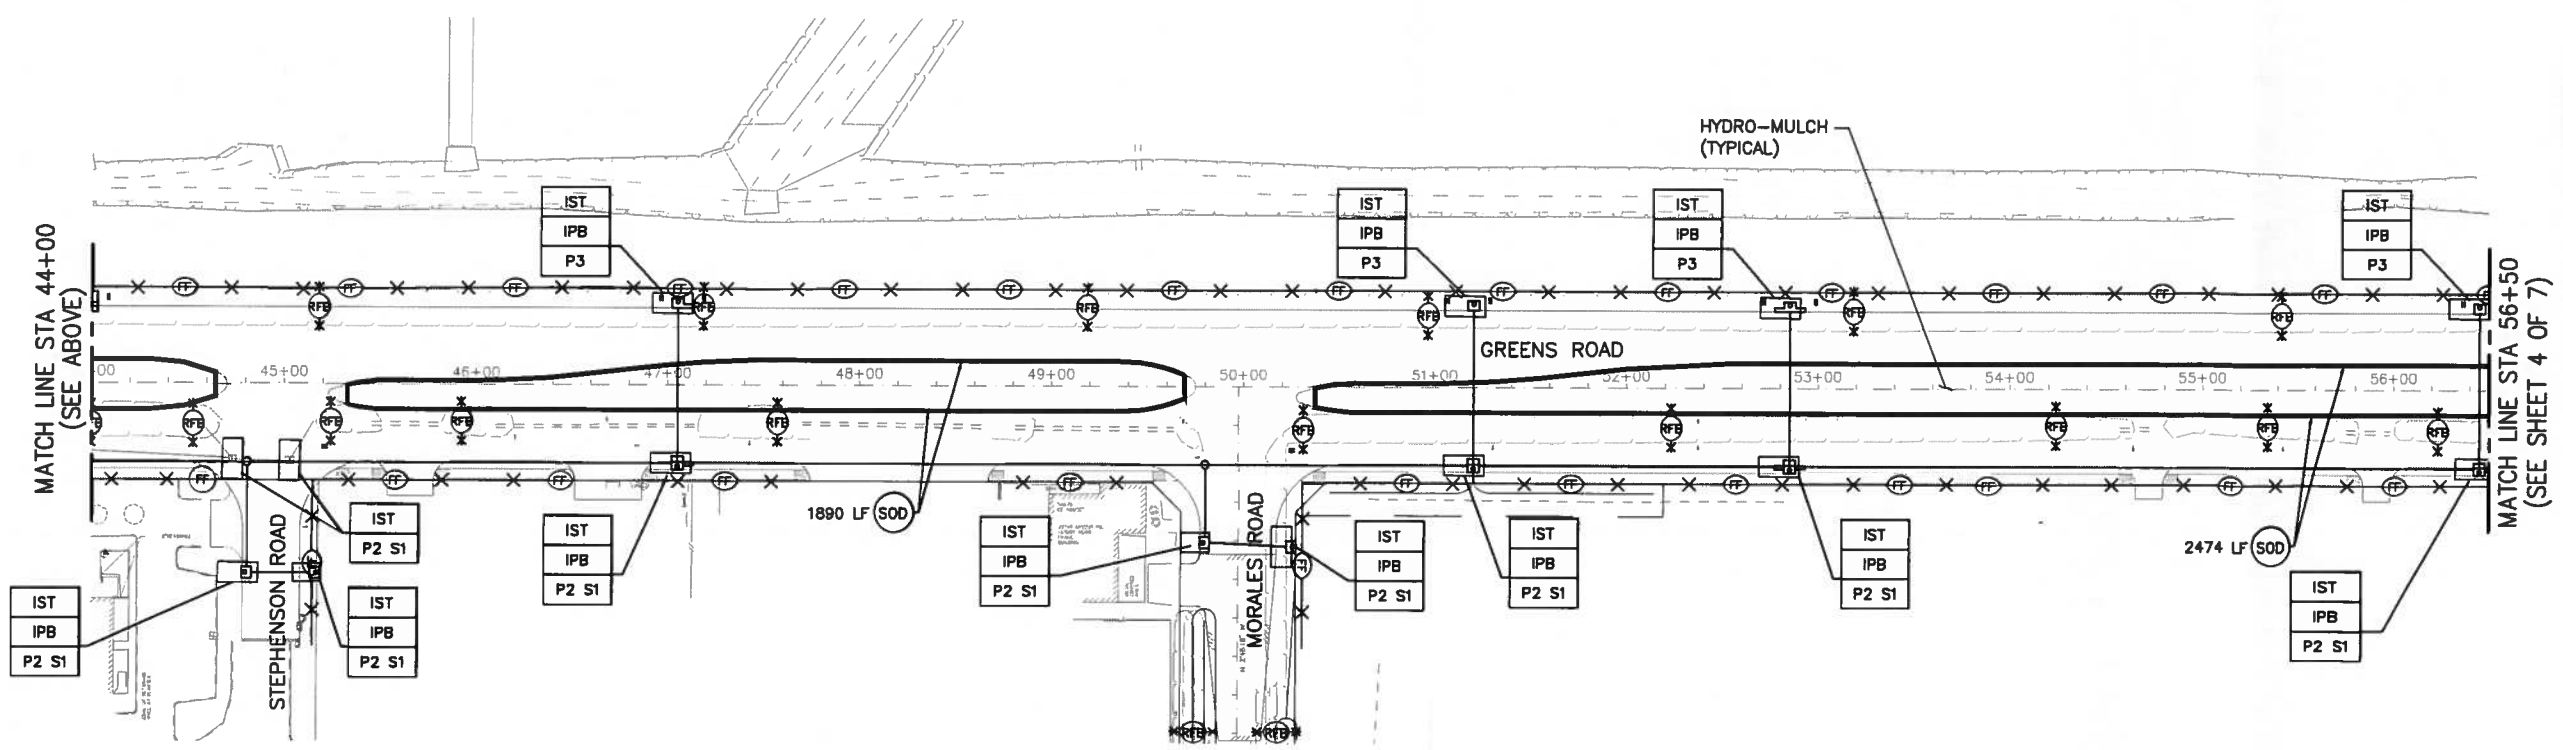

AECOM
AECOM TECHNICAL SERVICES, INC.- F-3580

©2015 Texas Department of Transportation

KIT Professionals, Inc.
Engineers • Planners • Construction Managers
2000 W. Sam Houston Pkwy S. Suite 1400
Houston, Texas 77042
Phone: (713)783-8700, Fax: (713)783-8747
TBPE Firm Registration No. F-4991

STATE OF TEXAS
KEITH R. DAVIS
82625
LICENSED PROFESSIONAL ENGINEER
2-1-16
KIT Professionals, Inc
TBPE Firm Registration No F-4991

SURVEYED BY:
GEOSOLUTIONS, LLC.
FB No. P-5658

CITY OF HOUSTON

DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

GREENS ROAD

STORM WATER POLLUTION PREVENTION PLAN

STA. 31+00 TO STA. 56+50
SHEET 3 OF 7

WBS NUMBER	
N-000686-0002-4	
DRAWING SCALE	
1"=50	
CITY OF HOUSTON PM	
SUDARSHAN GOUNI	
SHEET No. 371 of 403	

Feb 01 2016 11:23AM tate
M:\KIT_Projects\K06_PW_114\PROD\3.2.5_SWPPP\SWPPP.dwg
Includes Xref(s): _BORDER.dwg; Bridge.dwg; P-Paving.dwg; Topo_mod1-14-15.dwg; Alignment.dwg; SOD PANELS.dwg; _PSTM.dwg

NOTES:

1. ESTIMATED 25 LF TYPE 2 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE INDICATED.
2. ESTIMATED 40 LF TYPE 3 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE.
3. STABILIZATION DEVICES AS LOCATED ON THE SITE PLAN ARE FOR CLARITY PURPOSE ONLY. NO WORK SHALL BE PERFORMED BEYOND THE LIMITS OF THE EXISTING RIGHT OF WAY.
4. PLACE TEMPORARY SEEDING IN DISTURBED AREAS AFTER EVERY PHASE.

LEGEND:

- DIRECTION OF FLOW
- FF — FILTER FABRIC FENCE
- RFB — REINFORCE FILTER FABRIC BARRIER
- RFD 2 — TYPE 2 ROCK FILTER DAM
- RFD 3 — TYPE 3 ROCK FILTER DAM
- CONSTRUCTION EXIT TY I
- PX-SX — TCP PHASE - STEP
- IST — STAGE I, INLET SEDIMENT TRAP
- IPB — STAGE II, INLET PROTECTION BARRIER
- AREA INLETS: SCF PROTECTION BARRIER ESTIMATED: 50 LF
- OUTFALL INTERCEPTORS: SCF PROTECTION BARRIER ESTMATED: 50LF
- STAGGERED TWO ROWS OF SOD PANELS, SEE SWPPP DETAIL — SOD

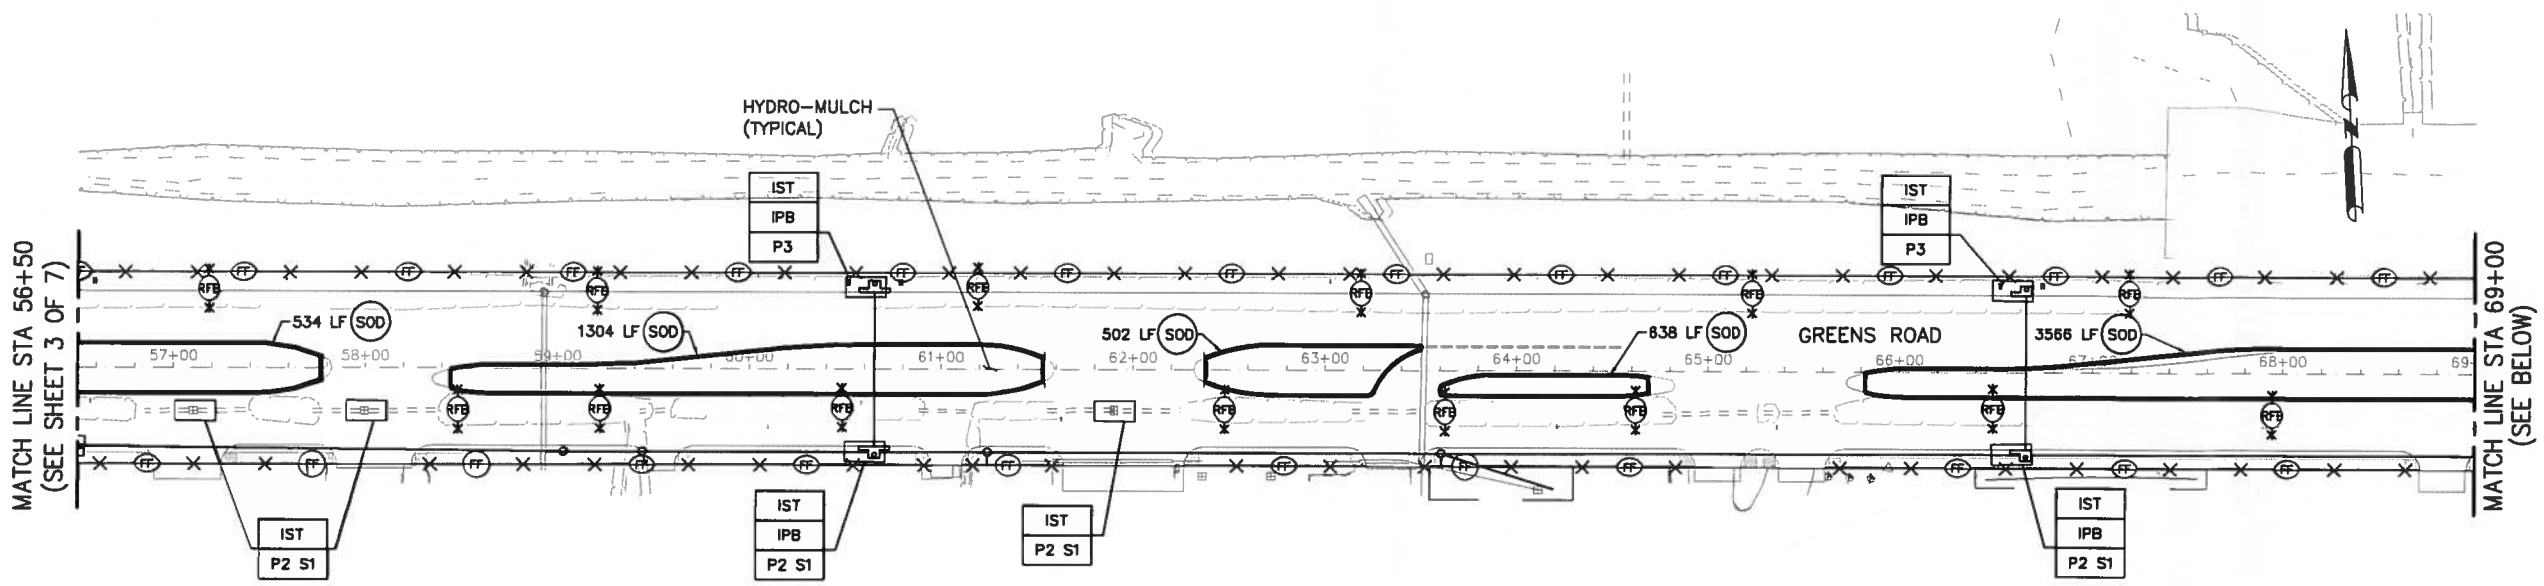

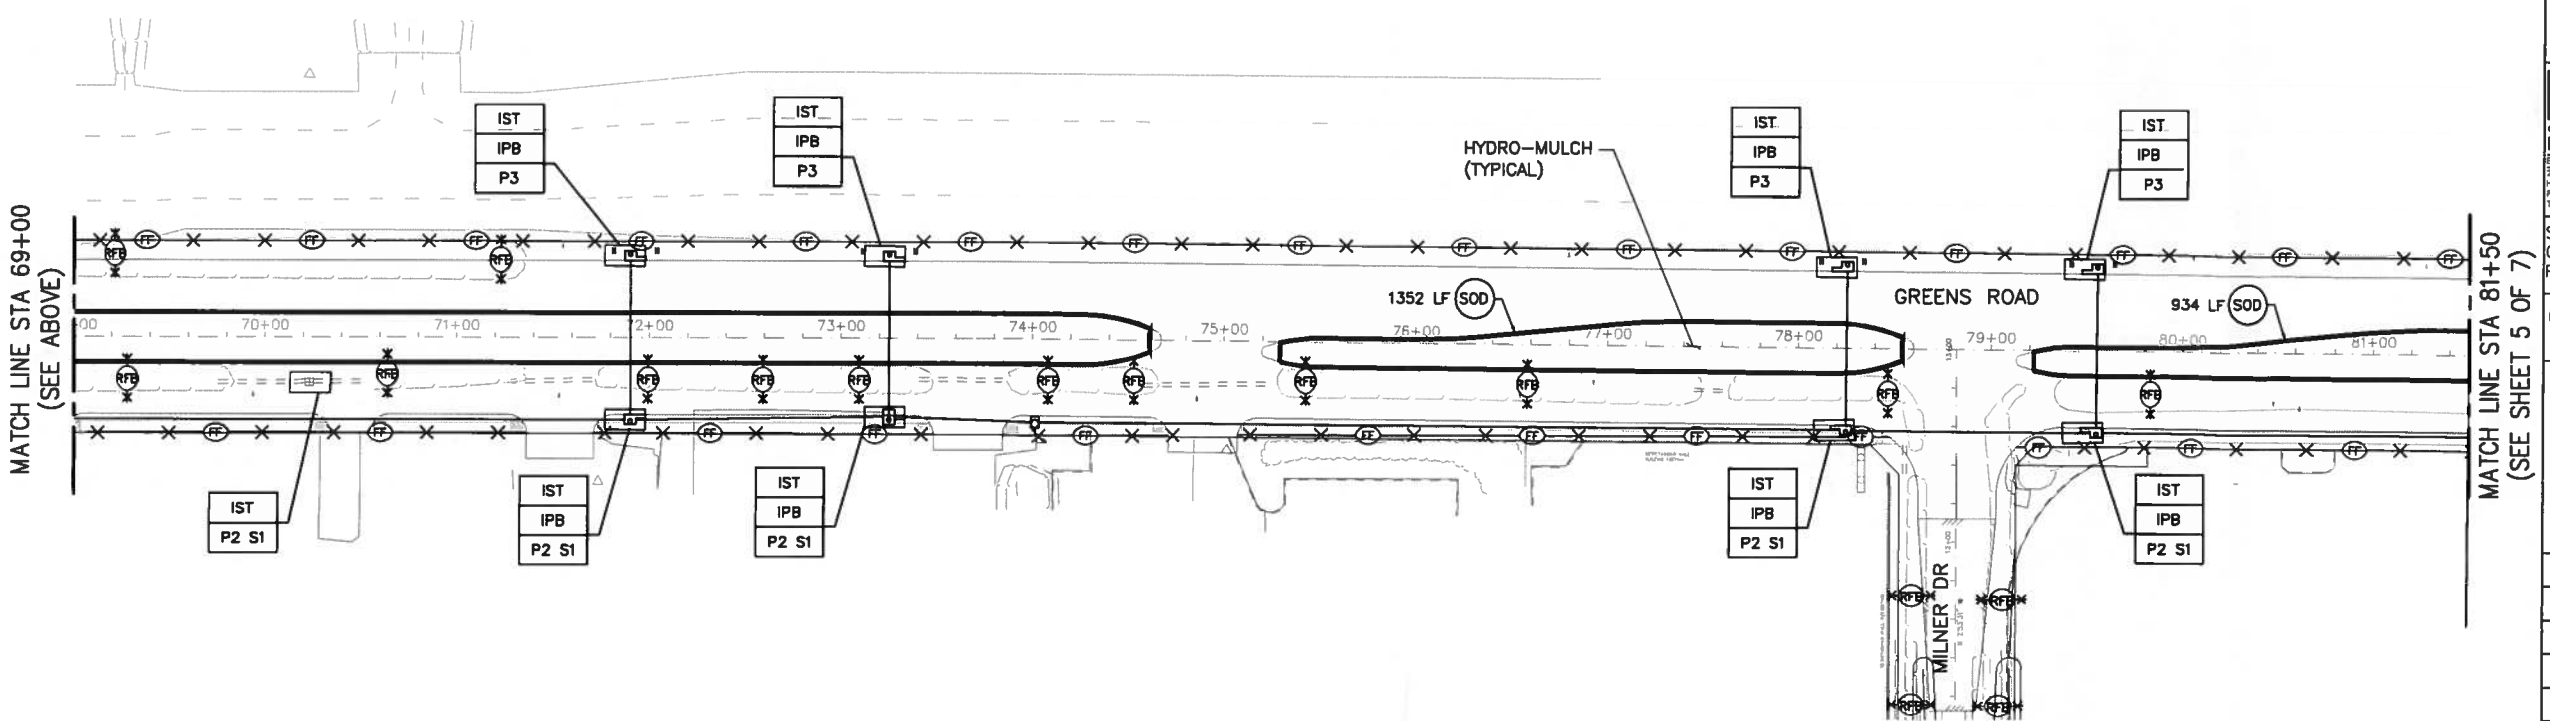

0 25' 50' 100'

AECOM
AECOM TECHNICAL SERVICES, INC.– F-3580

©2015 Texas Department of Transportation

KIT Professionals, Inc.
Engineers • Planners • Construction Managers
2000 W. Sam Houston Pkwy S. Suite 1400
Houston, Texas 77042
Phone: (713)783-8700, Fax: (713)783-8747
TBPE Firm Registration No. F-4991

SURVEYED BY:
GEOSOLUTIONS, LLC.
FB No. P-5658

STATE OF TEXAS
KEITH R. DAVIS
82625
LICENSED PROFESSIONAL ENGINEER
2-1-16
KIT Professionals, Inc.
TBPE Firm Registration No. F-4991

CITY OF HOUSTON
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

GREENS ROAD

STORM WATER POLLUTION PREVENTION PLAN

STA. 56+50 TO STA. 81+50
SHEET 4 OF 7

WBS NUMBER	
N-000686-0002-4	
DRAWING SCALE	
1"=50	
CITY OF HOUSTON PM	
SUDARSHAN GOUNI	
SHEET No. 372 of 403	

Feb 01 2016 11:23AM tate
M:\KIT_Projects\K06_PW_114\PROD\3.2.5_SWPPP\SWPPP.dwg
Includes Xref(s): _BORDER.dwg; Bridge.dwg; P-Paving.dwg; Topo_mod1-14-15.dwg; Alignment.dwg; SOD PANELS.dwg; _PSTM.dwg

NOTES:

1. ESTIMATED 25 LF TYPE 2 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE INDICATED.
2. ESTIMATED 40 LF TYPE 3 ROCK FILTER DAM PER LOCATION UNLESS OTHERWISE.
3. STABILIZATION DEVICES AS LOCATED ON THE SITE PLAN ARE FOR CLARITY PURPOSE ONLY. NO WORK SHALL BE PERFORMED BEYOND THE LIMITS OF THE EXISTING RIGHT OF WAY.
4. PLACE TEMPORARY SEEDING IN DISTURBED AREAS AFTER EVERY PHASE.
5. ALL DISTURBED AREA WITHIN IMPROVED AREA TO BE HYDRO-MULCHED.

LEGEND:

- DIRECTION OF FLOW
- FF — FILTER FABRIC FENCE
- RFB — REINFORCE FILTER FABRIC BARRIER
- RFD 2 — TYPE 2 ROCK FILTER DAM
- RFD 3 — TYPE 3 ROCK FILTER DAM
- CONSTRUCTION EXIT TY I
- PX-SX — TCP PHASE - STEP
- IST — STAGE I, INLET SEDIMENT TRAP
- IPB — STAGE II, INLET PROTECTION BARRIER

AREA INLETS:
SCF PROTECTION
BARRIER ESTIMATED: 50 LF

OUTFALL INTERCEPTORS:
SCF PROTECTION
BARRIER ESTMATED: 50LF

- STAGGERED TWO ROWS OF SOD PANELS, SEE SWPPP DETAIL — SOD

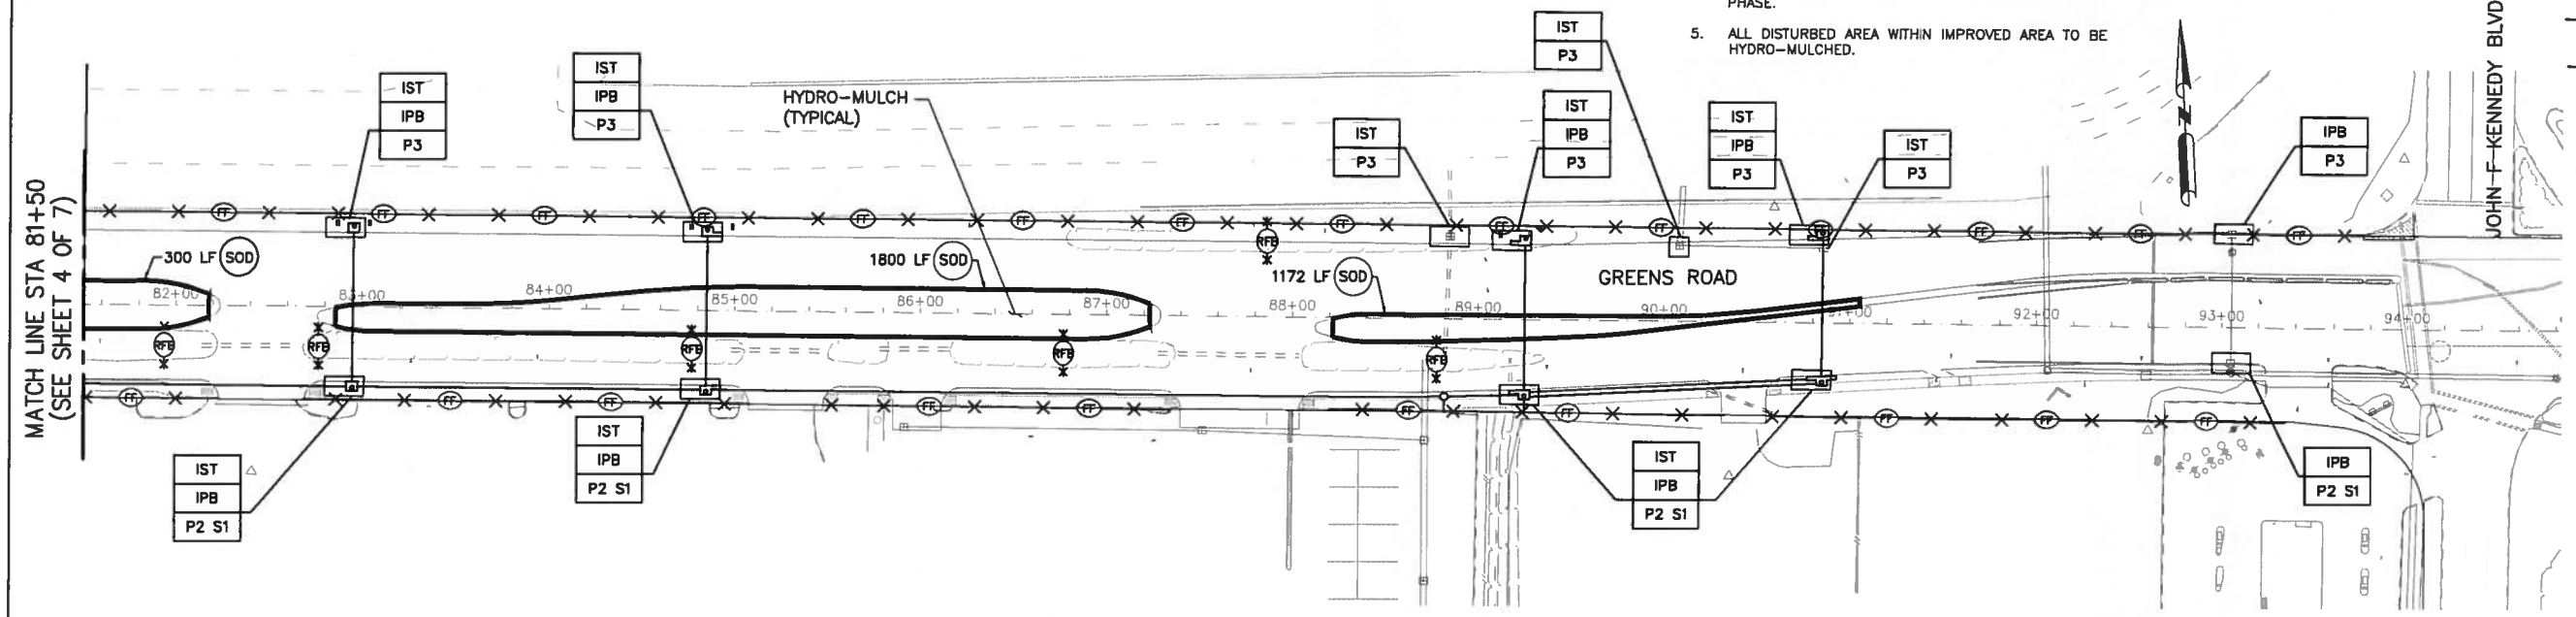

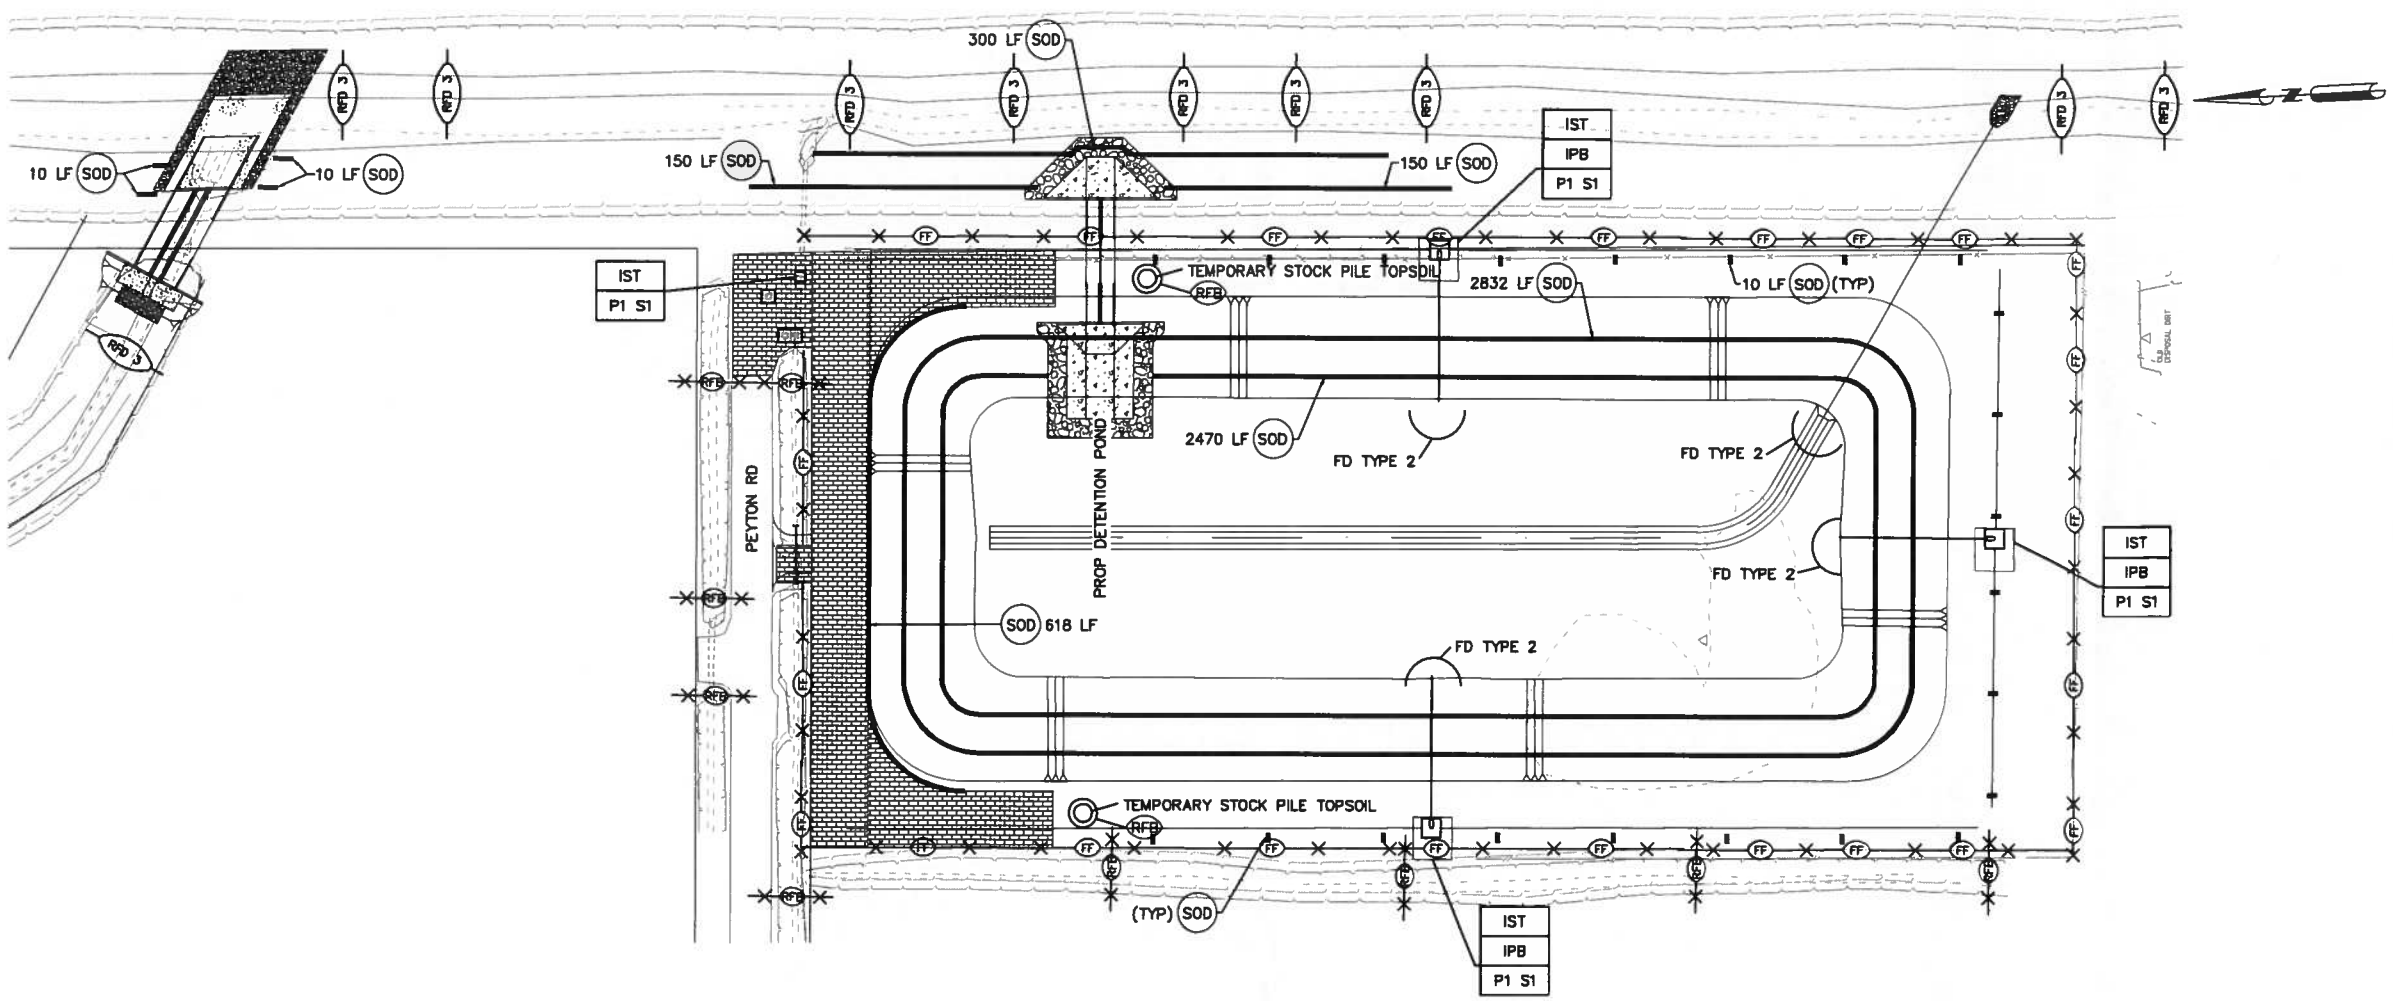

0 25' 50' 100'

AECOM
AECOM TECHNICAL SERVICES, INC.- F-3580

©2015 Texas Department of Transportation

KIT Professionals, Inc.
Challenging Challenges...
Engineers • Planners • Construction Managers
2000 W. Sam Houston Pkwy S. Suite 1400
Houston, Texas 77042
Phone: (713)783-8705, Fax: (713)783-8747
TBPE Firm Registration No. F-4991

SURVEYED BY:
GEOSOLUTIONS, LLC.
FB No. P-5658

STATE OF TEXAS
KEITH R DAVIS
82625
LICENSED PROFESSIONAL ENGINEER
2-1-16
KIT Professionals, Inc
TBPE Firm Registration No. F-4991

CITY OF HOUSTON

DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

GREENS ROAD

STORM WATER POLLUTION PREVENTION PLAN

STA. 81+50 TO END
SHEET 5 OF 7

WBS NUMBER	
N-000686-0002-4	
DRAWING SCALE	
1"=50	
CITY OF HOUSTON PM	
SUDARSHAN GOUNI	
SHEET No. 373 of 403	

Feb 01 2016 11:23AM tate
M:\KIT_Projects\K06_PW_114\PROD\3.2.5_SWPPP\SWPPP.dwg
Includes Xref(s): _BORDER.dwg; Bridge.dwg; P-Paving.dwg; Topo_mod1-14-15.dwg; Alignment.dwg; SOD PANELS.dwg; _PSTM.dwg

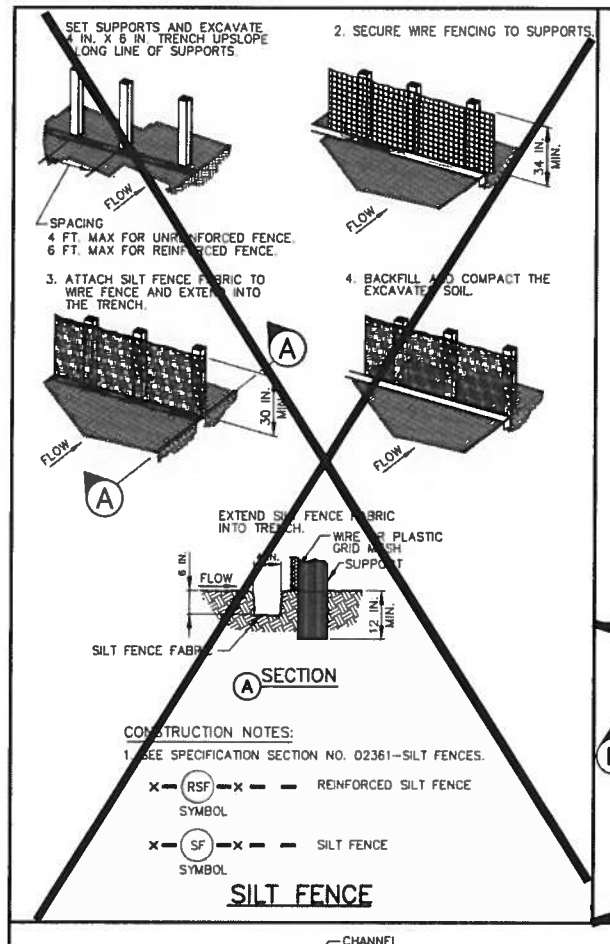

SILT FENCE

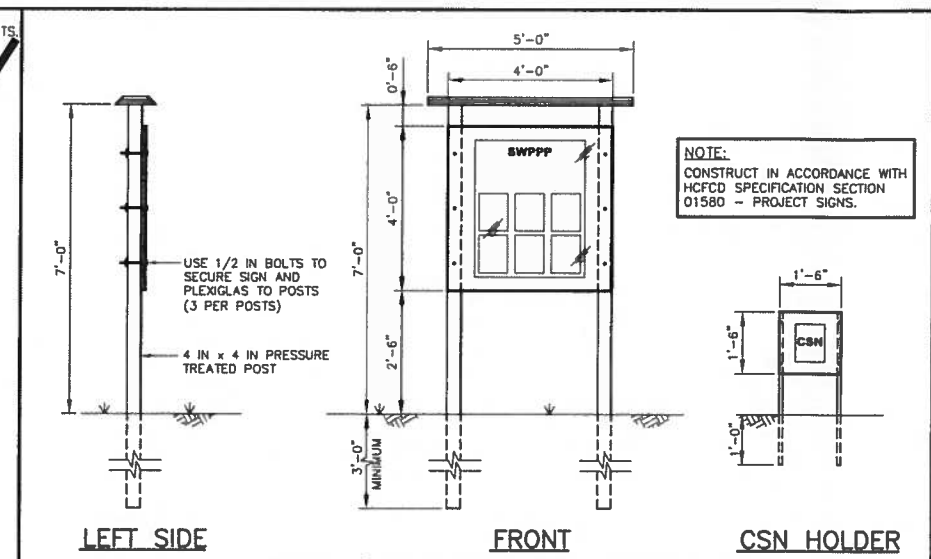

SWPPP / BMP SIGN AND CONSTRUCTION SITE NOTICE HOLDER DETAILS

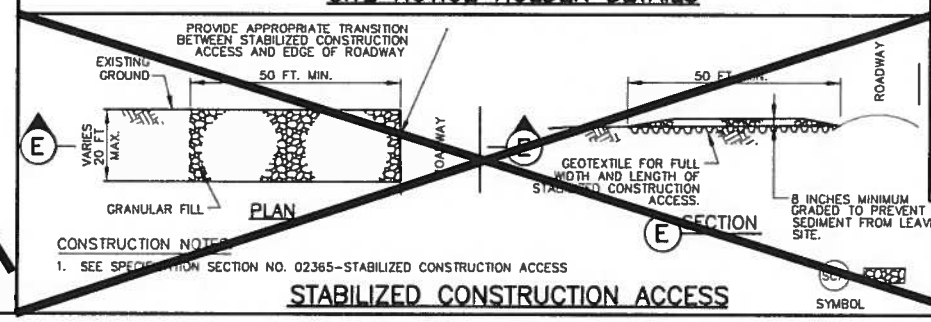

STABILIZED CONSTRUCTION ACCESS

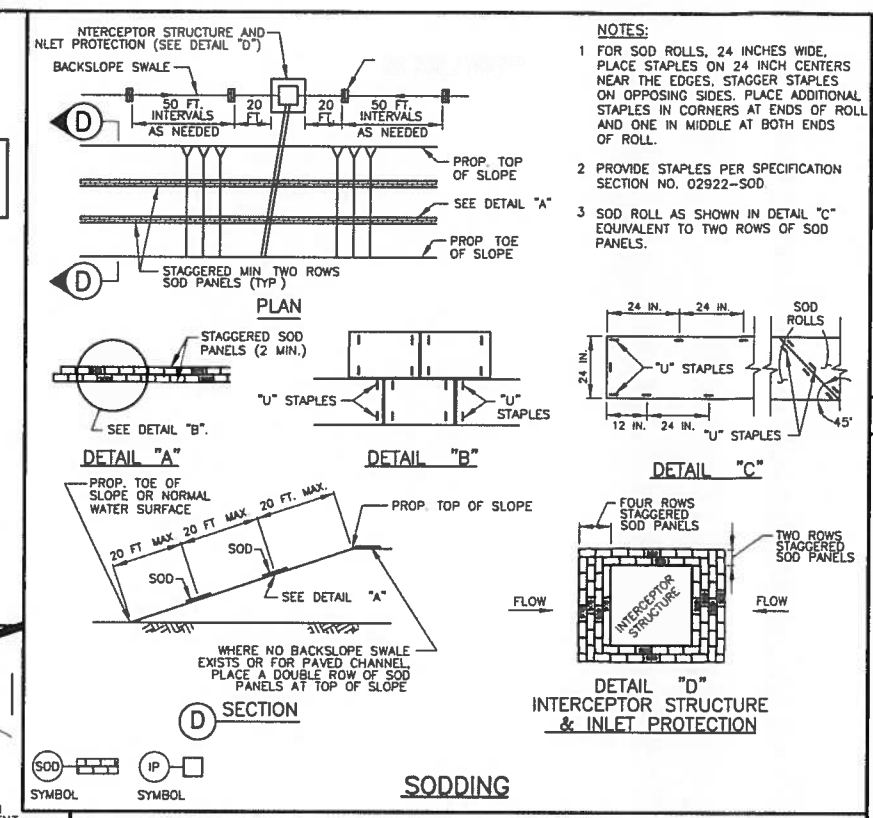

NOTES:

1. FOR SOD ROLLS, 24 INCHES WIDE, PLACE STAPLES ON 24 INCH CENTERS NEAR THE EDGES, STAGGER STAPLES ON OPPOSING SIDES. PLACE ADDITIONAL STAPLES IN CORNERS AT ENDS OF ROLL AND ONE IN MIDDLE AT BOTH ENDS OF ROLL.
2. PROVIDE STAPLES PER SPECIFICATION SECTION NO. 02922-SOD.
3. SOD ROLL AS SHOWN IN DETAIL "C" EQUIVALENT TO TWO ROWS OF SOD PANELS.

SODDING

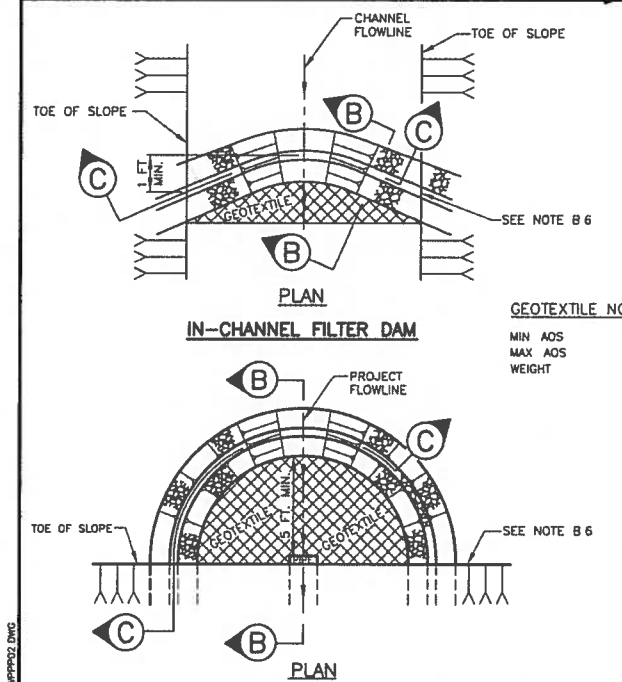

GEOTEXTILE NOTES:

MIN AOS	SIEVE NO	120 MIN
MAX AOS	SIEVE NO	50 MAX
WEIGHT	OZ/SY	4 OZ. MIN

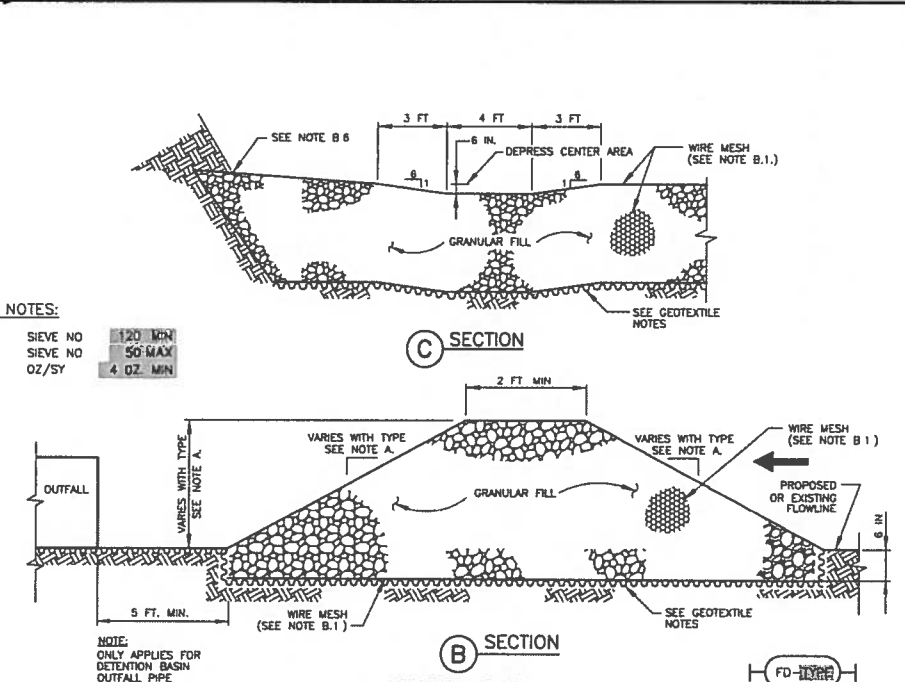

FILTER DAM

FILTER DAM NOTES.

A. TYPES OF FILTER DAMS
1 TYPE 1 (NON-REINFORCED)
a HEIGHT - 18-24 INCHES MEASURE VERTICALLY FROM EXISTING GROUND TO TOP OF FILTER DAM.
b TOP WIDTH - 2 FEET (MINIMUM)
c SLOPES - 2:1 (MAXIMUM)
2 TYPE 2 (REINFORCED)
a HEIGHT - 18-36 INCHES. MEASURE VERTICALLY FROM EXISTING GROUND TO TOP OF FILTER DAM.
b TOP WIDTH - 2 FEET (MINIMUM)
c SLOPES - 2:1 (MAXIMUM)
3. TYPE 3 (REINFORCED)
a. HEIGHT - 36-48 INCHES MEASURE VERTICALLY FROM EXISTING GROUND TO TOP OF FILTER DAM.
b TOP WIDTH - 2 FEET (MINIMUM)
c SLOPES - 3:1 (MAXIMUM)
4 TYPE 4 (GABION
a. HEIGHT 30 INCHES (MINIMUM) MEASURE VERTICALLY FROM EXISTING GROUND TO TOP OF FILTER DAM.
b TOP WIDTH 2 FEET (MINIMUM)
5 TYPE 5 AS SHOWN ON THE PLANS

B CONSTRUCT FILTER DAMS ACCORDING TO THE FOLLOWING CRITERIA UNLESS SHOWN OTHERWISE ON THE PLANS
1. TYPE 2 AND 3 FILTER DAM : SECURE WITH 20 GAUGE GALVANIZED WOVEN WIRE MESH WITH 1 INCH DIAMETER HEXAGONAL OPENINGS
2 GRANULAR FILL
a PLACE ON MESH TO HEIGHT AND SLOPES SHOWN ON PLANS OR AS SPECIFIED BY THE ENGINEER
b 3-5 INCHES FOR ROCK FILTER DAM TYPES 1,2, AND 4 AND 4-8 INCHES FOR ROCK FILTER DAM TYPE 3 REFER TO GRANULAR FILL IN SPECIFICATION SECTION NO 02378-RIPRAP AND GRANULAR FILL.
3 WIRE MESH FOLD AT UPSTREAM SIDE OVER GRANULAR FILL AND TIGHTLY SECURE TO ITSELF ON THE DOWNSTREAM SIDE USING WIRE TIES OR HOOK RINGS
4 IN STREAMS SECURE OR STAKE MESH TO STREAM BED PRIOR TO AGGREGATE PLACEMENT.
5 SEE SPECIFICATION SECTION NO. 02364-FILTER DAMS.
6 EMBED ONE FOOT MINIMUM INTO SLOPE AND AT SLOPE RAISE ONE FOOT HIGHER THAN CENTER OF DEPRESSED AREA

THIS DETAIL SHEET HAS BEEN PREPARED FOR USE ON HCFCD PROJECTS OR PROJECTS TO BE MAINTAINED BY THE HCFCD WHEN COMPLETED BY OTHERS AN ENGINEER WHO INCORPORATES THE DETAILS ON THIS SHEET BECOMES RESPONSIBLE FOR ITS USE IN THE END PRODUCT IN ACCORDANCE WITH RULE §137.33 (b) AND (e) OF THE TEXAS STATE BOARD OF REGISTRATION FOR PROFESSIONAL ENGINEERS

P.E. SEAL AND SIGNATURE

REV	DESCRIPTION	DATE	APPR

GREENS ROAD

N-000686-0002-3

STORMWATER POLLUTION PREVENTION DETAILS

PREPARED:
CHECKED:
APPROVED:

HARRIS COUNTY FLOOD CONTROL DISTRICT
9900 Northwest Freeway
Houston, Texas 77092

DATE: 08-31-05
SCALE: NTS

SHEET NUMBER
— OF —

AECOM
AECOM TECHNICAL SERVICES, INC.- F-3580

©2015 Texas Department of Transportation

KIT Professionals, Inc.
Engineers • Planners • Construction Managers
2000 W. Sam Houston Pkwy S. Suite 1400
Houston, Texas 77042
Phone: (713)783-8700, Fax: (713)783-8747
TBPE Firm Registration No. F-4991

STATE OF TEXAS
KEITH R DAVIS
82625
LICENSED PROFESSIONAL ENGINEER
2-1-16
KIT Professionals, Inc
TBPE Firm Registration No. F-4991

SURVEYED BY:
GEOSOLUTIONS, LLC.
FB No. P-5658

CITY OF HOUSTON
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

GREENS ROAD
HCFCD
STORM WATER POLLUTION PREVENTION STANDARD DETAILS

SHEET 6 OF 7

WBS NUMBER	
N-000686-0002-4	
DRAWING SCALE	
NTS	
CITY OF HOUSTON PM	
SUDARSHAN GOUNI	
SHEET No. 374 of 403	

Feb 01 2016 11:23AM tote
M:\KIT_Projects\K06_PW_114\PROD\3.2.5_SWPPP\SWPPP.dwg
Includes Xref(s): _BORDER.dwg; Bridge.dwg; P-Paving.dwg; Topo_mod1-14-15.dwg; Alignment.dwg; SOD PANELS.dwg; _PSTM.dwg

STD\SWPPP02.DWG

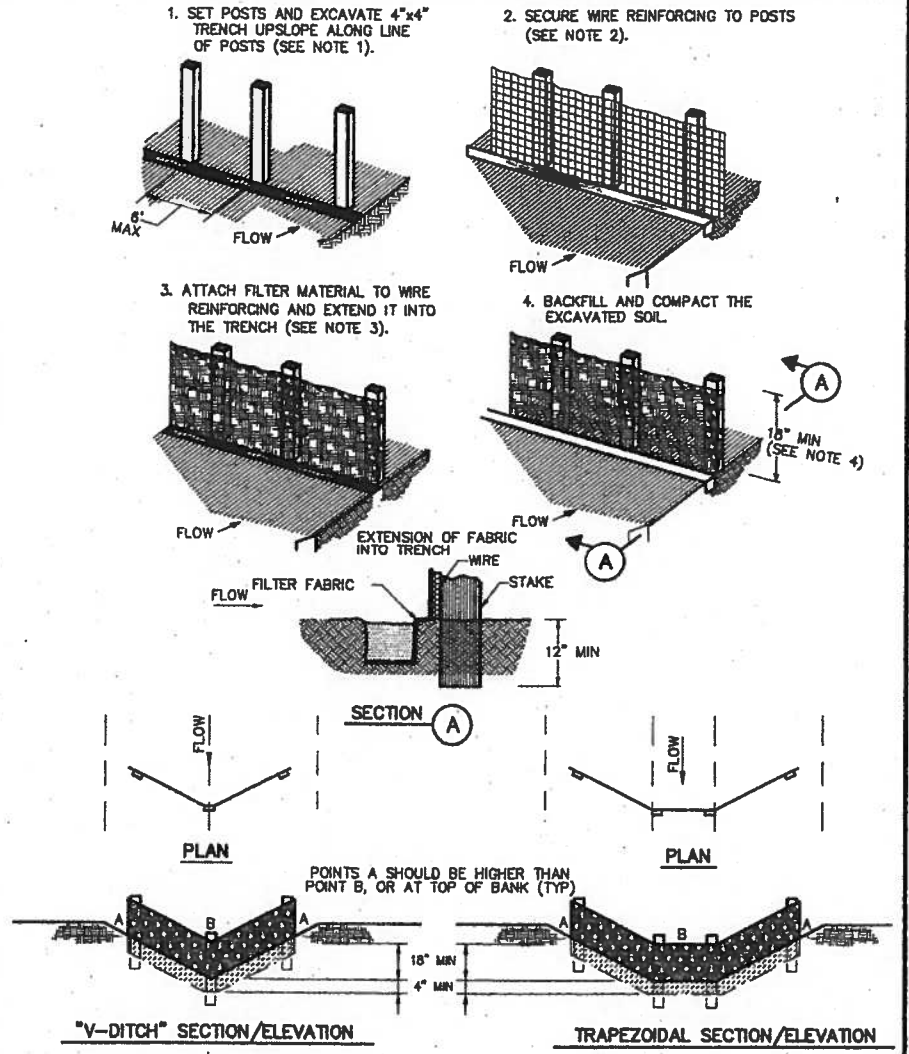

CONSTRUCTION NOTES:

1. SET 2 INCH BY 2 INCH WOODEN STAKES SPACED A MAX OF 6 FEET APART AND EMBEDDED A MIN OF 12 INCHES.
2. WOVEN WIRE REINFORCING TO BE FASTENED SECURELY TO BARRIER POSTS WITH STAPLES.
3. FILTER CLOTH TO BE FASTENED SECURELY TO WOVEN WIRE REINFORCING, WITH TIES SPACED EVERY 24 INCHES AT TOP AND MIDSECTION.
4. MINIMUM HEIGHT OF FILTER SHOULD BE 18 INCHES AND A MAXIMUM OF 36 INCHES ABOVE NATURAL GROUND.
5. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVERLAPPED 6 INCHES AT THE POSTS, AND FOLDED.
6. SEE COH STANDARD SPECIFICATION FOR FILTER FABRIC BARRIER.

X— (RFB) —X
SYMBOL

REINFORCED FILTER FABRIC BARRIER

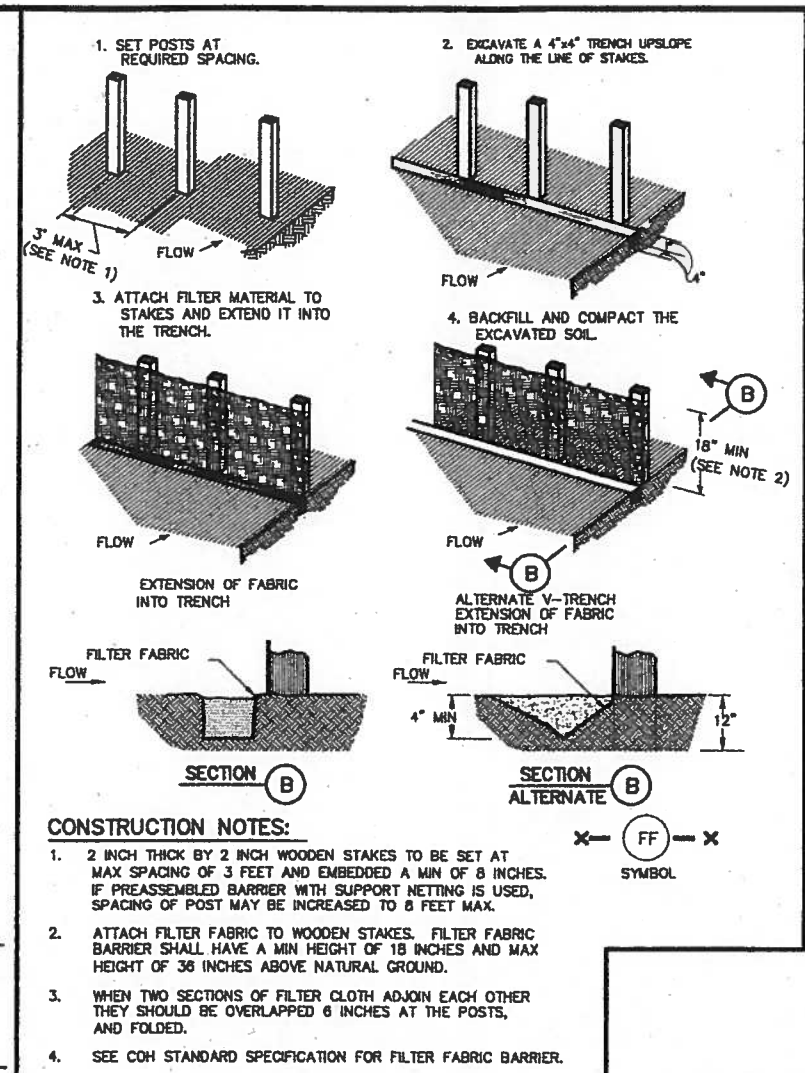

CONSTRUCTION NOTES:

1. 2 INCH THICK BY 2 INCH WOODEN STAKES TO BE SET AT MAX SPACING OF 3 FEET AND EMBEDDED A MIN OF 8 INCHES. IF PREASSEMBLED BARRIER WITH SUPPORT NETTING IS USED, SPACING OF POST MAY BE INCREASED TO 8 FEET MAX.
2. ATTACH FILTER FABRIC TO WOODEN STAKES. FILTER FABRIC BARRIER SHALL HAVE A MIN HEIGHT OF 18 INCHES AND MAX HEIGHT OF 36 INCHES ABOVE NATURAL GROUND.
3. WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHOULD BE OVERLAPPED 6 INCHES AT THE POSTS, AND FOLDED.
4. SEE COH STANDARD SPECIFICATION FOR FILTER FABRIC BARRIER.

X— (FF) —X
SYMBOL

FILTER FABRIC BARRIER

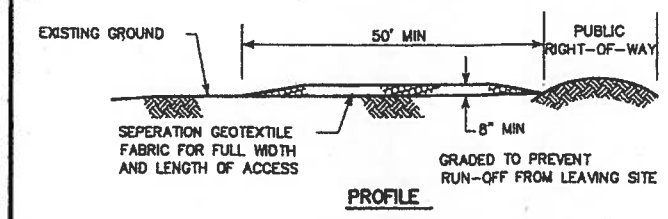

PROFILE

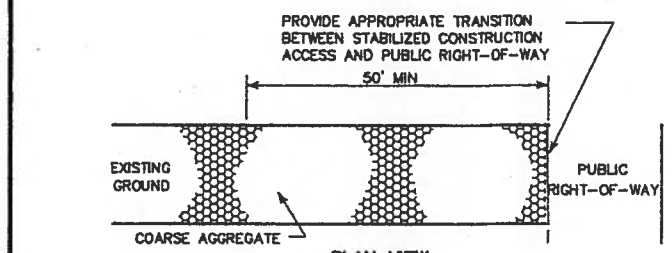

PLAN VIEW

CONSTRUCTION NOTES:

1. LENGTH SHALL BE AS SHOWN ON THE CONSTRUCTION DRAWINGS, BUT NOT LESS THAN 50 FEET.
2. THICKNESS SHALL BE NOT LESS THAN 8 INCHES.
3. WIDTH SHALL BE NOT LESS THAN FULL WIDTH OF ALL POINTS OF INGRESS OR EGRESS.
4. STABILIZATION FOR OTHER AREAS SHALL HAVE THE SAME AGGREGATE THICKNESS AND WIDTH REQUIREMENTS AS THE STABILIZED CONSTRUCTION ACCESS, UNLESS OTHERWISE SHOWN ON THE CONSTRUCTION DRAWINGS.
5. STABILIZED AREA MAY BE WIDENED OR LENGTHENED TO ACCOMODATE A WASHING AREA. AN OUTLET SEDIMENT TRAP MUST BE PROVIDED FOR THE WASHING AREA.
6. COH STANDARD SPECIFICATION FOR STABILIZED CONSTRUCTION ACCESS.
7. STABILIZED CONSTRUCTION ACCESS SHALL BE MAINTAINED FREE OF SEDIMENT FOR THE DURATION OF THE PROJECT.

(SC)
SYMBOL

STABILIZED CONSTRUCTION ACCESS

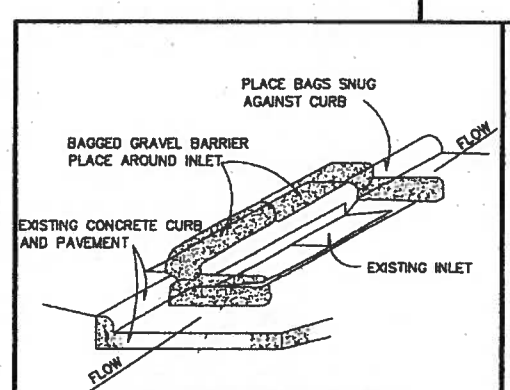

INLET PROTECTION BARRIER

(FOR STAGE II INLETS)
BAGGED GRAVEL BARRIER

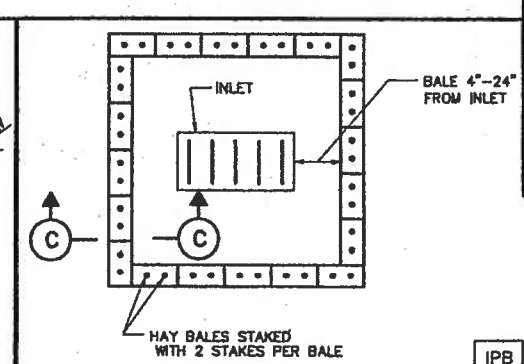

PLAN

IPB
SYMBOL

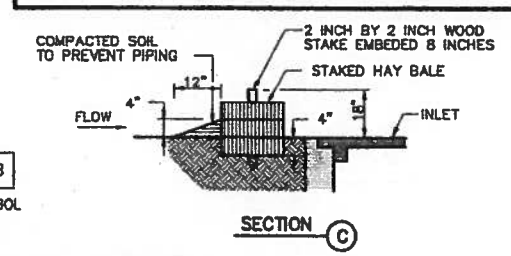

SECTION C

HAY BALE INLET PROTECTION BARRIER

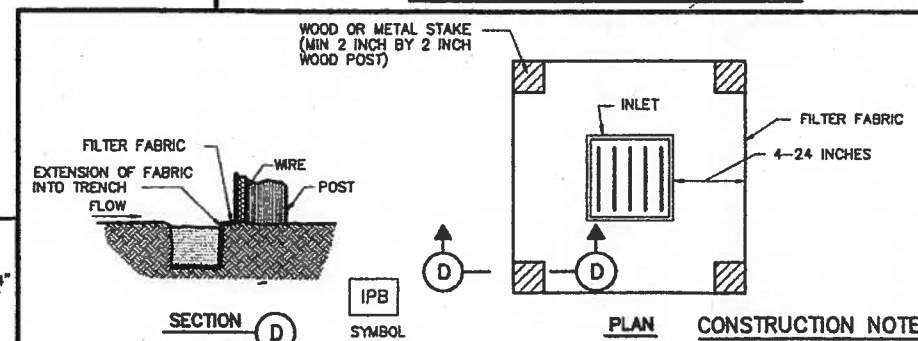

SECTION D

IPB
SYMBOL

PLAN

SILT FENCE INLET PROTECTION BARRIER

CONSTRUCTION NOTE:

1. SEE CONSTRUCTION NOTES FOR RFB.

CITY OF HOUSTON
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

STORM WATER POLLUTION PREVENTION PLAN DETAILS

(NOT TO SCALE)

APPROVED BY: CITY ENGINEER	APPROVED BY: DIRECTOR OF PUBLIC WORKS AND ENGINEERING
EFF DATE: JULY-01-2010	DWG NO: 01571-01

AECOM
AECOM TECHNICAL SERVICES, INC.- F-3580

©2015 Texas Department of Transportation

KIT Professionals, Inc.
Engineers • Planners • Construction Managers
2000 W. Sam Houston Pkwy S., Suite 1400
Houston, Texas 77042
Phone: (713)783-8700, Fax: (713)783-8747
TBPE Firm Registration No. F-4991

SURVEYED BY:
GEOSOLUTIONS, LLC.
FB No. P-5658

STATE OF TEXAS
KEITH R. DAVIS
82625
LICENSED PROFESSIONAL ENGINEER
2-1-16
KIT Professionals, Inc
TBPE Firm Registration No. F-4991

CITY OF HOUSTON
DEPARTMENT OF PUBLIC WORKS AND ENGINEERING

GREENS ROAD

COH STORM WATER POLLUTION PREVENTION PLAN DETAILS

SHEET 7 OF 7

WBS NUMBER	
N-000686-0002-4	
DRAWING SCALE	
NTS	
CITY OF HOUSTON PM	
SUDARSHAN GOUNI	
SHEET No.374A of 403	

Feb 01 2016 11:23AM tote
M:\KIT_Projects\K06_PW_114\PROD\3.2.5_SWPPP\SWPPP.dwg
Includes Xref(s): _BORDER.dwg; Bridge.dwg; P-Paving.dwg; Topo_mod1-14-15.dwg; Alignment.dwg; SOD PANELS.dwg; _PSTM.dwg