Parson Brinckerhoff, Inc.
16285 Park Ten Place, Suite 400
Houston, Texas 77084

Project No.: 12-762E
Report No.: 1
Project Type: 24/33/35
March 10, 2014

Attention: Mr. Gabriel Y. Johnson, P.E.
Vice President

Subject: Trench Safety Recommendations
Proposed Hollister Road Paving and
Drainage – White Oak Bayou to West Gulf Bank
WBS No. R-000704-0001-3
City of Houston, Texas

Gentlemen:

Submitted here are Geotech Engineering and Testing (GET) recommendations on trench safety for the above referenced project. The following is our trench safety recommendations together with the earth pressure diagram for the braced excavations.

General

Occupational Safety and Health Administration (OSHA) has required a trench protective system for trenches deeper than five-ft. Trenches that are deeper than five-ft, should be shored, sheeted, braced or laid back to a stable slope, or some other appropriate means of protection should be provided where workers might be exposed to moving ground or caving. OSHA developed a soil classification system to be used as a guideline in determining protective requirements for trench excavations.

OSHA classification system categorizes the soil and rock in four types based on shear strength and stability. These classifications are summarized in the following report sections.

Stable Rock

means natural solid mineral matter that can be excavated with vertical sides and remain intact while exposed.

Type A Soil

means cohesive soils with an unconfined compressive strength of 1.5-ton per square foot (tsf) or greater. Examples of cohesive soils are: clay, silty clay, sandy clay, clay loam, silty clay loam, sandy clay loam, caliche and hardpan. No soil is Type A if:

- The soil is fissured; or
- The soil is subject to vibration from heavy traffic, pile driving or similar effects; or

- The soil has been previously disturbed; or
- The soil is part of a slope, layered system where the layers dip into the excavation on a slope of 4(h): 1(v) or greater; or
- The material is subject to other factors that would require it to be classified as a less stable material.

Type B Soil

- Cohesive soil with an unconfined compressive strength greater than 0.5 tsf but less than 1.5 tsf; or
- Granular cohesionless soils including: angular gravel, silt, silt loam, sandy loam, and in some case, silty clay loam and sandy clay loam; or
- Previously disturbed soils except those which would otherwise be classified as Type C soil; or
- Soil that meets the unconfined compressive strength or cementation requirements for Type A, but is fissured or subject to vibration; or
- Dry rock that is not stable; or
- Material that is part of a sloped, layered system where the layers dip into the excavation on a slope less steep than 4(h): 1(v), but only if the material would otherwise be classified as Type B.

Type C Soil

- Cohesive soil with an unconfined compressive strength of 0.5 tsf or less; or
- Granular soils including gravel, sand, and loamy sand; or
- Submerged soil or soil from which water is freely seeping; or
- Submerged rock that is not stable; or
- Materials in a sloped, layered system where the layers dip into the excavation on a slope 4 (h) : 1(v) or steeper.

Under the assumption that appropriate groundwater control measures are carried out, and the groundwater table, if present, is lowered and maintained at least 3 feet below the excavation depths, the stable cohesive soils (CL) & (CH), with unconfined compressive strength greater than 0.5 tsf, are classified as OSHA soil Type "B". The granular soils, which are less stable, are classified as OSHA soil Type "C".

Based on our geotechnical exploration and laboratory test results details of soil classifications at each boring are summarized below:

OSHA SOIL TYPE

Boring No.	Depth Range [1], ft	Soil Type	OSHA Soil Classification
B-1	0 – 2	Fill: Sandy Silt (ML)	C
	2 – 6	Lean Clay with Sand (CL)	B
	6 – 8	Lean Clay with Sand (CL)	C
	8 – 10	Lean Clay with Sand (CL)	B
	10 – 25	Lean Clay with Sand (CL)	B
B-2	0 – 2	Fill: Lean Clay (CL)	B
	2 – 12	Lean Clay with Sand (CL)	B
	12 – 14	Lean Clay with Sand (CL)	B
	14 – 25	Lean Clay with Sand (CL)	B

Note: 1. Refer to each boring log for soils stratigraphy

Stockpiling of excavated materials may not be allowed near the banks of excavated areas. Generally, a distance of one-half the excavation depth on both sides of the trench should be kept clear of any excavated material.

Trenches for the underground utilities should be provided with proper trench support system. The trenches should be provided with a temporary shoring system on excavations deeper than five-ft. We understand that the sanitary sewer lines will be placed at a depth of about 15-ft below existing grade. The trenches can be made using shored, sheeted and braced, laid back stable slope or other means of appropriate protection system should be provided where workers are exposed to moving ground or caving. The slopes may be constructed in accordance with Table B-1 and shoring may be constructed in accordance with Table C-1.1, Table C-1.2 and Table C-1.3 of 29 CFR Part 1926 of OSHA.

In the event that a trench sheeting is used, the sheeting can be constructed in the form of cantilever sheeting or with bracing. Lateral earth pressures for each method used are summarized on Plate 1. The trenching and shoring operations should follow OSHA Standards. We recommend that a geotechnical engineer monitor all phases of trench excavation and bracing to assure trench safety.

Timber shoring as outlined in 29 CFR Part 1926 of OSHA recommendation may be used in the construction of trench supporting system.

For trench excavation, it is necessary to maintain the stability of the sides and base and not to disturb the soil below the excavation grade. In braced cuts, if the sheeting is terminated at the base of the cut, the bottom of the excavation can become unstable under certain conditions. The stability of the trench bottom is governed by the shear strength of the soils and the differential hydrostatic head. For cuts in cohesive soils (such as lean clay with sand (CL) stability of the bottom can be evaluated in accordance with the procedure outline on Plate 2. However, where cohesionless soils were encountered, dewatering will be required to prevent bottom blowup if the groundwater is encountered during construction. Design soil parameters presented on Plate 3 can be used for design.

Groundwater Conditions

We understand that the depths of underground utilities will be less than 15-ft below existing grade. Our short-term field exploration along the project alignment indicated that groundwater was not encountered during and 24-hours after drilling. Hence, groundwater dewatering may not be required. Fluctuations in groundwater can occur as a function of seasonal moisture variation. Groundwater control recommendations are presented in the following report sections.

Fluctuation in groundwater can occur as a function of seasonal moisture variation. Groundwater control recommendations are presented in the following report sections.

In the event that groundwater is encountered during construction, it is our opinion that groundwater should be lowered to a depth of at least three-ft below the deepest excavation grade in order to provide dry working conditions and firm bedding. Any minor water inflow in cohesive soil layers can probably be removed using a sump-pump or trench sump-pump. Wellpoint system can be used in the area where sand/ silt soils are present. Since the wellpoint suction lift is about 15-ft, multi-stage wellpoint system or ejector systems may be used for dewatering.

Design of a dewatering system should consider the amount of groundwater to be lowered and the permeability of the affected soils. The selection and proper implementation of an effective groundwater control system is the responsibility of the contractor. The design of groundwater and surface water should be in accordance with the City of Houston Specifications, Section 01578 − Control of Ground Water and Surface Water.

The results of our field exploration and laboratory testing indicate that unsatisfactory soils for excavation, such as sandy silt (ML) and soft (CL) soils, exist at various depths in the borings along the project alignment. A summary of the unsatisfactory soils, locations and depths are as follows:

Boring(s)	Depth Range, ft.
B-1	0 to 2 and 6 to 8

If these conditions are encountered during the time of construction, suitable groundwater control measures should be implemented in accordance with the "City of Houston Standard Specifications, Section 01578 – Control of Groundwater and Surface Water". Furthermore, the contractor may have to over excavate an additional 6-inch and remove unstable or unsuitable materials with approval by geotechnical engineer, and then place an equal depth of cement stabilization sand.

If these conditions are encountered during the time of construction, suitable groundwater control measures should be implemented in accordance with the "City of Houston Specifications, Section 01578 – Control of Groundwater and Surface Water". Furthermore, the contractor may have to over excavate additional 6 inches and remove unstable or unsuitable materials with approval by geotechnical engineer, then place non-woven geotextile follows by compaction of 12-inch of crushed stone or 6-inch of reinforced concrete pad.

Due to potential variability of the on-site soils, unstable trench conditions may exist in the areas where we did not conduct our borings. If these conditions are encountered during the time of construction, a stable trench should be provided to allow proper bedding and installation.

Our recommendation on trench safety at the project site does not address the effects of excavations on existing buildings/facilities at the project site. This study was outside the scope of our work.

We appreciate the opportunity to be of service. Should you have any questions or need additional assistance, please call.

Very truly yours,

GEOTECH ENGINEERING AND TESTING

Sam Samoo, M.S.C.E.
Project Manager

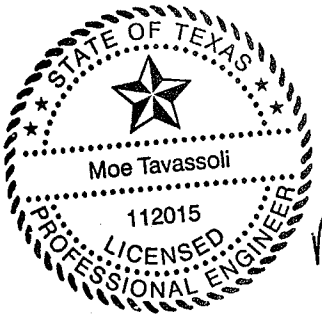

Moe Tavassoli
03-11-14

Moe Tavassoli, Ph.D., P.E.
Engineering Manager

SS/MT/ss

Copies Submitted: (1) Hard Copy – Parsons Brinckerhoff, Inc. – Mr. Gabriel Y. Johnsons, P.E.
(1) PDF Copy Email – Mr. Gabriel Y. Johnsons, P.E.
(1) PDF Copy Email – Mr. Murad A. Mohammad, P.E.
(1) Digital Copy

Enclosure: Trench Lateral Earth Pressure Diagrams, Plate 1
Cut in Cohesive Soil, Plate 2
Design Soil Parameters, Plate 3